

All-Island Transmission System Performance Report

2019



Table of Contents

| | |
|---|----|
| 1. Introduction..... | 7 |
| 2. Executive Summary | 8 |
| 2.1 Key Data | 8 |
| 3. All-Island System Data | 9 |
| 3.1 Overview of the All-Island Electricity System | 9 |
| 3.2 Total System Production | 9 |
| 3.3 System Records | 10 |
| 3.4 Generation Capacity | 10 |
| 3.5 Generation Availability | 11 |
| 3.6 Generation Forced Outage Rate | 12 |
| 3.7 Generation Scheduled Outage Rate | 13 |
| 4. EirGrid Transmission System Performance | 15 |
| 4.1 Summary | 15 |
| 4.2 Grid Development and Maintenance | 15 |
| 4.2.1 Completed Capital Projects | 15 |
| 4.2.2 New Connection Offers | 16 |
| 4.2.3 Connections Energised | 17 |
| 4.2.4 Customers Certified Operational | 17 |
| 4.3 General System Performance | 18 |
| 4.3.1 Under-Frequency Load Shedding | 18 |
| 4.3.2 Under-Voltage Load Shedding | 19 |
| 4.4 System Minutes Lost | 20 |
| 4.5 Zone Clearance Ratio | 21 |
| 4.5.1 Frequency Control | 21 |
| 4.6 Summary of key disturbances | 22 |
| 4.6.1 Loss of load | 22 |
| 4.6.2 Under-Frequency Load Shedding | 22 |
| 4.6.3 Storms Resulting in Trippings | 22 |
| 4.7 Transmission System Availability & Outages | 24 |
| 4.7.1 Transmission System Availability | 24 |
| 4.7.2 Transmission Plant Availability | 24 |
| 4.7.3 Cause of Transmission Plant Unavailability | 26 |
| 4.7.4 110 kV Circuit Unavailability | 26 |
| 4.7.5 220 kV Circuit Unavailability | 27 |
| 4.7.6 275 kV Circuit Unavailability | 28 |
| 4.7.7 400 kV Circuit Unavailability | 28 |

| | |
|---|----|
| 4.7.8. East West Interconnector..... | 31 |
| 4.7.9. East West Interconnector Unavailability | 31 |
| 4.7.10 Transmission Outage Duration | 31 |
| 4.7.11 Timing of Transmission Outages | 32 |
| 4.7.12 Forced Outages..... | 33 |
| 4.7.13 Forced Outages per km | 33 |
| 4.7.14 Forced Outages per MVA | 35 |
| 5. SONI Transmission System Performance..... | 36 |
| 5.1 Summary..... | 36 |
| 5.2 Transmission System Availability..... | 37 |
| 5.2.1 System Availability..... | 37 |
| 5.2.2 System Unavailability..... | 39 |
| 5.2.3 System Historical Availability Performance | 40 |
| 5.2.4 System Historical Unavailability Performance | 41 |
| 5.2.5 Moyle Interconnector | 41 |
| 5.2.6 Moyle Interconnector Historical Availability | 42 |
| 5.2.7 Moyle Interconnector Historical Unavailability | 43 |
| 5.2.8 Moyle Interconnector Monthly Unavailability | 43 |
| 5.2.9 275 kV Tie Line..... | 44 |
| 5.2.10 110 kV Tie lines | 45 |
| 5.3 Transmission System Security | 47 |
| 5.3.1 Incidents for 2019 | 47 |
| 5.3.2 Number of Incidents and Estimated Unsupplied Energy | 48 |
| 5.3.3 Incident Analysis..... | 48 |
| 5.3.4 Unsupplied Energy | 49 |
| 5.3.5 System minutes lost..... | 49 |
| 5.3.6 Zone Clearance Ratio | 50 |
| 5.4 Quality of Service | 50 |
| 5.4.1 Voltage | 50 |
| 5.4.2 Voltage Excursions..... | 51 |
| 5.4.3 Frequency | 52 |
| 5.4.4 Frequency Excursions | 53 |
| 5.4.5 Historical Frequency Excursions..... | 54 |
| 6. Appendix 1 Glossary..... | 55 |
| 6.1 DCEF | 55 |
| 6.2 Disturbance | 55 |
| 6.3 Fault..... | 55 |

| | | |
|------|---|----|
| 6.4 | Main system: EirGrid | 55 |
| 6.5 | Main system: SONI | 56 |
| 6.6 | Major incident | 56 |
| 6.7 | MVA Minute Lost | 56 |
| 6.8 | Non main system/outside the main system: EirGrid | 56 |
| 6.9 | Non main system/outside the main system: SONI | 56 |
| 6.10 | Non System Fault | 56 |
| 6.11 | Permanent Fault | 57 |
| 6.12 | POTT | 57 |
| 6.13 | Protection - Correct Operation | 57 |
| 6.14 | Protection - Incorrect Operation | 57 |
| 6.15 | PUTT | 57 |
| 6.16 | Sustained Interruption | 57 |
| 6.17 | System Fault | 57 |
| 6.18 | System Minute | 58 |
| 6.19 | Transient Fault | 58 |
| 6.20 | Zone Clearance Ratio | 58 |
| 6.21 | Zones of Protection | 59 |
| 7. | Appendix 2 All Island Frequency Excursion Graphs | 60 |
| 7.1 | Great Island 4- 20/03/2019 | 61 |
| 7.2 | Dublin Bay 1 24/04/2019 | 61 |
| 7.3 | Whitegate 1 08/05/2019 | 62 |
| 7.4 | Great Island 4 – 20/05/2019 | 62 |
| 7.5 | Whitegate 1- 15/08/2019 | 63 |
| 8. | Appendix 3 All Island Fully Dispatchable Generation Plant | 64 |
| 9. | Appendix 4 EirGrid Maintenance Policy Terms | 67 |
| 10. | Appendix 5 Formulae | 68 |
| 10.1 | Ireland Availability & Unavailability Formula | 68 |
| 10.2 | System Minute Formula | 68 |

List of Figures

| | |
|---|----|
| Figure 1: Generation System Availability 2019 | 12 |
| Figure 2: Generation System Forced Outage Rate 2019 | 13 |
| Figure 3: Generation System Scheduled Outage Rate 2019 | 14 |
| Figure 4: Under frequency disturbances 2004-2019 | 18 |
| Figure 5: Lowest system frequency 2004-2019 | 19 |
| Figure 6: System minutes lost and associated targets: EirGrid 2004-2019 | 20 |
| Figure 7: Zone clearance ratio: EirGrid 2004-2019 | 21 |
| Figure 8: Monthly Variations of System Unavailability 2019 | 24 |
| Figure 9: Causes of Unavailability on the 110 kV System in 2019 | 27 |
| Figure 10: Causes of Unavailability on the 220 kV System in 2019 | 28 |
| Figure 11: Causes of Unavailability on the 400kV System in 2019 | 29 |
| Figure 12: Duration of Outages in 2018 & 2019 | 31 |
| Figure 13: Percentage unavailability in each month of 2018 & 2019 | 32 |
| Figure 14: Average duration of outages 2018 & 2019 | 33 |
| Figure 15: Forced Outages of lines and cables per km in 2019 | 34 |
| Figure 16: Forced Outage per MVA in 2019 | 35 |
| Figure 17: Transmission System Availability 2019 | 39 |
| Figure 18: Transmission System Unavailability 2019 | 40 |
| Figure 19: Historical System Availability 2005/2006 to 2019 | 40 |
| Figure 20: Historical System Unavailability 2005/2006 to 2019 | 41 |
| Figure 21: Moyle Interconnector Monthly Unavailability 2019 | 44 |
| Figure 22: Historical North-South Tie Line Availability 2005/2006 to 2019 | 45 |
| Figure 23: North-South Tie Line Availability 2005/2006 to 2019 | 46 |
| Figure 24: 110kV Tie Line Unavailability 2019 | 47 |
| Figure 25: Historical System Security 2005/2006 to 2019 | 48 |
| Figure 26: Historical Unsupplied Energy 2005/2006 to 2019 | 49 |
| Figure 27: System minutes lost 2012 - 2019 | 50 |
| Figure 28: Historic Frequency Excursions 2012-2019 | 54 |
| Figure 29: Zones of Protection | 59 |
| Figure 30: Great Island 4 Frequency Excursion Incident- 20/03/2019 | 61 |
| Figure 31: Dublin Bay 1 Frequency Excursion Incident 24/04/2019 | 61 |
| Figure 32: Whitegate 1 Frequency Excursion Incident- 08/05/2019 | 62 |
| Figure 33: Great Island 4 Frequency Excursion Incident- 20/05/2019 | 62 |
| Figure 34: Whitegate 1 Frequency Excursion Incident- 15/08/2019 | 63 |

List of Tables

| | |
|--|----|
| Table 1: Total Exported Energy 2018 & 2019..... | 10 |
| Table 2: System Records 2018 & 2019 | 10 |
| Table 3: New Capacity Executed Demand & Generation Connection Agreements | 16 |
| Table 4: Demand & Generation Connections Energised in 2019 | 17 |
| Table 5: Customers Certified Operational in 2019..... | 18 |
| Table 6: Transmission System Plant Availability 2019 | 25 |
| Table 7: Transmission System Plant Unavailability Categories | 26 |
| Table 8: Transmission System Plant Outage 2019..... | 30 |
| Table 9: Voltage step change limits in operational timescales..... | 51 |
| Table 10: Frequency Excursions in 2019..... | 53 |
| Table 11: All Island Frequency Excursion Incidents | 60 |
| Table 12: All Island Fully Dispatchable Generation Plant | 64 |

1. Introduction

EirGrid and SONI, as Transmission System Operators (TSOs) for Ireland and Northern Ireland respectively, are pleased to present the annual Transmission System Performance Report for 2019. This report contains transmission system data and performance statistics for the transmission system in Ireland and Northern Ireland for the year 2019 (01 January 2019 – 31 December 2019).

EirGrid is required to publish an annual report on the performance of the TSO business in accordance with Condition 18 of the Transmission System Operator Licence granted to EirGrid by the Commission for Regulation of Utilities (CRU).

Similarly, SONI is required to produce an annual report on the performance of the TSO business in accordance with Condition 20 of the Licence to participate in the Transmission of Electricity granted to SONI Ltd by the Department for the Economy.

This report contains high-level transmission system characteristics and a detailed breakdown of key figures along with an explanation of what these figures mean for the all-island transmission system in the coming year and into the future. Through comparison with previous reports, this report provides a useful resource through which possible trends can be identified.

This report is structured as follows:

- Section 3 outlines all-island system data, generation availability and outages,
- Section 4 details the performance of the EirGrid TSO business during 2019 against the criteria approved by the CRU,
- Section 5 details the performance of the SONI TSO business during 2019 against the criteria approved by The Utility Regulator in Northern Ireland.

Appendices which provide further detail on the data, results and methodology of relevance are included at the end of this report.

2. Executive Summary

The annual Transmission System Performance Report for 2019 is a comprehensive review of the transmission system through which EirGrid and SONI make available key all-island system operating data from the previous year.

Key statistics detailed in this report include:

- All-Island Generation Statistics
- Transmission System Availability Statistics for Ireland and Northern Ireland
- Details on System Events leading to System Minutes Lost
- Details of All-Island System Frequency Events

2.1 Key Data

All-island

- All-island peak demand reached 6,558 MW on 17 December 2019. The minimum all-island demand was 2,542 MW and occurred on 30 June 2019.
- The all-island installed capacity of conventional generation in 2019 was 8,376 MW.
- In 2019 the system frequency was operated within 49.9 Hz and 50.1 Hz for 99.66% of the time.
- There were no major incidents in 2019. A major incident is one which results in the loss of greater than or equal to one system minute as a result of a single system disturbance.

Ireland

- In 2019 the availability of the East West Interconnector was 97.63%.
- The weighted average availability of the Ireland transmission system in 2019 was 96.88%.
- The System Minutes lost for 2019, attributable to EirGrid, was 0.176.

Northern Ireland

- The availability of the Moyle Interconnector for 2019 was 97.68%.
- The average availability of the Northern Ireland transmission system in 2019 was 96.63%.
- The System Minutes lost for 2019, attributable to SONI, was 0.921

3. All-Island System Data

3.1 Overview of the All-Island Electricity System

The transmission system in Ireland and Northern Ireland provides the means to transport energy from generators to demand centres across the island. The transmission system is comprised of high-voltage overhead lines and cables that connect power stations, interconnectors and substations. Transformers link different voltage levels and provide a path for power to flow from higher to lower voltage networks. The transmission system in Ireland is operated at 400 kV, 220 kV and 110 kV. The transmission system in Northern Ireland is operated at 275 kV and 110 kV.

The 400 kV, 275 kV and 220 kV networks form the backbone of the transmission system. They have higher power carrying capacity and lower losses than the 110 kV network.

The Ireland and Northern Ireland transmission systems are electrically connected by means of one 275 kV double circuit. This connection is from Louth station in Co. Louth (IE) to Tandragee station in Co. Armagh (NI).

There are also two 110 kV connections:

- Letterkenny station in Co. Donegal (IE) to Strabane station in Co. Tyrone (NI)
- Corraclassy station in Co. Cavan (IE) to Enniskillen station in Co. Fermanagh (NI)

This section contains basic all-island transmission system data. Further information can be found on the EirGrid Group website: www.eirgridgroup.com.

3.2 Total System Production

Total exported energy takes into account energy supplied by large-scale and some small-scale generation¹ as well as pumped storage units on the island. This does not take into account interconnector imports and exports.

¹ Small-scale generation that is modelled in our Energy Management System, typically ≥ 5 MW

Table 1: Total Exported Energy 2018 & 2019

| | 2018 | 2019 |
|--|--------|--------|
| All-Island Total Exported Energy [GWh] | 36,996 | 36,513 |
| Ireland Total Exported Energy [GWh] | 28,823 | 28,347 |
| Northern Ireland Total Exported Energy [GWh] | 8,173 | 8,167 |

3.3 System Records

Peak demand is a measure of the maximum demand on the transmission system over a particular period (e.g. annual or seasonal) and is a key measurement for any power system. The transmission system in Ireland and Northern Ireland is a winter peaking system as a result of greater heating and lighting requirements during the winter months. The all-island winter peak in 2019 was 6,558 MW and occurred at 17:27 on 17 December.

In summer, the reduced need for heating and lighting results in a lower demand for electricity. The minimum demand is known as the ‘minimum summer night valley’ and in 2019 a minimum all-island demand of 2,542 MW was recorded at 05:30 on 30 June.

From the installed wind capacity, a peak all-island wind generation output of 4,038MW was achieved on 18 December. Table 2 provides a summary of the system records for 2018 and 2019.

Table 2: System Records 2018 & 2019

| | 2018 | 2019 |
|----------------------------------|-------|-------|
| Winter Peak Demand [MW] | 6,508 | 6,558 |
| Minimum Summer Night Valley [MW] | 2,520 | 2,542 |
| Maximum Wind Generation [MW] | 3,990 | 4,038 |

3.4 Generation Capacity

Generating plant is connected to both the transmission and distribution systems. All generation contributes to meeting system demand. The total generation capacity is

calculated as the sum of all fully operational generator capacities connected to both systems².

The all-Island installed capacity of conventional generation in December 2019 was 8,376 MW (6,558 MW in Ireland and 1,818 MW in Northern Ireland). The capacity of demand side units (DSUs) was 543 MW in Ireland and 99 MW in Northern Ireland, with an average availability of 35.6%. There was also 87 MW of aggregated generating units (AGUs) that contributed towards the capacity margin in Northern Ireland. This does not include any import capacity from the Moyle Interconnector or the East West Interconnector.

The all-island installed capacity of wind generation in 2019 was 5,388MW (4,112 MW in Ireland and 1,276 MW in Northern Ireland).

Appendix 3 provides a list of the fully dispatchable generating units connected to the power system.

3.5 Generation Availability

Generation Availability is a measure of the capability of a generator to deliver power in a given period to the transmission system. In order for EirGrid and SONI to operate a secure and reliable transmission system in an economic and efficient manner, it is necessary for generators to maintain a high rate of availability.

Generation system availability is calculated on a daily and 365-day rolling average basis³. Figure 1 shows the daily and 365-day rolling average availability for 2019.

² Fully operational generator capacity is given by the Maximum Export Capacity (MEC) of the generator.

³ 365-day rolling average is a capacity weighted average availability over the previous 365 days.

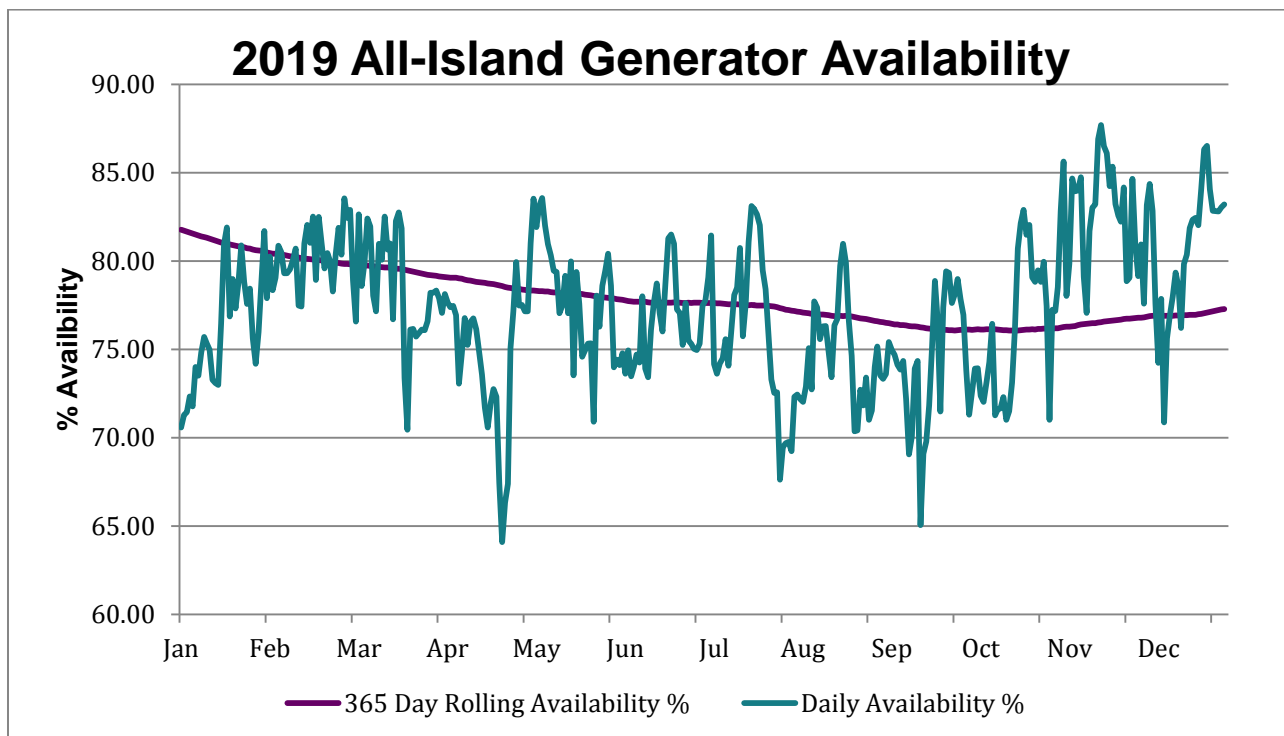


Figure 1: Generation System Availability 2019

- The average daily generation system availability in 2019 was 77.29%.
- The maximum daily generation system availability in 2019 was 87.69%.
- The minimum daily generation system availability in 2019 was 64.09%.

3.6 Generation Forced Outage Rate

The generation forced outage rate (FOR) is calculated on a daily and rolling 365-day average basis. The daily FOR is a capacity weighted percentage of the time during the day that generation units are unavailable due to unforeseen/unplanned outages. The 365-day rolling FOR is the average of the daily FOR over the previous 365 days. The daily FOR and 365-day rolling FOR are shown in Figure 2.

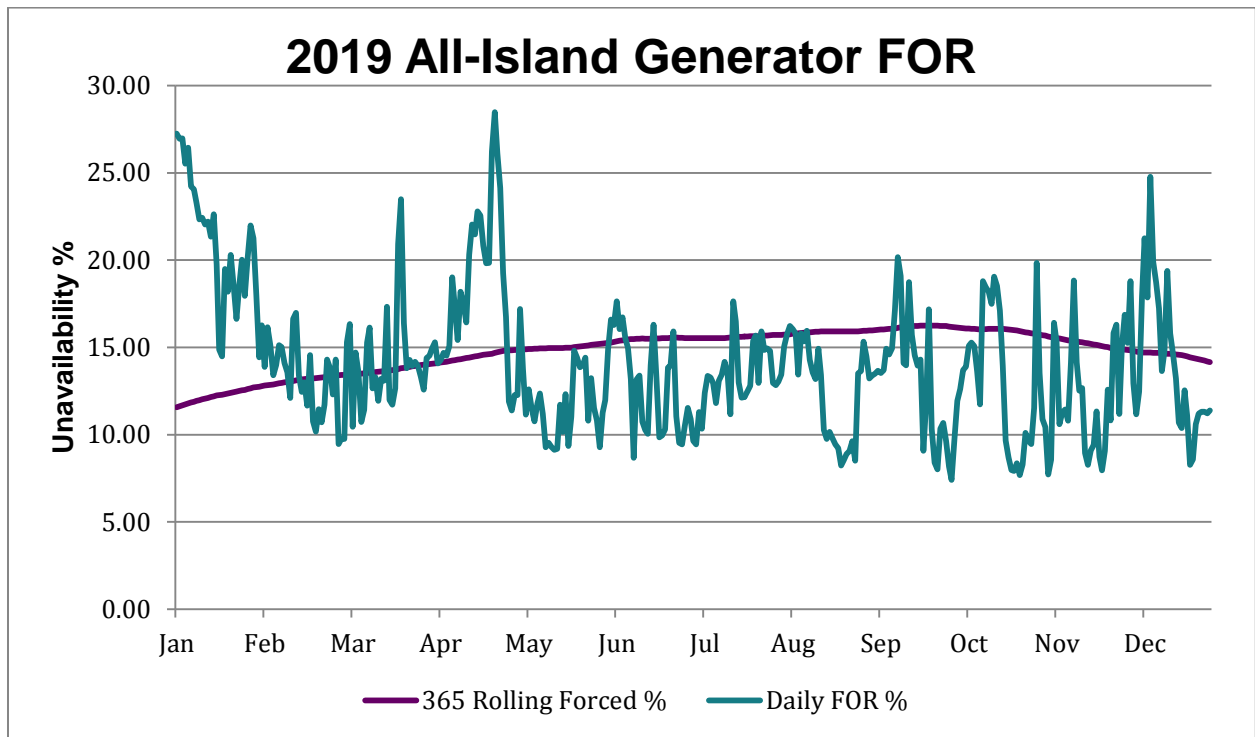


Figure 2: Generation System Forced Outage Rate 2019

- The average daily generation system forced outage rate in 2019 was 14.15%.
- The maximum daily generation system forced outage rate in 2019 was 28.49%.
- The minimum daily generation system forced outage rate in 2019 was 7.40%.

3.7 Generation Scheduled Outage Rate

The generation scheduled outage rate (SOR) can be calculated on a daily and rolling 365-day average basis. The daily SOR is a capacity weighted percentage of the time during the day that generation units are unavailable due to planned outages. The 365-day rolling SOR is the average of the weekly SOR over the previous 365 days. The daily SOR and 365-day rolling SOR are shown in Figure 3.

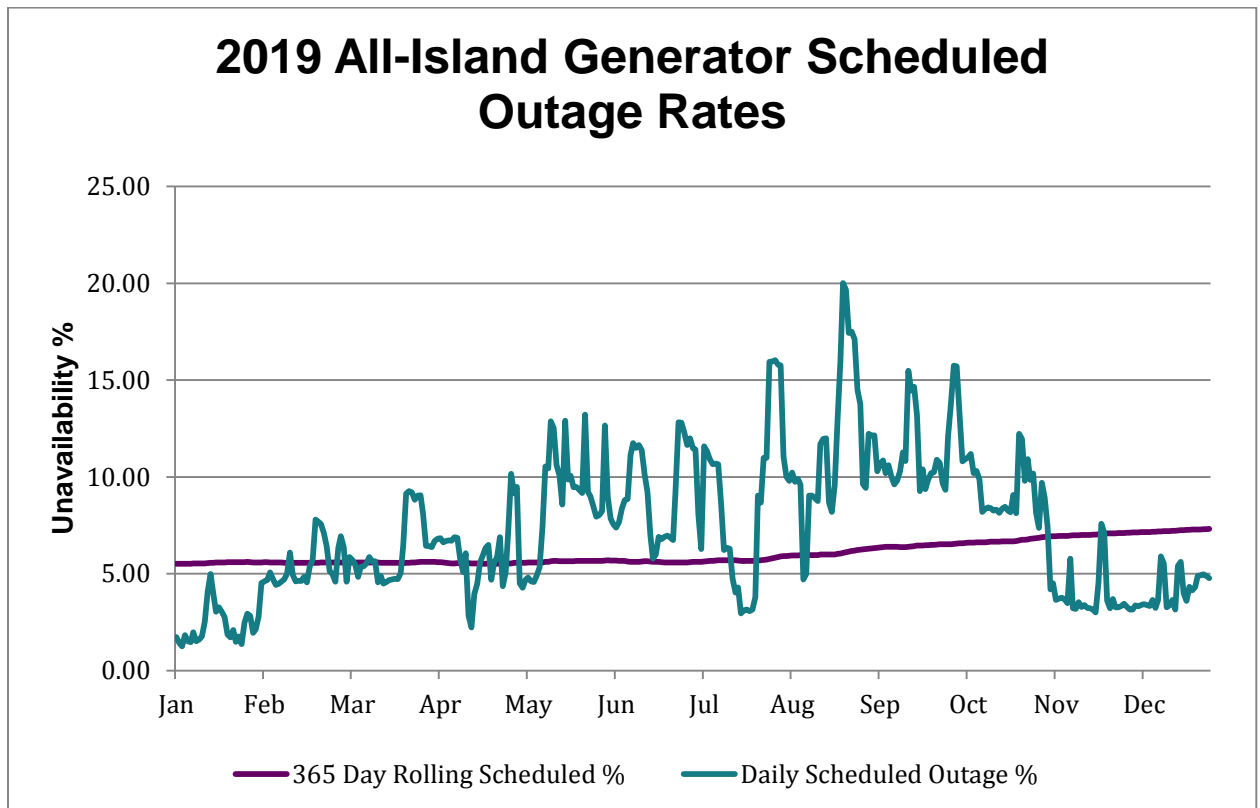


Figure 3: Generation System Scheduled Outage Rate 2019

- The average daily generation system scheduled outage rate in 2019 was 7.32%.
- The maximum daily generation system scheduled outage rate in 2019 was 20.05%.
- The minimum daily generation system scheduled outage rate in 2019 was 1.25%.

4. EirGrid Transmission System Performance

This section relates to the performance of EirGrid TSO and the transmission system in Ireland only, unless explicitly stated otherwise. This data has been prepared by EirGrid in accordance with the requirements of Part 5 of Condition 18 of its Transmission System Operator Licence.

4.1 Summary

There were no major incidents in 2019. A major incident is one which results in the loss of greater than or equal to one system minute as a result of a single system disturbance.

The system minutes lost as a result of faults on the main system was 0.176 in 2019. No system minutes were lost due to the disconnection of normal tariff load customers during Under Frequency Load Shedding (UFLS) disturbances.

EirGrid have a target to operate the system frequency within the range 49.9 Hz to 50.1 Hz for 94% of the time. In 2019, the system frequency was within the agreed limits 99.66% of the time.

4.2 Grid Development and Maintenance

This section provides an overview of grid development activities in 2019.

4.2.1 Completed Capital Projects

The following capital projects were completed in 2019:

- Binbane-Letterkenny 110 kV Line - Tievebrack Loop-in;
- Bellacorick - Moy 110 kV Line Uprate;
- Great Island - Wexford 110 kV Line Uprate;
- Oweninny Power 1 & 2 - Shallow Connection Works;

- Midleton T101 transformer;
- Booltiagh 110 kV Station Extension;
- Glenree Shallow Works for DSO20(2);
- Coomatagart 110 kV Shallow Works (Kilgarvan Wind Farm);
- Clonee Phase 2 Extension;
- Bandon 110 kV Station – Protection Works; and
- Cloghran 110 kV Station - Replacement of No.2 HV Transformers.

4.2.2 New Connection Offers

Parties seeking a new connection to the transmission system must apply to EirGrid for a connection offer. EirGrid operates within a regulatory approved process for providing connection offers to generators and demand customers seeking direct connection to the transmission system. The process for issuing generation offers was consulted on in 2017 resulting in the Enduring Connection Policy (ECP) which led to a significant increase in the number of new generation capacity offers issuing in 2019. Applications for ECP-2 will open later in 2020.

In order to connect to the transmission system, all demand and generation customers must execute a connection agreement with EirGrid. Table 3 summarises the total number of new capacity connection agreements executed in 2019 and their associated load or generation capacities. A connection offer which is accepted in one year is unlikely to impact on connected generation capacity in the same year given the lead times associated with construction.

Table 3: New Capacity Executed Demand & Generation Connection Agreements

| | Demand | Generation | Interconnector |
|---|---------------|-------------------|-----------------------|
| Executed Connection Offer Agreements in 2019 [No.] | 5 | 4 | 1 |
| Executed Connection Offer Agreements in 2019 [Capacity] | 392 MVA | 173 MW | 500 MW |

In addition to issuing connection offers for new generation and demand capacity, EirGrid facilitates existing contracted customers in modifying existing connection agreements.

4.2.3 Connections Energised

When a connection agreement is executed for a new connection, it typically takes a number of years before the demand or generation is connected to the transmission system. This period includes project development, time taken to obtain consents and to construct the connection.

When the transmission connection is energised, it then takes a number of months for the generator to reach commercial operation. This period is generally much shorter for demand customers.

Table 4 provides an overview of the number of new connections to the transmission system commissioned in 2019.

Table 4: Demand & Generation Connections Energised in 2019

| | Demand | Conventional Generation | PPM⁴ |
|--|---------------|--------------------------------|------------------------|
| Connections Energised in 2019 [No.] | 0 | 0 | 15 |
| Connections Energised in 2019 [Capacity] | 0 MVA | 0 MW | 466 MW |

4.2.4 Customers Certified Operational

Table 5 provides an overview of customers connected to the transmission system who have been deemed fully operational. It shows customer connections which have completed the testing phase and have received an operational certificate from EirGrid. This includes generators connected to the distribution network. Note that demand customers are not currently certified by EirGrid and are therefore not included in the table.

Following energisation, the unit is required to complete Grid Code Compliance testing, following which Operational Certificates⁵ are issued.

⁴ PPM: Power Park Modules

⁵ EirGrid issues Operational Certificate Justifications for distribution WFPS. These are the included in the figures shown.

Table 5: Customers Certified Operational in 2019

| | Total number of new units certified operational in 2019 | Total new capacity certified operational in 2019 |
|--|---|--|
| WFPS | 10 | 365 MW |
| Conventional | 0 | 0 MW |
| DSU including existing with change in capacity | 40 | 44 MW |

4.3 General System Performance

4.3.1 Under-Frequency Load Shedding

There were no UFLS disturbances in 2019 which resulted in shedding of normal tariff load customers.

The relays to disconnect normal tariff customer load are only activated once the system frequency drops to 48.85 Hz. The lowest system frequency in 2019 was between 49.342 Hz.

Figure 4 provides a trend of the number of disturbances since 2004 that involved operation of under-frequency relays to disconnect interruptible and normal tariff end-users. No normal tariff customers have been disconnected due to an under-frequency disturbance since 2014.

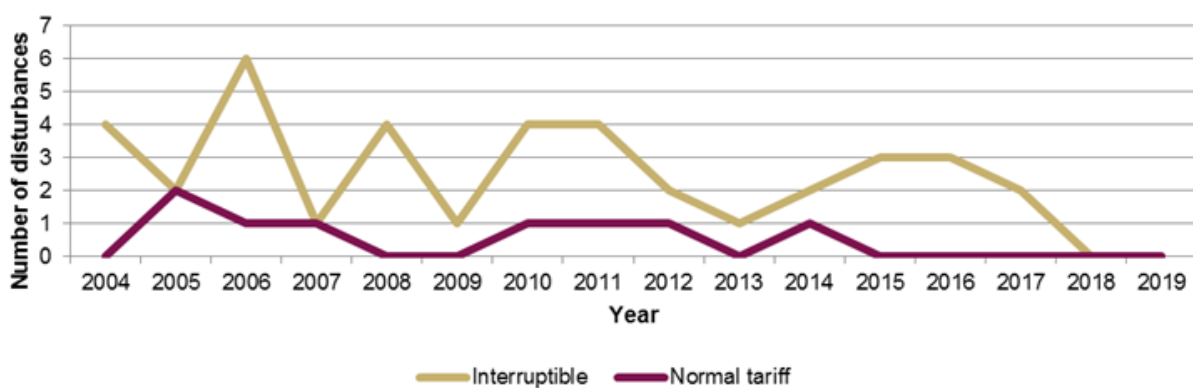


Figure 4: Under frequency disturbances 2004-2019

Figure 5 provides a trend of the lowest system frequency by year since 2004.

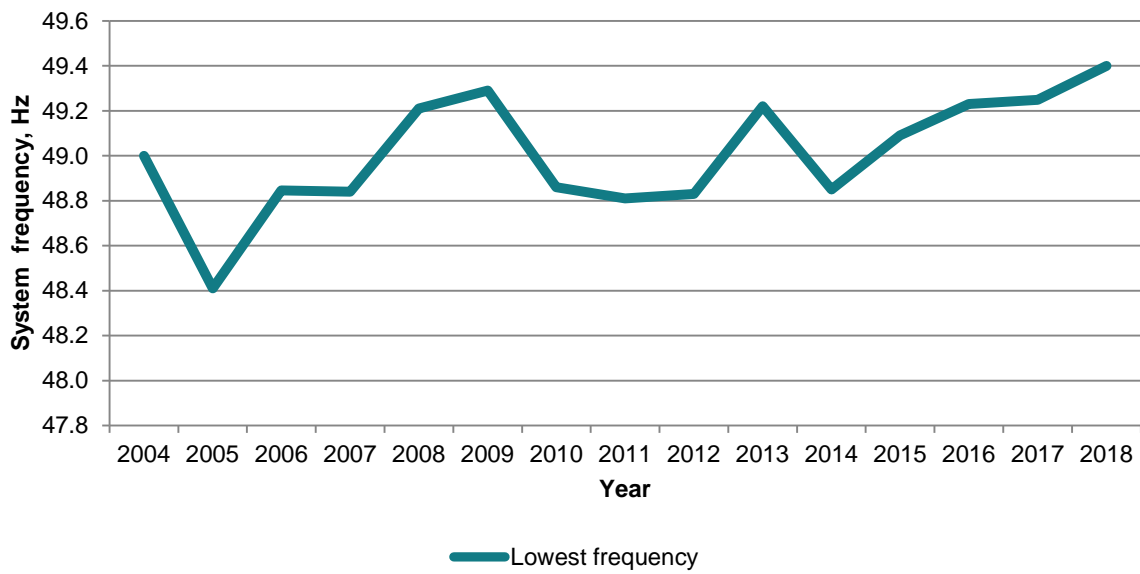


Figure 5: Lowest system frequency 2004-2019

4.3.2 Under-Voltage Load Shedding

There was no incident of Under-Voltage Load Shedding in 2019.

4.4 System Minutes Lost

This section provides information for system minutes lost (SML) attributable to the transmission system operator.

System minutes lost is a measure of the energy not supplied for a disturbance. The metric takes account of the load lost (MW), duration of disconnection (minutes) and peak system demand (MW), to allow for historical comparison. For example, if 300 MW were lost for 10 minutes and the system peak was 3000 MW, this would represent one system minute.

- System minutes = (load x duration) / (system peak) = (300 x 10) / 3000 = 1

The total system minutes lost (SML) as a result of faults on the main system for 2019, attributable to EirGrid, was 0.176.

The trend of system minutes lost since 2004 is shown in Figure 6, with incentive/penalty limits and deadbands as provided by the Commission for Regulation of Utilities (CRU). The central target provided until 2010 was replaced in 2011 with a deadband between 1.5 and 3.0 SML, where there is neither penalty nor incentive. One fifth of the incentive amount is awarded for every 0.1 SML below 1.5 SML, down to 1.0 SML. One fifth of the incentive amount is penalised for every 0.1 SML above 3.0 SML, up to 3.5 SML.

The mean number of system minutes lost per year since 2004 was 1.050.

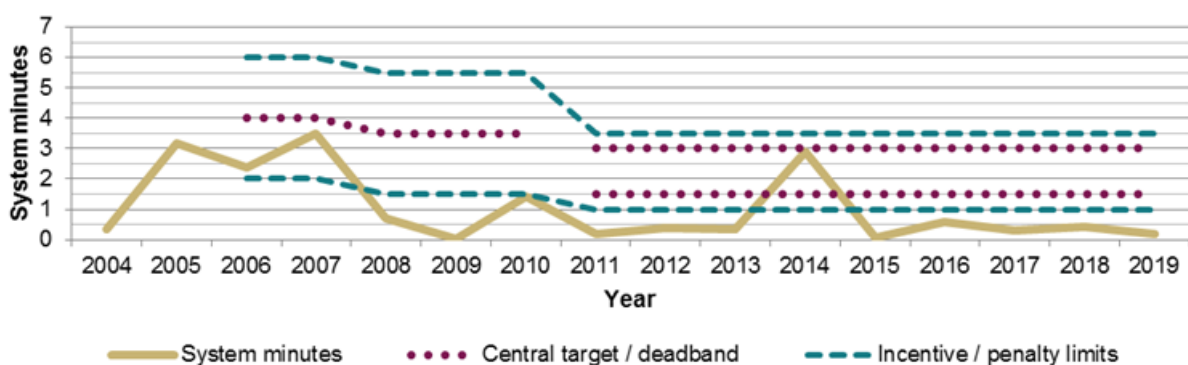


Figure 6: System minutes lost and associated targets: EirGrid 2004-2019

4.5 Zone Clearance Ratio

This section provides details of the short circuit faults on the main system and outside the main system for which main system protection is expected to operate without delay.

Zone clearance ratio (ZCR) is defined as the ratio of the number of short circuit faults, not cleared in zone 1 to the total number of short circuit faults per year cleared by main system protection. See Appendix A for further definition of Zones and ZCR.

Of the 55 short circuit faults in 2019, main system protection was expected to operate without delay for 54 short circuit faults on the main system. . There were no faults non-zone 1 clearances. The ZCR trend since 2004 is shown in Figure 7.

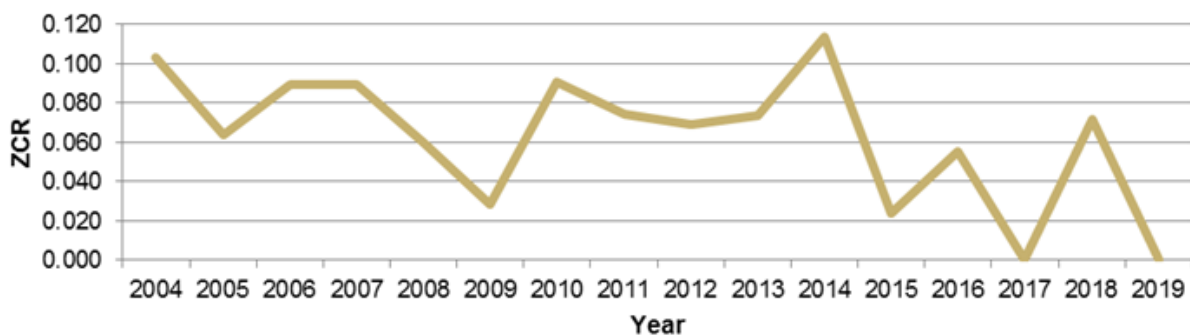


Figure 7: Zone clearance ratio: EirGrid 2004-2019

4.5.1 Frequency Control

In 2019 the system frequency was operated between 49.9 Hz to 50.1 Hz for 99.66% of the time.

4.6 Summary of key disturbances

4.6.1 Loss of load

In April, the Binbane-Cathaleen's Fall 110 kV circuit tripped to clear a single phase to ground fault. The cause of the fault is unknown. An interruption to end-users occurred, resulting in 0.078041 system minutes lost.

In May, the Killeel 110 kV circuit breaker in Maynooth 220 kV station tripped and reclosed due to a flash over on a glass insulator string. An interruption to end-users occurred, resulting in 0.000018 system minutes lost.

In June, the Kilpaddoge-Rathkeale 110 kV line tripped to clear a fault caused by lightning. An interruption to end-users occurred, resulting in 0.021246 system minutes lost.

In September, the T141 transformer 110 kV circuit breaker in Letterkenny 110 kV station tripped due to a commissioning error. An interruption to end-users occurred, resulting in 0.073549 system minutes lost.

In November, the Letterkenny-Tievebrack 110 kV line tripped due to lightning. Tievebrack 110 kV station was tail-fed at the time of the disturbance, resulting in the trip of the transformer T141. An interruption to end-users occurred, resulting in 0.002870 system minutes lost.

4.6.2 Under-Frequency Load Shedding

There were no under frequency load shedding disturbances in 2019.

4.6.3 Storms Resulting in Trippings

Between 10:33 and 18:43 hours on 8 December, there were 6 faults during the Storm Atiyah. The faults were caused by wind and lightning. All faults were single phase to ground on overhead lines; one at 400 kV and five at 110 kV. All faults were zone 1 clearances. Fault clearance times were between 49 ms and 89 ms. The disturbance resulted in the trip of 7.7 MW of wind generation. There were no supply interruptions as a result of the disturbance.

Between 21:14 and 22:46 hours on 18 December, there were four faults on the 110 kV system during Storm Elsa. All faults were caused by wind. An orange status weather warning was in place at the time of the faults. All faults were correctly cleared by the lines' protection in less than 90 ms. Two circuits were automatically reclosed as expected and two circuits tripped, reclosed and tripped again.

4.7 Transmission System Availability & Outages

4.7.1 Transmission System Availability

When considering transmission system availability, it is the convention to analyse it in terms of transmission system unavailability. The formula for calculating transmission system unavailability is given in Appendix 5. Figure 8 shows the percentage Transmission System Unavailability in each month for 2019.

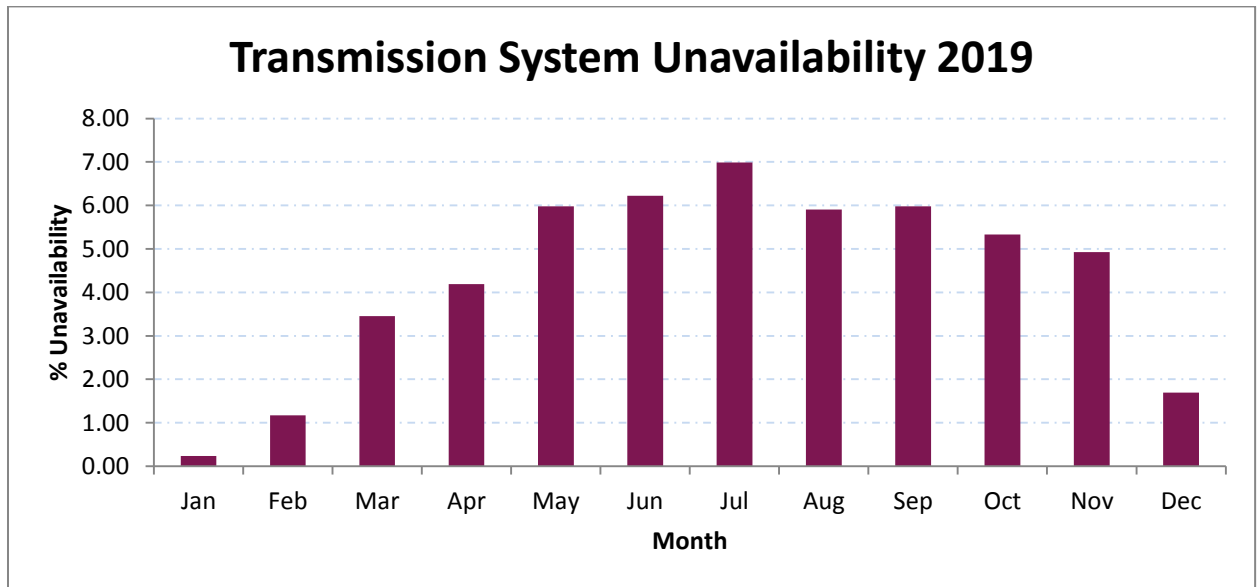


Figure 8: Monthly Variations of System Unavailability 2019

4.7.2 Transmission Plant Availability

The measure of plant availability is the kilometre-day for feeders and the MVA-day for transformers. The availability figures vary between the different categories of plant. The formulae for calculating transmission plant availability are provided in Appendix 1.

Table 6 provides a detailed breakdown of all plant availability figures for 2019.

Table 6: Transmission System Plant Availability 2019

| Plant Type | Circuit Length [km] | Number of Outages | Availability (%) 2019 |
|---------------------------|----------------------------|-------------------|-----------------------|
| 110 kV Circuits | 4,528 | 326 | 97.11 |
| 220 kV Circuits | 1,927 | 76 | 97.30 |
| 275 kV Circuits | 97 | 1 | 96.65 |
| 400 kV Circuits | 439 | 11 | 95.53 |
| Plant Type | Transformer Capacity [MVA] | Number of Outages | Availability (%) 2019 |
| 220 / 110 kV Transformers | 11,089 | 91 | 97.84 |
| 275 / 220 kV Transformers | 1,200 | 6 | 91.40 |
| 400 / 220 kV Transformers | 4,050 | 18 | 83.21 |
| Total | 6,991 km | 529 | Weighted Average (%) |
| | 16,339 MVA | | 96.88 |

4.7.3 Cause of Transmission Plant Unavailability

Transmission plant unavailability is classified into the categories outlined in Table 7.

Table 7: Transmission System Plant Unavailability Categories

| Category | Description |
|--|--|
| Forced & Fault | Refers to unplanned outages. An item of plant trips or is urgently removed from service. Usually caused by imminent plant failure. There are three types of forced outage: A) Fault & Reclose B) Fault & Forced C) Forced (No Tripping) The above forced outages are explained in detail in Section 6.6. |
| Safety & System Security | Safety: Refers to transmission plant outages which are necessary to allow for the safe operation of work to be carried out. System Security: Refers to outages which are necessary to avoid the possibility of cascade tripping or voltage collapse as a result of a single contingency. When a line is out for maintenance it may be necessary to take out additional lines for this reason. |
| New Works | An outage to install new equipment or uprate existing circuits. |
| Corrective & Preventative Maintenance | Corrective Maintenance: Is carried out to repair damaged plant. Repairs are not as urgent as in the case of a forced outage. Preventative Maintenance: Is carried out in order to prevent equipment degradation which could lead to plant being forced out over time. Includes line inspections, tests and routine replacements. |
| Other Reasons | A number of other reasons may be attributed to plant unavailability, such as testing, protection testing and third party work. |

4.7.4 110 kV Circuit Unavailability

Figure 9 provides a breakdown of the causes of unavailability on the 110 kV network in 2019.

The largest contributor to unavailability (52%) on the 110 kV network was attributable to the "New Works" category. This category is for outages to install new equipment or uprate existing circuits.

A further 40% of unavailability on the 110 kV network in 2019 were outages for the purpose of corrective and preventive maintenance. This type of maintenance includes, amongst others, ordinary services, condition assessments, wood-pole replacement/straightening and general line maintenance.

Only 4% of unavailability was due to forced outages.

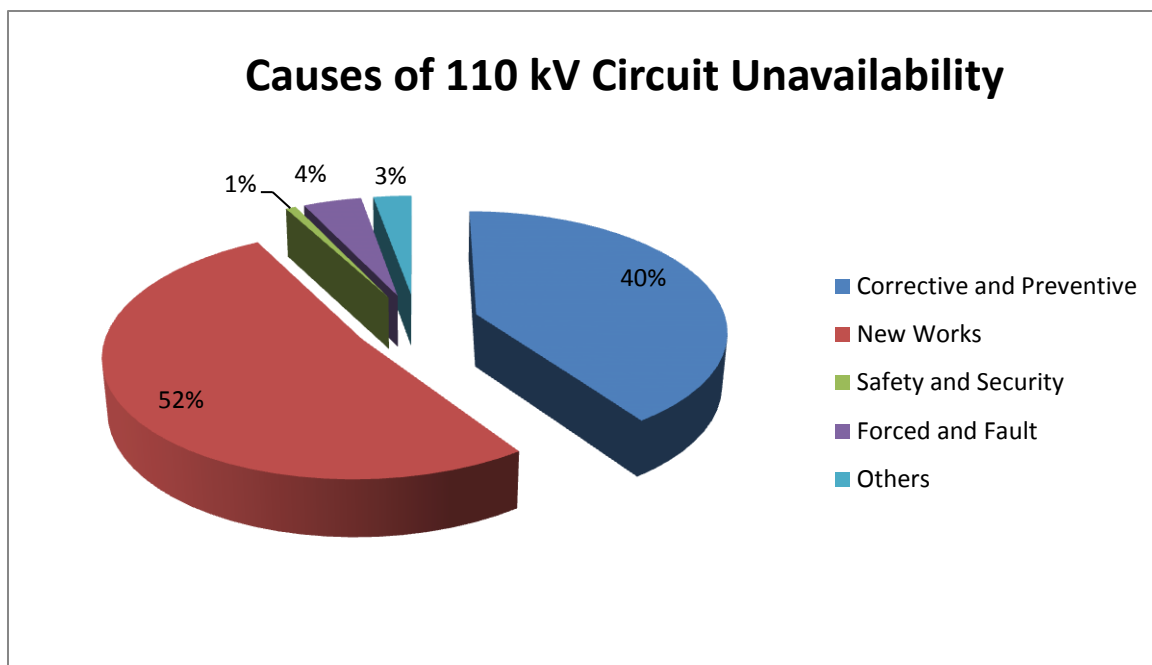


Figure 9: Causes of Unavailability on the 110 kV System in 2019

4.7.5 220 kV Circuit Unavailability

Figure 10 provides a breakdown of the causes of unavailability on the 220 kV network in 2019.

The largest contributor to unavailability (43%) on the 220 kV network in 2019 were outages for the purpose of "New Works".

Approximately 12% of unavailability on the 220 kV network was attributable to Forced and Fault.

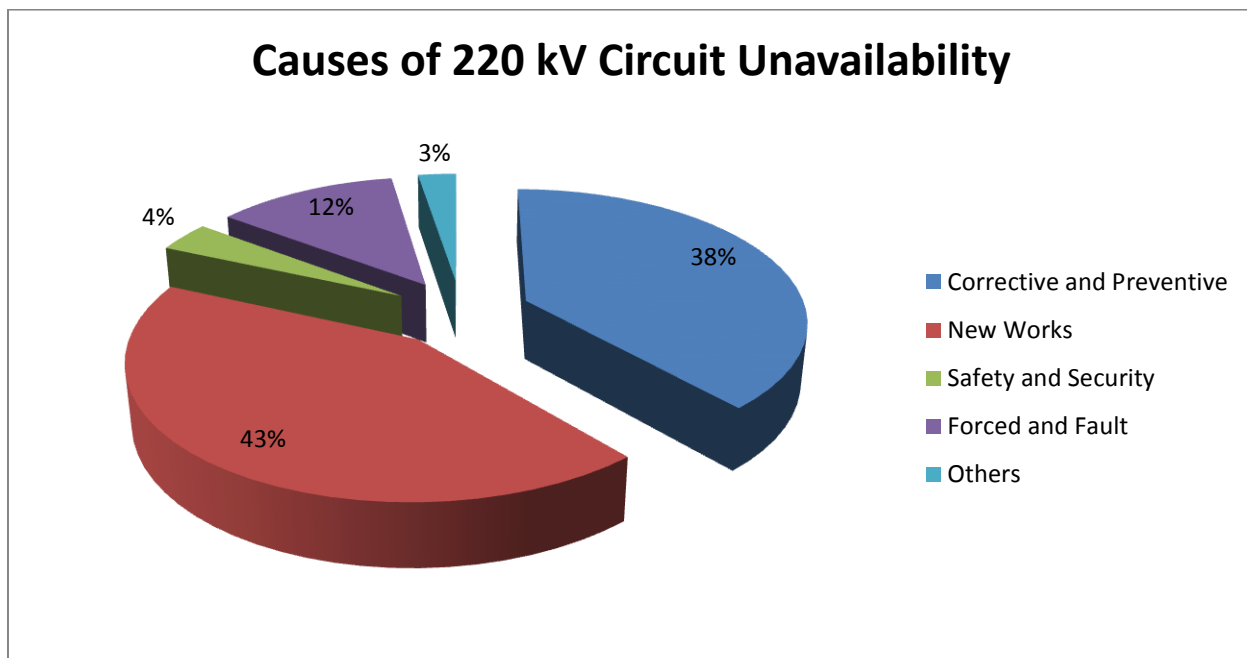


Figure 10: Causes of Unavailability on the 220 kV System in 2019

4.7.6 275 kV Circuit Unavailability

The 275 kV tie-line consists of 48.5 km of 275 kV double-circuit between Louth station and Tandragee station which is situated in County Armagh. In 2019 there was only one outage of 275 kV tie-lines, with Louth-Tandragee 2 (TWO) on outage for 24 days.

4.7.7 400 kV Circuit Unavailability

Figure 11 provides a breakdown of the causes of unavailability on the 400 kV network in 2019.

The largest contributor to unavailability (89%) on the 400 kV network in 2019 was corrective and preventive maintenance works.

The major corrective and preventive contribution was the outage of the Moneypoint – Oldstreet 400 kV circuit which lasted approximately 29 days while the majority of the other outages lasted less than a week.

Causes of 400 kV Circuit Unavailability

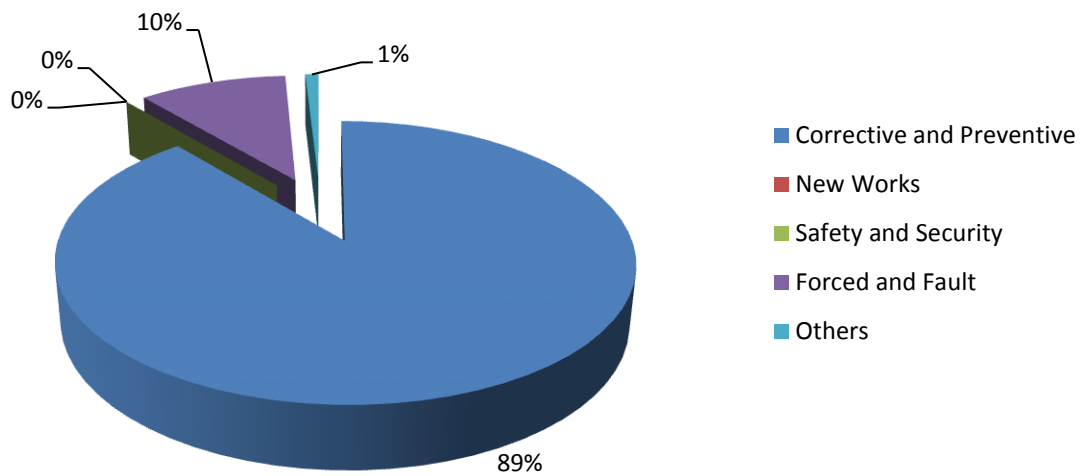


Figure 11: Causes of Unavailability on the 400kV System in 2019

Table 8 provides a breakdown of the transmission system outages that occurred in 2019 by plant type.

Table 8: Transmission System Plant Outage 2019

| Plant Type | No. of Items | Circuit Length | Forced & Fault | Safety & System Security | New Works | Corrective & Preventive Maintenance | Other | Total No. of Outages |
|---------------------|--------------|----------------------|----------------|--------------------------|-----------|-------------------------------------|-------|----------------------|
| 110 kV Circuits | 232 | 4,528 | 29 | 9 | 30 | 230 | 28 | 326 |
| 220 kV Circuits | 63 | 1,927 | 12 | 8 | 11 | 35 | 10 | 76 |
| 275 kV Circuits | 2 | 97 | 0 | 0 | 0 | 1 | 0 | 1 |
| 400 kV Circuits | 4 | 439 | 2 | 0 | 0 | 6 | 3 | 11 |
| Total | 301 | 6,991 | 43 | 17 | 41 | 272 | 41 | 414 |
| Plant Type | No. of Items | Transformer Capacity | Forced & Fault | Safety & System Security | New Works | Corrective & Preventive Maintenance | Other | Total No. of Outages |
| 220 / 110 kV Trafos | 55 | 11,089 | 17 | 5 | 5 | 52 | 12 | 91 |
| 275 / 220 kV Trafos | 3 | 1,200 | 0 | 0 | 0 | 3 | 3 | 6 |
| 400 / 220 kV Trafos | 8 | 4,050 | 5 | 0 | 1 | 9 | 3 | 18 |
| Total | 66 | 16,339 | 22 | 5 | 6 | 64 | 18 | 115 |

4.7.8. East West Interconnector

The East West Interconnector (EWIC) is a high-voltage direct current (HVDC) scheme which links the power systems of Ireland and Great Britain. It has a power rating of 500 MW. EWIC is a fully regulated interconnector which was developed and is owned by EirGrid Interconnector DAC (EIDAC) which is part of the EirGrid Group. The scheme consists of two Converter Stations located in Meath, Ireland and Deeside, Wales connected by 264 km HV cable, 185 km of which is submarine.

4.7.9. East West Interconnector Unavailability

In 2019 the availability of the East West Interconnector (EWIC) was 97.63%.

Outages contributing to EWIC unavailability mostly included maintenance works.

4.7.10 Transmission Outage Duration

The duration of transmission outages is useful for assessing transmission system performance. Transmission outages are broken into eight time classifications ranging from less than 10 minutes to greater than four weeks. The total number of outages in each time classification is shown in Figure 12.

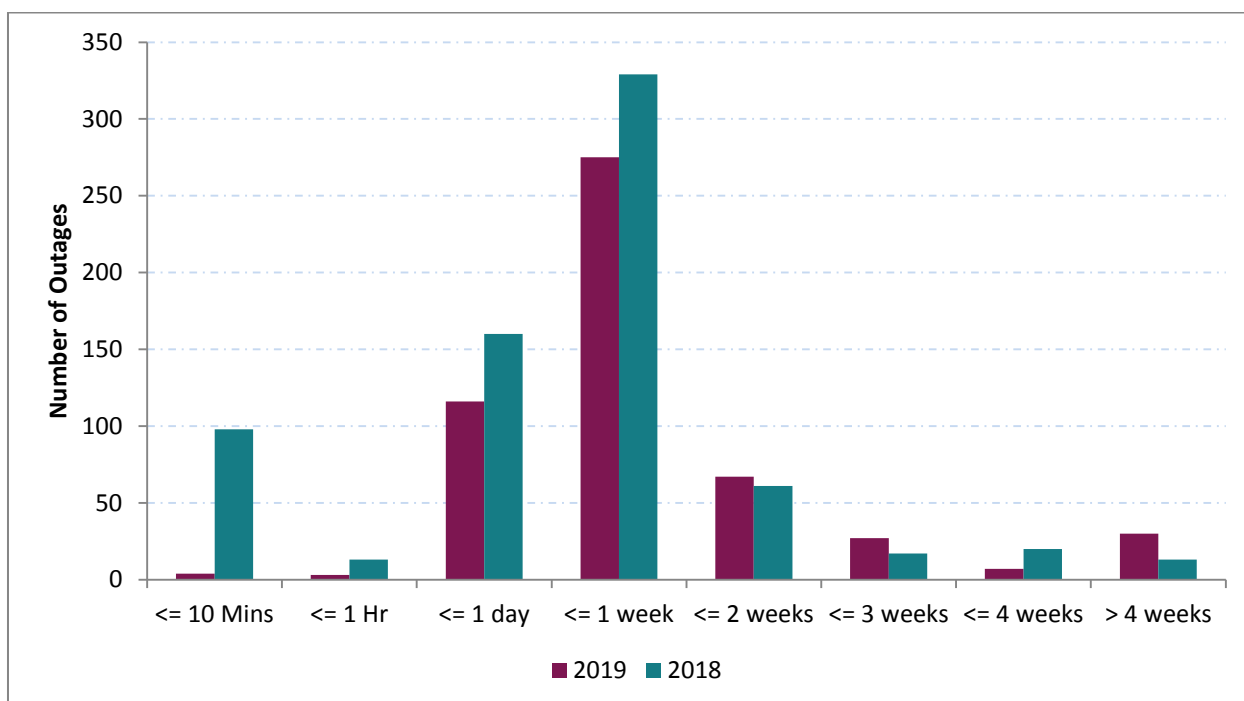


Figure 12: Duration of Outages in 2018 & 2019

The majority of the outage durations are concentrated between one day and 2 weeks with the peak occurring between one day and 1 week. In the category of one hour to one day, outages can be arranged to avoid peak load times and thereby reduce the impact on the system, while one week outages for annual maintenance are commonplace during the outage season.

4.7.11 Timing of Transmission Outages

Transmission outages are scheduled, where possible, during periods of low load in the summertime (however, this can be limited by a number of factors such as personnel availability and shortage of hydro-power support in some areas). The seasonal nature of transmission outages is apparent in Figure 13 below.

Figure 13 shows the percentage unavailability of the transmission system in each month. The March-November period (known as the outage season) sees the highest rates of unavailability during the year, when decreased system load is taken advantage of to carry out extensive maintenance outages. Figure 14 shows the average duration in days of the transmission outages in each month in 2019.

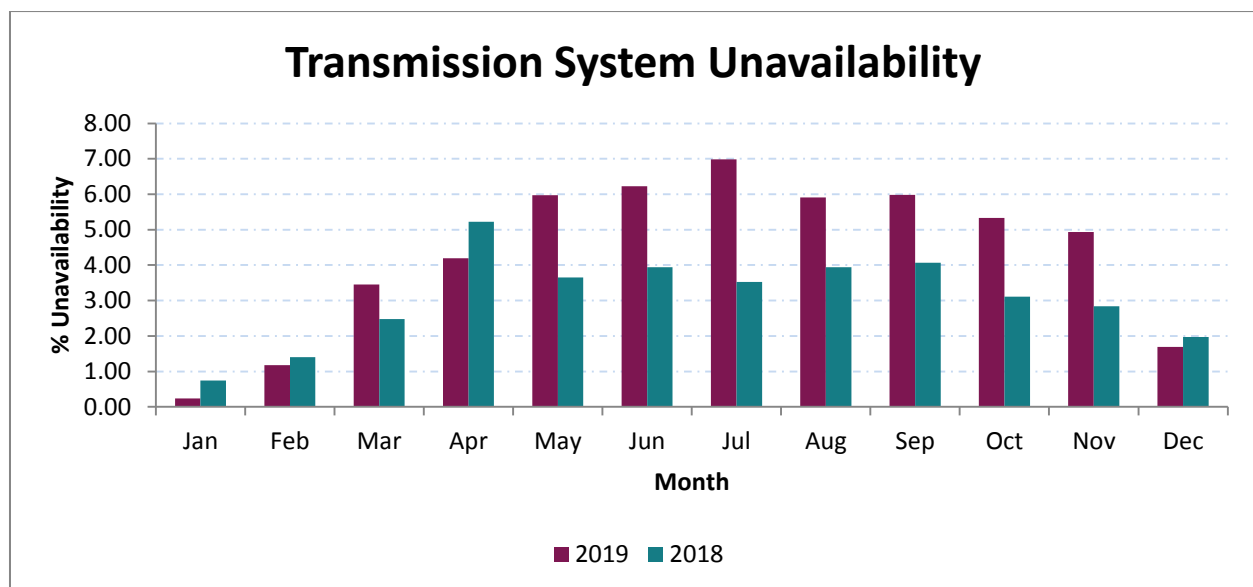


Figure 13: Percentage unavailability in each month of 2018 & 2019

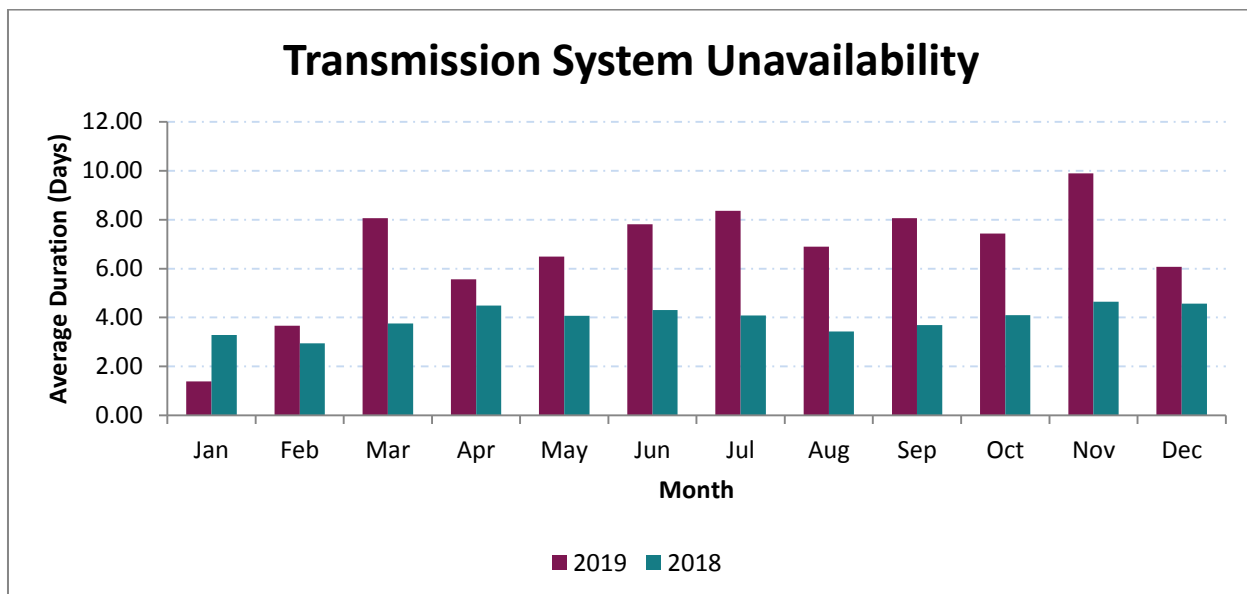


Figure 14: Average duration of outages 2018 & 2019

4.7.12 Forced Outages

There are two main outage classifications, voluntary outages and forced outages. The majority of outages are voluntary outages that are scheduled by EirGrid. Forced outages are not scheduled and cause the most disruption to the transmission system. Due to their disruptive nature, forced outages merit further analysis.

4.7.13 Forced Outages per km

The measure used for analysing the forced outages of lines and cables is the number of forced outages per kilometre of feeder, and is shown in Figure 15.

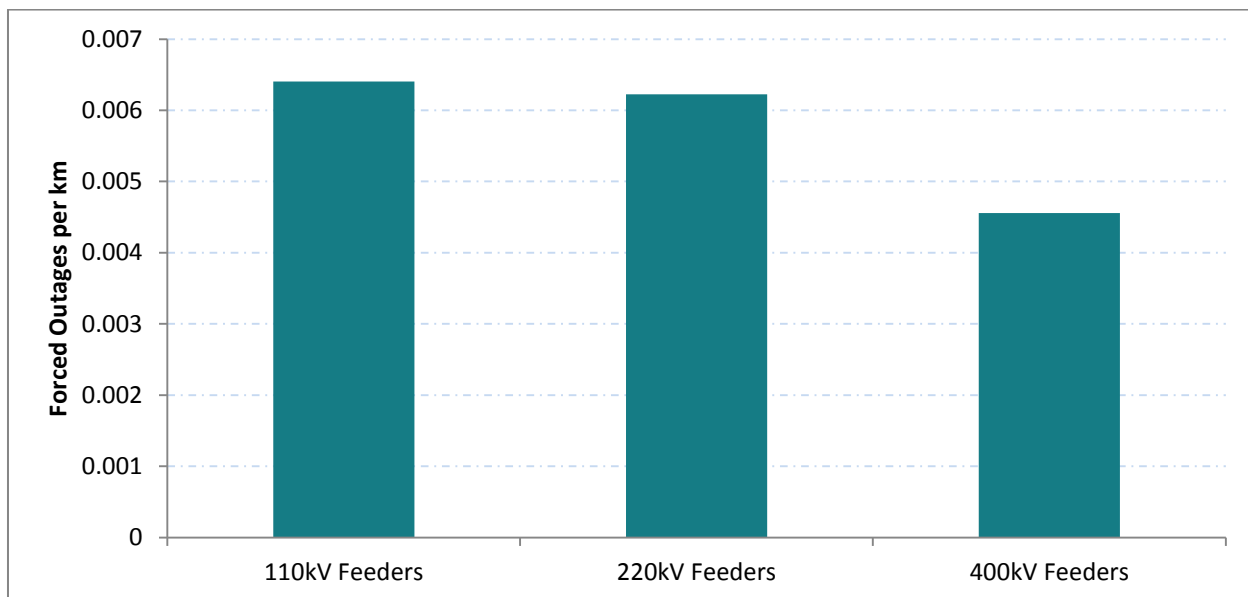


Figure 15: Forced Outages of lines and cables per km in 2019

4.7.14 Forced Outages per MVA

The measure used for analysing the forced outages of transformers is the number of forced outages per MVA capacity, which can be seen in Figure 16.

A major outage in 2019 was the forced outage of the Moneypoint T4201 400/220 kV transformer which forced out from the end of January and remained out for the remainder of 2019.

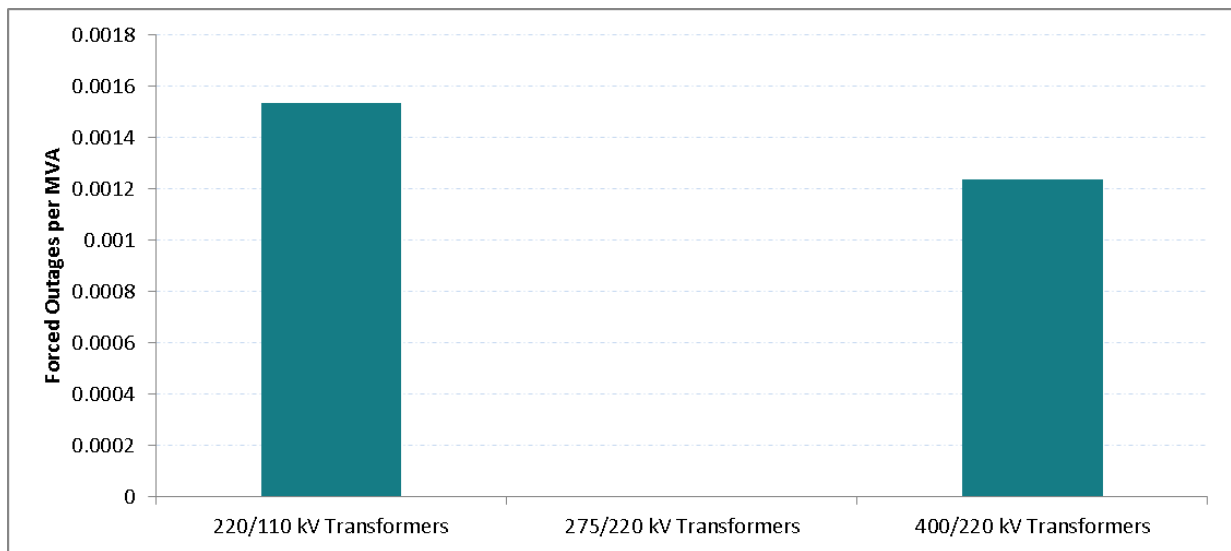


Figure 16: Forced Outage per MVA in 2019

5. SONI Transmission System

Performance

This section details the performance of the transmission system in Northern Ireland, unless explicitly stated otherwise. This data has been prepared by SONI in accordance with Condition 20 of the 'Licence to participate in the Transmission of Electricity'.

5.1 Summary

SONI is responsible for the safe, secure, efficient and reliable operation of the Northern Ireland transmission network. The transmission network is operated at 275 kV and 110 kV and is made up of approximately 150 circuits covering a total length of approximately 2,130 km. The primary purpose of the transmission system is to transport power from generators and interconnectors to bulk supply points which connect the transmission system to the distribution system.

Availability is a key measure of power system performance. In this report availability refers to the proportion of time a transmission circuit or interconnector was available.

The annual system availability for 2019 was 96.39%.

The annual availability of the Moyle Interconnector for 2019 was 97.68%. This is the highest availability on the Moyle interconnector since its connection to the system in 2002.

The North-South 275 kV tie line, connecting Louth in Ireland and Tandragee in Northern Ireland, had an availability of 83.88% in 2019. The annual availability of the Strabane – Letterkenny and Enniskillen – Corraclassy 110 kV tie lines was 100% and 68% respectively in 2019.

The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 set out the statutory obligations in relation to managing both frequency and voltage for Northern Ireland. Under the regulation SONI is required to report incidents which have caused interruptions to supplies to customers to the transmission asset owner,

NIE Networks. Part 8, paragraph 33 of the regulation contains details of the requirements for the reporting of incidents.

In 2019, there were two transmission incidents leading to customers being off supply. This was;

- On the 11th of March at 01:36, an incident at Donegall substation resulted in the loss of supply to 12,600 customers, equating to a total loss of 6.5 MW. The total system minutes lost for this event was 0.019 minutes
- On the 20th of March at 21:33, an incident at Rathgael substation resulted in the loss of supply to 41,995 customers, equating to a total loss of 32 MW. The total system minutes lost for this event was 0.902 minutes.

Quality of service is measured by the number of voltage and frequency excursions which fall outside statutory limits. There were no voltage excursions in 2019 outside the statutory limits.

The nominal frequency of the all-island transmission system is 50 Hz, and is normally controlled within the range of 49.95 Hz and 50.05 Hz. SONI is required to report on system faults where the frequency drops below 49.8 Hz or above 50.2 Hz. In 2019, there were 30 system events where the frequency exceeded these limits.

The reporting of frequency excursions is carried out in accordance with the definitions and principles of the National Fault and Interruption Reporting Scheme (NAFIRS), (Engineering Recommendation G43/2). The effects of national / regional emergencies and disputes are excluded.

5.2 Transmission System Availability

5.2.1 System Availability

Transmission system availability is the proportion of time a transmission circuit was available during the calendar year. A circuit is defined as the overhead line, cable, transformer or any combination of these that connects two busbars together or connects the transmission system to another system. Transmission system availability is reduced when a circuit is taken out of service, either for planned or unplanned purposes.

Planned outages are necessary to facilitate new user connections, network development and maintenance of network assets necessary to deliver acceptable levels of system security and reliability. These are outages planned with at least seven days' notice.

Unplanned outages can be a result of equipment failure or a fault caused by adverse weather etc. These are outages required immediately or planned with less than seven days' notice.

System Availability is calculated using the formula:

$$\text{System Availability (\%)} = \frac{\sum \text{Hours each circuit is available}}{(\text{No. of Circuits}) * (\text{Total No. Hours in Period})}$$

In 2019, the analysis of the transmission system availability data has produced the following results:

- The average availability of the Northern Ireland transmission system was in 2019 was 96.39%; and
- The average winter system availability (for the winter months January, February, November and December 2019) was 98.02%.

Figure 17 below shows the month by month variation in Transmission System Availability in Northern Ireland.

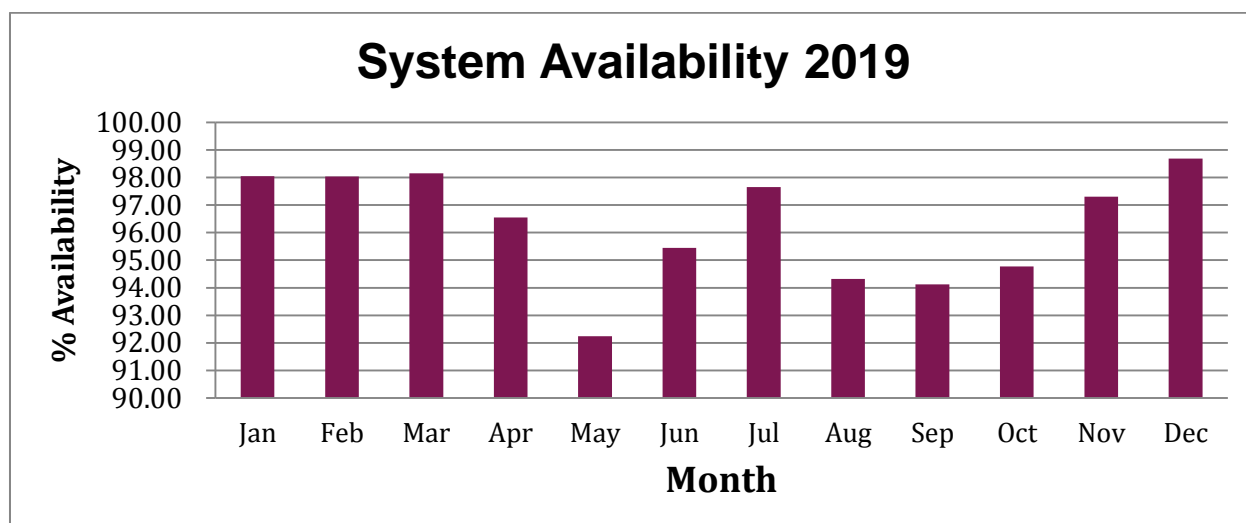


Figure 17: Transmission System Availability 2019

Overall, the availability of the system is high, particularly over the winter months, such as January and December, where maintenance is avoided due to the higher electrical demand and potential adverse weather conditions. The preference is for maintenance to take place over the summer months when network loading is generally lower to mitigate the risk of affecting the supply to customers.

5.2.2 System Unavailability

Figure 18 below shows the month by month variation in planned and unplanned system unavailability.

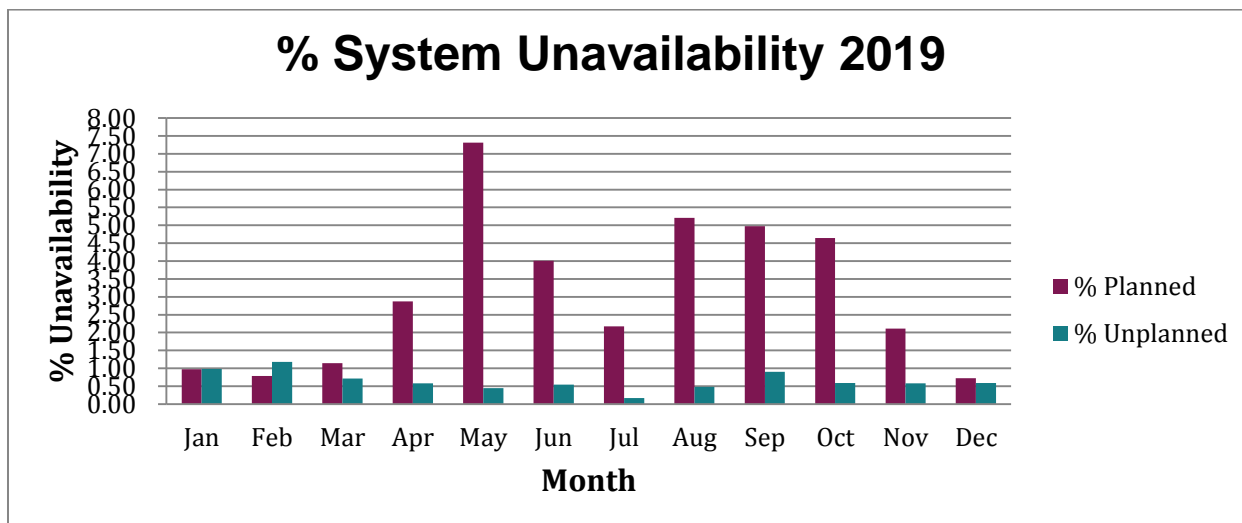


Figure 18: Transmission System Unavailability 2019

The majority of outages occurred during the spring/summer months. This reflects the policy of planning outages during periods of lower electrical demand.

5.2.3 System Historical Availability Performance

Figure 19 shows the historic variation in system availability from 2005/2006 to 2019 for the transmission network in Northern Ireland.

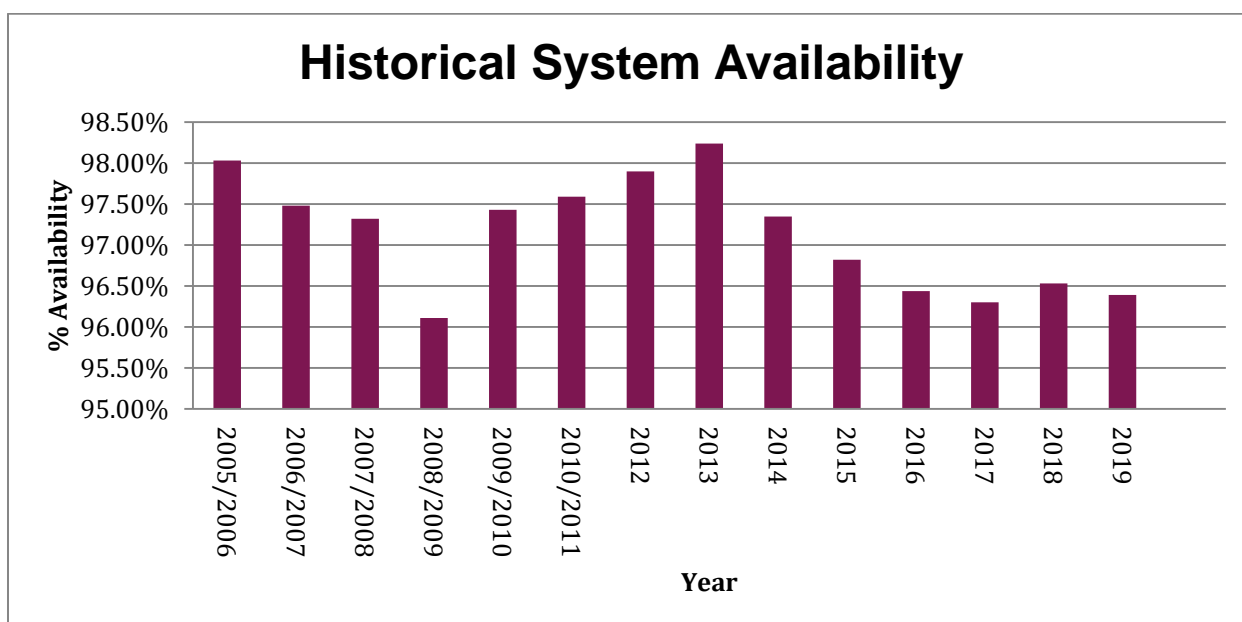


Figure 19: Historical System Availability 2005/2006 to 2019

5.2.4 System Historical Unavailability Performance

Figure 20 below shows the breakdown of the system unavailability from 2005/2006 to 2019.

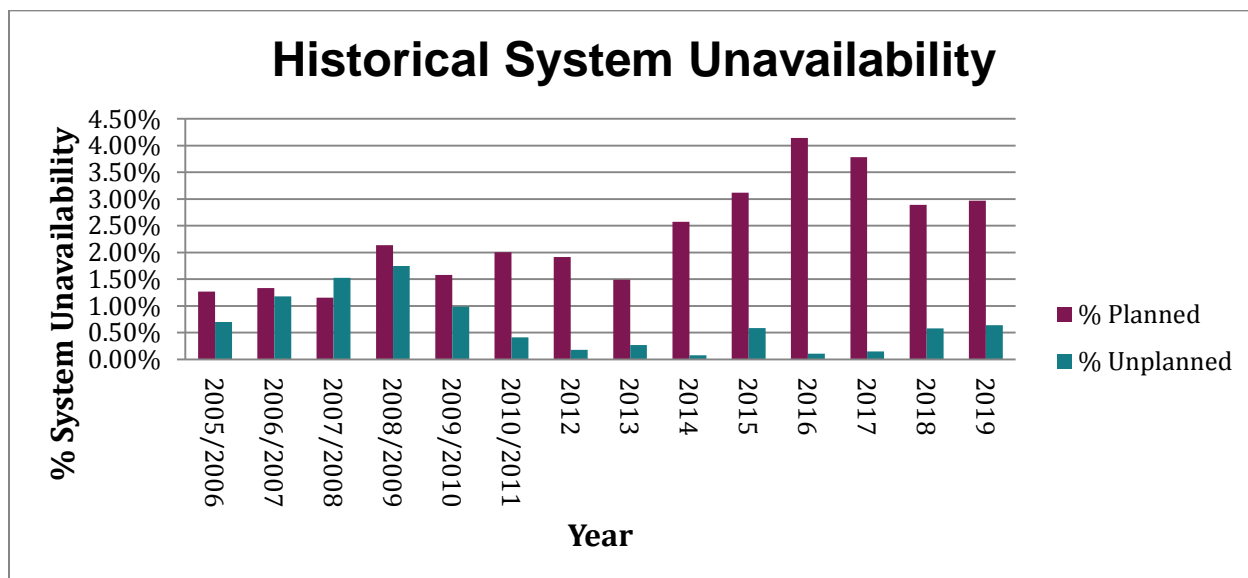


Figure 20: Historical System Unavailability 2005/2006 to 2019

There has been a marginal drop in system unavailability in 2019 compared to 2018, shown in Figure 20 above. In 2019, as part of the price control RP6, NIE Networks has continued its commitment to upgrade existing infrastructure as well as constructing new assets to meet the ongoing needs of the power system.

5.2.5 Moyle Interconnector

The Moyle interconnector, owned by Mutual Energy, connects the power systems of Northern Ireland and Scotland. The interconnector is a High Voltage Direct Current (HVDC) system; consisting of two submarine power cables and two HVDC-AC converter stations; one located at Islandmagee in Northern Ireland and the other at Auchencrosh in Scotland. The system has an operational import capacity of 442 MW and an operational export capacity of a maximum 400 MW. Note: SONI revised the import and export figures for Moyle from a Northern Ireland perspective in July 2019 from 300 MW to 380 MW export and removed the 410MW import limit that was in place during summer months. Note also that the firm export limit on Moyle is 80 MW

due to network limitations in Scotland. There is an agreed process between Moyle and NGE SO on releasing additional “non-firm” export capacity when GB system conditions allow.

The interconnector is operated by SONI, and the performance of the interconnector is detailed in this report.

During 2019, the longest outage taken by Moyle was an eight day scheduled outage in June for maintenance of Pole 2 converter transformers and associated equipment at Ballycronanmore Converter Station.

5.2.6 Moyle Interconnector Historical Availability

The Annual Availability of the Moyle Interconnector for 2019 was 97.68%.

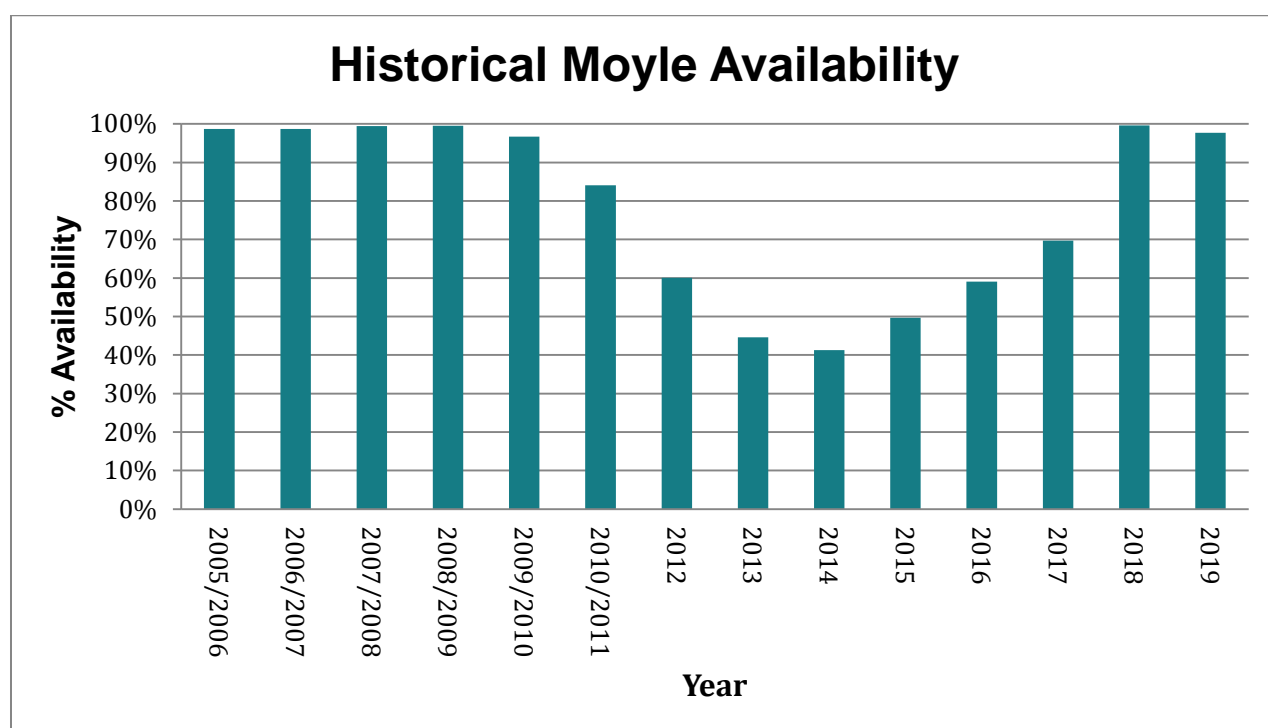


Figure 21: Historical Moyle Interconnector Availability 2005/2006 to 2019

5.2.7 Moyle Interconnector Historical Unavailability

The 2019 Annual Unavailability of the Moyle Interconnector was 2.32%.

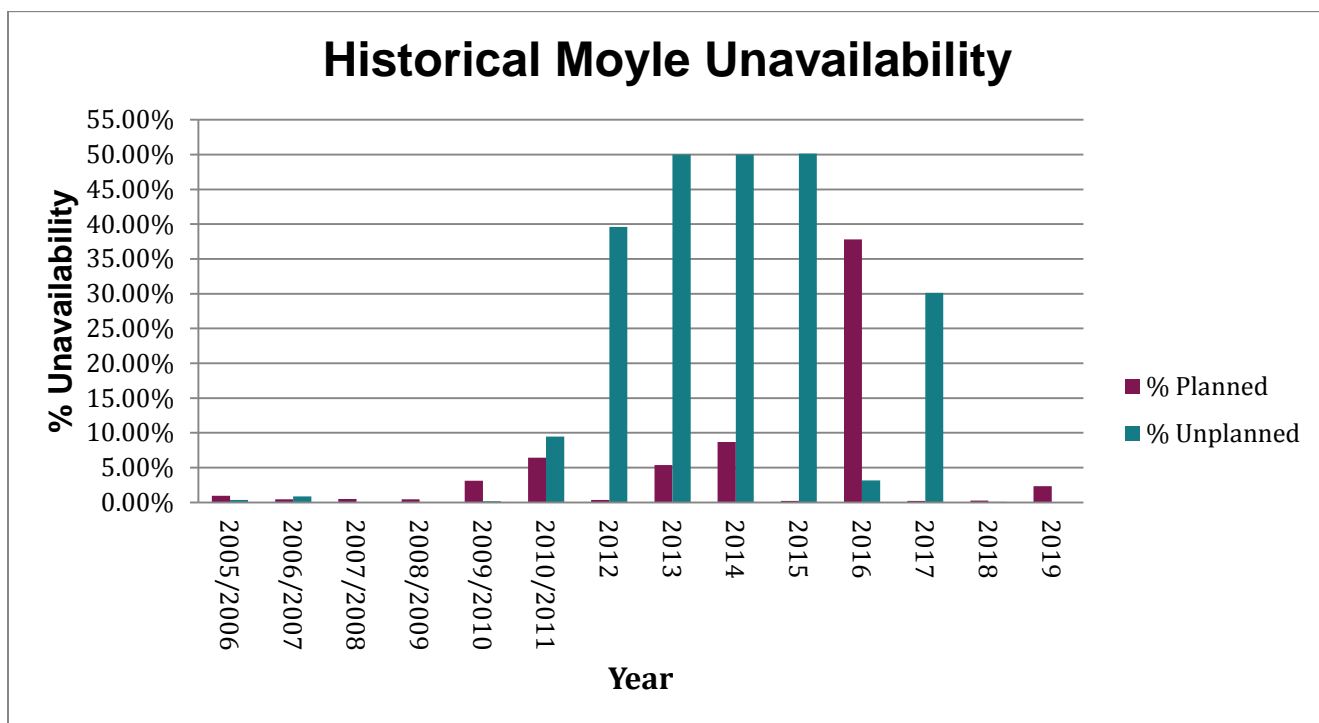


Figure 22: Historical Moyle Interconnector Unavailability 2005/2006 to 2019

5.2.8 Moyle Interconnector Monthly Unavailability

Figure 21 below shows the month by month variation of unavailability of the interconnector.

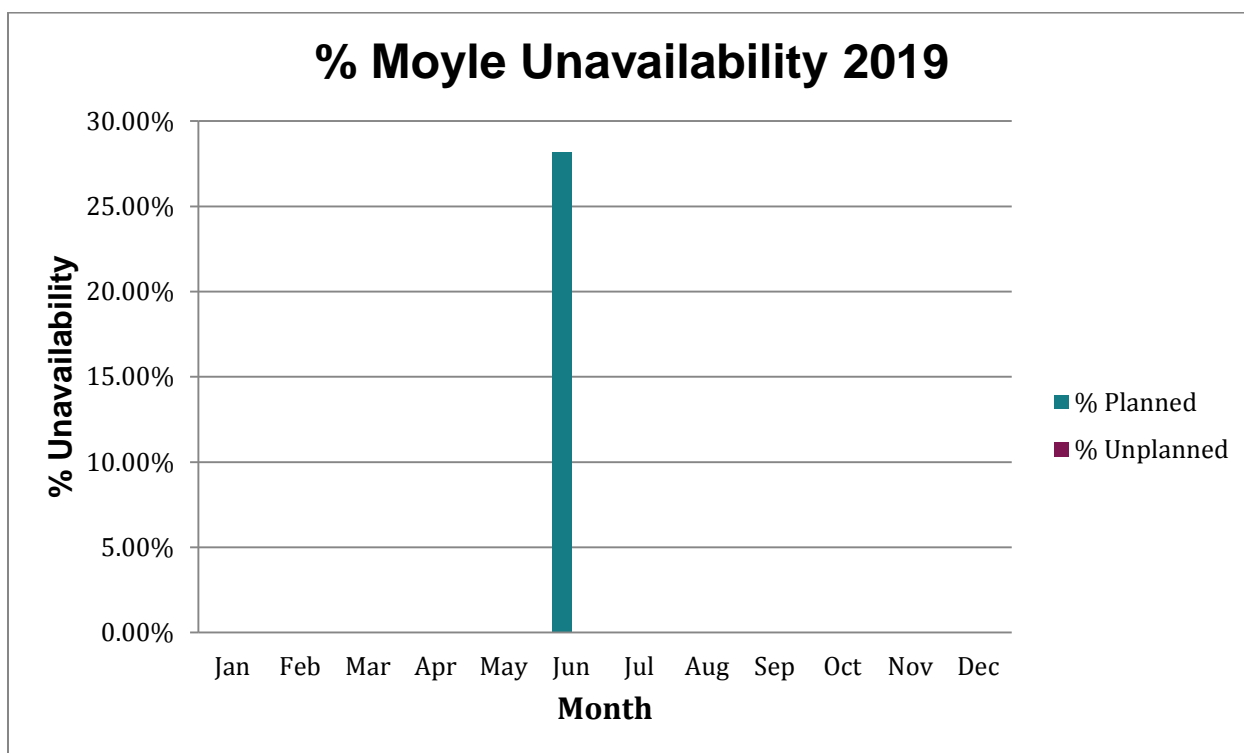


Figure 21: Moyle Interconnector Monthly Unavailability 2019

Figure 21 shows the scheduled maintenance that was carried out in June. There were 0 emergency outages in 2019.

5.2.9 275 kV Tie Line

The connections between Ireland and Northern Ireland are referred to as 'Tie Lines'.

The Northern Ireland transmission system is connected to the transmission system in Ireland by means of one 275 kV double-circuit connection from Tandragee 275 kV substation in Co. Armagh to Louth 220 kV substation in Co. Louth.

The 275 kV double-circuit tie line is used as the method for synchronising the Northern Ireland and Ireland power systems together. Energy can flow freely between both jurisdictions, depending on the operating requirements and generating plant being utilised on the all island power system.

The annual average availability of the 275 kV North-South Tie Line in 2019 was 96.66%.

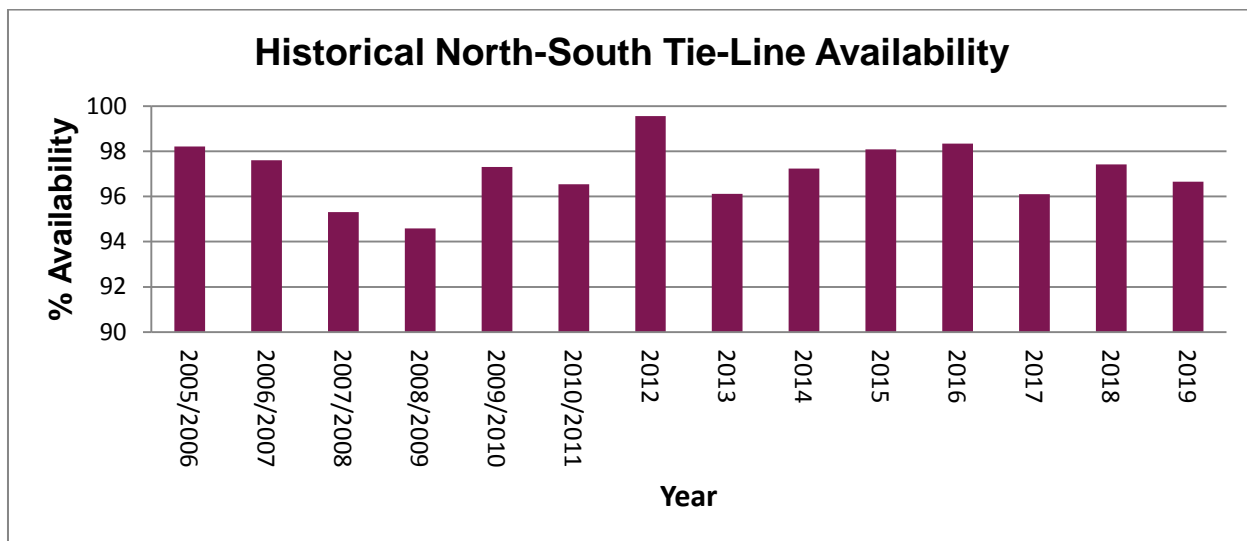


Figure 22: Historical North-South Tie Line Availability 2005/2006 to 2019

5.2.10 110 kV Tie lines

There are two 110 kV connections between Ireland and Northern Ireland:

- Strabane – Letterkenny 110 kV circuit
- Enniskillen – Corraclassy 110 kV circuit

These 110 kV tie lines provide an AC connection between the two transmission systems, which allows emergency flows of active and reactive power for frequency and voltage support, increasing system stability.

Phase Shifting Transformers (PST), designed for energy to flow in two directions, are installed at Strabane and Enniskillen and control the flow of energy between Ireland and Northern Ireland. These PSTs are rated at 125 MW each and are, in normal operation, operated to maintain a 0 MW flow between both jurisdictions. To negate any potential system abnormalities as a result of transmission outages, either scheduled or unplanned, a flow can be manually allowed that can support system operation in both jurisdictions.

Also, in times of high wind, the Strabane-Letterkenny tie line is used to import excess wind energy being produced.

The availability of the 110 kV Tie Lines was 83.88%% in 2019.

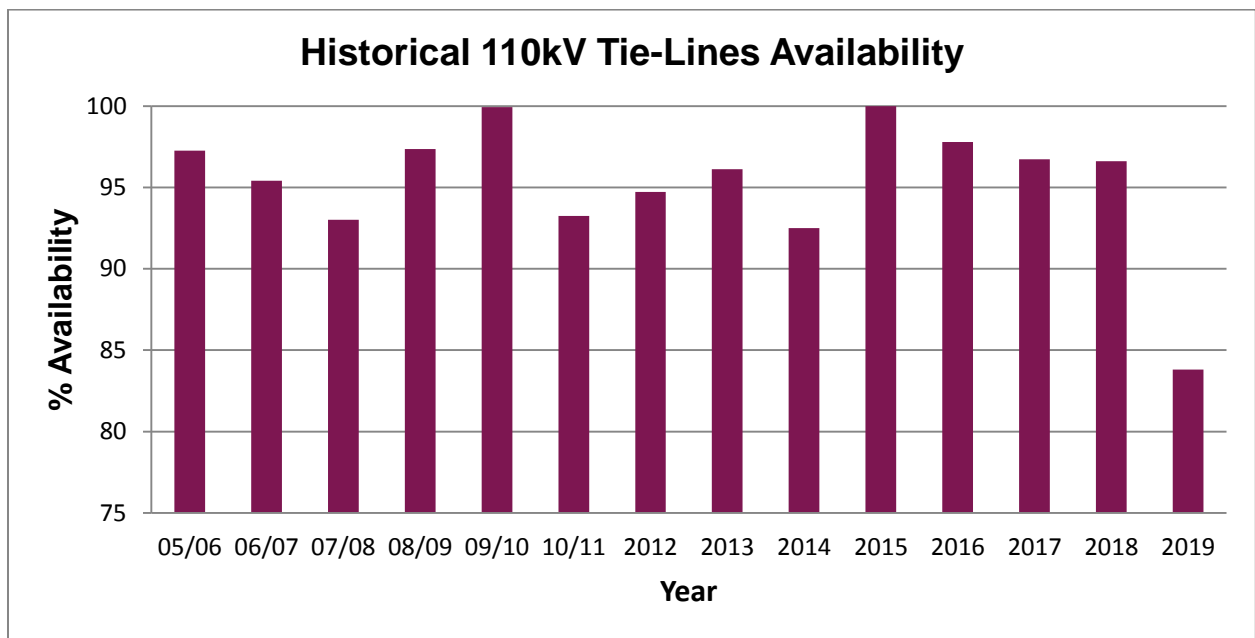


Figure 23: North-South Tie Line Availability 2005/2006 to 2019

A breakdown of 110 kV tie line unavailability is shown in Figure 24 below.

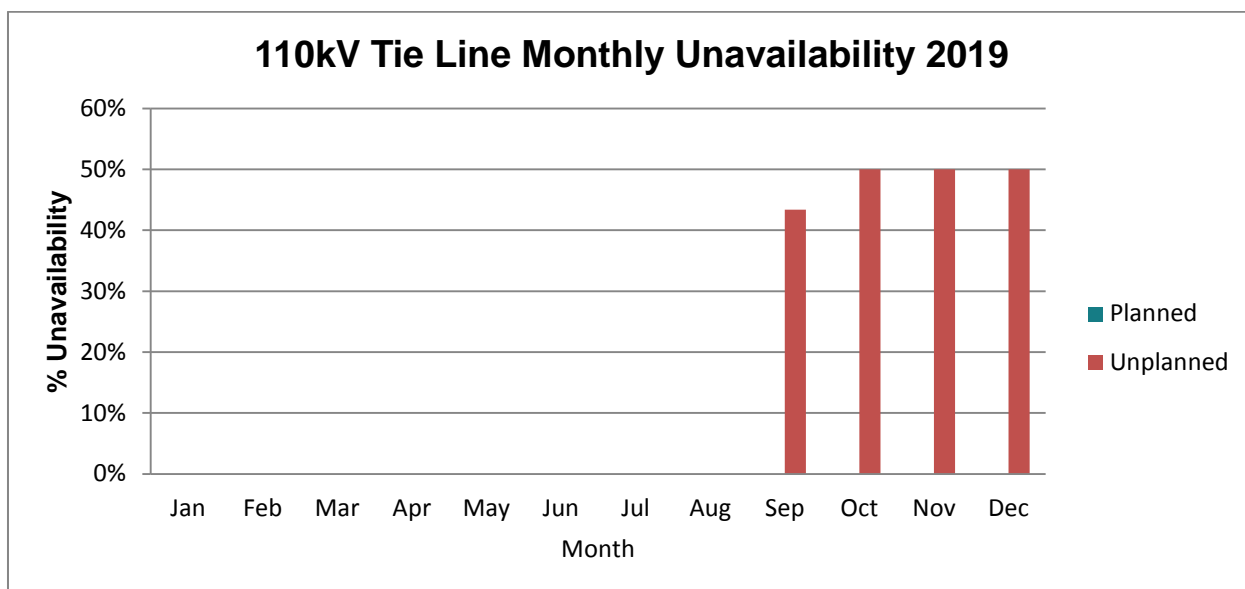


Figure 24: 110kV Tie Line Unavailability 2019

5.3 Transmission System Security

An incident is a system event that results in loss of supply. In this section incidents resulting from issues on the Northern Ireland Transmission system are described individually. The following sections detail the nature, location and duration of the incidents with an estimate of energy unsupplied.

5.3.1 Incidents for 2019

The criterion for the reporting of incidents is specified in Part 8, paragraph 33, of 'The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012'. An incident shall be reported if there has been:

- any single interruption of supply, to any demand of 20 MW or more at the time of the interruption, for a period of three minutes or longer; or
- any single interruption of supply, to any demand of 5 MW or more at the time of the interruption, for a period of one hour or longer; or
- any single interruption of supply to 5,000 or more consumer's installations for a period of one hour or longer.

5.3.2 Number of Incidents and Estimated Unsupplied Energy

In 2019, there was one system event in Northern Ireland that resulted in the loss of supply to customers. Details of this event are given below.

- On the 11th of March at 01:36, an incident at Donegall substation resulted in the loss of supply to 12600 customers, equating to a total loss of 6.5 MW. All customers were fully restored within 2 minutes of the event happening.
- On the 20th of March at 21:33, an incident at Rathgael substation resulted in the loss of supply to 41,995 customers, equating to a total loss of 32 MW. All customers were fully restored within 103 minutes of the event happening.

5.3.3 Incident Analysis

Figure 25 details the incidents that have occurred historically in Northern Ireland.

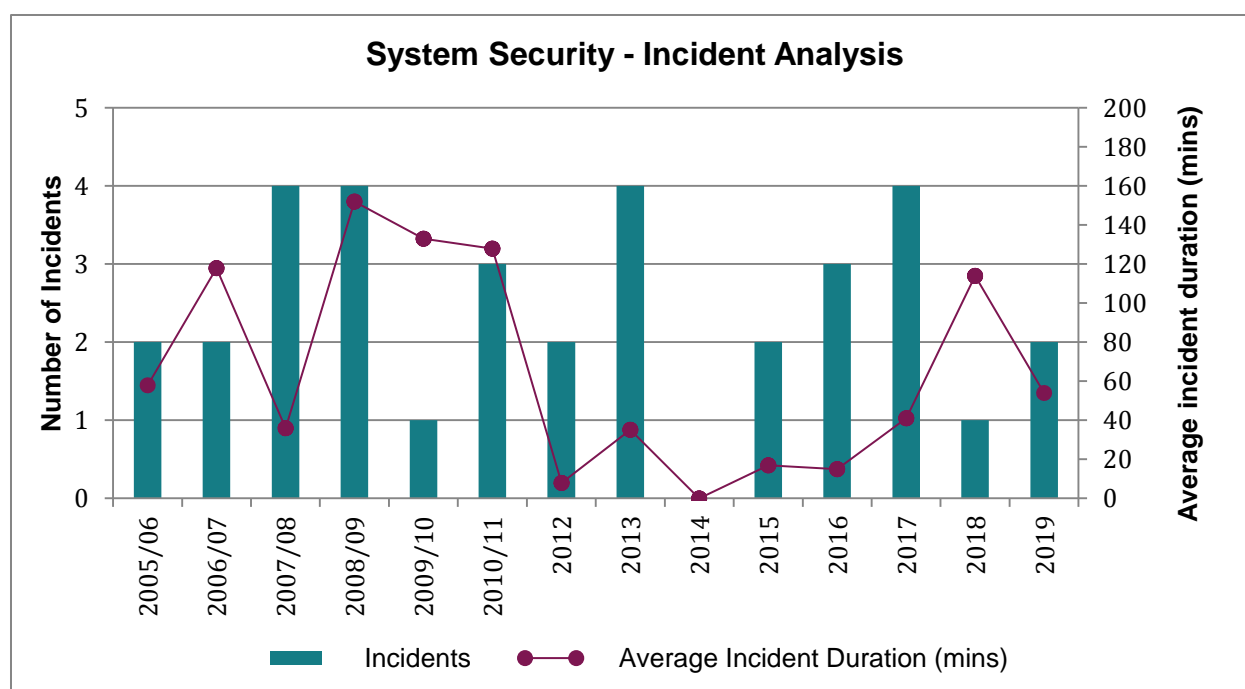


Figure 25: Historical System Security 2005/2006 to 2019

5.3.4 Unsupplied Energy

Figure 26 below shows the historical amount of unsupplied energy to Northern Ireland customers.

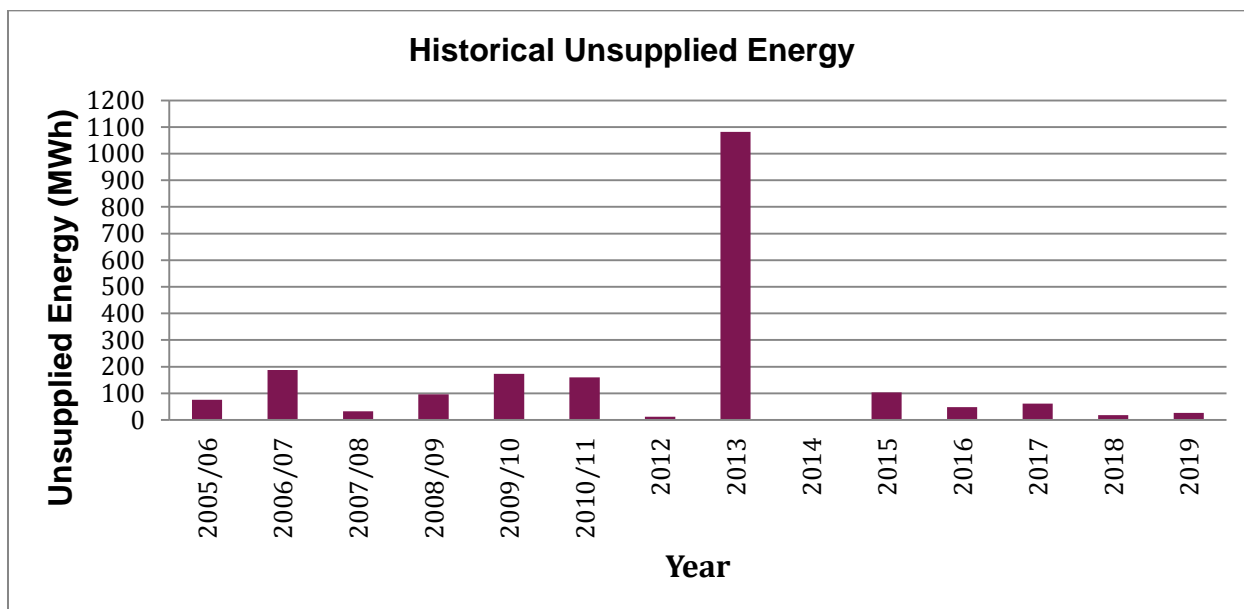


Figure 26: Historical Unsupplied Energy 2005/2006 to 2019

5.3.5 System minutes lost

The total system minutes lost for 2019, attributable to SONI, was 0.921. The trend of system minutes lost since 2012 is shown in Figure 27. The mean number of system minutes lost per year since 2012 was 2.067.

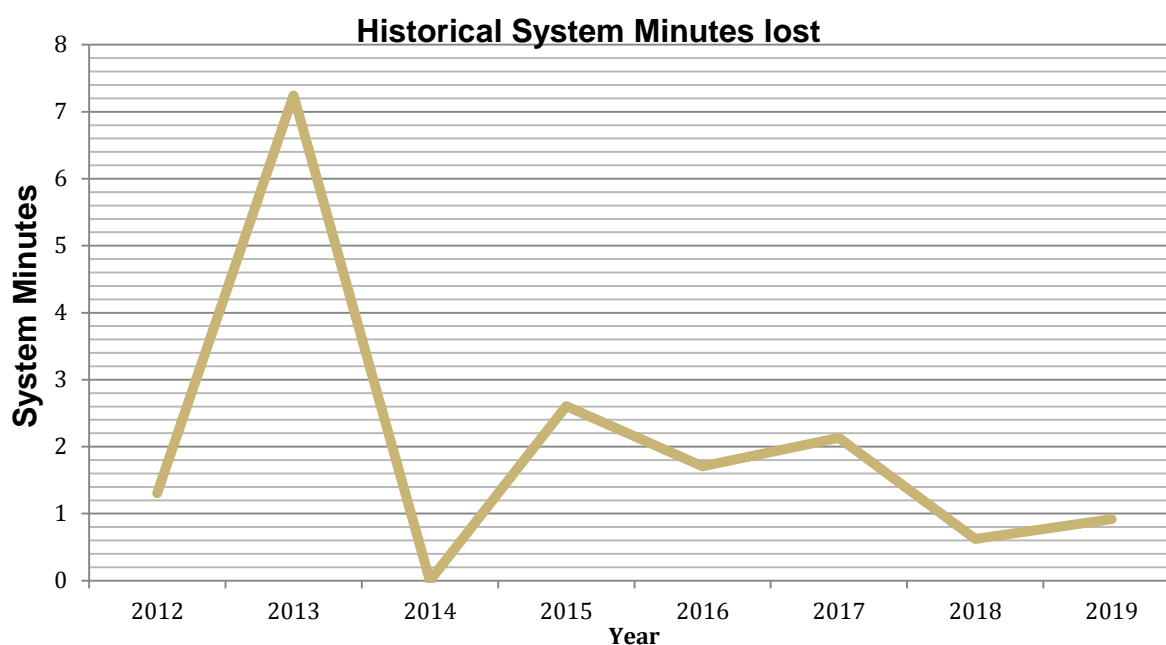


Figure 27: System minutes lost 2012 - 2019

5.3.6 Zone Clearance Ratio

The Zone Clearance Ratio (ZCR) is defined as the ratio of the number of short circuit, system faults, not cleared in Zone 1 to the total number of short circuit faults per year cleared by Main System protection. See Appendix A for further definition of Zones and ZCR.

In 2019, the ZCR was 0. There were 2 system faults cleared by protection on the main system. Of the 2 faults, both were cleared in zone 1.

5.4 Quality of Service

Quality of service is measured with reference to system voltage and frequency.

5.4.1 Voltage

The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 details the requirements for the management of voltage in Northern Ireland.

Part 7, paragraph 28 permit variations not exceeding 10% for operating voltages of 110 kV or higher. As well as adhering to legislation, SONI also operates the

transmission system in such a way as to comply with the Operating Security Standards⁶, acceptable step changes in voltages are detailed in Table 9.

Table 9: Voltage step change limits in operational timescales

| Transmission System secured events or switching event | Voltage fall | Voltage rise |
|---|--------------|--------------|
| Following loss of single circuit | -6% | +6% |
| Following loss of double circuit overhead line | -10% | +6% |

5.4.2 Voltage Excursions

There were no voltage excursions exceeding these limits in 2019.

⁶ [SONI Operating Security Standards](#)

5.4.3 Frequency

SONI is required to manage the frequency of the power system. Power system frequency is a measure of balance between the electrical demand on the network and the amount of energy being generated. The Electricity Safety, Quality and Continuity Regulations (Northern Ireland) 2012 details the requirements for the management of Frequency in Northern Ireland.

Part 7, paragraph 28 of the regulations permits a frequency variation of up to 0.5 Hz above or below 50 Hz. In line with previous publications this report contains details of frequency events where the frequency has dropped below 49.6 Hz or greater than 50.5 Hz. There were five reportable frequency excursions in Northern Ireland in 2019. Graphs in Appendix 2 contain traces of system frequency as well as raw and averaged rate of change of frequency data.

5.4.4 Frequency Excursions

Table 10: Frequency Excursions in 2019

| Cause of Incident | Date | Time (UTC) | MW Lost | Pre-incident Frequency (Hz) | Nadir (Hz) | Min Frequency POR (Hz) | Rate of Change of Frequency | t<49.6 Hz seconds | t<49.5 Hz seconds | N-S Tie Line Flow MW |
|---------------------|------------|------------|---------|-----------------------------|------------|------------------------|-----------------------------|-------------------|-------------------|----------------------|
| | | | | | | | Max df/dt Hz/Sec | | | |
| Great Island 4 Trip | 20/03/2019 | 16:46:15 | 380 | 49.98 | 49.54 | 49.87 | -0.26 | 1.6 | 0.0 | 179 |
| Dublin Bay 1 Trip | 24/04/2019 | 16:21:07 | 404 | 49.81 | 49.593 | 49.74 | -0.23 | 0.5 | 0.0 | 167 |
| Whitegate 1 Trip | 08/05/2019 | 10:14:24 | 351 | 50.02 | 49.58 | 49.600 | -0.26 | 4.0 | 0.0 | 42 |
| Great Island 4 Trip | 20/05/2019 | 15:54:14 | 413 | 50.03 | 49.54 | 49.56 | -0.27 | 5.4 | 0.0 | 357 |
| Whitegate 1 Trip | 15/08/2019 | 11:15:13 | 380 | 49.98 | 49.35 | 49.36 | -0.33 | 7.2 | 4 | 307.9 |

Definitions

| | |
|-------------------------------------|--|
| Time | Considered to be when the frequency falls through 49.8 Hz |
| Pre-incident Frequency | Average system frequency between t – 60 seconds and t – 30 seconds |
| Nadir | Minimum system frequency from t 0 to t + 6 minutes |
| Minimum Frequency in POR Timeframe | Minimum frequency during POR timeframe from t + 5 seconds to t + 15 seconds |
| Maximum Rate of Change of Frequency | Maximum rate of change of frequency calculated over 500 ms during the period t – 5 seconds to t + 30 seconds |
| N-S Tie Line Flow | Flow on the N-S t – 5 seconds (+ve represents an export from Northern Ireland) |

5.4.5 Historical Frequency Excursions

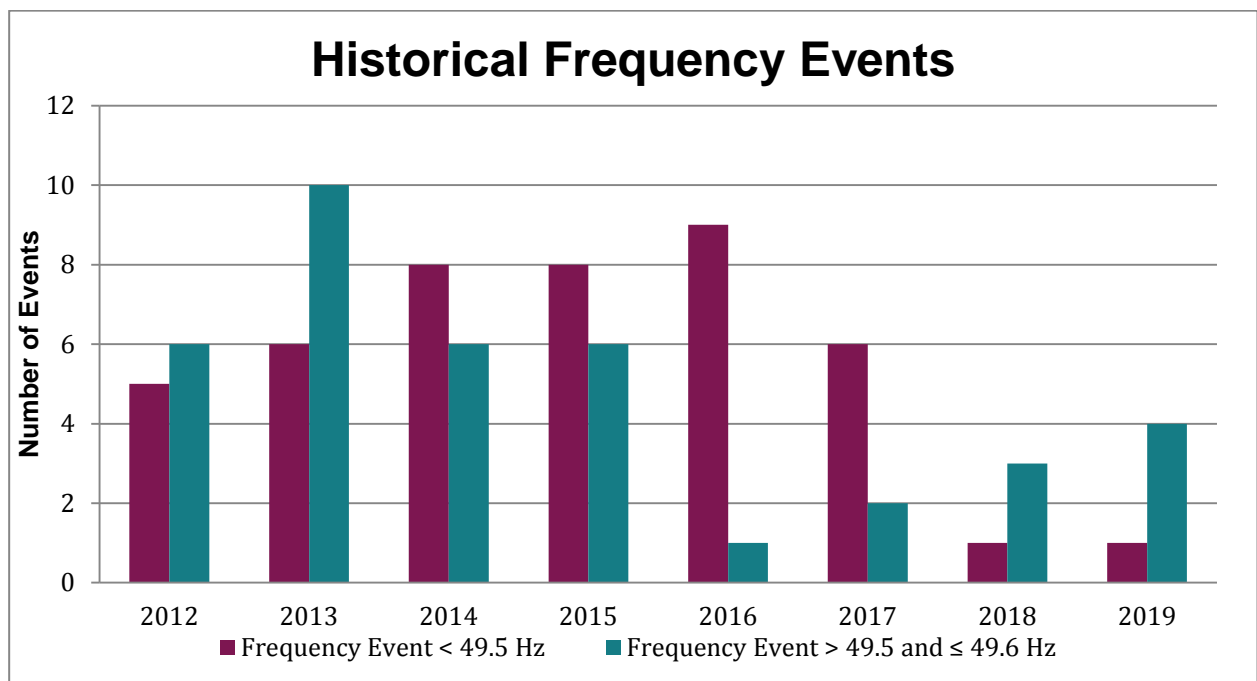


Figure 28: Historic Frequency Excursions 2012-2019

6. Appendix 1 Glossary

6.1 DCEF

Directional comparison earth fault. A teleprotection scheme that allows accelerated tripping by exchanging permit and receive signals for earth faults in a relay's forward direction.

6.2 Disturbance

A system disturbance is defined as one or more related faults and their consequences which occur either simultaneously or over a period of time. These incidents are grouped in a single system disturbance report under the highest voltage involved.

6.3 Fault

Any abnormal event causing or requiring the tripping of a Main System circuit breaker automatically within the Main System. Any abnormal event causing or requiring the closing of a Main System circuit breaker automatically within the Main System. Any abnormal event causing or requiring the tripping of an MV circuit breaker automatically by under frequency relay operation.

6.4 Main system: EirGrid

The main transmission system includes: the 400 kV, 220 kV and 110 kV overhead line (OHL) and underground cable (UGC) network, the 400 kV, 220 kV and 110 kV busbars and couplers, the 400/220 kV and 220/110 kV coupling transformers (with the exception of those feeding the Dublin city 110 kV network). It also includes the 275 kV ESB/NIE Networks interconnector as far as the border with Northern Ireland, and the associated 275/220 kV transformers. The main transmission system does not include the Dublin city 110 kV network or the 220/110 kV coupling transformers at Carrickmines, Inchicore and Poolbeg. The HV circuit breakers of tail connected lines and directly connected transformers (DSO load, directly connected industrial customer load, generator and HVDC interconnector transformers) are part of the main transmission system thus faults on these lines and transformers, which cause transmission system circuit breakers to be tripped, are reported.

6.5 Main system: SONI

The main transmission system includes: the 275 kV and 110 kV OHL and UGC network, the 275 kV and 110 kV busbars and couplers, the 275/110 kV interbus transformers, and all 110/33 kV transformers (aka main transformers). It also includes the 275 kV ESB/NIE Networks interconnector as far as the border with Ireland. The HV circuit breakers of directly connected transformers (generator and HVDC interconnector transformers) are part of the main transmission system thus faults on these transformers, which cause transmission system circuit breakers to be tripped, are reported.

6.6 Major incident

A major incident is one which results in the loss of greater than or equal to one system minute as a result of a single system disturbance.

6.7 MVA Minute Lost

Amount of Power (Mega Volt-Amp) not supplied during an interruption of one minute.

6.8 Non main system/outside the main system: EirGrid

All HV plant on the Irish electricity network that does not form part of the main system: the Dublin 110 kV network (controlled by the DSO at the northern distribution control centre (NDCC)). The MV system in Ireland is controlled by the NDCC in Leopardstown), all DSO and industrial customer load transformers, all IPP generator transformers, and all plant on the NIE Networks owned, SONI controlled, HV system in Northern Ireland.

6.9 Non main system/outside the main system: SONI

All HV plant connected to the Northern Irish electricity network that does not form part of the main system: all IPP generator transformers, HVDC interconnector transformers, and all plant on the ESB owned, EirGrid controlled, HV system in Ireland

6.10 Non System Fault

Any unplanned circuit breaker operation resulting from a cause other than a system fault or incorrect manual operation from a control point.

6.11 Permanent Fault

A fault is permanent if the component or unit is damaged and cannot be restored to service until repair or replacement is completed. An overhead line trips and stays out of service due to the absence or outage of reclosing facilities; the fault is permanent if maintenance staff have to carry out equipment repairs or replacement before the line is returned to service. A protection setting change is required on the piece of plant before or after it is switched in following a fault.

6.12 POTT

Permissive overreach transfer trip. A distance teleprotection scheme that allows accelerated tripping by exchanging permit and receive signals for faults in a relay's zone 2.

6.13 Protection - Correct Operation

The operation is correct if a fault is cleared by the protection (in any time step) such that the correct circuit breakers open and no other circuit breaker opens.

6.14 Protection - Incorrect Operation

The operation is incorrect if, while a fault is being cleared, a circuit breaker is opened which should not have opened or a circuit breaker remains closed which should have opened.

6.15 PUTT

Permissive underreach transfer trip. A distance teleprotection scheme that allows accelerated tripping by receiving a signal for a fault in a relay's forward direction.

6.16 Sustained Interruption

A sustained interruption is one which lasts for more than one minute.

6.17 System Fault

Any fault or system abnormality which involves, or is the result of failure of primary electrical apparatus and which requires the disconnection of the affected equipment from the system by the automatic tripping of the associated circuit breaker.

6.18 System Minute

A measure of the energy not supplied for a disturbance. The metric takes account of the load lost (MW), duration of disconnection (Minutes) and peak system demand (MW), to allow for historical comparison. For example, if 300 MW were lost for 10 minutes and the system peak was 3000 MW, this would represent one System Minute.

$$\text{System Minutes} = (\text{Load MW} \times \text{Duration mins}) / (\text{System Peak MW}) = (300 \times 10) / 3000 = 1$$

6.19 Transient Fault

A fault is transient if the unit or component is undamaged and is restored to service through manual switching operations, or rapid automatic reclosure on overhead lines, without repair being performed, but possibly with on-site inspection.

6.20 Zone Clearance Ratio

The Zone Clearance Ratio is defined as the ratio of the number of short circuit faults not cleared in Zone 1 to the total number of short circuit faults per year. The more faults cleared in Zone 1, the quicker they are taken off the power system which reduces the risk of system instability, plant damage and injury to personnel.

6.21 Zones of Protection

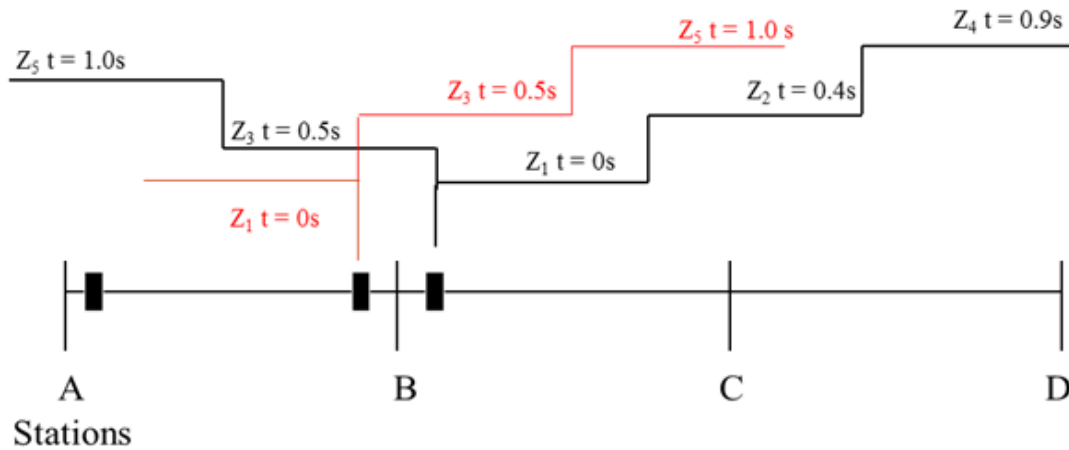


Figure 29: Zones of Protection

Zone 1 on an impedance (distance) relay is the primary protection zone and in the case of an overhead line is set to 70 - 85% of the circuit length depending on the location of the circuit in the transmission network. There is no time delay for the relay to pick up when a fault occurs within the Zone 1 reach, as shown in Figure 29. Typical Zone 1 clearance times are 50 to 150 ms.

Zone 2 on an impedance relay is used as a backup protection zone and is set to 100% of the circuit length plus 20 - 50% of the length of the shortest feeder at the remote end of the protected circuit. A delay of approximately 400 ms is applied in Zone 2 settings and so typical Zone 2 fault clearance times are 450 to 550 ms.

Zone 3 on an impedance relay is used as a backup protection zone and is set to 20 - 50% of the length of the shortest feeder in the reverse direction. A delay of approximately 500 ms is applied in Zone 3 settings and so typical Zone 3 fault clearance times are 550 to 650 ms.

Zone 4 is the third forward step of a distance scheme with a time delay of approximately 900 ms.

Zone 5 is the second reverse step of a distance protection scheme with a time delay of approximately 1.1 seconds.

7. Appendix 2 All Island Frequency Excursion Graphs

Table 11: All Island Frequency Excursion Incidents

| Cause of Incident | Date |
|---------------------|------------|
| Great Island 4 Trip | 20/03/2019 |
| Dublin Bay 1 Trip | 24/04/2019 |
| Whitegate WG1 Trip | 08/05/2019 |
| Great Island 4 Trip | 20/05/2019 |
| Whitegate WG1 Trip | 15/08/2019 |

7.1 Great Island 4- 20/03/2019

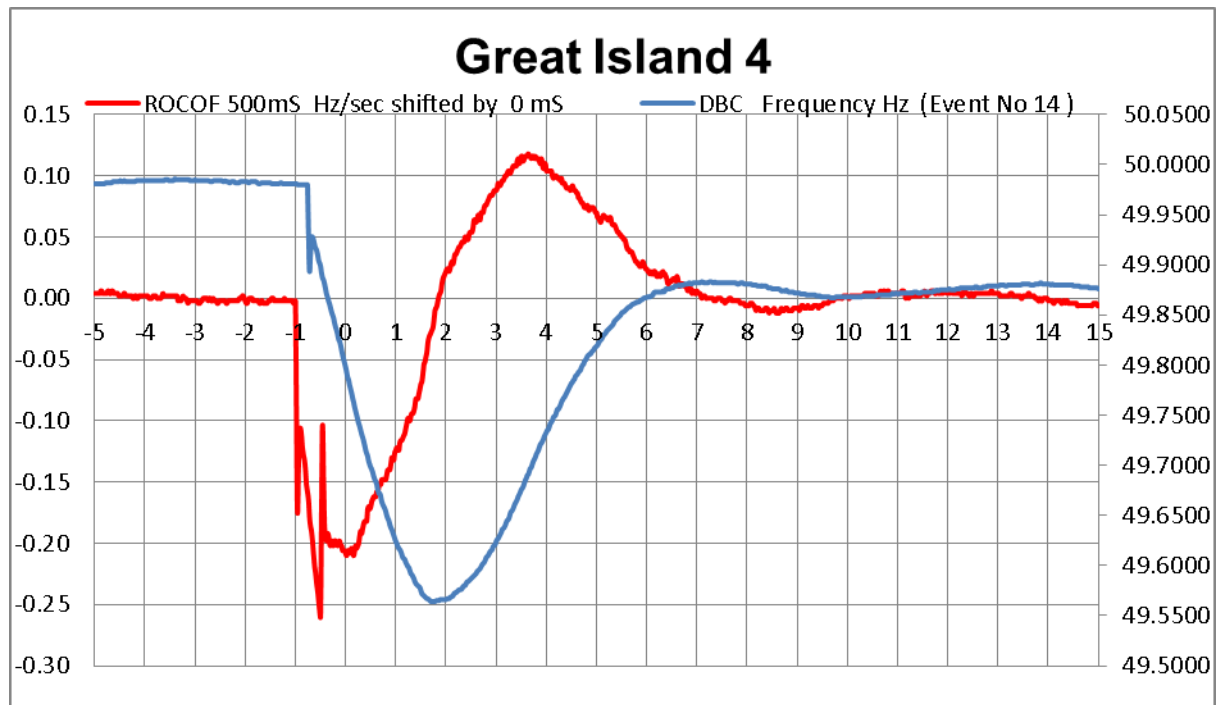


Figure 30 Great Island 4 Frequency Excursion Incident- 20/03/2019

7.2 Dublin Bay 1 24/04/2019

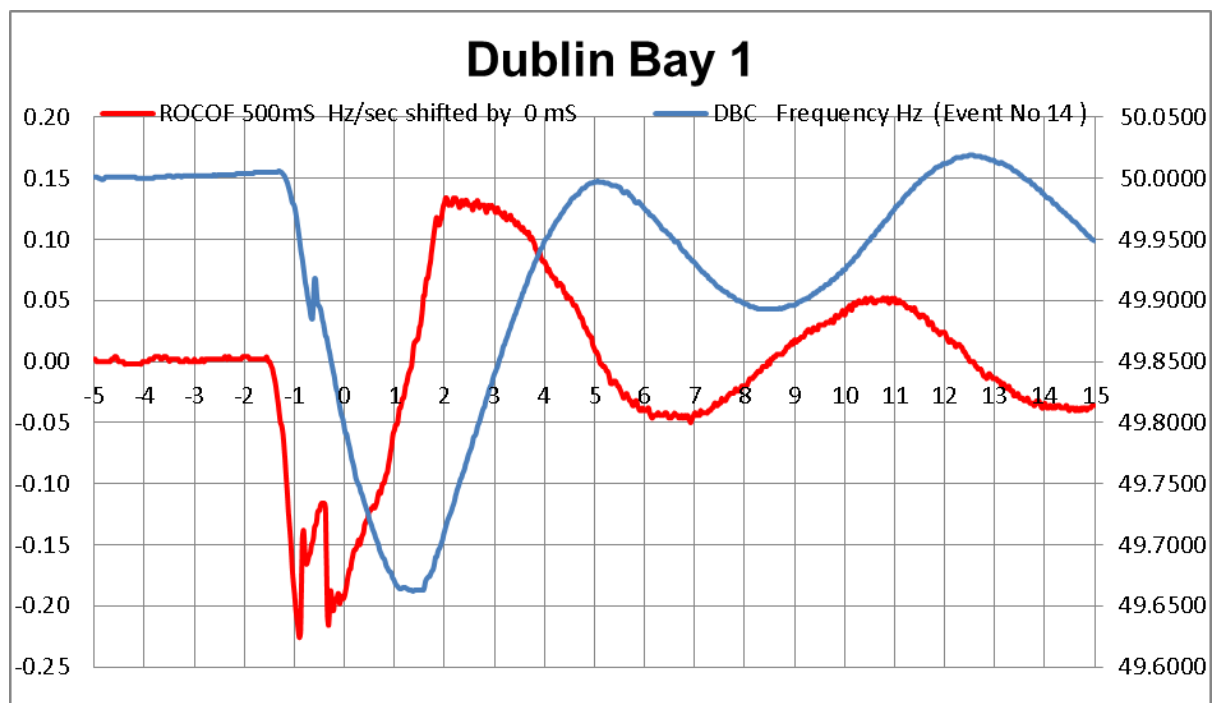


Figure 31: Dublin Bay 1 Frequency Excursion Incident 24/04/2019

7.3 Whitegate 1 08/05/2019

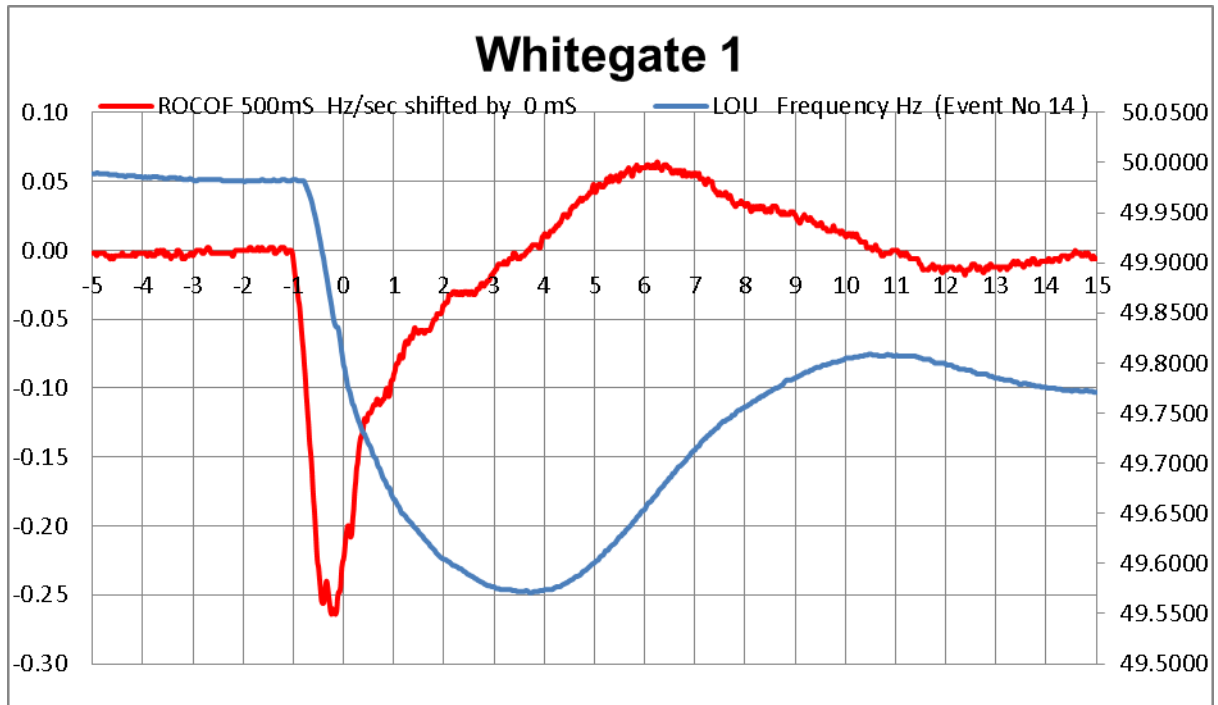


Figure 32: Whitegate 1 Frequency Excursion Incident- 08/05/2019

7.4 Great Island 4 – 20/05/2019

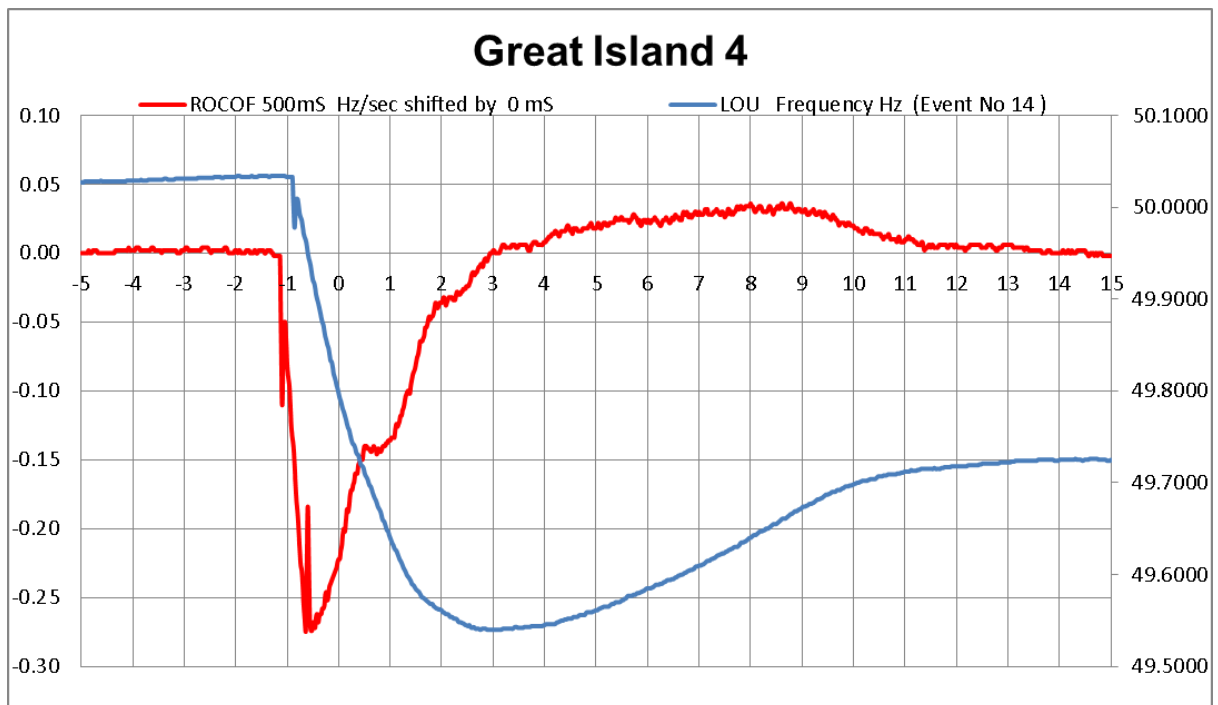


Figure 33: Great Island 4 Frequency Excursion Incident- 20/05/2019

7.5 Whitegate 1- 15/08/2019

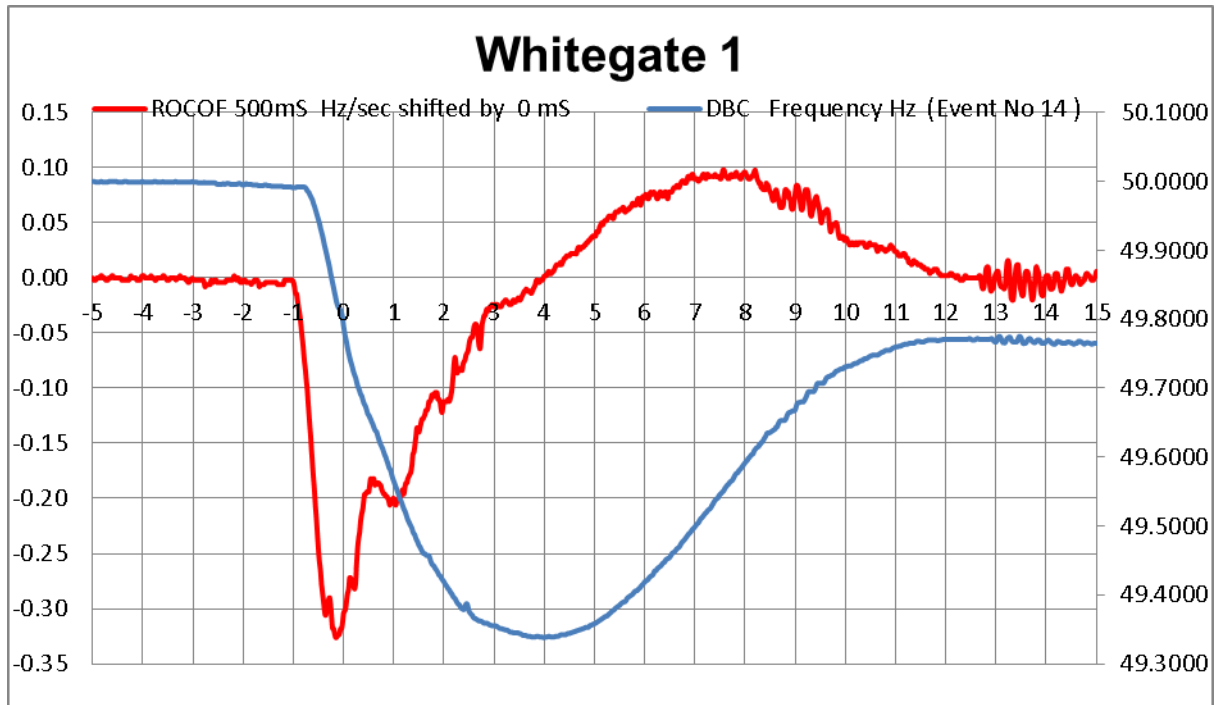


Figure 34: Whitegate 1 Frequency Excursion Incident- 15/08/2019

8. Appendix 3 All Island Fully Dispatchable Generation Plant

Table 12: All Island Fully Dispatchable Generation Plant

| Company | Unit | Capacity (MW) | Fuel | 365-day Rolling Availability % |
|----------------------------|---------------------|---------------|-----------------------|--------------------------------|
| AC Automation | AC - ACA | 7.625 | DSU | 75.00 |
| Activation Energy | AEDSU - AE1 | 94.733 | DSU | 26.76 |
| | AEDSU - AE2 | 12.464 | DSU | 15.41 |
| | AEDSU - AE3 | 13.969 | DSU | 56.16 |
| | AEDSU - AE4 | 15.096 | DSU | 60.48 |
| | AEDSU - AE5 | 15.3 | DSU | 55.33 |
| | AEDSU - EN1 | 15.451 | DSU | 26.93 |
| | AEDSU - EN2 | 16.298 | DSU | 3.33 |
| | AEDSU - EN3 | 16.33 | DSU | 16.71 |
| | AEDSU - EN4 | 15.7 | DSU | 15.95 |
| | AEDSU - EN5 | 5.84 | DSU | 50.23 |
| | AEDSU - EN6 | 10.705 | DSU | 64.50 |
| Activation Energy Ltd (NI) | AE_DSU_NI - AEA | 9.044 | DSU | 50.89 |
| EPUK | Ballylumford - B10 | 101 | Gas / Distillate Oil | 78.05 |
| | Ballylumford - B21 | 246 | Gas / Distillate Oil | 82.64 |
| | Ballylumford - B22 | 246 | Gas / Distillate Oil | 82.48 |
| | Ballylumford - BGT1 | 58 | Distillate | 98.39 |
| | Ballylumford - BGT2 | 58 | Distillate | 98.25 |
| | Kilroot - KPS1 | 238 | Coal / Heavy Fuel Oil | 72.39 |
| | Kilroot - KPS2 | 238 | Coal / Heavy Fuel Oil | 65.24 |
| | Kilroot - KGT1 | 29 | Distillate | 91.26 |
| | Kilroot - KGT2 | 29 | Distillate | 94.77 |
| | Kilroot - KGT3 | 42 | Distillate | 95.80 |
| | Kilroot - KGT4 | 42 | Distillate | 95.62 |
| Aughinish Alumina Ltd | Seal Rock - SK3 | 81 | Gas / Distillate Oil | 89.24 |
| | Seal Rock - SK4 | 81 | Gas / Distillate Oil | 88.74 |
| Bord Gáis | Whitegate - WG1 | 444 | Gas / Distillate Oil | 89.17 |
| Contour Global | Contour - CGA | 12 | Gas | 95.18 |
| Coolkeeragh ESB | Coolkeeragh - C30 | 408 | Gas / Distillate Oil | 87.98 |
| | Coolkeeragh - CG8 | 53 | Distillate | 86.49 |

| Company | Unit | Capacity (MW) | Fuel | 365-day Rolling Availability % |
|---------------------------------|--------------------|---------------|----------------------|--------------------------------|
| DAE Virtual Power Plant | DAE VPP - DP1 | 18.61 | DSU | 55.35 |
| | DAE VPP - DP2 | 25.8 | DSU | 3.95 |
| Dublin Waste To Energy | Dublin Waste - DW1 | 61 | Waste to Energy | 90.11 |
| Edenderry Power Ltd | Edenderry - ED1 | 118 | Peat | 80.46 |
| | Edenderry - ED3 | 58 | Gas / Distillate Oil | 98.79 |
| | Edenderry - ED5 | 58 | Gas / Distillate Oil | 98.47 |
| Electric Ireland DSU | Electric Irl - EI1 | 20.104 | DSU | 65.45 |
| Electricity Exchange Limited | Elect Exchng - EE1 | 46.674 | DSU | 51.22 |
| | Elect Exchng - EE2 | 28.173 | DSU | 34.86 |
| | Elect Exchng - EE3 | 8.312 | DSU | 36.11 |
| | Elect Exchng - EE4 | 10.976 | DSU | 37.50 |
| | Elect Exchng - EE5 | 9.803 | DSU | 59.16 |
| | Elect Exchng - EE6 | 13.682 | DSU | 50.51 |
| | EmpowerAGU - EMP | 13 | Distillate | 95.87 |
| Endeco Technologies | Endeco T Ltd - EC1 | 47.003 | DSU | 54.83 |
| | Endeco T Ltd - EC2 | 11.018 | DSU | 19.45 |
| | Endeco T Ltd - EC5 | 14.686 | DSU | 53.32 |
| | Endeco T NI - ECA | 15.664 | DSU | 17.42 |
| Energy Trading Ireland | ETI Ltd (NI) - ETB | 8.712 | DSU | 19.61 |
| | ETI Ltd (NI) - ETD | 7.05 | DSU | 11.69 |
| | ETI Ltd (NI) - ETR | 17.66 | DSU | 10.37 |
| | Ener Trd Irl - ET1 | 12.61 | DSU | 56.23 |
| Evermore Renewable Energy | Lisahally - LPS | 18 | Biomass | 74.97 |
| Indaver | Indaver - IW1 | 17 | Waste to Energy | 89.08 |
| IPOWER | iPower AGU - AGU | 62 | Distillate | 90.61 |
| Powerhouse Generation Ltd. | Powerhouse G - PG1 | 10.284 | DSU | 43.02 |
| Powerhouse Generation Ltd. (NI) | PHG - PH1 | 34.195 | DSU | 34.19 |
| SSE Generation Ireland | Great Island - GI4 | 431 | Gas / Distillate Oil | 78.80 |
| | Rhode - RP1 | 52 | Distillate | 94.07 |
| | Rhode - RP2 | 52 | Distillate | 93.95 |
| | Tarbert - TB1 | 54 | Heavy Fuel Oil | 97.68 |
| | Tarbert - TB2 | 54 | Heavy Fuel Oil | 94.55 |
| | Tarbert - TB3 | 241 | Heavy Fuel Oil | 78.56 |
| | Tarbert - TB4 | 241 | Heavy Fuel Oil | 91.24 |
| | Tawnaghmore - TP1 | 52 | Distillate | 99.96 |
| | Tawnaghmore - TP3 | 52 | Distillate | 99.70 |
| SYNERGEN | Dublin Bay - DB1 | 86 | Gas / Distillate Oil | 86.78 |
| Tynagh Energy Ltd | Tynagh - TYC | 400 | Gas / Distillate Oil | 87.29 |

| Company | Unit | Capacity (MW) | Fuel | 365-day Rolling Availability % |
|---------------------------|--------------------|---------------|------------------------|--------------------------------|
| Viridian Power and Energy | Huntstown - HN2 | 408 | Gas / Distillate Oil | 84.91 |
| | Huntstown - HNC | 342 | Gas / Distillate Oil | 83.77 |
| | Viridian DSU - VE1 | 20.067 | DSU | 42.45 |
| | Viridian DSU - VE2 | 13.47 | DSU | 39.41 |
| ESB Power Generation | Ardnacrusha - AA1 | 21 | Hydro | 98.79 |
| | Ardnacrusha - AA2 | 22 | Hydro | 94.88 |
| | Ardnacrusha - AA3 | 19 | Hydro | 97.60 |
| | Ardnacrusha - AA4 | 24 | Hydro | 88.92 |
| | Aghada - AD2 | 431 | Gas / Distillate Oil | 74.19 |
| | Aghada - AT11 | 90 | Gas / Distillate Oil | 98.66 |
| | Aghada - AT12 | 90 | Gas / Distillate Oil | 98.69 |
| | Aghada - AT14 | 90 | Gas / Distillate Oil | 98.86 |
| | Erne - ER1 | 10 | Hydro | 90.57 |
| | Erne - ER2 | 10 | Hydro | 93.01 |
| | Erne - ER3 | 22.5 | Hydro | 96.76 |
| | Erne - ER4 | 22.5 | Hydro | 92.35 |
| | Lee - LE1 | 27 | Hydro | 90.68 |
| | Lee - LE2 | 27 | Hydro | 88.6 |
| | Lee - LE3 | 27 | Hydro | 96.06 |
| | Liffey - LI1 | 15 | Hydro | 94.94 |
| | Liffey - LI2 | 15 | Hydro | 87.50 |
| | Liffey - LI4 | 4 | Hydro | 97.43 |
| | Liffey - LI5 | 4 | Hydro | 99.70 |
| | Lough Ree - LR4 | 91 | Peat | 69.10 |
| | Moneypoint - MP1 | 285 | Coal / Heavy Fuel Oil | 74.05 |
| | Moneypoint - MP2 | 285 | Coal / Heavy Fuel Oil | 50.73 |
| | Moneypoint - MP3 | 285 | Coal / Heavy Fuel Oil | 56.67 |
| | North Wall - NW5 | 104 | Gas / Distillate Oil | 72.69 |
| | Poolbeg - PBA | 230 | Gas / Distillate Oil | 74.83 |
| | Poolbeg - PBB | 230 | Gas / Distillate Oil | 75.94 |
| | Turlough H - TH1 | 73 | Hydro - Pumped Storage | 89.55 |
| | Turlough H - TH2 | 73 | Hydro - Pumped Storage | 87.75 |
| | Turlough H - TH3 | 73 | Hydro - Pumped Storage | 88.07 |
| | Turlough H - TH4 | 73 | Hydro - Pumped Storage | 91.42 |
| | West Offaly - WO4 | 137 | Peat | 86.45 |

9. Appendix 4 EirGrid Maintenance Policy Terms

The following summarises the main terms and activities in the asset maintenance policy as operated by EirGrid⁷. The overall objective of maintenance is to ensure that the assets continue to meet their service and performance requirements including safety, environmental and output parameters⁸. Maintenance activities help to realise expected life time of an asset.

There are four primary maintenance categories:

1. Preventative/Routine: Preventive/routine maintenance is planned at predetermined intervals to reduce the likelihood of equipment degradation which could lead to plant failure e.g. condition assessment. This type of maintenance is planned in advance and the frequencies of these activities are pre-determined by the EirGrid Asset Maintenance Policy
2. Corrective: Corrective maintenance may consist of repair, restoration or replacement of equipment before functional failure. Corrective maintenance requirements are identified through regular inspections. The aim of routine inspections is to identify the potential for failure in time for the solution to be planned and scheduled and then performed during the next available outage.
3. Fault: Fault maintenance includes activities arising from unexpected equipment failure in service.
4. Statutory Maintenance: Maintenance which is carried out to facilitate statutory requirements e.g. Pressure Vessel Inspections, bund inspections.

Please refer to the 'Guide to Transmission Equipment Maintenance' which is published on the EirGrid website for further information⁹.

⁷ In Northern Ireland maintenance policy for the transmission system is the responsibility of NIE Networks as licenced Transmission Owner.

⁸ An anatomy of Asset Management – Institute of Asset Management Version 2 (July 2014)

⁹ www.eirgridgroup.com/site-files/library/EirGrid/Guide-to-Transmission-Equipment-Maintenance-March-2019.pdf

10. Appendix 5 Formulae

10.1 Ireland Availability & Unavailability Formula

Availability of 110kV, 220 kV, 275 kV and 400 kV lines:

$$\text{System Availability} = 1 - \frac{\sum_{i=1}^{i=n} \text{Duration of Outage (i)} * \text{Length of Line (i)}}{\sum_{j=1}^{j=m} \text{Length of Line (j)} * \text{Days in a Year}}$$

Where: n = The total number of lines (at that voltage level) for which outages occurred

m = The total number of lines at that voltage level

Availability of 220 kV/110 kV, 275 kV/220 kV and 400 kV/220 kV transformers:

$$\text{System Availability} = 1 - \frac{\sum_{i=1}^{i=n} \text{Duration of Outage (i)} * \text{MVA of Transformer (i)}}{\sum_{j=1}^{j=m} \text{MVA of Transformer (j)} * \text{Days in a Year}}$$

Where: n = The total number of transformers for which outages occurred
m = The total number of transformers at that voltage level

System Unavailability:

$$\text{System Unavailability} = 1 - \frac{\sum \text{Hours each Circuit is Available}}{\text{Number of Circuits} * \text{Hours in Period}}$$

The equation above is the same as that used by OFGEM (The Office of Gas and Electricity Markets) in the UK.

10.2 System Minute Formula

System Minutes:

$$\text{System Minutes} = \frac{\text{Energy not supplied MW Minutes}}{\text{Power at System Peak}}$$

$$\text{System Minutes} = \frac{(\text{MVA Minutes}) * (\text{Power Factor})}{\text{System Peak to Date}}$$

Where Power Factor = 0.9.