



### LEGEND

- Proposed 400kV OHL Outer Conductor
- Consented Residential Planning Application (March 2013 to March 2015)
- Consented Residential Planning Applications (March 2015 to June 2016)
- Proposed Tower and Maximum Tower Foundation
- Proposed Substation Site
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 1 of 29



DRAWING NUMBER


60320996/2019/PROP/1

REV

2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.

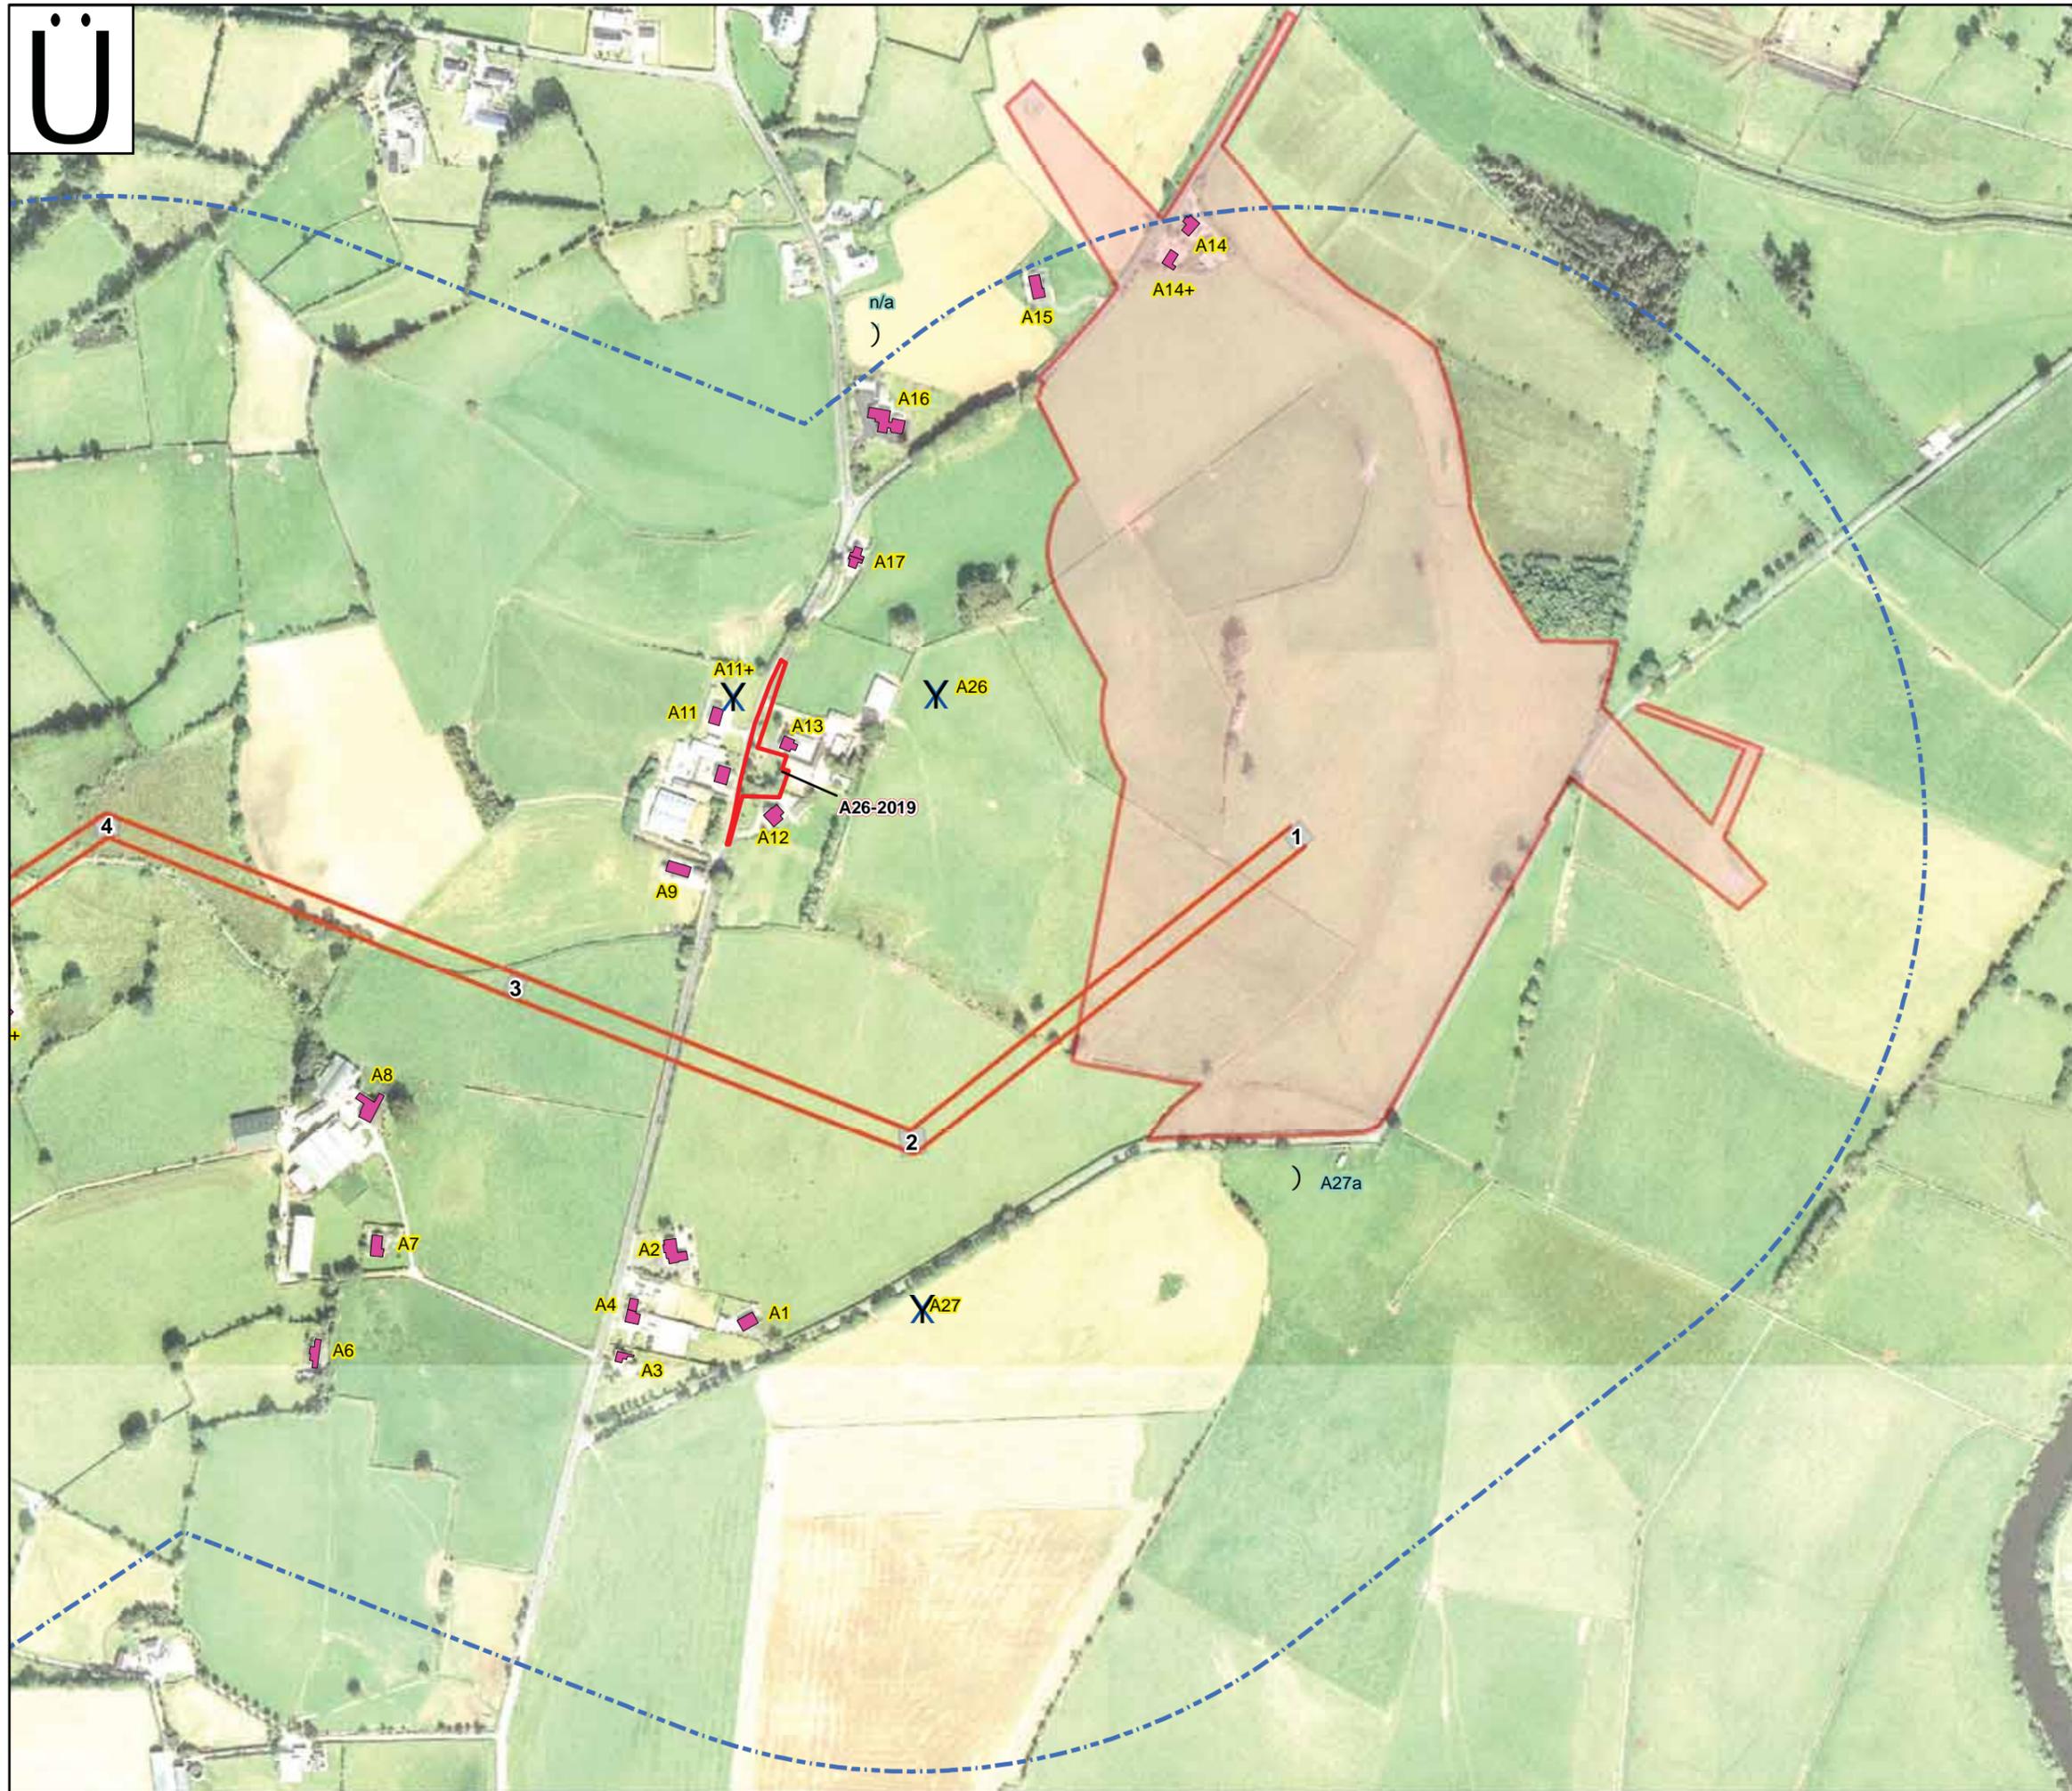



### LEGEND

- Proposed 400kV OHL Outer Conductor
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 2 of 29



DRAWING NUMBER


60320996/2019/PROP/2

REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.

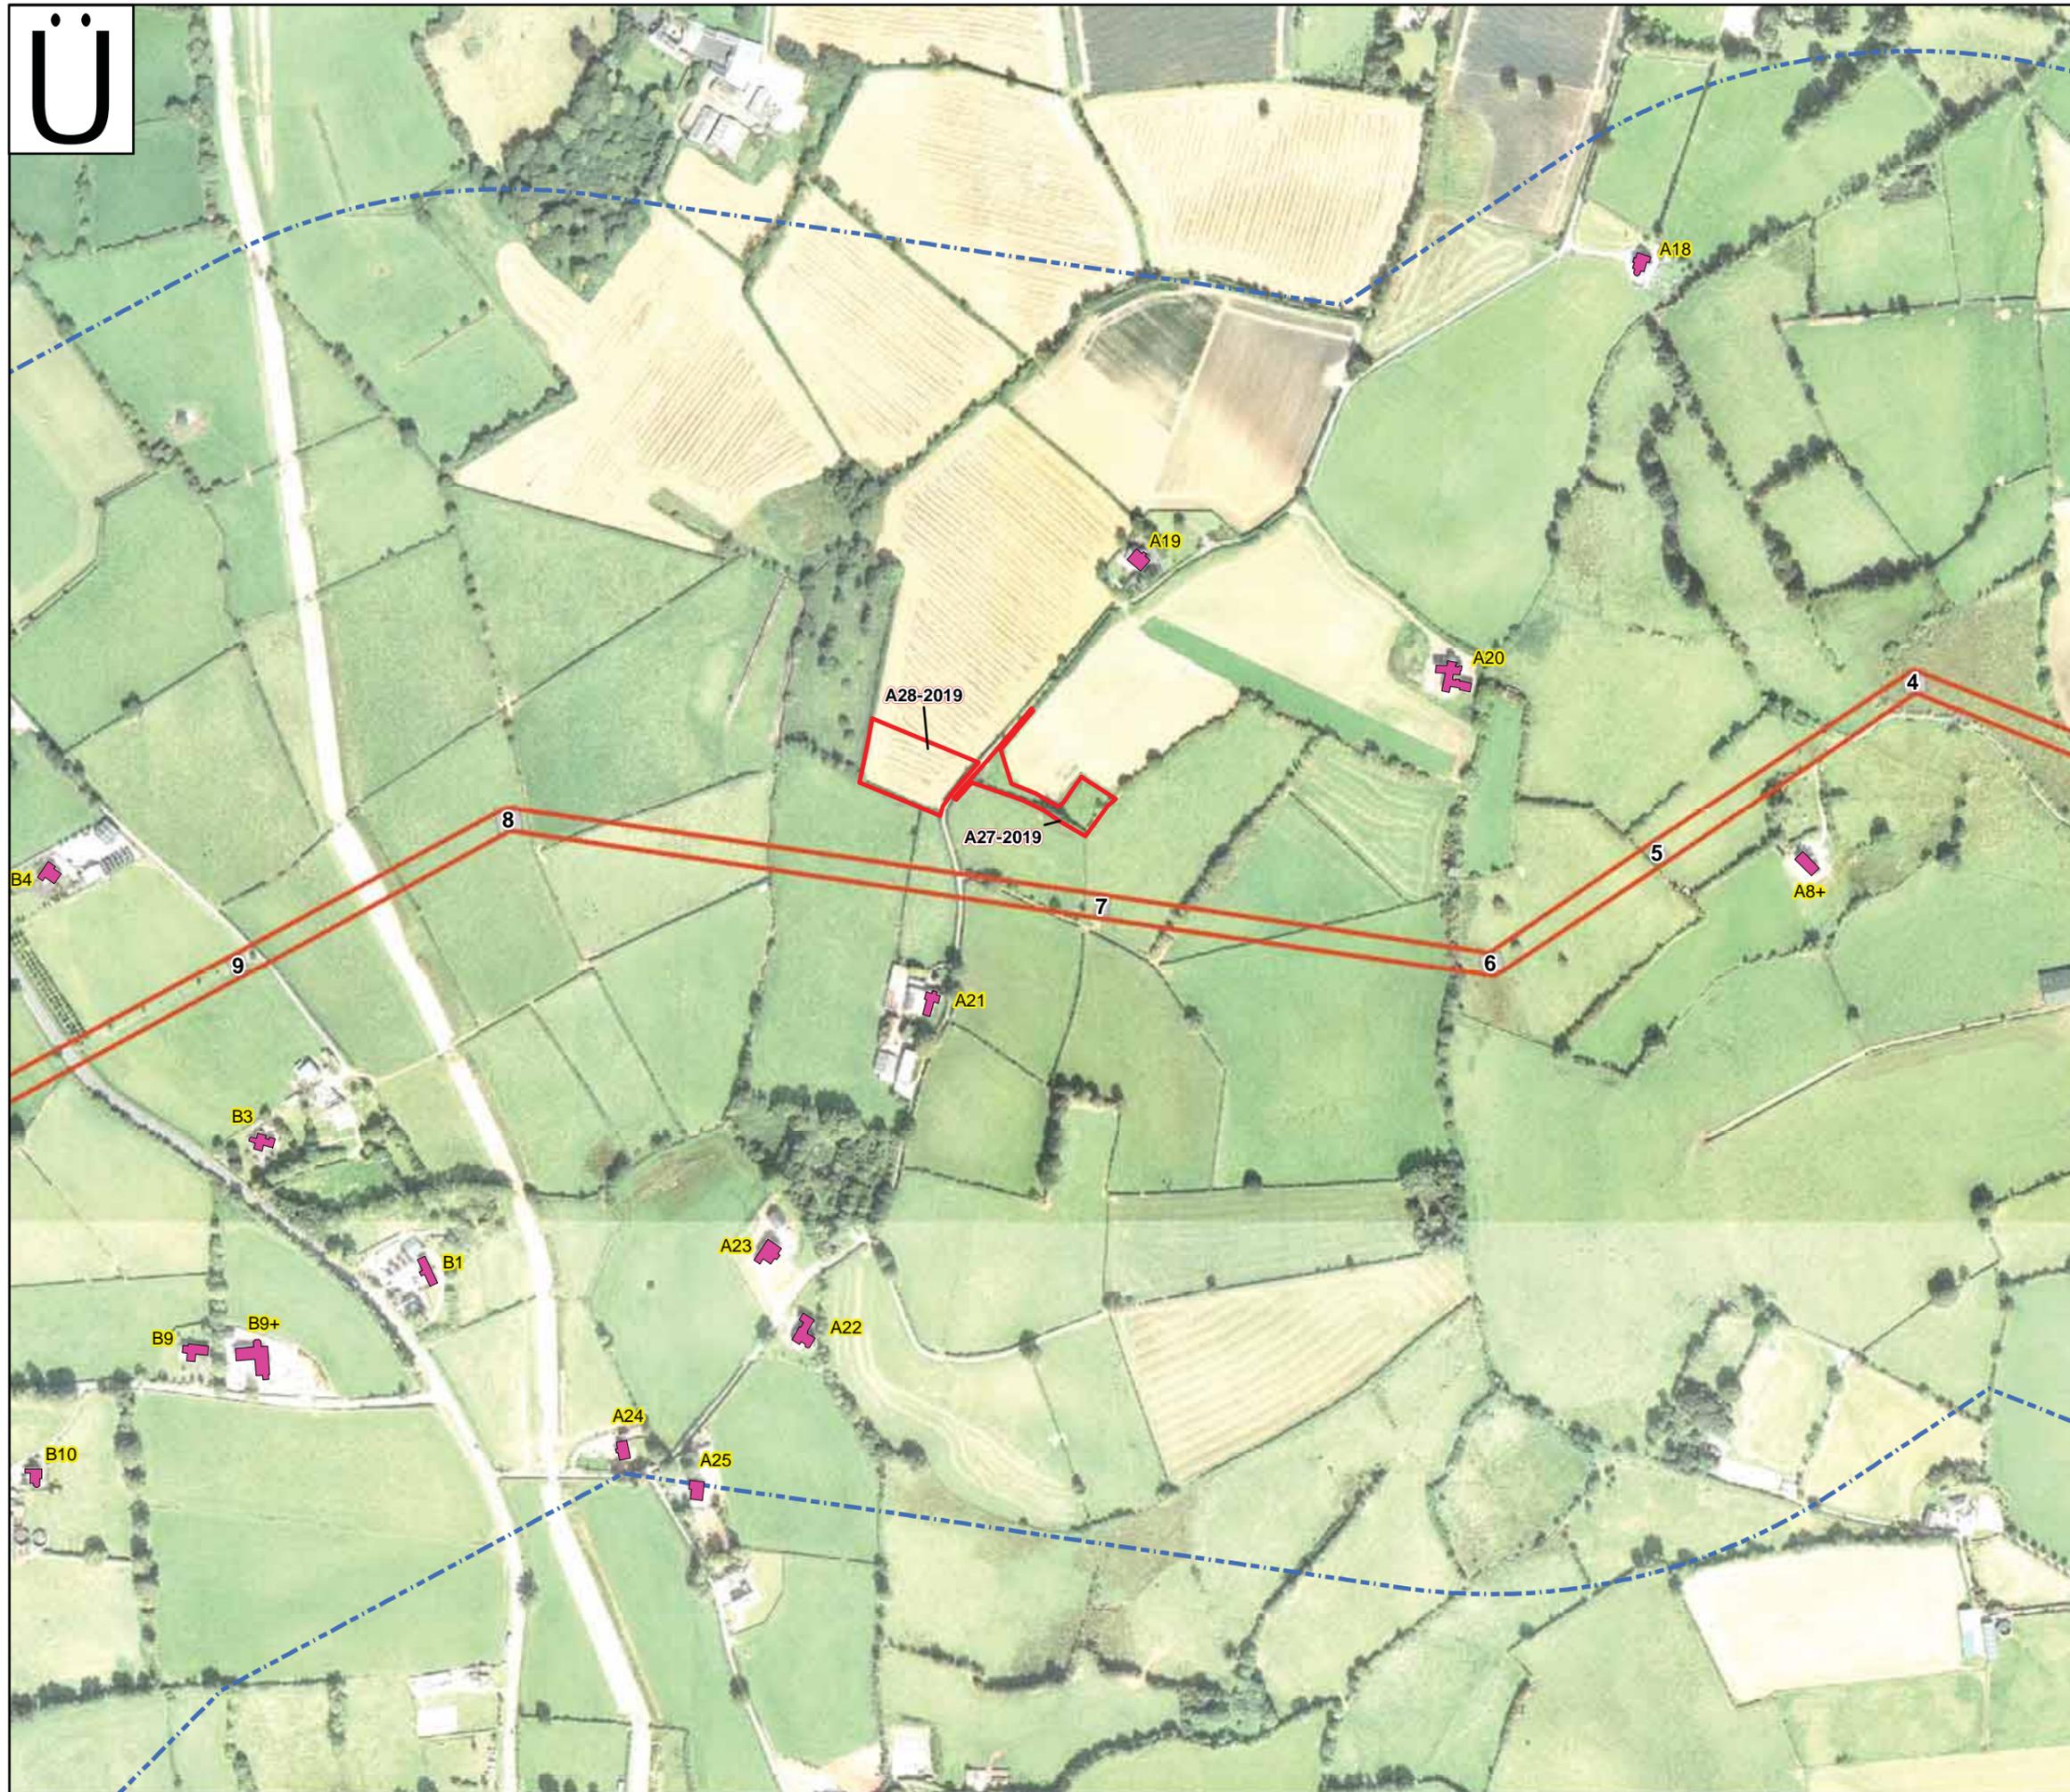



### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Consented Residential Planning Application (March 2013 to March 2015)
-  Consented Residential Planning Applications (March 2015 to June 2016)
-  New Pointer Property (Since Oct 2014)
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 3 of 29



### DRAWING NUMBER

60320996/2019/PROP/3

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Consented Residential Planning Application (March 2013 to March 2015)
-  New Pointer Property (Since Oct 2014)
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 4 of 29



### DRAWING NUMBER


60320996/2019/PROP/4

### REV

2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.

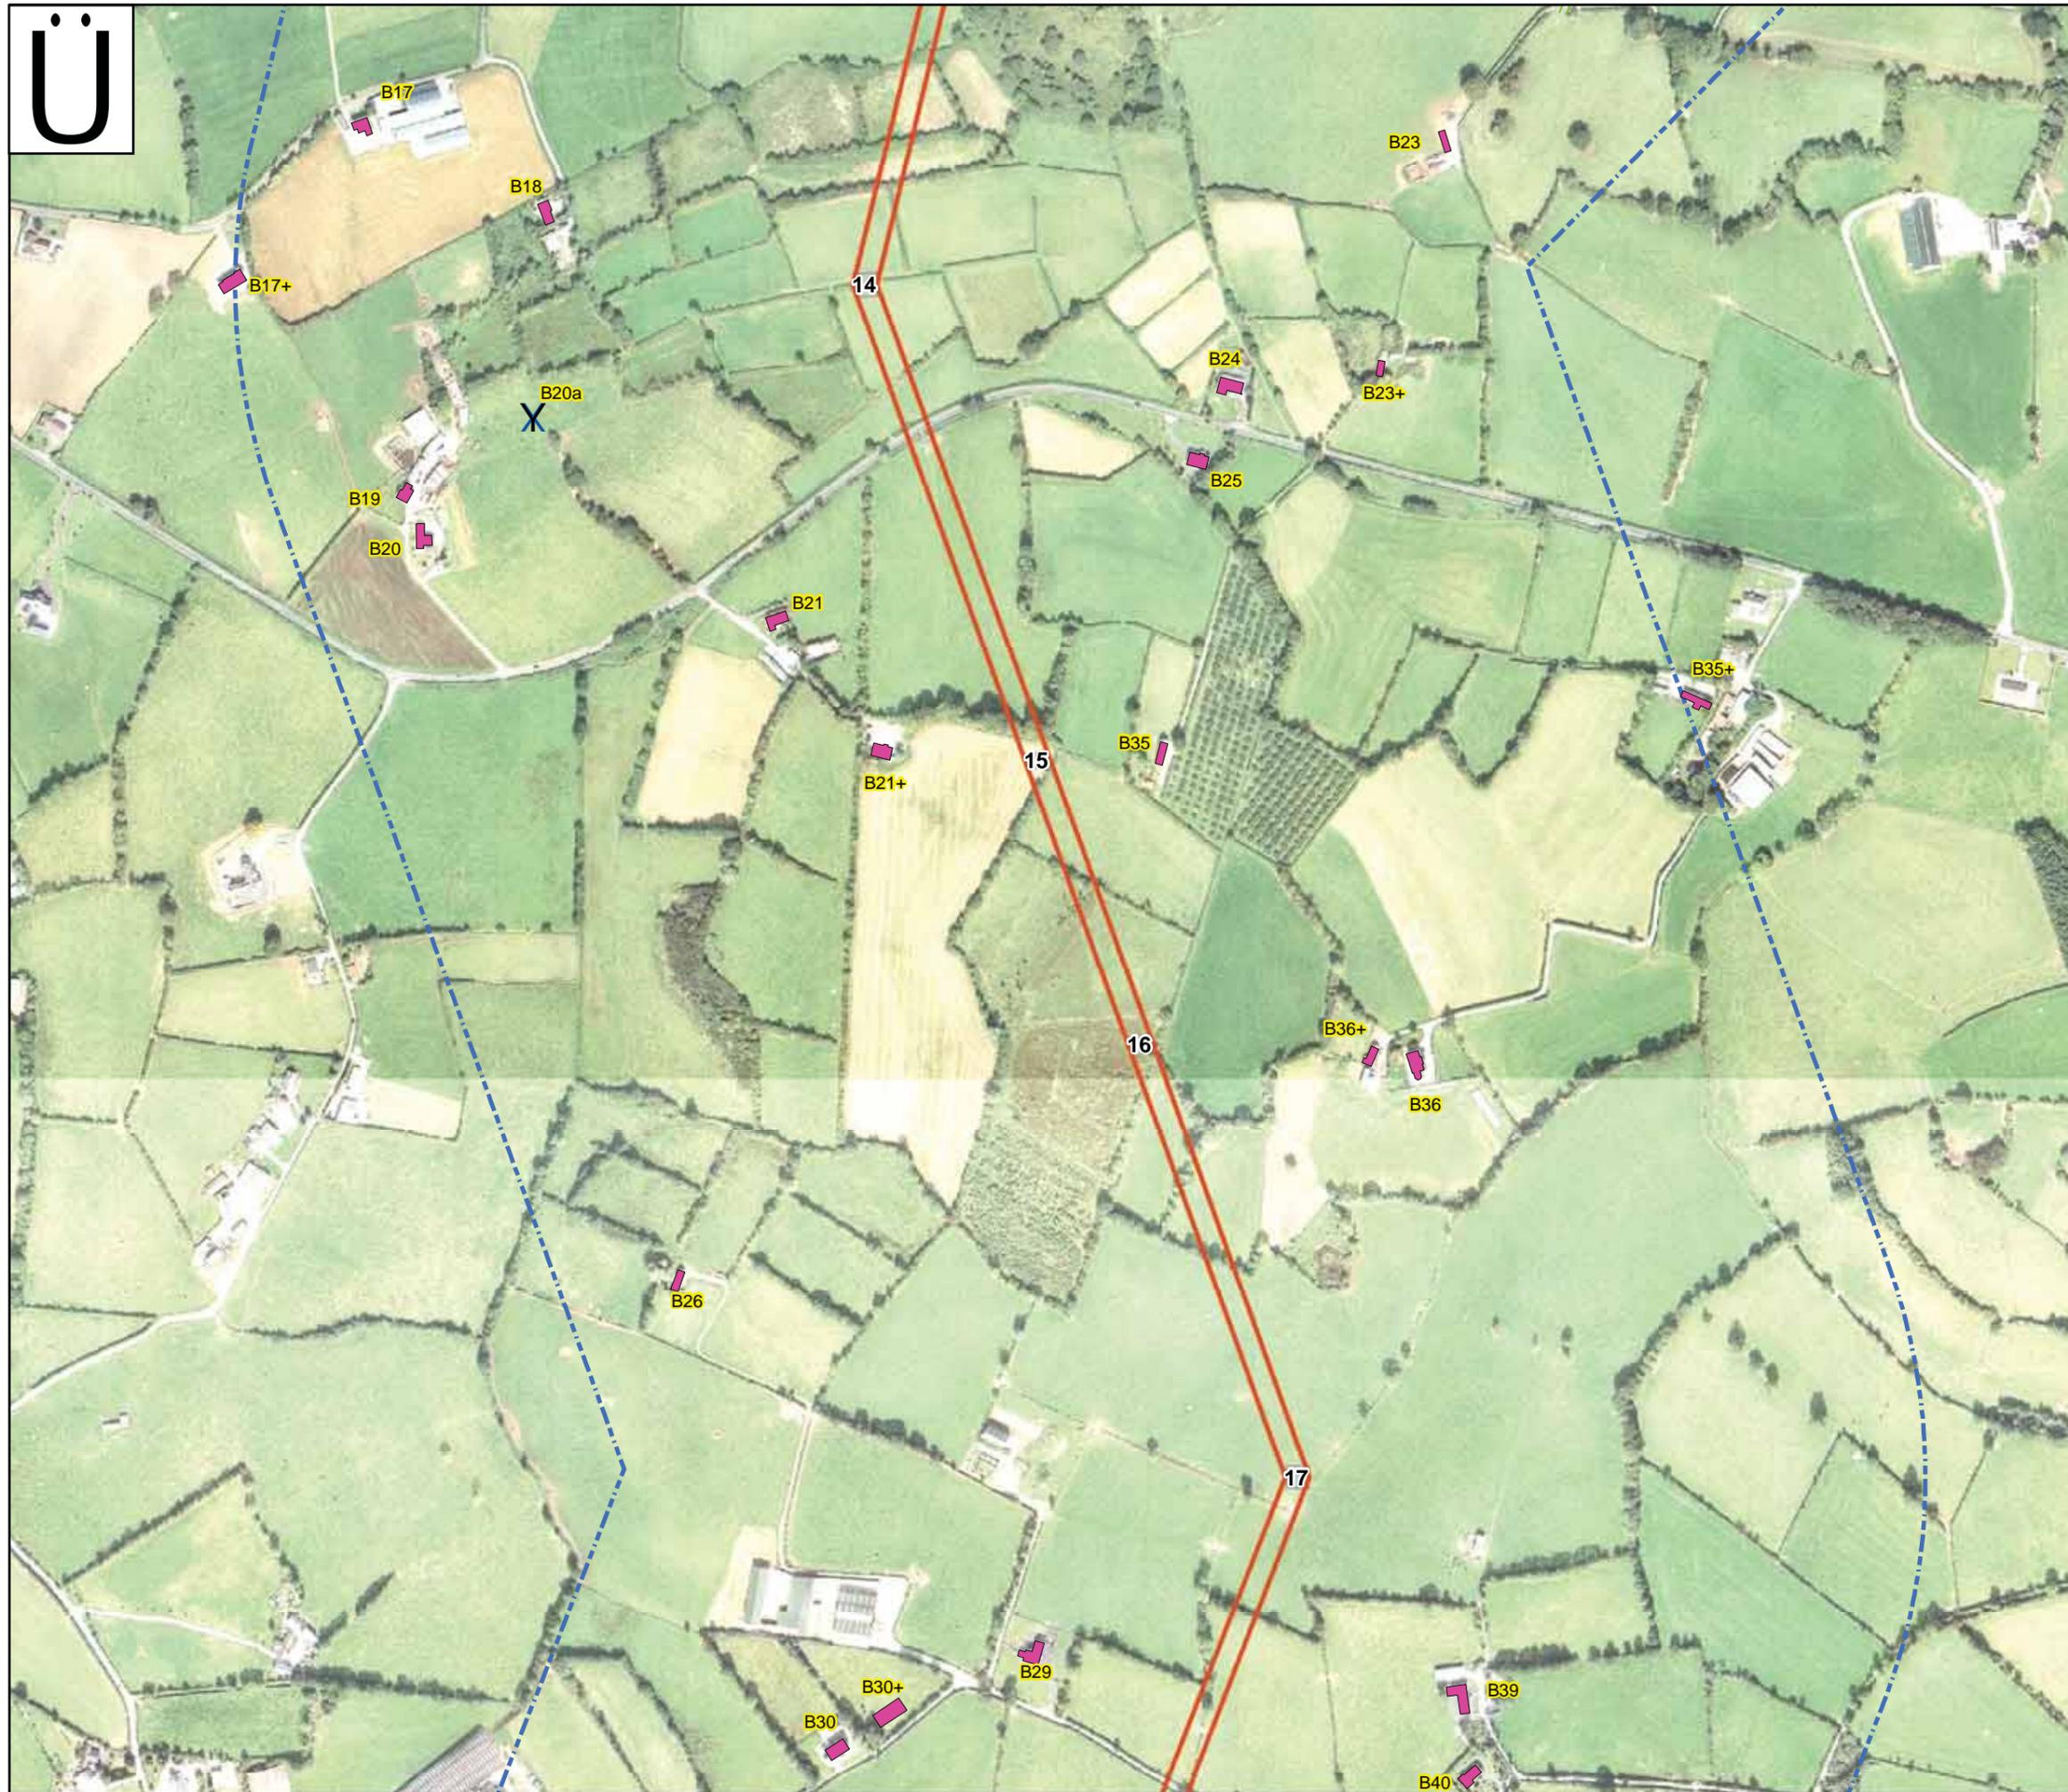



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Application (March 2013 to March 2015)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 5 of 29




DRAWING NUMBER

60320996/2019/PROP/5

REV

2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

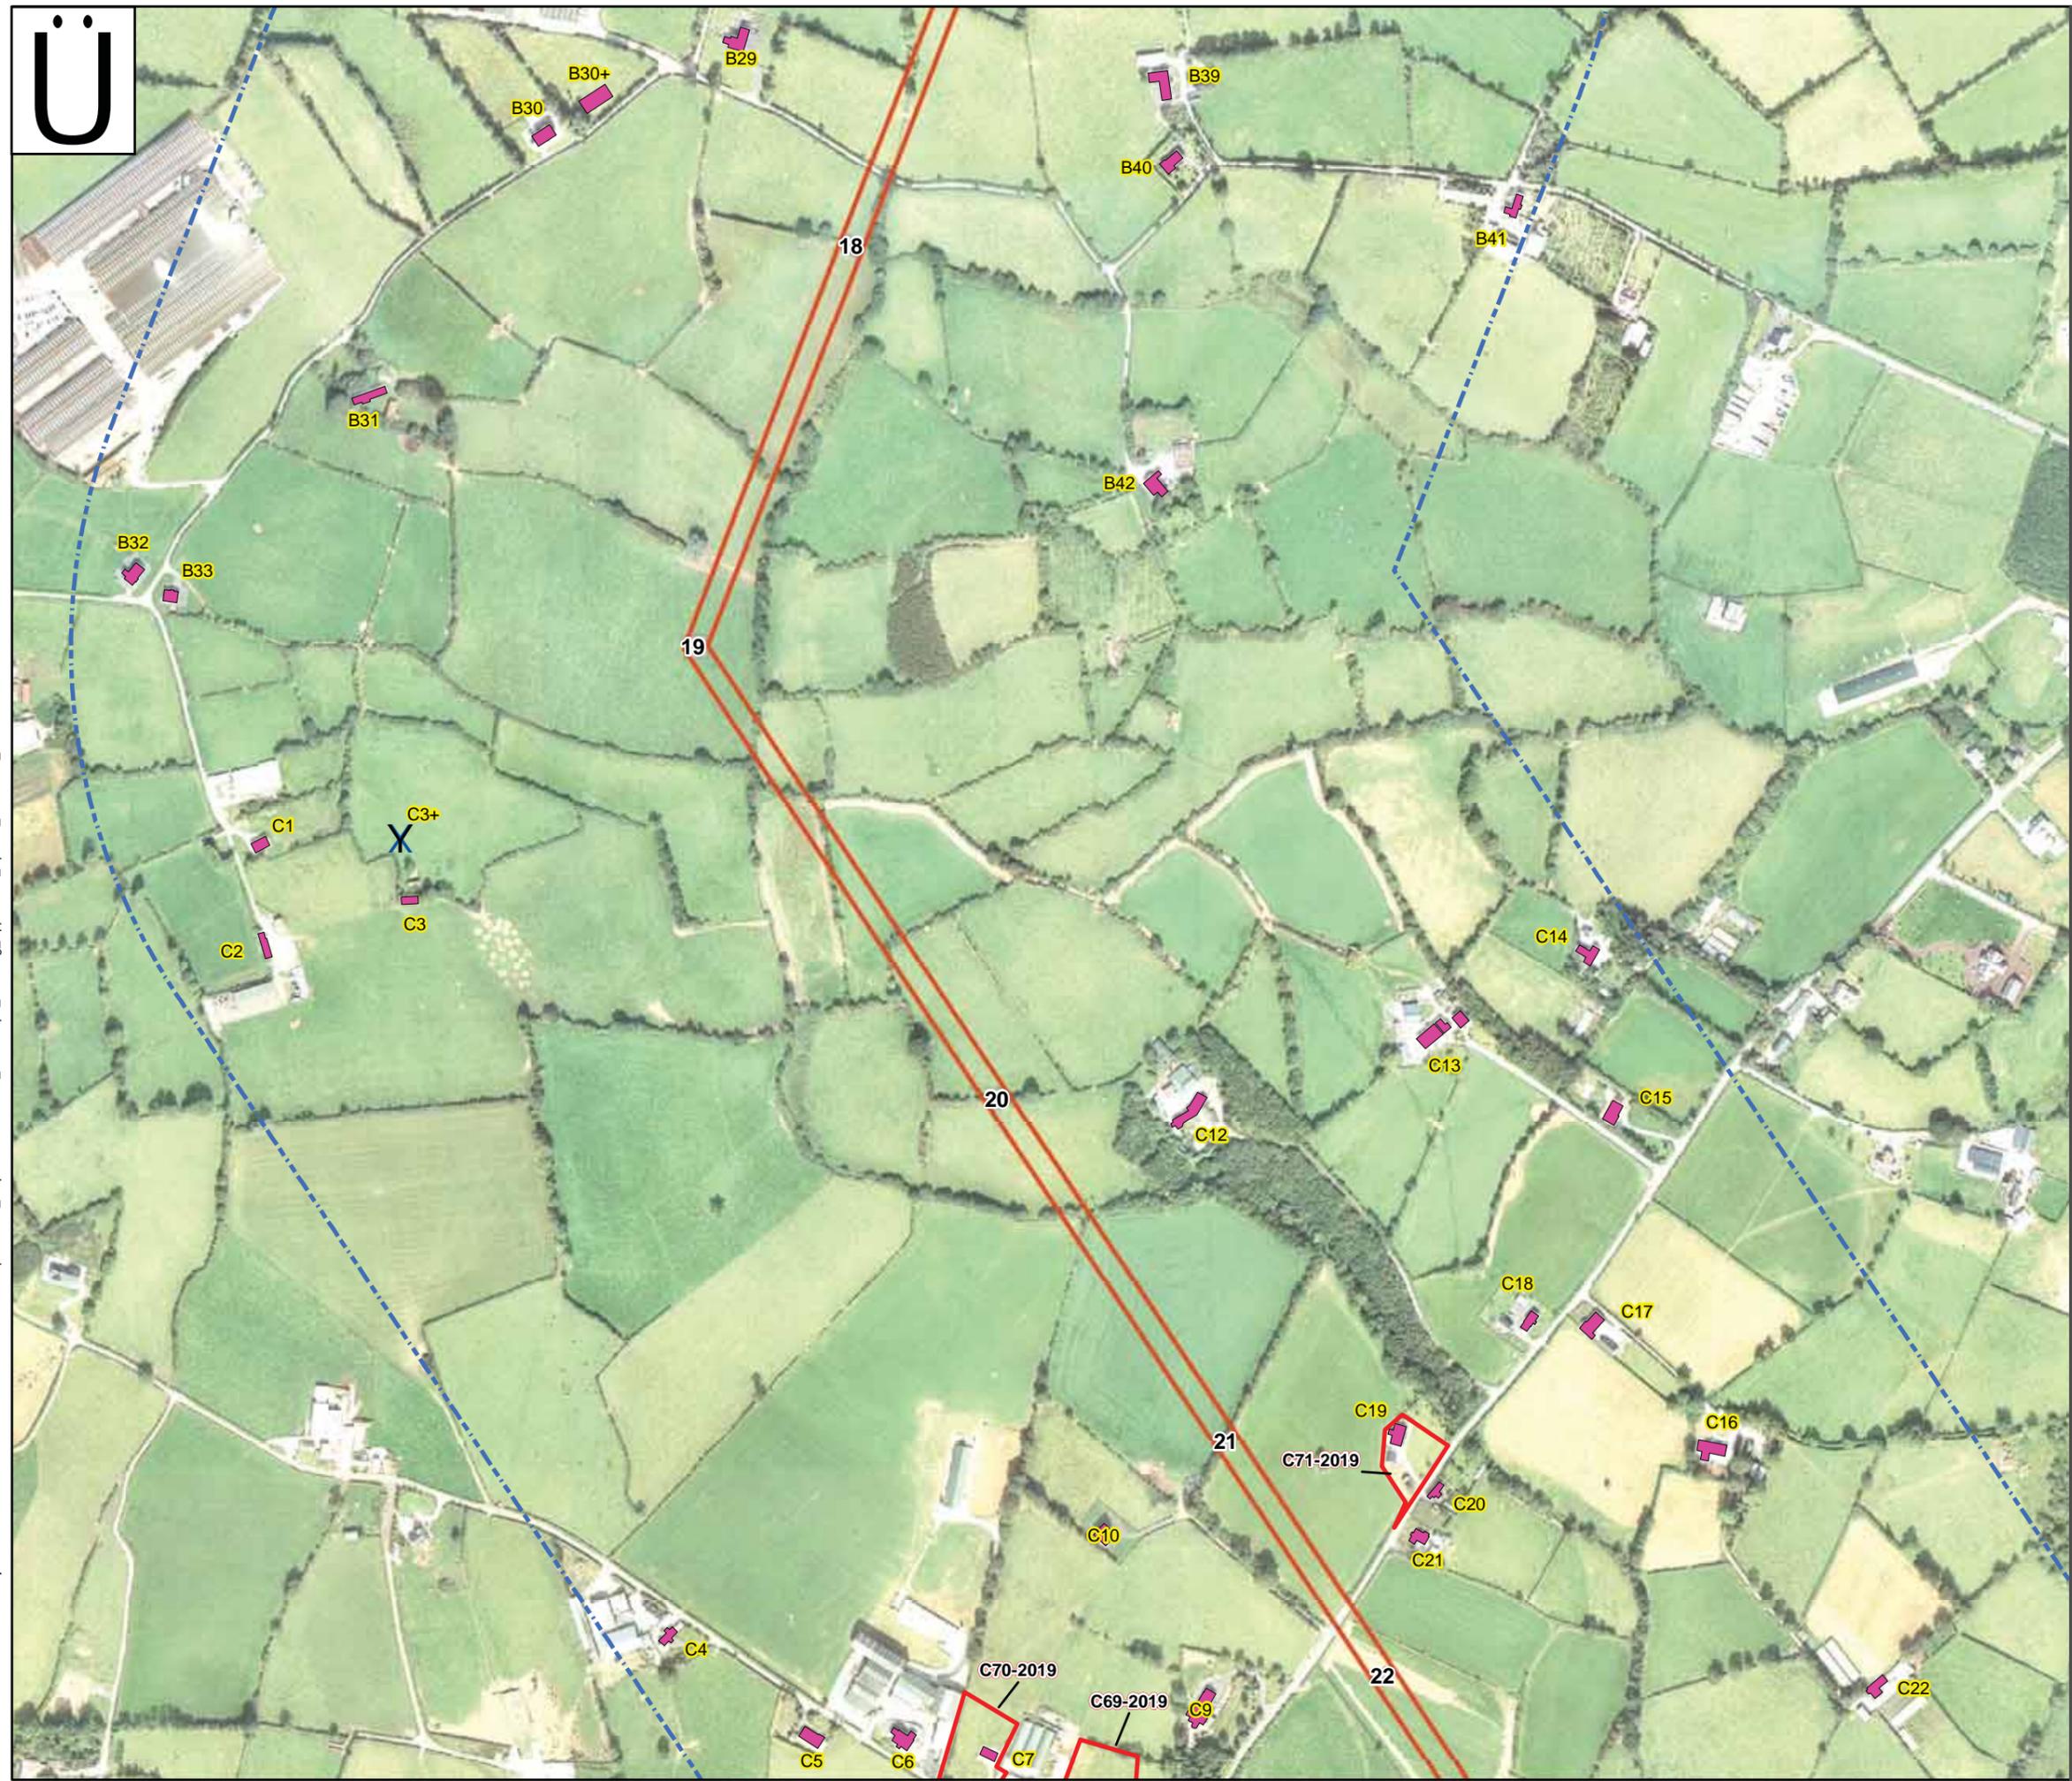

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



### LEGEND

- Proposed 400kV OHL Outer Conductor
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 6 of 29



### DRAWING NUMBER

60320996/2019/PROP/6

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.





- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - New Pointer Property (Since Oct 2014)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
Sheet 7 of 29



DRAWING NUMBER  
60320996/2019/PROP/7

REV  
2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Consented Residential Planning Application (March 2013 to March 2015)
-  Consented Residential Planning Applications (March 2015 to June 2016)
-  New Pointer Property (Since Oct 2014)
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 8 of 29



DRAWING NUMBER REV

60320996/2019/PROP/8



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



### LEGEND

- Proposed 400kV OHL Outer Conductor
- Consented Residential Planning Application (March 2013 to March 2015)
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 9 of 29



### DRAWING NUMBER

60320996/2019/PROP/9

### REV

2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*





- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Application (March 2013 to March 2015)
  - Consented Residential Planning Applications (March 2015 to June 2016)
  - New Pointer Property (Since Oct 2014)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

**PROJECT NUMBER**

60320996

**DRAWING TITLE**

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

**Sheet 10 of 29**



**DRAWING NUMBER**

60320996/2019/PROP/10

**REV**

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd




This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



**LEGEND**

- Proposed 400kV OHL Outer Conductor
- Consented Residential Planning Application (March 2013 to March 2015)
- New Pointer Property (Since Oct 2014)
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

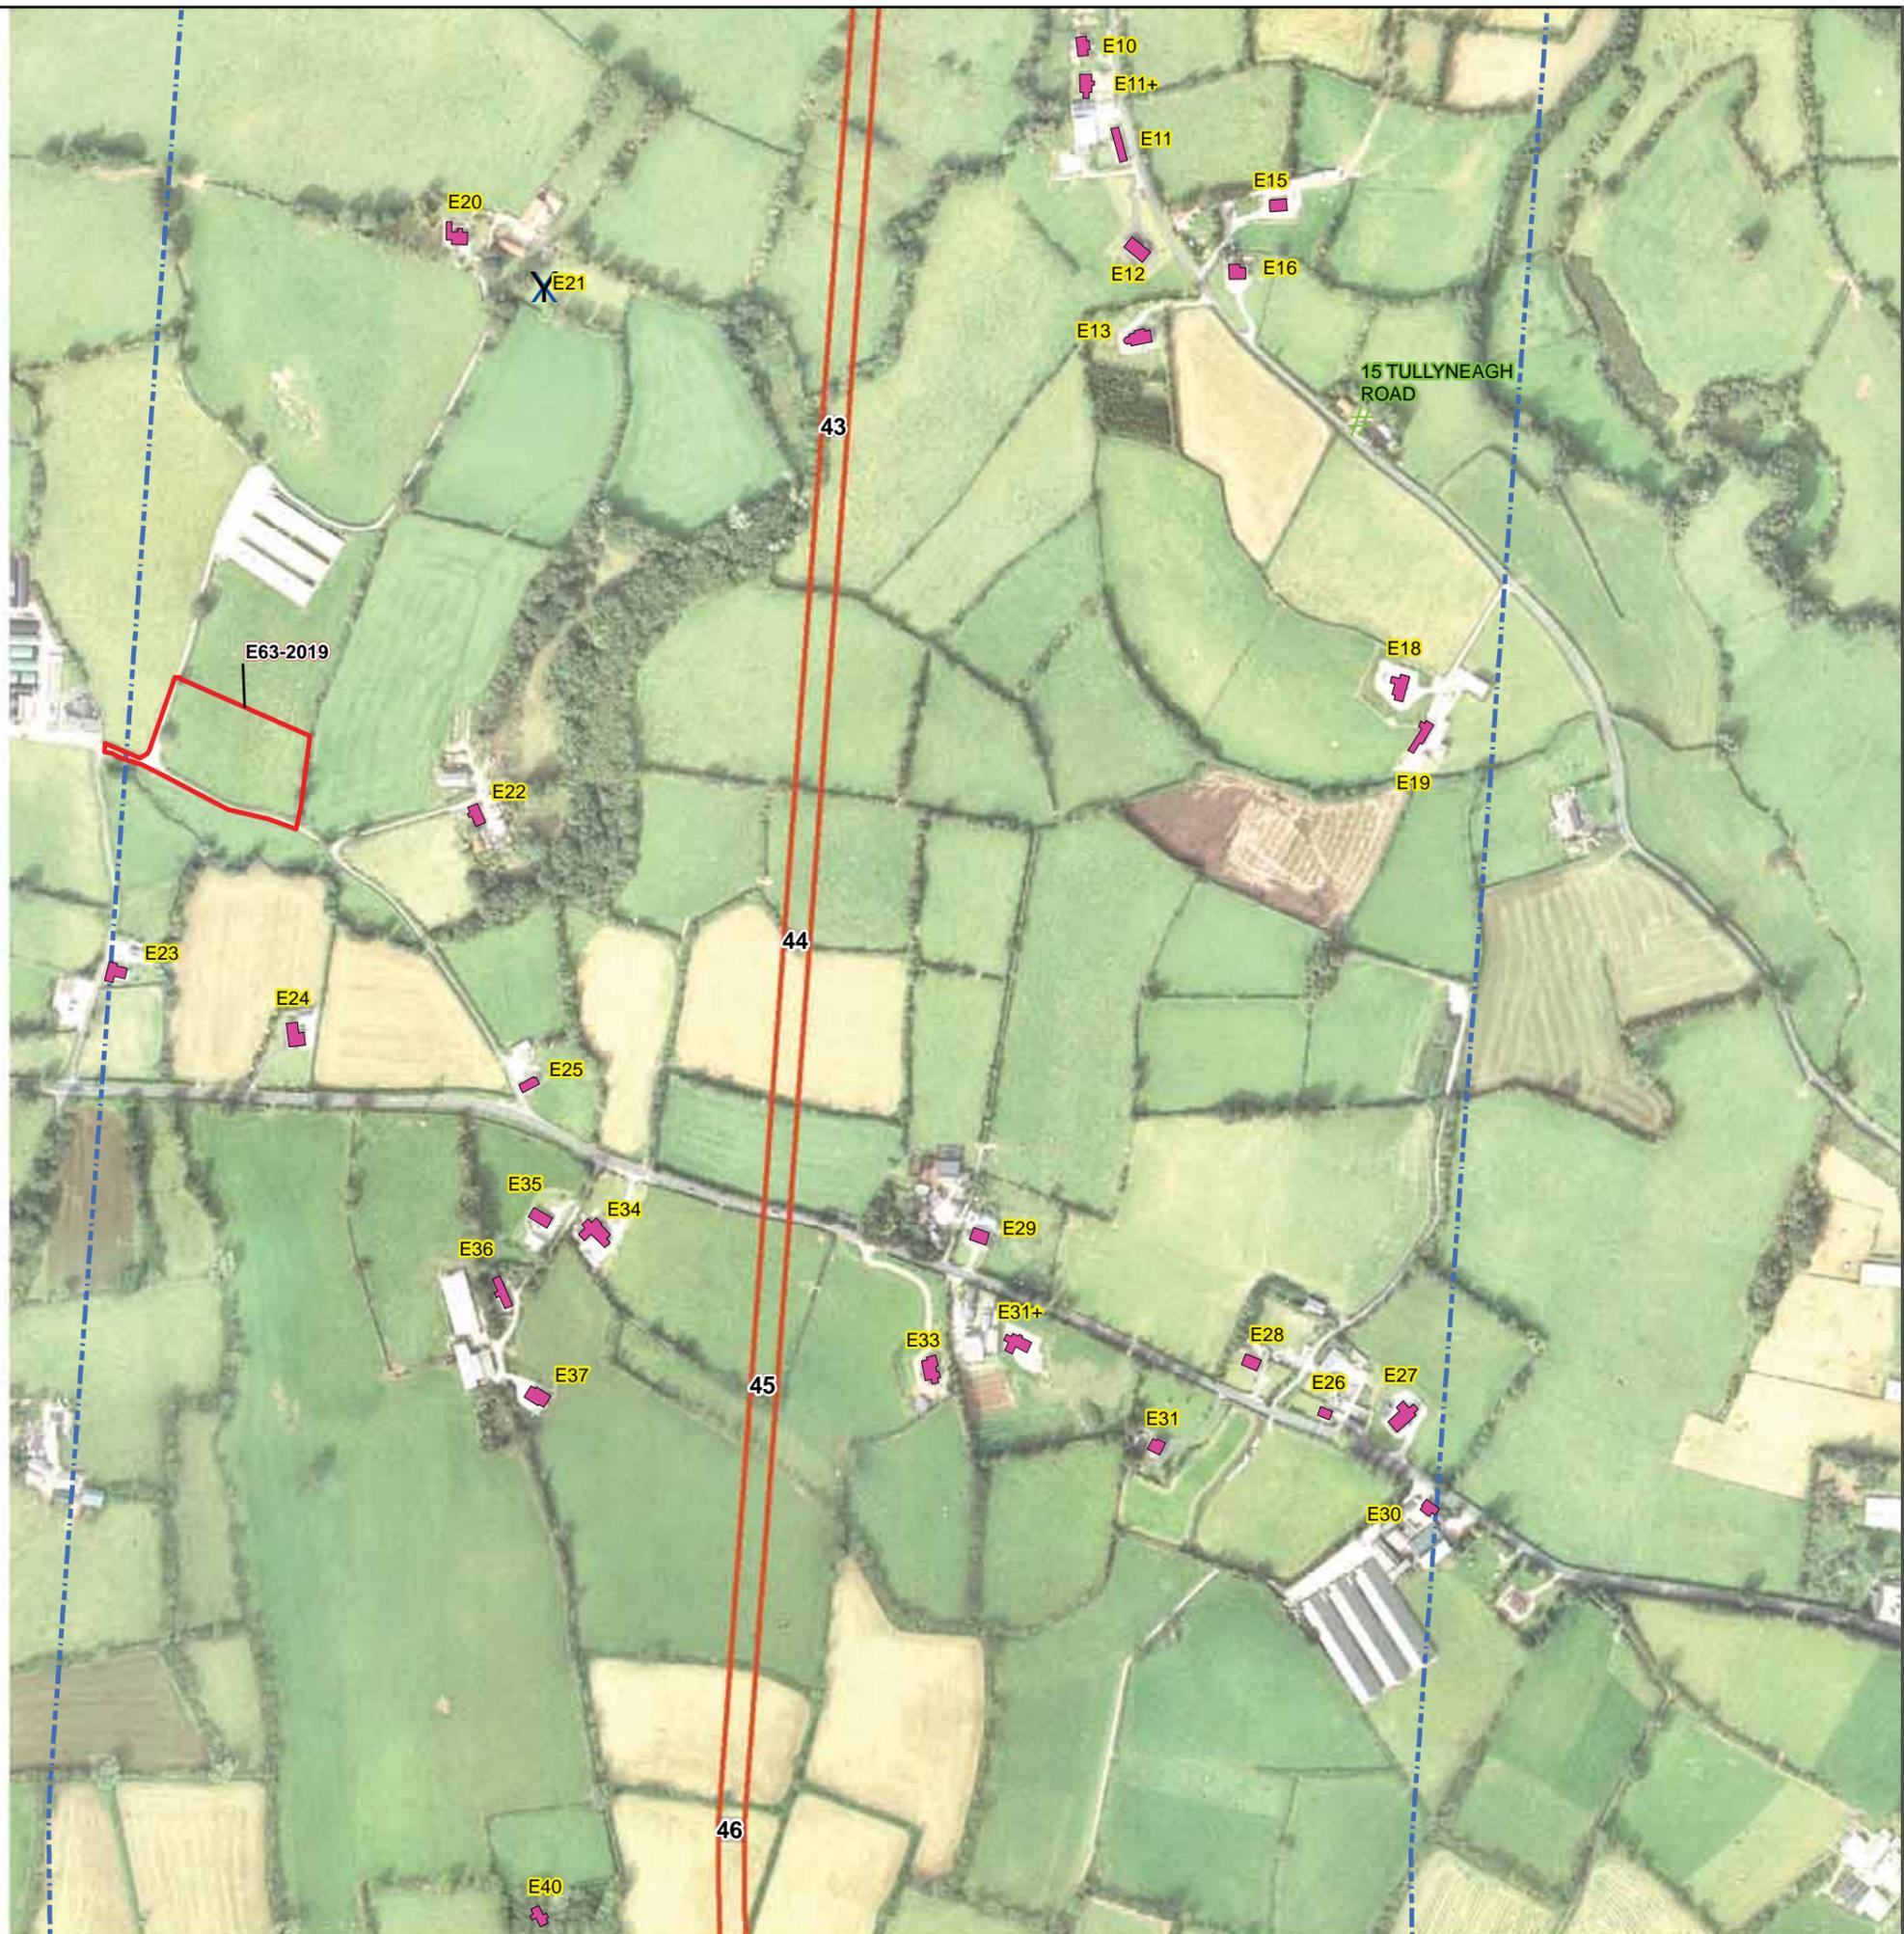

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
**Sheet 11 of 29**



DRAWING NUMBER  
60320996/2019/PROP/11

REV  
2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Application (March 2013 to March 2015)
  - Proposed Tower and Maximum Tower Foundation
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Document Path: P:\UK\BLF1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)  
**Sheet 12 of 29**



DRAWING NUMBER  
60320996/2019/PROP/12



### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Consented Residential Planning Application (March 2013 to March 2015)
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 13 of 29



### DRAWING NUMBER

60320996/2019/PROP/13

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*





### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Consented Residential Planning Application (March 2013 to March 2015)
-  Consented Residential Planning Applications (March 2015 to June 2016)
-  New Pointer Property (Since Oct 2014)
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 14 of 29



### DRAWING NUMBER

60320996/2019/PROP/14

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd


This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*





### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

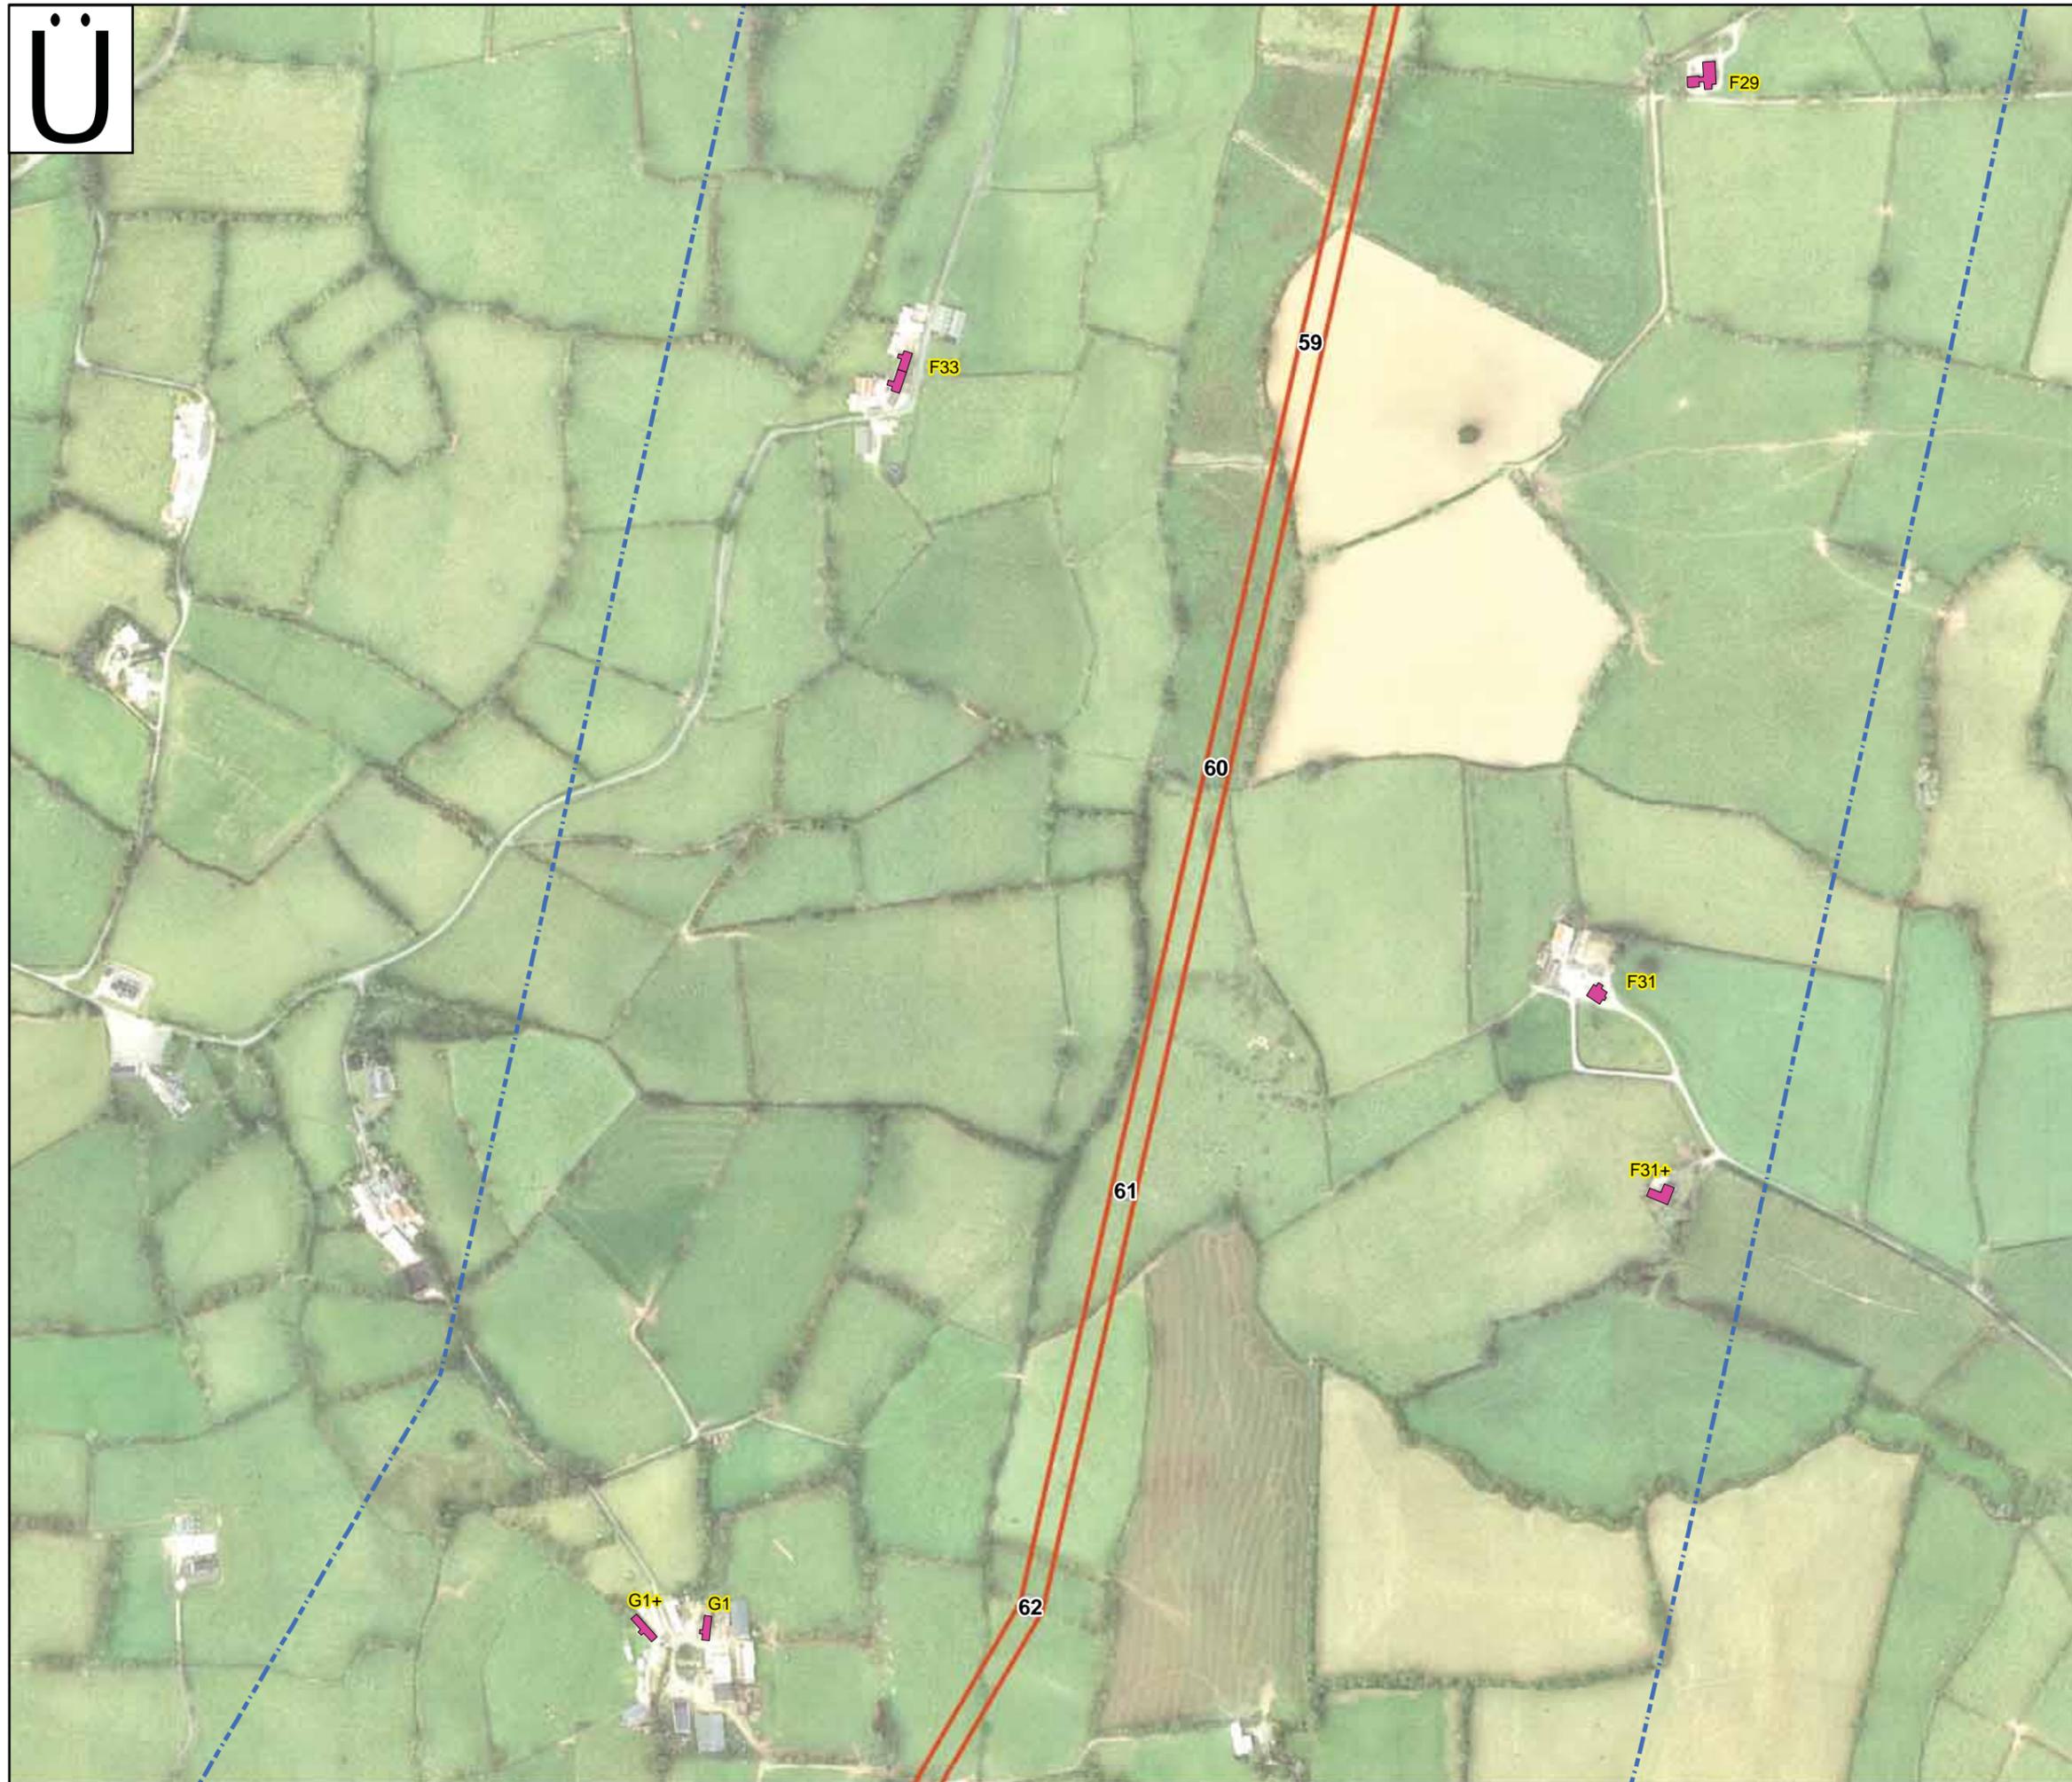

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 15 of 29



### DRAWING NUMBER

60320996/2019/PROP/15

### REV

2

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



- LEGEND**
-  Proposed 400kV OHL Outer Conductor
  -  Consented Residential Planning Application (March 2013 to March 2015)
  -  Consented Residential Planning Applications (March 2015 to June 2016)
  -  Proposed Tower and Maximum Tower Foundation
  -  500m Buffer from Proposed OHL Centreline
  -  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3


PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)  
**Sheet 16 of 29**



DRAWING NUMBER  
60320996/2019/PROP/16

Document Path: P:\UK\BLF1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

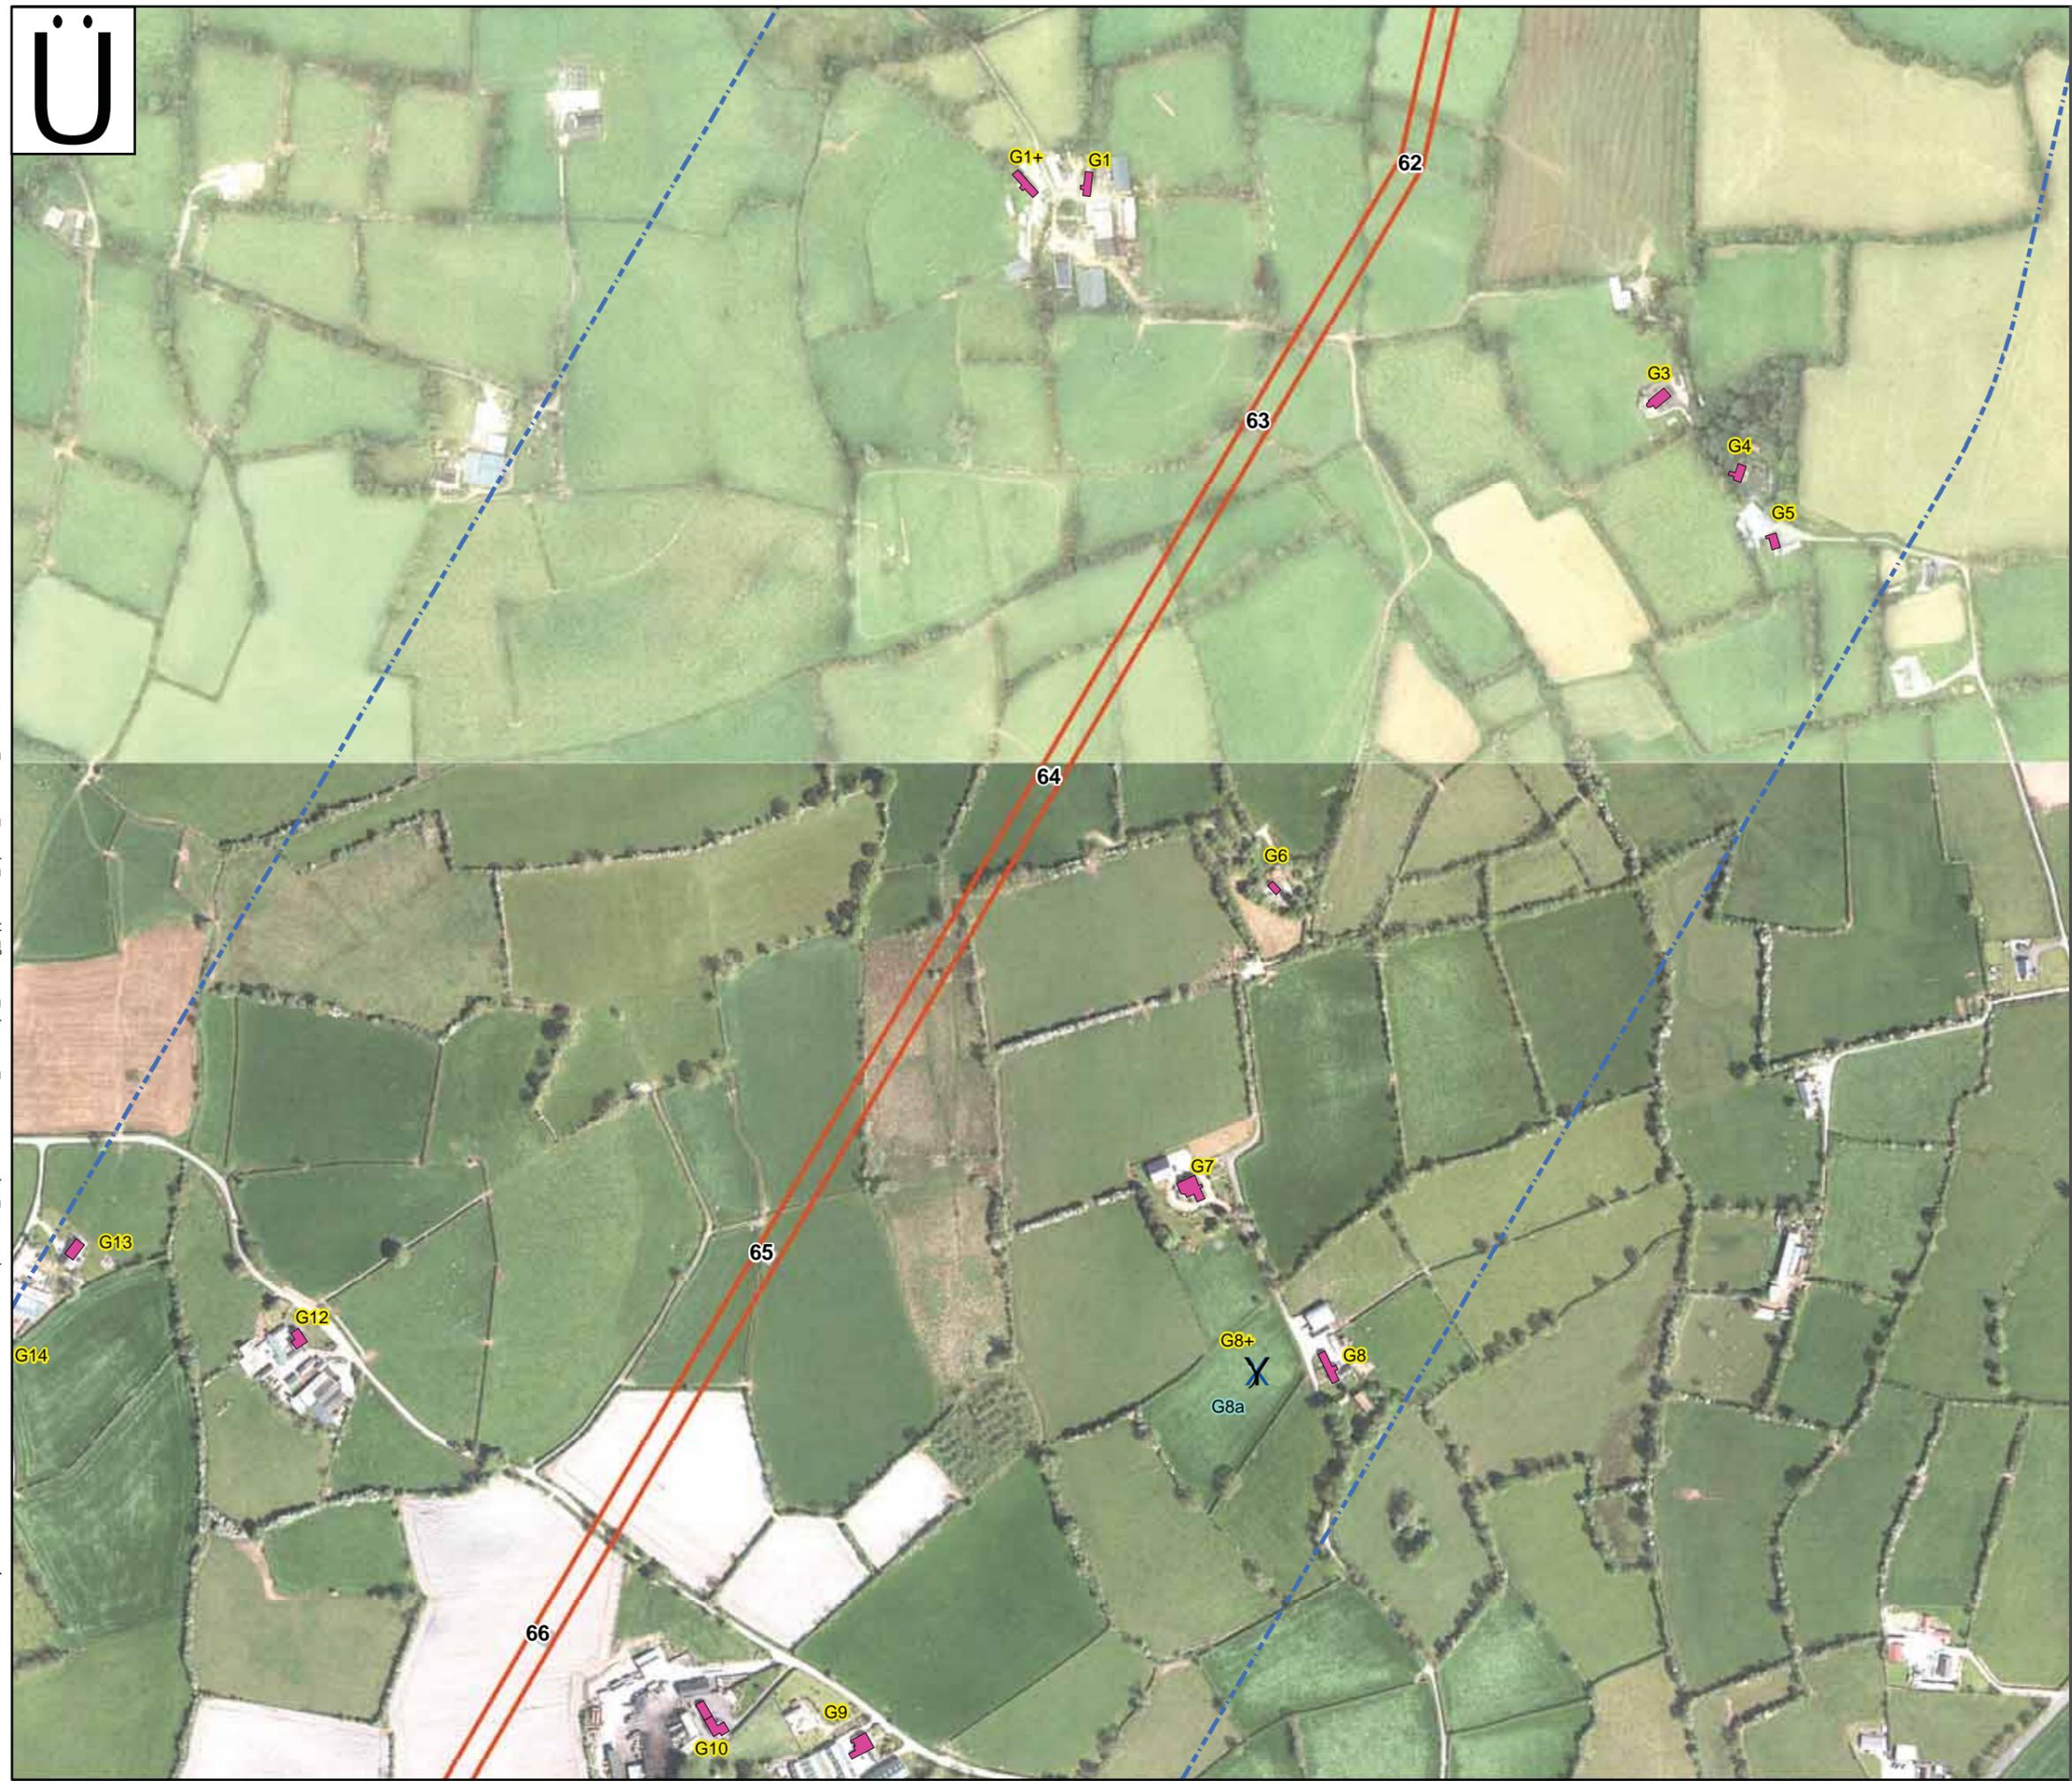

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Application (March 2013 to March 2015)
  - Consented Residential Planning Applications (March 2015 to June 2016)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996


DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
**Sheet 17 of 29**



DRAWING NUMBER  
60320996/2019/PROP/17

REV  
2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

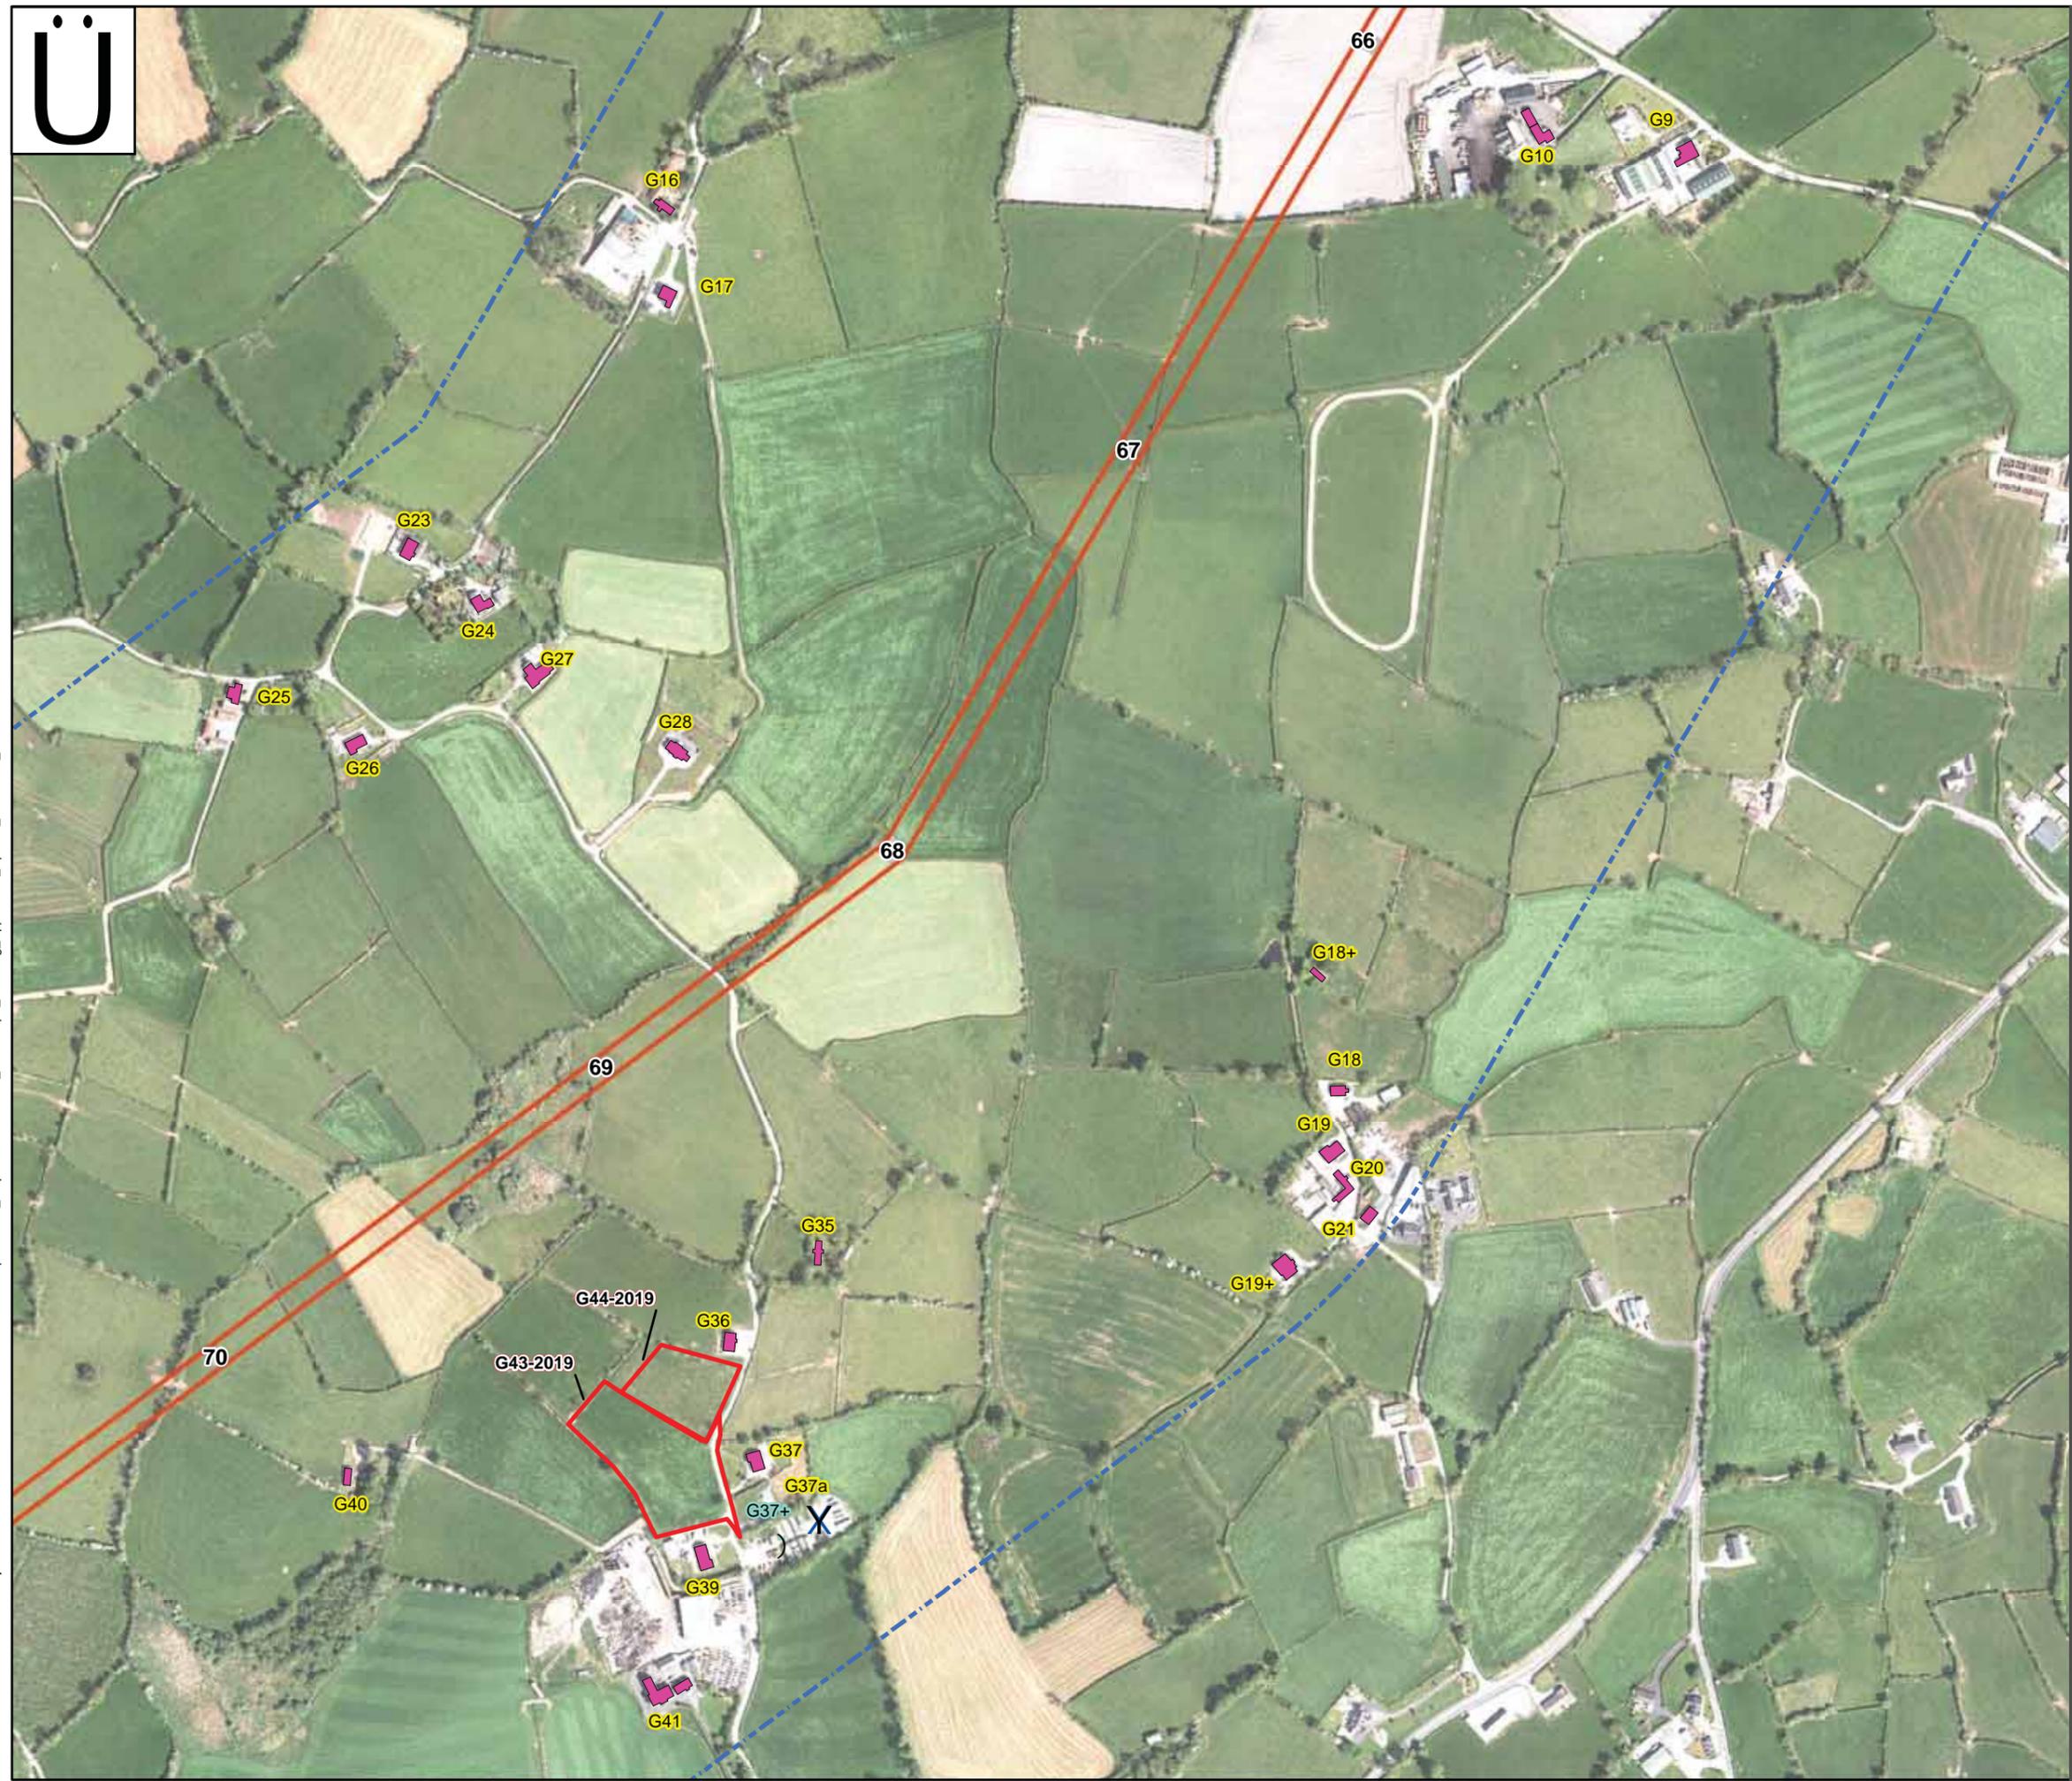

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



### LEGEND

- Proposed 400kV OHL Outer Conductor
- Consented Residential Planning Application (March 2013 to March 2015)
- Consented Residential Planning Applications (March 2015 to June 2016)
- New Pointer Property (Since Oct 2014)
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 18 of 29




### DRAWING NUMBER

60320996/2019/PROP/18

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

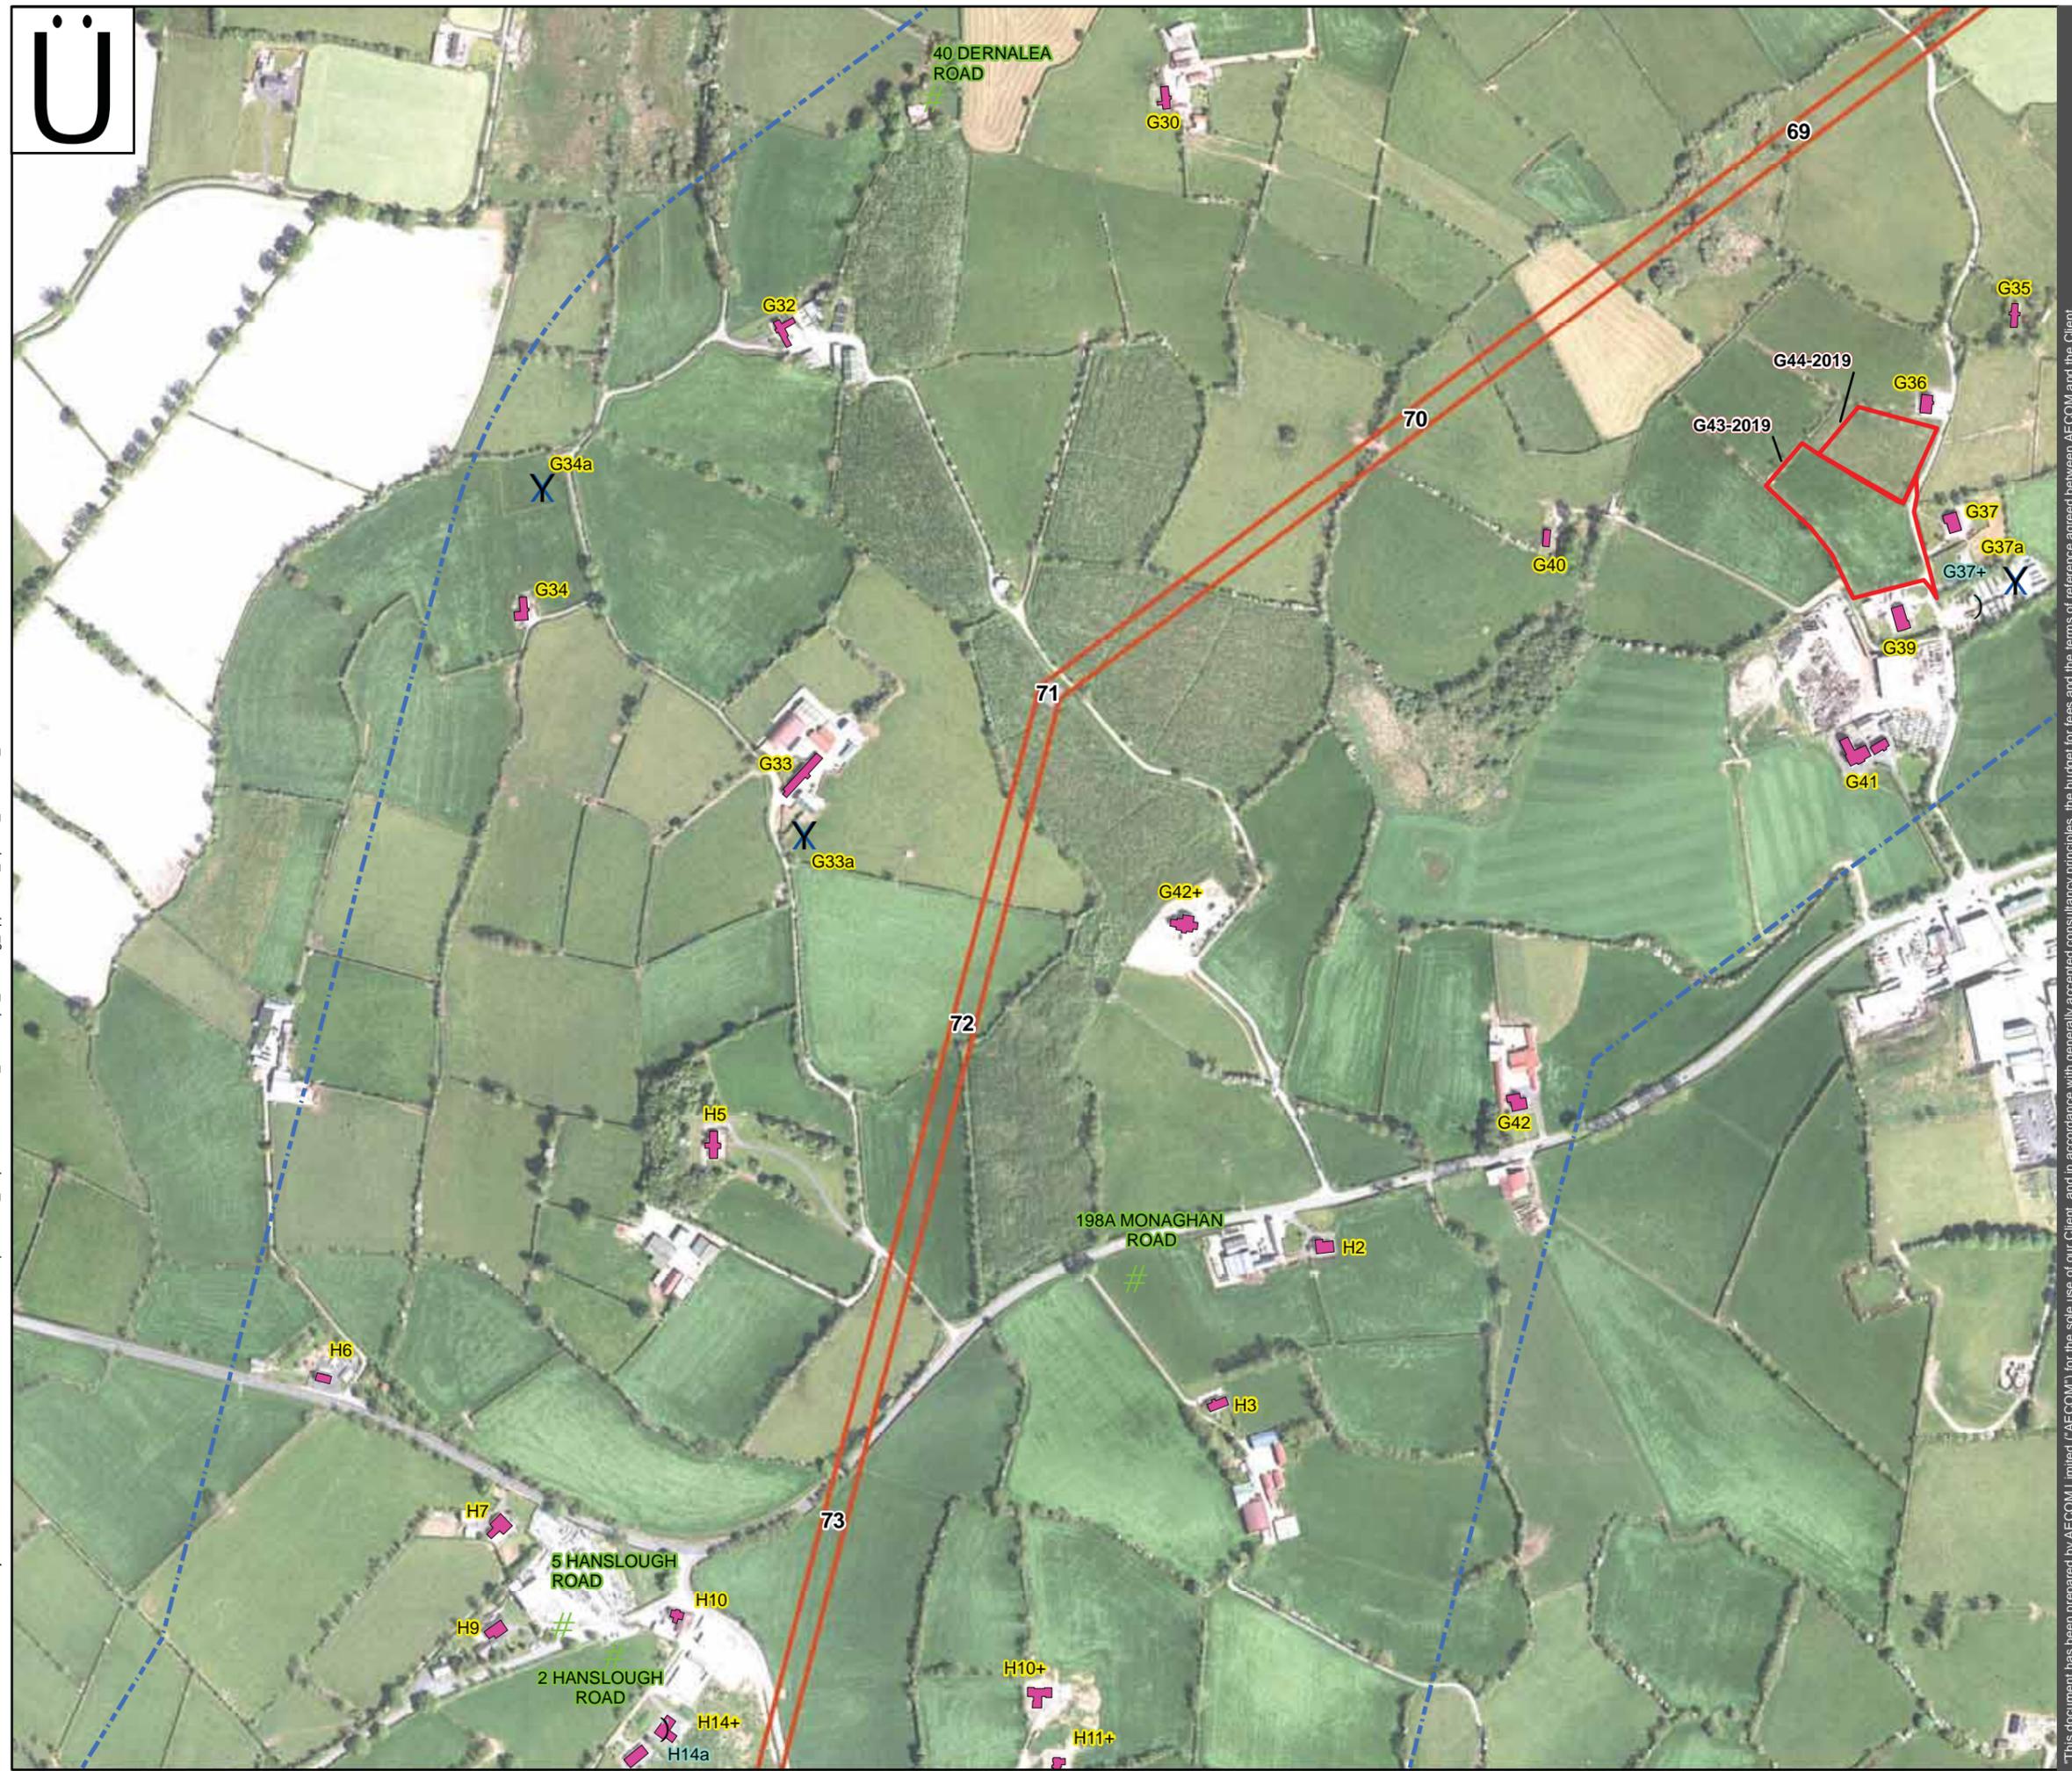

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Application (March 2013 to March 2015)
  - Consented Residential Planning Applications (March 2015 to June 2016)
  - New Pointer Property (Since Oct 2014)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 19 of 29



DRAWING NUMBER

60320996/2019/PROP/19

REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



### LEGEND

- Proposed 400kV OHL Outer Conductor
- New Pointer Property (Since Oct 2014)
- Proposed Tower and Maximum Tower Foundation
- Planning Applications 2019
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 20 of 29



### DRAWING NUMBER

60320996/2019/PROP/20

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - New Pointer Property (Since Oct 2014)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3


PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
**Sheet 21 of 29**



DRAWING NUMBER  
60320996/2019/PROP/21

Document Path: P:\UK\BFL1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

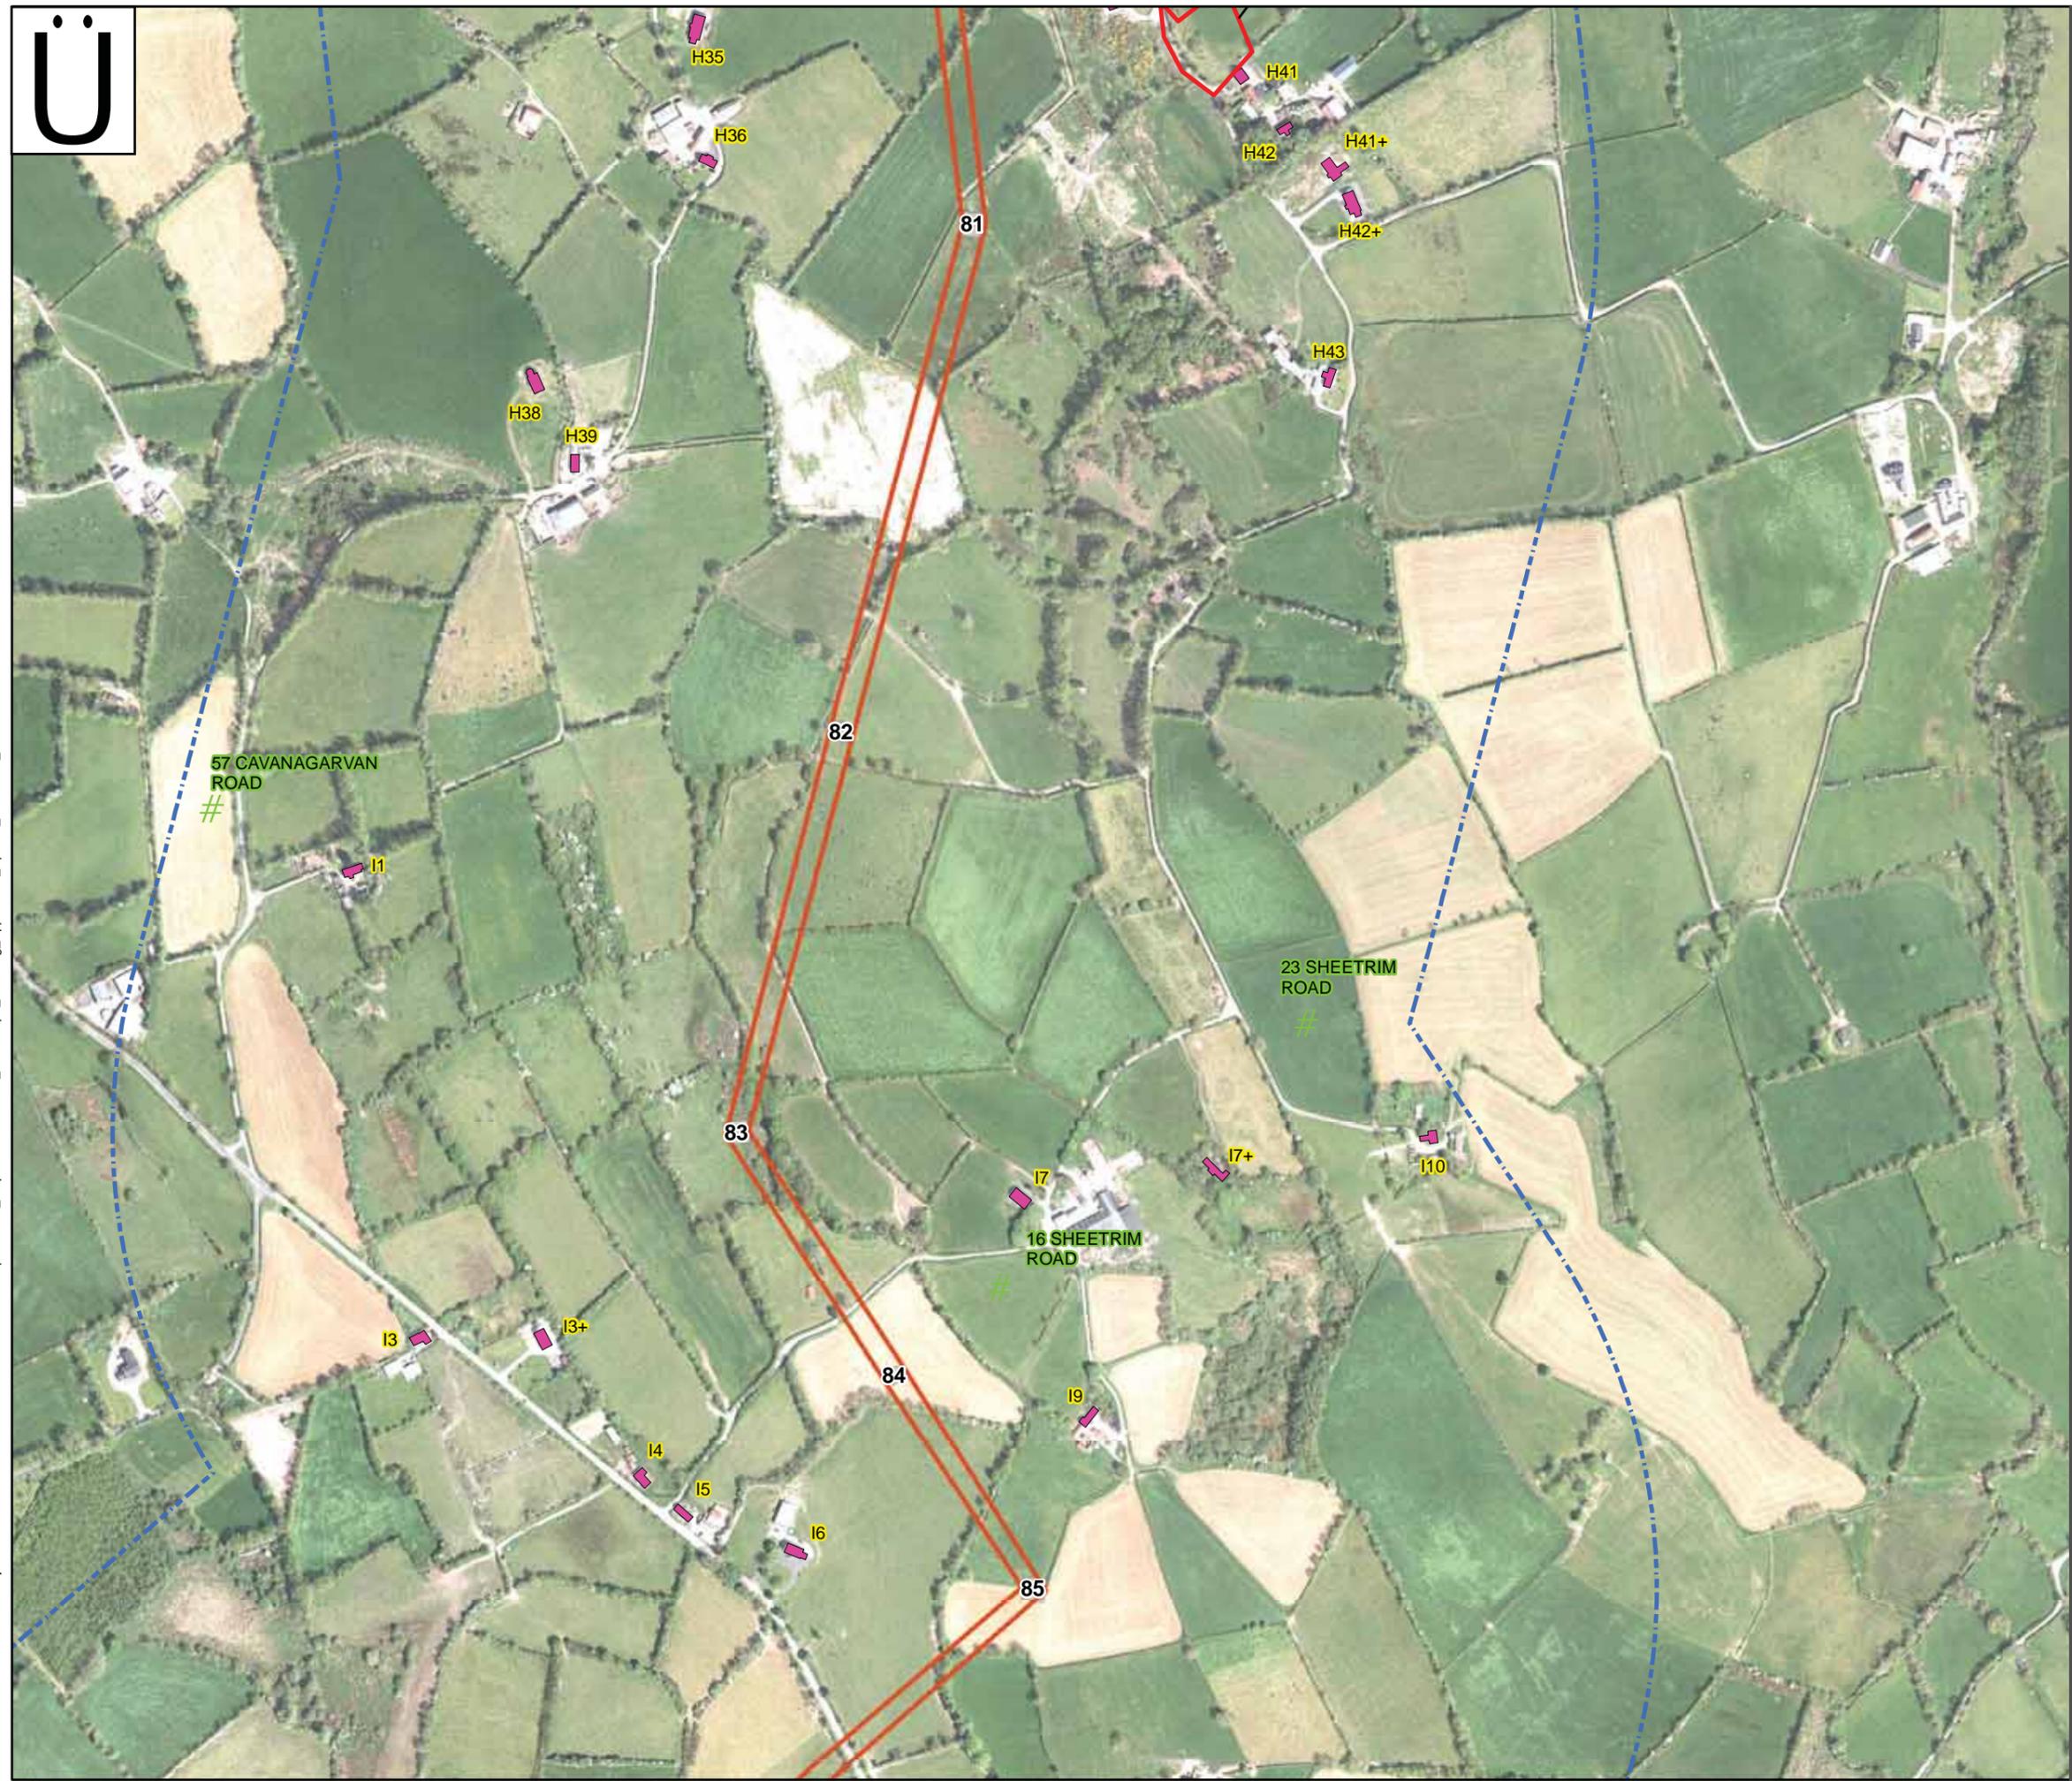

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 22 of 29



### DRAWING NUMBER

60320996/2019/PROP/22

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\BLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.





### LEGEND

-  Proposed 400kV OHL Outer Conductor
-  Proposed Tower and Maximum Tower Foundation
-  500m Buffer from Proposed OHL Centreline
-  Residential Property (With ID)



Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 23 of 29



DRAWING NUMBER

60320996/2019/PROP/23

REV

2

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

Sheet 24 of 29



DRAWING NUMBER

60320996/2019/PROP/24

REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



- LEGEND
- Proposed 400kV OHL Outer Conductor
  - Consented Residential Planning Applications (March 2015 to June 2016)
  - Proposed Tower and Maximum Tower Foundation
  - Planning Applications 2019
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996


DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
Sheet 25 of 29



DRAWING NUMBER  
60320996/2019/PROP/25

REV  
2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

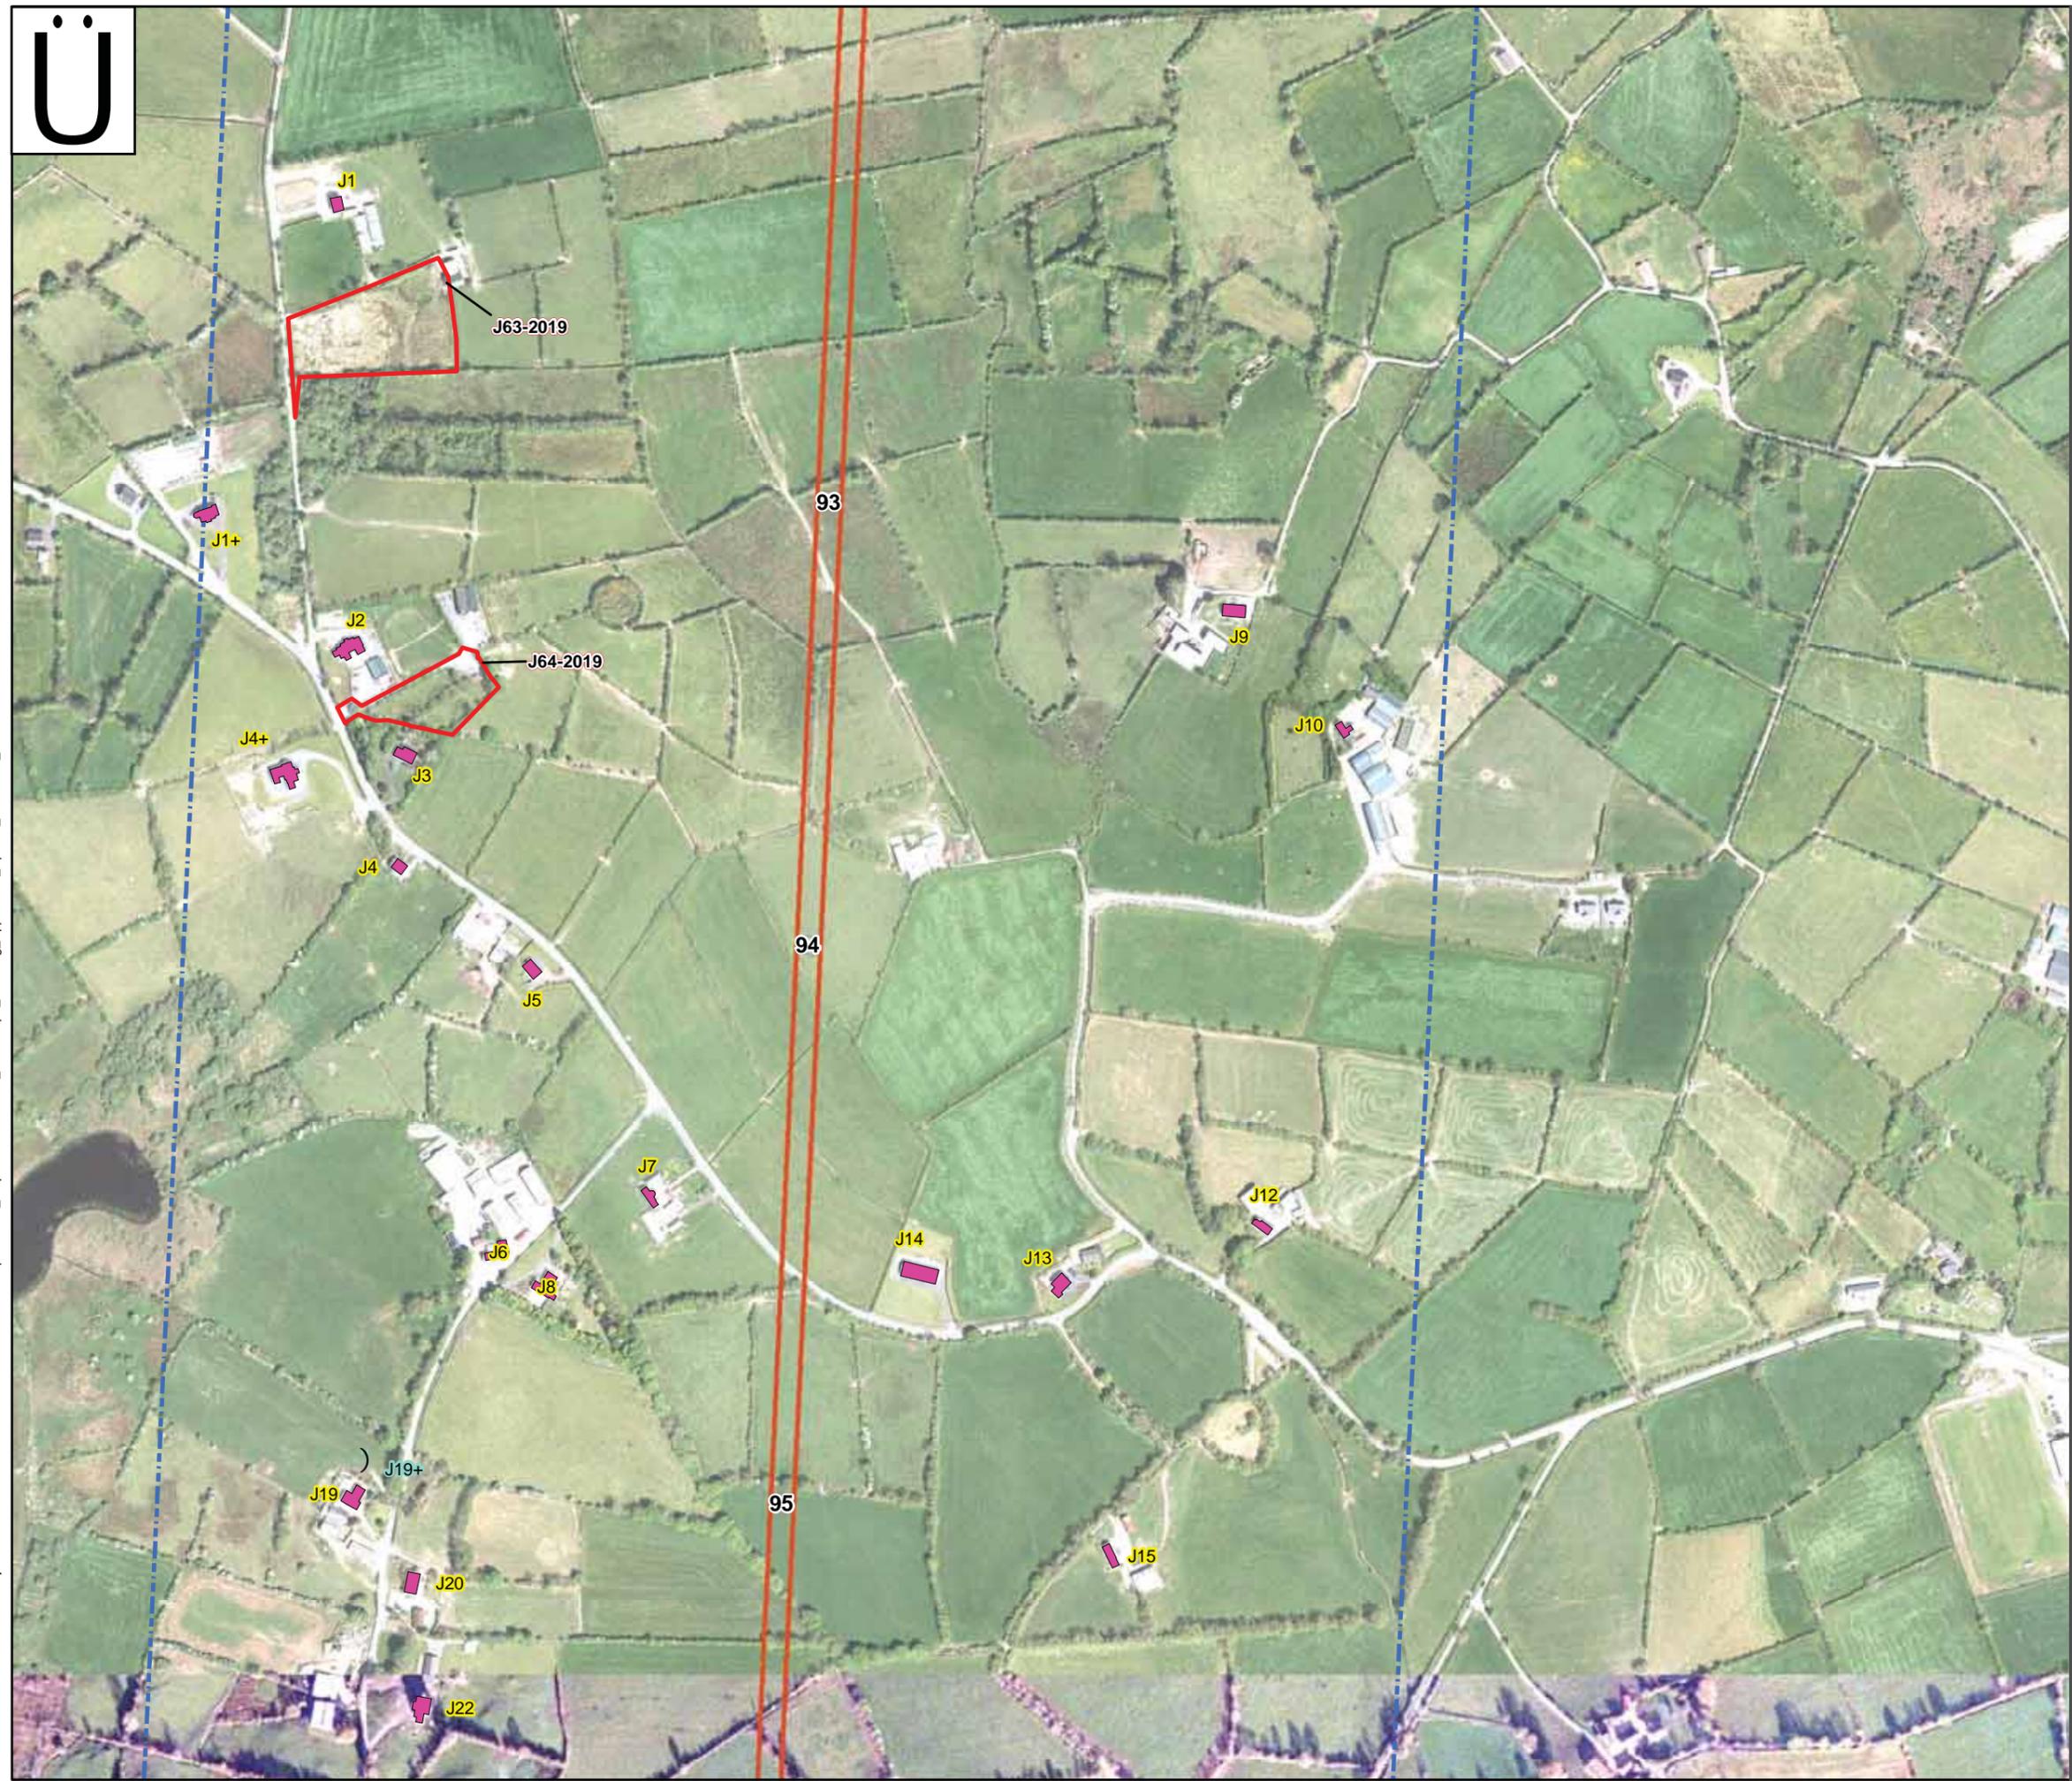

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.



### LEGEND

- Proposed 400kV OHL Outer Conductor
- NI / RoI Border
- Consented Residential Planning Application (March 2013 to March 2015)
- Consented Residential Planning Applications (March 2015 to June 2016)
- New Pointer Property (Since Oct 2014)
- Proposed Tower and Maximum Tower Foundation
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

### PROJECT NUMBER

60320996

### DRAWING TITLE

FIGURE 9.1 – Individual Property Assessment Sheets (2019 Update)

### Sheet 26 of 29




### DRAWING NUMBER

60320996/2019/PROP/26

### REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

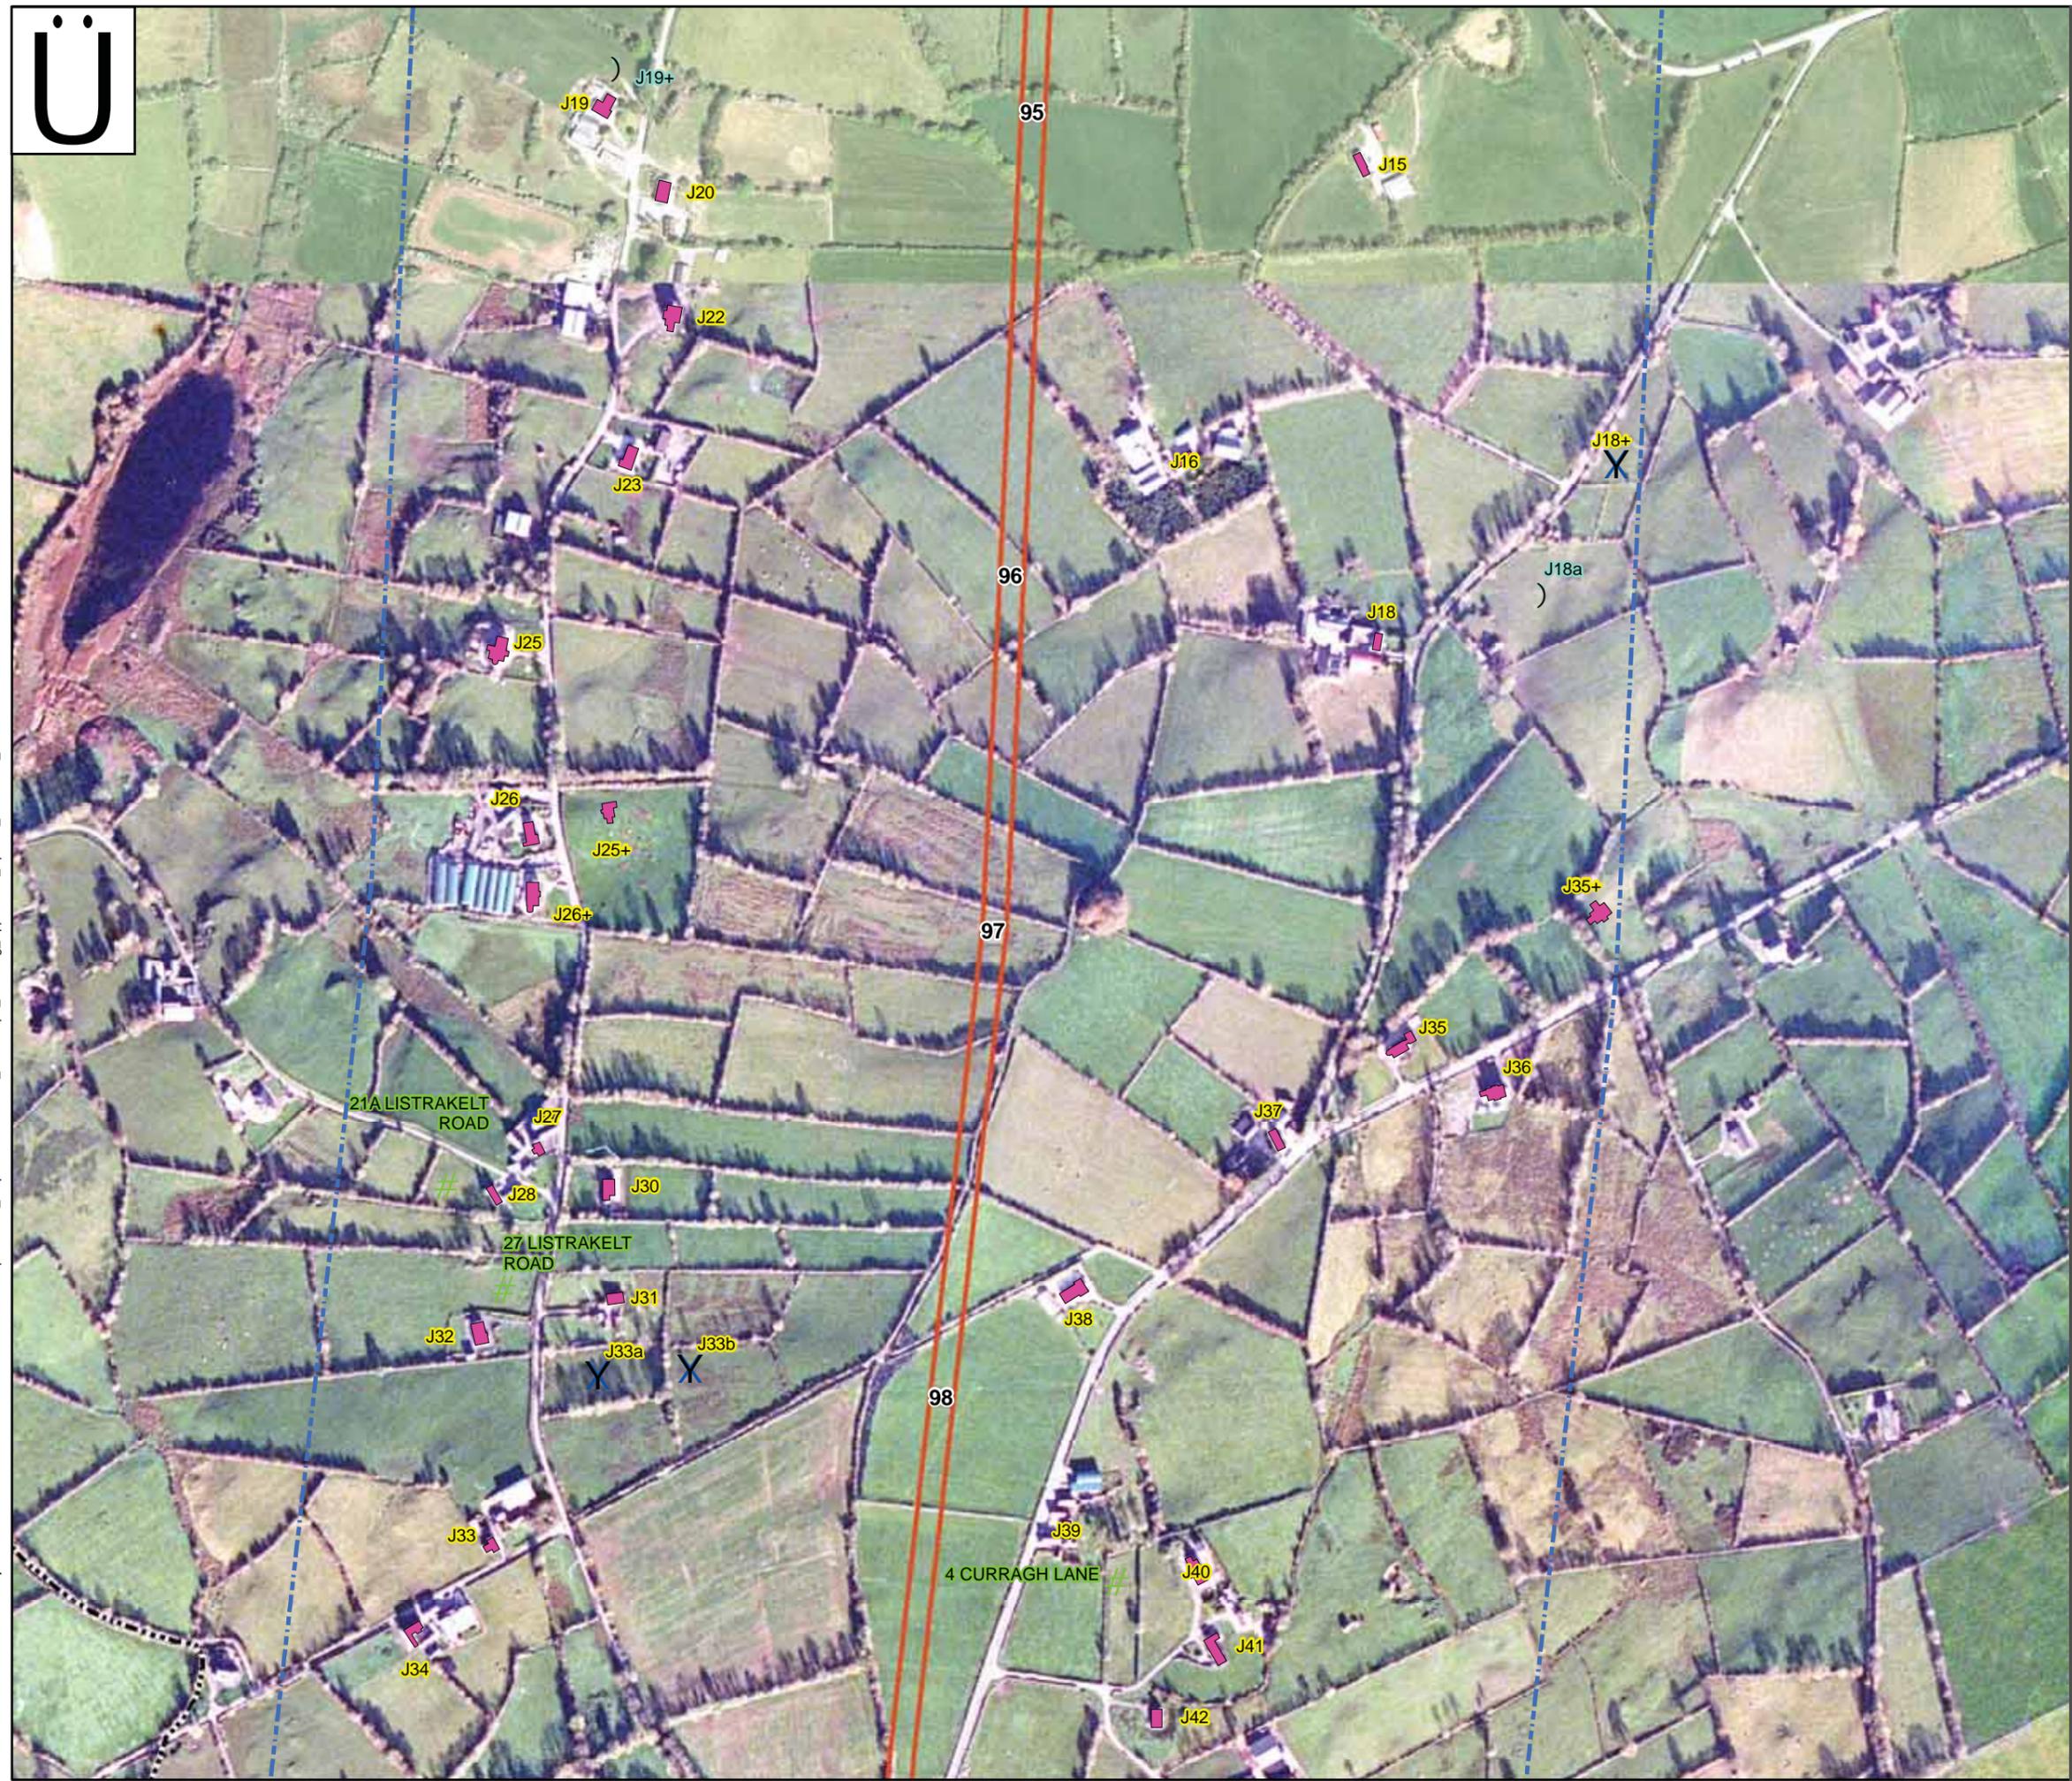

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in this document. No third party may rely upon this document without the prior and express written agreement of AECOM.



- LEGEND**
- Proposed 400kV OHL Outer Conductor
  - Proposed EirGrid 400kV Overhead Line
  - NI / RoI Border
  - Consented Residential Planning Application (March 2013 to March 2015)
  - New Pointer Property (Since Oct 2014)
  - Proposed Tower and Maximum Tower Foundation
  - 500m Buffer from Proposed OHL Centreline
  - Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
**Sheet 27 of 29**



DRAWING NUMBER  
60320996/2019/PROP/27

REV  
2

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd



This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



**LEGEND**

- Proposed 400kV OHL Outer Conductor
- Proposed EirGrid 400kV Overhead Line
- NI / RoI Border
- New Pointer Property (Since Oct 2014)
- Proposed Tower and Maximum Tower Foundation
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)



Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER  
60320996

DRAWING TITLE  
FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)  
**Sheet 28 of 29**



DRAWING NUMBER  
60320996/2019/PROP/28

Document Path: P:\UK\BFL1-IE\Projects\45457\IBLE NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.\*



PROJECT

TYRONE TO CAVAN  
INTERCONNECTOR

CLIENT



LEGEND

- Proposed 400kV OHL Outer Conductor
- Proposed EirGrid 400kV Overhead Line
- NI / RoI Border
- New Pointer Property (Since Oct 2014)
- 500m Buffer from Proposed OHL Centreline
- Residential Property (With ID)

Note: Planning applications included in this Figure have been identified from a desktop review of the Planning Portal. Includes applications from 22-02-17 to 30-03-19 within 500m of the project red line boundary – including access tracks

DRAWN: SW  
CHECKED: CW  
APPROVED: KC  
DATE: JUL 2019  
SCALE: 1:5,000 @ A3

PROJECT NUMBER

60320996

DRAWING TITLE

FIGURE 9.1 – Individual Property  
Assessment Sheets (2019 Update)

Sheet 29 of 29



DRAWING NUMBER

60320996/2019/PROP/29

REV

2

Document Path: P:\UK\BLF1-IE\Projects\45457\IBL NS Interconnector\GIS\2019 GIS Updates\02\_Maps\Interconnector\_Landscape\_Planning\_Application\_Update\_20190701\_.mxd

This document has been prepared by AECOM Limited ("AECOM") for the sole use of our Client, and in accordance with generally accepted consultancy principles, the budget for fees and the terms of reference agreed between AECOM and the Client. Any information provided by third parties and referred to herein has not been checked or verified by AECOM, unless otherwise expressly stated in the document. No third party may rely upon this document without the prior and express written agreement of AECOM.

