





Disclaimer

EirGrid and SONI have followed accepted practice in the collection and analysis of data available. While all reasonable care has been taken in the preparation of this statement, EirGrid and SONI/NIE Networks are not responsible for any loss that may be attributed to the use of this information. Prior to taking business decisions, interested parties are advised to seek separate and independent opinion in relation to the matters covered by this statement and should not rely solely upon data and information contained herein. Information in this document does not amount to a recommendation in respect of any possible investment. This document does not purport to contain all the information that a prospective investor or participant in the wholesale electricity market may need. Furthermore, all interested parties are strongly advised to channel any enquiries through EirGrid and SONI.

This document incorporates the Transmission System Capacity Statement for Northern I reland and the Transmission Forecast Statement for Ireland.

For queries relating to this document or to request a copy contact: enquiries@soni.ltd.uk or info@eirgrid.com.

COPYRIGHT NOTICE

All rights reserved. This entire publication is subject to the laws of copyright. This publication may not be reproduced or transmitted in any form or by any means, electronic or manual, including photocopying without the prior written permission of EirGrid and SONI.

©SONI Ltd 2019 12 Manse Rd, Belfast, BT6 9RT, N. Ireland ©EirGrid Plc 2019 The Oval, 160 Shelbourne Road, Ballsbridge, Dublin 4, Ireland

Table of contents

Foreword		1
Documen	t Structure	2
Abbrevia	tion and Terms	3
Executive	e Summary	10
1. Introd	uction	14
1.1.	Governing Arrangements	17
	1.1.1. Roles and Responsibilities (Governance)	17
	1.1.2. Duty to Prepare a Statement	17
	1.1.3. Integrated Single Electricity Market	17
1.2.	Data Management	18
1.3.	Other Information	19
1.4.	Publication	20
2. The Ele	ectricity Transmission System	22
2.1.	Overview of the All-Island Electricity Transmission System	24
2.2.	Existing Connections Between Ireland and	
	Northern Ireland Transmission Systems	26
2.3.	Interconnection with Great Britain and Europe	27
	2.3.1. Moyle Interconnector	29
	2.3.2. East-West Interconnector	29
	2.3.3. Future European Interconnection	29
2.4.	Transmission Development Plans	30
2.5.	Ireland Transmission System Developments	30
	2.5.1. Grid Development Strategy	30
	2.5.2. Reviewing and Improving our Public Consultation Process	31
	2.5.3. Tomorrow's Energy Scenarios	
	2.5.4. Project Delivery	
	2.5.5. Historical Transmission Developments	
	2.5.6. Descriptions of Ireland Development Projects	
2.6.	Northern Ireland Transmission System Developments	
	2.6.1. Grid Development Process	
	• • • • • • • • • • • • • • • • • • • •	
2.7	2.6.3. Projects Not Included in the 2018 TYFTS Analysis	
2.7.	Joint Ireland and Northern Ireland Approved Transmission System Developments	
2.8.	Connection of New Generation Stations	
2.9.	Connection of New Interface Stations	
2.10.	Detailed Transmission Network Information	43

3. Dema	and	44
3.1.	All-Island, Ireland and Northern Ireland Peak Transmission Demand	46
	3.1.1. Large Demand Increases in the Dublin Area	47
3.2.	Demand Data	49
	3.2.1. Generated Peak Demand Profiles	49
	3.2.2. All-Island Demand Profiles	49
	3.2.3. All-Island Weekly Demand Peaks	51
	3.2.4. Load Duration Curves	51
3.3.	Forecast Demand at Transmission Interface Stations in Ireland	52
3.4.	Forecast Demand at Northern Ireland Bulk Supply Points (BSP)	53
4. Gene	ration	54
4.1.	Generation in Ireland	56
	4.1.1. Existing and Planned Transmission Connected Generation	56
	4.1.2. Planned Closure of Generation Plant	57
	4.1.3. Wind Generation	58
	4.1.4. Offshore Generation	59
	4.1.5. Demand Side Units	59
	4.1.6. Embedded Generation	59
4.2.	Generation in Northern Ireland	60
	4.2.1. Existing and Planned Transmission Connected Generation	61
	4.2.2. Planned Retirement/Divestiture of Generation	61
	4.2.3. Northern Ireland Renewable Generation	62
	4.2.4. Demand Side Units	63
	4.2.5. Embedded Generation	64
	4.2.6. Northern Ireland Generation Mix	65
5. Trans	mission System Performance	66
5.1.	Forecast Power Flows	68
5.2.	Compliance with Planning Standards	69
	5.2.1. Ireland	69
	5.2.2. Northern Ireland	
5.3.	Short Circuit Current Levels	70
	5.3.1. Assessment of Short Circuit Current Levels in Ireland	71
	5.3.2. Assessment of Short Circuit Current Levels in Northern Ireland	71
	5.3.3. Maximum Short Circuit Current Results	72
	5.3.4. Minimum Short Circuit Current Results	75

6. Over	view of Transmission System Capability Analyses	76
6.1.	All-Island Demand Opportunity Analysis	78
	6.1.1. Approach for Calculation of Demand Opportunity	78
	6.1.2. Method for Calculating Limits for Increased Demand Connections	80
	6.1.3. Calculation of Capability for Demand in Dublin	82
	6.1.4. Calculation of Capability for Demand at Any Station Outside Dublin	83
6.2.	All-Island Generator Opportunity Analysis	83
	6.2.1. Approach for Calculation of Generation Opportunity	84
6.3.	Factors Impacting On Results	86
7. Trans	mission System Capability for New Generation	88
7.1.	Summary of analysis	90
7.2.	Background	90
7.3.	New Generation Capacity	90
7.4.	Generation Opportunity	91
	7.4.1. At Selected 220 kV, 275 kV and 400 kV Stations	91
	7.4.2. At Selected 110 kV Stations	92
7.5.	Generation Locational Signals and Their Impact on Transmission Network Cap	acity 93
	7.5.1. TLAFs	93
	7.5.2. GTUoS	95
7.6.	Assumptions behind the TLAF and GTUoS models	96
	7.6.1. TLAFs	96
	7.6.2. GTUoS	97
7.7.	How to Use the Information for Generation	97
8. Trans	mission System Capability for New Demand	98
8.1.	Transmission System Demand Capability Obligations	100
8.2.	All-Island Transmission System Capability for New Demand	100
8.3.	Opportunities for New Demand in the Dublin Area	102
	8.3.1. Context	102
	8.3.2. The Dublin Network	102
	8.3.3. Dublin Transmission Development Plans	104
	8.3.4. North Dublin	104
	8.3.5. West Dublin	105
	8.3.6. South Dublin	106
	8.3.7. Impact of Additional Generation & Flexible Demand on	
	North, West and South Dublin	
	8.3.8. Looking Forward	
	8.3.9. Summary	108

8.4.	Transmission System Capability for New Demand in Ireland	108
	8.4.1. Opportunities for New Demand in the Midlands and West	108
	8.4.2. Opportunities for New Demand in the North-East	109
	8.4.3. Opportunities for New Demand in the North-West	109
	8.4.4. Opportunities for New Demand in the South-East	110
	8.4.5. Opportunities for New Demand in the South-West	111
8.5.	Controllable Demand	111
8.6.	Transmission System Capability for New Demand in Northern Ireland	112
	8.6.1. Opportunities for New Demand in East of Northern Ireland	112
	8.6.2. Opportunities for New Demand in West of Northern Ireland	112
8.7.	How to Use the Information for Demand	114
Appendi	x A	116
Appendi	x B	128
Appendi	x C	160
Appendi	x D	176
Appendi	x E	196
Appendi	x F	242
Appendi	x G	246
Appendi	x H	250



Foreword

EirGrid and SONI, as the transmission system operators (TSOs) for Ireland and Northern Ireland respectively, have collaborated to produce this All-Island Ten Year Transmission Forecast Statement (TYTFS).

This statement has been prepared in accordance with the provisions of Section 38 of the Electricity Regulation Act, 1999 (EirGrid) and Condition 33 of SONI's TSO licence.

TYTFS 2018 presents the most up-to-date available transmission system information at the data freeze date of July 2018.

This statement continues to show that data centres now represent significant demand connections in Ireland. A large portion of these data centres are connected or plan to connect in the Dublin area. Depending on the level of demand from these future connections, new large scale generation, transmission solutions, demand side response and/or storage will be required to maintain security of supply in the area.

The system needs in the Dublin area are dynamic due to the connection of these new large scale demand customers combined with potential changes in the connected generation portfolio.

In response to this we have confirmed the need for investment in the greater Dublin area. We are progressing two projects: Capital Project 966 and Capital Project 1021 which together further reinforce the Dublin region. These projects are being developed in line with our consultation and engagement process which is outlined in our "Have Your Say" document. This is available on the EirGrid website¹.

The opportunities to connect new large scale demand in Northern Ireland are dependent on the completion of the planned North – South 400 kV interconnector. This development will increase security of supply in both Northern Ireland and Ireland. It will also support realising the benefits, and the further development, of renewable power generation and provide economic benefits to customers in both jurisdictions.

The results presented in the TYTFS highlight new generation opportunities in the east of the island, and in particular in the east of Northern Ireland and in north Dublin. The results also show that future generation connections in the North-West, West and South-West regions would require network reinforcements.

Those who are considering connecting generation or demand to the transmission systems of Ireland or Northern Ireland should contact us at info@eirgrid.com or enquiries@soni.ltd.uk. We hope you find this document informative and we welcome any feedback and suggestions.



Mark Foley Chief Executive, EirGrid Group



Robin McCormack
Executive Director Operations,
Planning & Innovation,
EirGrid Group

¹ www.eirgridgroup.com/_uuid/7d658280-91a2-4dbb-b438-efoo5a857761/EirGrid-Have-Your-Say_May-2017.pdf

Document Structure

This document contains an Abbreviations and Terms section, an Executive Summary, eight main sections and eight appendices. The structure of the document is as follows:

The **Abbreviations and Terms** provides a list of abbreviations and terms used in the document.

The **Executive Summary** gives an overview of the main highlights of the document.

Chapter 1: Introduction: presents the purpose and context of the All -Island Transmission Forecast Statement. Our statutory and legal obligations are also introduced.

Chapter 2: The Electricity Transmission System: describes the existing all - island transmission system. A brief outline of transmission system development plans for both Ireland and Northern Ireland is also given.

Chapter 3: Demand: describes the demand forecast assumptions over the study period of 2018 – 2027.

Chapter 4: Generation: describes the projected generation connection assumptions over the study period of 2018 – 2027.

Chapter 5: Transmission System Performance: provides information on power flow and short circuit study results.

Chapter 6: Overview of Transmission System Capability Analysis: outlines the analysis me thods used to carry out the demand and generation opportunities' analyses.

Chapter 7: Transmission System Capability for New Generation: describes the opportunities for connection of new generation on the all - island transmission system.

Chapter 8: Transmission System Capability for New Demand: describes the opportunities for connection of new demand on the all- island transmission system.

Appendix A: Maps and Schematic Diagrams

Appendix B: Transmission System Characteristics

Appendix C: Demand Forecasts at Individual Transmission Interface Stations

Appendix D: Generation Capacity and Dispatch Details

Appendix E: Short Circuit Currents

Appendix F: Approaches to Consultation for Developing the Grid

Appendix G: References

Appendix H: Power Flow Diagrams

Abbreviations and Terms

Abbreviations

AC Alternating Current
ACS Average Cold Spell

ATR Associated Transmission Reinforcement

BETTA The British Electricity Trading and Transmission Arrangements

BSP Bulk Supply Point

CCGT Combined Cycle Gas Turbine

CHP Combined Heat and Power

CRU Commission for the Regulation of Utilities

DC Direct Current / Double Circuit

DCCAE Department of Communications, Climate Action and Environment

DfE Department for the Economy

DO Distillate Oil

DSM Demand Side Management
DSO Distribution System Operator

EIDAC EirGrid Interconnector DAC

ESB Electricity Supply Board

ESRI Economic and Social Research Institute

EU European Union

FAQ Firm Access Quantity

GCS Generation Capacity Statement

GIS Gas Insulated Switchgear

HFO Heavy Fuel Oil

HVDC High Voltage Direct Current

IA Interconnector Administrator

IME Internal Market for Electricity

IMP Independent Market Participant

IPP Independent Power Producer

IRL Ireland

ITC Incremental Transfer Capability

kV Kilo Volts

LFG Land Fill Gas

MIL Moyle Interconnector Limited

MCR Maximum Continuous Rating

MEC Maximum Export Capacity

MIC Maximum Import Capacity

MVA Megavolt-Amperes

MW Megawatt

NI Northern Ireland

NIE Northern Ireland Electricity Networks

NTC Net Transfer Capacity

PPB Power Procurement Business

PU Per Unit

PST Phase Shifting Transformer
RES Renewable Energy Schemes

RIDP Renewable Integration Development Project

RMS Root Mean Square

RP Review Period

SEM Single Electricity Market

SONI System Operator for Northern Ireland

SPS Special Protection Scheme

SVC Static Var Compensator

SP Summer Peak
SS Substation

SV Summer Valley

TDP Transmission Development Plan

TDPNI Transmission Development Plan Northern Ireland

TYTFS Ten Year Transmission Forecast Statement

TRM Transfer Reserve Margin

TSO Transmission System Operator

TTC Total Transfer Capacity

TX Transformer

WFPS Wind Farm Power Station

WP Winter Peak

Terms

Active Power The product of voltage and the in-phase component

of alternating current measured in Megawatts (MW). When compounded with the flow of 'reactive power', measured in Megavolt-Amperes Reactive (Mvar), the resultant is measured in Megavolt-Amperes (MVA).

Autumn Peak This is the maximum Northern Ireland demand in the

period September to October inclusive.

Associated Transmission Reinforcement Associated Transmission Reinforcements (ATRs) are

all of the transmission reinforcements that must be completed in order for a generator to be allocated FAQ. ATRs include reinforcements such as line and busbar

upratings, new stations and new lines.

Bulk Supply Point A point at which the Northern Ireland transmission

system is connected to the distribution system.

Busbar The common connection point of two or more circuits.

Capacitor An item of plant normally utilised on the electrical

network to supply reactive power to loads (generally locally) and thereby supporting the local area voltage.

Circuit An element of the transmission system that carries

electrical power.

Combined Cycle Gas Turbine A collection of gas turbines and steam units; waste

heat from the gas turbine(s) is passed through a heat recovery boiler to generate steam for the steam

turbine(s).

Combined Heat and Power A plant designed to produce both heat and electrical

power from a single heat source.

Constraint A transfer limit imposed by finite network capacity.

Contingency The unexpected failure or outage of a system

component, such as a generation unit, transmission line, transformer or other electrical element. A contingency may also include multiple components, which are related by situations leading to simultaneous

component outages.

Commission for Regulation of Utilities The Commission for Regulation of Utilities (CRU) is the

regulator for the electricity, natural gas and public water

sectors in Ireland.

Data Freeze Date The dates on which the Transmission Forecast Statement

data was effectively "frozen" for both EirGrid and SONI. Changes to transmission system characteristics made after these dates do not feature in the analyses carried

out for this Transmission Forecast Statement.

Deep Reinforcement Refers to transmission system reinforcement additional

to the shallow connection that is required to allow a new generator or demand to operate at maximum capacity.

Demand The peak demand figures in Table 3-1 in the introduction

refer to the power that must be transported from transmission system-connected generation stations to meet all customers' electricity requirements. These

figures include transmission losses.

Demand-Side Management The modification of normal demand patterns usually

through the use of financial incentives.

EirGrid plc is the state-owned company established to

take on the role and responsibilities of Transmission System Operator in Ireland as well as market operator of

the wholesale trading system.

EirGrid Interconnector DAC EIDAC is an organisation that is part of the EirGrid Group.

EIDAC owns the East West Interconnector linking the electricity grids in Ireland and Wales. EIDAC sell capacity on the East West Interconnector through auctions.

Embedded Generation Refers to generation that is connected to the distribution

system or at a customer's site.

Firm Access Quantity The level of firm financial access available in the

transmission network for a generator is that generator's Firm Access Quantity or 'FAQ'. Firm financial access means that if a generator is constrained on or off, it is eligible for compensation in the manner set out in the

Trading & Settlement Code.

Gate 2 The term given to the group-processing scheme that

applies to approximately 1,300 MW of renewable generation seeking connection to the transmission and

distribution systems.

Gate 3 The term given to the group-processing scheme that

applies to approximately 10,000 MW of generation seeking connection to the transmission and distribution

systems.

Generation Dispatch The configuration of outputs from the connected

generation units.

Grid Code (EirGrid) The EirGrid Grid Code is designed to cover all material

technical aspects to the operation and use of the transmission system of Ireland. The code was prepared by the TSO (pursuant to Section 33 of the Electricity Regulation Act, 1999) and approved by the CER. The Grid

Code is available on www.eirgrid.com.

Grid Code (SONI) The SONI Grid Code is designed to permit the

development, maintenance and operation of an efficient, co-ordinated and economical transmission system in Northern Ireland. It is prepared by the TSO (SONI) pursuant to condition 16 of SONI's Licence. The

SONI Grid Code is available at www.soni.ltd.uk

Interconnector Administrator An Interconnector Administrator (IA) facilitates the allocation of capacity and energy trading. Trading is

carried out using an Auction Management Platform (AMP) for the Moyle and East West Interconnectors.

Incremental Transfer Capability A measure of the transfer capability remaining in the

physical transmission system for further commercial

activity over and above anticipated uses.

Interconnector The tie line, facilities and equipment that connect the

transmission system of one independently supplied

transmission system to that of another.

Integrated Single Electricity Market The Integrated Single Electricity Market (SEM) is the

wholesale electricity market operating in Ireland and Northern Ireland. Further information is available at www.sem-o.com/ and www.semcommittee.com/

Loadflow Study carried out to simulate the flow of power on the

transmission system given a generation dispatch and

system load.

Maximum Continuous Rating

The maximum capacity (MVA) modified for ambient temperature conditions that the circuit can sustain

indefinitely without degradation of equipment life.

The MCR of a generator is the maximum capacity (MW) modified for ambient temperature conditions that the generation unit can sustain indefinitely without degradation of equipment life. All generation capacity figures in this Transmission Forecast Statement are maximum continuous ratings (defined as its MCR at 10 °C), expressed in exported terms i.e., generation unit

output less the unit's own load.

Maximum Export Capacity The maximum export value (MW) provided in accordance

with the generator's connection agreement. The MECs are contract values which the generator chooses to cater for peaking under certain conditions that are not normally achievable or sustainable e.g., a CCGT plant can produce greater output at lower temperatures.

Node Connecting point at which several circuits meet.

Node and station are used interchangeably in this

Transmission Forecast Statement.

Parametric Analysis (P-V) curves A parametric study involves a series of power flows that

monitor the changes in one set of power flow variables with respect to another in a systematic fashion. In this Transmission Forecast Statement the two variables are

voltage and ITC.

Per Unit (pu.) Ratio of the actual electrical quantity to the selected

base quantity. The base quantity used here for calculation of per unit impedances is 100 MVA.

Phase Shifting Transformer An item of plant employed on the electrical network to

control the flow of active power.

Power Factor The power factor of a load is a ratio of the active power

requirement to the reactive power requirement of the

load.

Reactive Compensation The process of supplying reactive power to the network.

Reactor An item of plant employed on the electrical network to

either limit short circuit levels or prevent voltage rise depending on its installation and configuration.

Shallow Connection Shallow Connection means the local connection assets

required to connect a customer to the Transmission System and which are for the specific benefit of that

particular customer.

SONI System Operator for Northern Ireland (SONI) Ltd is

owned by EirGrid plc. SONI ensures the safe, secure and economic operation of the high-voltage electricity system in Northern Ireland and in cooperation with EirGrid is also responsible for running the all-island

wholesale market for electricity.

Split Busbar Refers to the busbar(s) at a given substation which is

operated electrically separated. Busbars are normally split to limit short circuit levels or to maintain security of

supply.

Static Var Compensator Device which provides fast and continuous capacitive

and inductive reactive power supply to the power

system.

Summer Valley This is the minimum system demand. It occurs in the

period March to September, inclusive in Ireland and May

to August, inclusive in Northern Ireland

Summer Peak This is the maximum system demand in the period

March to September, inclusive in Ireland and May to

August, inclusive in Northern Ireland.

Tee Connection Un-switched connection into existing line between two

other stations.

Total Transfer Capability The total capacity available on cross-border circuits

between Ireland and Northern Ireland for all flows, including emergency flows that occur after a

contingency in either system.

Transformer An item of equipment connecting busbars at different

nominal voltages. (see also Phase Shifting Transformer)

Transmission Interface Station A station that is a point of connection between the

transmission system and the distribution system or

directly-connected customers.

Transmission Losses A small proportion of energy is lost mainly as heat whilst

transporting electricity on the transmission system. These are known as transmission losses. As the amount of energy transmitted increases, losses also increase.

Transmission Peak The peak demand that is transported on the

transmission system. The transmission peak includes an

estimate of transmission losses.

Transmission Planning Criteria The set of standards that the transmission system of

Ireland is designed to meet.

Transmission System The transmission system is a meshed network of high-

voltage lines and cables (400 kV, 275 kV, 220 kV and 110 kV) for the transmission of bulk electricity supply around Ireland and Northern Ireland. The transmission system and network are used interchangeably in this

Transmission Forecast Statement.

Uprating To increase the rating of a circuit. This is achieved

by increasing ground clearances and/or replacing conductor, together with any changes to terminal

equipment and support structures.

Utility Regulator (UR)

UR is an independent non-ministerial government

department set up to ensure the effective regulation of the Electricity, Gas and Water and Sewerage industries

in Northern Ireland.

Winter Peak This is the maximum annual system demand. It occurs in

the period October to February, inclusive in Ireland and in the Period November to February in Northern Ireland.

EirGrid and SONI – Ten Year Transmission Forecast Statement 2018 • Page 9

Executive Summary

The All-Island Ten Year Transmission Forecast Statement (TYTFS) 2018 provides the following information:

- Network models and data of the all-island transmission system;
- Forecast generation capacity and demand growth;
- Maximum and minimum fault levels at transmission system stations;
- Predicted transmission system power flows at different points in time; and
- Demand and generation opportunities on the transmission system.

TYTFS 2018 is prepared in accordance with the statutory regulations outlined in Table S-1.

Table S-1: Statutory Regulations requiring the TSOs to produce a Transmission Forecast Statement

Ireland	Northern Ireland
Section 38 of the Electricity Regulation Act 1999	Condition 33 of the Licence to participate in the
(as amended)	Transmission of Electricity

TYTFS 2018 describes the transmission system on the island of Ireland from 2018 to 2027. EirGrid and SONI have jointly prepared TYTFS 2018. This document supersedes the All-Island Ten Year Transmission Forecast Statement 2017-2026.

This document presents the most up-to-date information available for the all-island transmission system at the data freeze date of July 2018. Where applicable we provide information on transmission system projects under development. Where multiple solutions are presented for a transmission system project, no particular preference is given to one solution².

In recent years there has been an increase in activity in the demand sector. The demand forecast used in our analysis is the median all-island transmission peak demand forecast which is taken from All-Island Generation Capacity Statement 2018-2027 (GCS)³. The demand forecast represents an average annual increase in all-island winter peak demand of 2.0% over the period of GCS 2018-2019⁴. This represents an increase in demand forecast since GCS 2017-2026, when the forecast average annual increase in all-island winter peak demand was 1.0%⁵.

This TYTFS shows that data centres now represent significant demand connections in Ireland. A large portion of these data centres are connected or plan to connect in the Dublin area. Depending on the level of demand connections, new large scale generation, transmission solutions, demand side response and/or storage will be required to maintain security of supply in the area.

The system needs in the Dublin area are dynamic due to the connection of these new large scale demand customers combined with potential changes in the connected generation portfolio.

In response to this we have confirmed the need for investment in the greater Dublin area. We are progressing two projects: Capital Project 966 and Capital Project 1021 which together further reinforce the Dublin region. We are progressing these projects in line with our consultation and engagement process which is outlined in our "Have Your Say" document. This is available on the EirGrid website⁶.

² In line with our strategy to consider all practical technology options for network development.

³ www.eirgridgroup.com/site-files/library/EirGrid/Generation Capacity Statement 2018.pdf

⁴ The cumulative forecast increase in demand over the period of GCS 2018-2027 is 22%.

⁵ The cumulative forecast increase in demand over the period of GCS 2017-2026 was 11%.

⁶ www.eirgridgroup.com/_uuid/7d658280-91a2-4dbb-b438-ef005a857761/EirGrid-Have-Your-Say_May-2017.pdf

The all-island renewable generation capacity is expected to increase rapidly over the period of this statement, reaching approximately 8,500 megawatts (MW) of generation capacity. Onshore wind contributes to the majority of renewable generation. However, there has recently been a significant increase in solar generation applications? In addition, in March 2019 the Irish Minister for Communications, Climate Action and Environment, Richard Bruton, announced that he intends to set a target of 70% of electricity from renewable energy sources by 2030. In order to meet this target, investment will be needed in new renewable generation capacity, system service infrastructure and electricity networks. As noted in GCS 2018 some large conventional plants, with a total capacity of approximately 1,900 MW, are expected to retire in the period.

TYTFS 2018 includes maximum and minimum short circuit current levels at transmission system stations. This information is given at each 110 kilovolt (kV), 220 kV, 275 kV and 400 kV transmission system station. Short circuit levels at each transmission system station are given for the following years: 2018; 2021; and 2024.

Results show that several stations on the island are approaching, or have the potential to exceed, their rated short circuit current level. This can be seen in the maximum short circuit current level analysis, when there are high generation levels on the system. We manage the transmission system to mitigate possible risks while investment plans are in place to resolve these issues. Information on short circuit current levels is presented in Chapter 5.

Interconnection with neighbouring countries offers many benefits, which include:

- Enhancing the security of supply of the transmission system;
- Facilitating the integration of variable renewable generation; and
- Facilitating greater competition and the potential for wholesale electricity prices to be reduced.

The benefits arise because interconnection gives the transmission system access to a wider generation base, and gives generators here access to a wider demand base.

Our analyses include the Moyle and East-West Interconnector (EWIC) high voltage direct current (HVDC) interconnectors. These interconnectors connect the all-island transmission system to the Great Britain transmission system. While no connection offers were in place for further interconnection at the data freeze date, EirGrid is processing two interconnector applications following a CRU direction. The two applications are the proposed Celtic Interconnector between Ireland and France, and the proposed Greenlink Interconnector between Ireland and Great Britain.

Our analyses assume the planned North – South 400 kV interconnector is in place in winter 2023. The results of the analyses performed for TYTFS 2018, post 2023, are therefore dependent on the North South reinforcement being commissioned. The reinforcement will increase security of supply in both Northern Ireland and Ireland. It will also support realising the benefits, and further the development, of renewable power generation and provide economic benefits to customers in both jurisdictions. Information on the North - South 400 kV interconnector is presented in Chapter 2.

TYTFS 2018 includes information on generation and demand opportunities for interested parties. This information is based on assessments and studies carried out on an all-island basis. The methodologies applied to the all-island opportunity analyses are presented in Chapter 6. Information on opportunities is presented in Chapter 7 and Chapter 8.

The all-island generation opportunities assessment in Chapter 7 provides information for generators wishing to connect to the transmission system. Generator opportunity is assessed at a number of 110 kV, 220 kV, 275 kV and 400 kV nodes across the all-island transmission system.

⁷ See Chapter 4 Generation for more information on the increase in solar generation applications.

The results show that there are opportunities for new generation of significant scale close to the large demand centres in the east of the island, in particular in the east of Northern Ireland and in north Dublin. The results also show that future generation connections in the North-West, West and South-West regions would require network reinforcements.

Regional changes in locational tariff signals are also described in Chapter 7. This information is provided to help network users make informed decisions when exploring potential transmission network connection locations. Regions with surplus generation capacity in the South West, West and North West of Ireland have lower Transmission Loss Adjustment Factors and higher Generator Transmission Use of System charges than Eastern regions with higher demand levels and less surplus generation.

The all-island demand opportunity results, based on the 2024 transmission system, are presented in Chapter 8. The study indicates that a significant number of stations across the island have the capability to accommodate demand connections, some to a lesser degree than others. The planned North-South 400 kV interconnector improves the generation adequacy situation in Northern Ireland. It is also an important factor when considering the capacity of the system to connect significant amounts of additional demand in Northern Ireland.

Chapter 8 also includes a qualitative assessment of the demand capability in the Dublin area. This assessment has been included as a result of the recent large volume of data centre connections and enquires in the Dublin area. The Dublin area assessment provides:

- A description of the Dublin transmission network;
- Areas of focus for demand connections in Dublin and the scale of interest in each zone; and
- Planned transmission developments in Dublin.

The results of demand and generation opportunity analyses are based on high level transmission network assessments. The results provide guidance, the actual connection capacity and possible connection solutions can only be determined following detailed individual connection studies. We will continue to examine innovative solutions and technologies in response to future connection enquiries.


Those who are considering connecting generation or demand to the transmission systems of Ireland or Northern Ireland should contact us. It is advisable to consult us early in the project process. In Ireland customers can contact us at info@eirgrid.com while in Northern Ireland customers can contact us at enquiries@soni.ltd.uk for further information.



All-Island Ten Year

Transmission Forecast
Statement 2018

1. Introduction

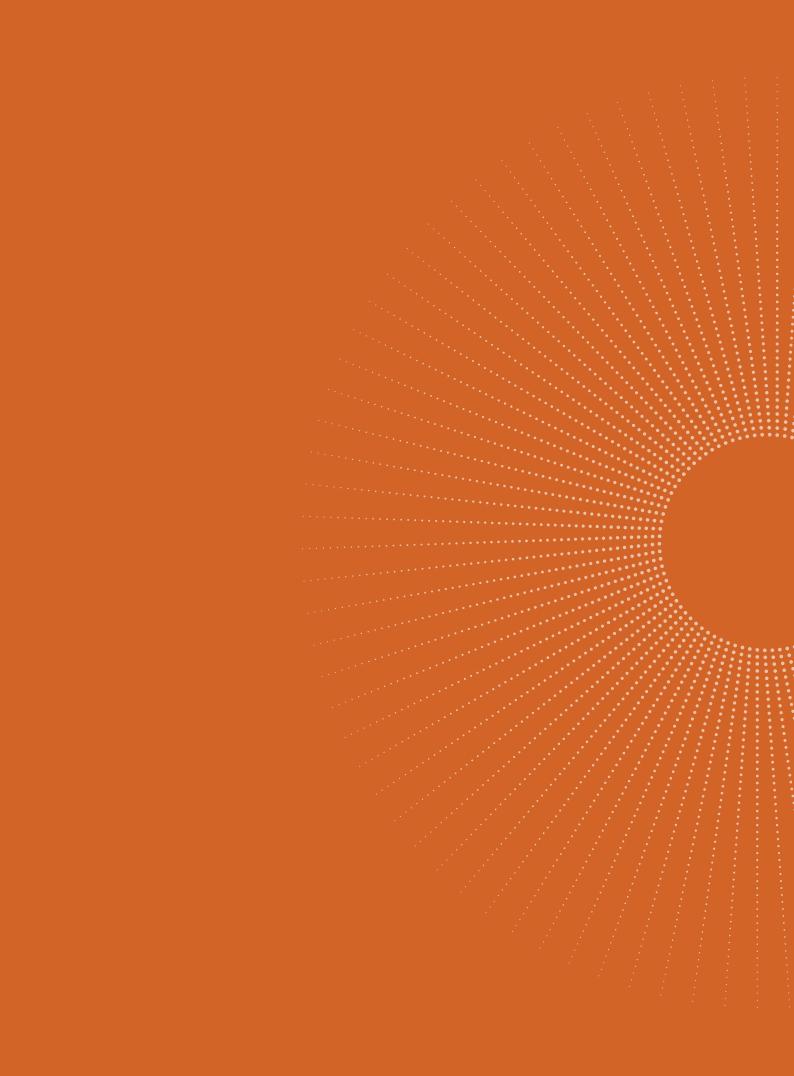

1. Introduction

The transmission system is a network of 400 kV, 275 kV, 220 kV and 110 kV high-voltage lines and cables. It is the backbone of the power system, efficiently delivering large amounts of power from where it is generated to where it is needed.

EirGrid is the Transmission System Operator (TSO) in Ireland, while SONI is the TSO in Northern Ireland. As TSOs, we jointly prepare and publish the All-Island Ten Year Transmission Forecast Statement (TYTFS) each year.

EirGrid plans and develops the transmission system in Ireland to ensure it meets forecast transmission system operating conditions. SONI is responsible for planning and operating the transmission system in Northern Ireland within defined security standards.

The TYTFS 2018 provides information on:

- Planned network developments;
- Electricity demand growth;
- Generation capacity; and
- Interconnection with other electricity transmission systems.

The TYTFS can be used by users and potential users of the transmission system to identify opportunities to connect to and make use of the transmission system. The appendices provide further information and transmission system data to enable the reader to perform power flow analysis.

When using data provided in the TYTFS 2018, readers should consider other documents we produce, or are involved in producing, including⁸:

- All-Island Generation Capacity Statement (GCS);
- EirGrid's Transmission Development Plan for Ireland;
- SONI's Transmission Development Plan for Northern Ireland; and
- European Network of Transmission System Operators for Electricity's (ENTSO-E's) Ten Year Network Development Plan for Europe.

Generation Capacity Statement 2018-2027 outlines demand forecasts and assesses the generation adequacy of the island of Ireland from 2018 to 2027. Where possible the TYTFS 2018 complements the demand information presented in the GCS.

EirGrid publishes a Transmission Development Plan (TDP) for Ireland each year. The recent TDP is available on the EirGrid website. SONI published its first Transmission Development Plan Northern Ireland 2018-2027 (TDPNI) in 2018 under Condition 40 of its TSO licence. The TDPs for Ireland and Northern Ireland provide details of the transmission system developments expected to be progressed in Ireland and Northern Ireland in the coming 10 years. These transmission system developments are also included in the data, assumptions and analyses in the TYTFS.

The European Network of Transmission System Operators for Electricity (ENTSO-E) publishes a Ten Year Network Development Plan (TYNDP) every two years. The TYNDP outlines projects of pan European significance.

⁸ Our publications are available at www.eirgridgroup.com and www.soni.ltd.uk/

1.1. Governing Arrangements

1.1.1. Roles and Responsibilities (Governance)

Northern Ireland

Under our licence in Northern Ireland, held by SONI, we are required to plan⁹ and operate the Northern Ireland Transmission System.

In doing so we must comply with both the SONI Transmission System Security and Planning Standards (TSSPS) and the SONI Grid Code.

Ireland

Under our licence in Ireland, held by EirGrid, we are required to operate, develop and ensure the maintenance of the Irish Transmission System.

In doing so we must comply with both the EirGrid TSSPS and the EirGrid Grid Code.

1.1.2. Duty to Prepare a Statement

EirGrid and SONI are each required to publish a Transmission Forecast Statement in line with the Statutory Regulations in Table 1-1. Since 2012 we have jointly prepared and produced an all-island document, following an agreement with the Regulatory Authorities in Ireland¹⁰ and Northern Ireland¹¹.

Table 1-1: Statutory Regulations requiring the TSOs to produce a Transmission Forecast Statement

Ireland	Northern Ireland
Section 38 of the Electricity Regulation Act 1999 (as amended)	Condition 33 of the Licence to participate in the Transmission of Electricity

TYTFS 2018 has been prepared in accordance with and in fulfilment of these obligations. The format was approved by the Commission for Regulation of Utilities (CRU) and the Utility Regulator (UR).

1.1.3. Integrated Single Electricity Market

A Single Electricity Market (SEM) has been operating on the island of Ireland, since 2007. The allisland wholesale electricity market allows customers in both Ireland and Northern Ireland to benefit from increased competition. This in turn allows customers to benefit from reduced energy costs and improved reliability of supply.

The model of the SEM changed considerably on 1 October 2018 to take account of the requirements of the European Network Codes¹² and the Target Model¹³. The new market design is called the Integrated - Single Electricity Market (SEM¹⁴).

The transmission systems of Ireland and Northern Ireland are electrically connected by means of a 275 kV tie-line. This tie-line connects Louth station in Co. Louth (Irl) to Tandragee station, in Co. Armagh (NI).

⁹ Under the direction of the Utility Regulator (NI), investment planning functions are now the responsibility of SONI as of May 2014 (ref: Commission Decisions 12.4.2013 pursuant to Article 3(1) of Regulation (EC) No 714/2009 and Article 10(6) of Directive 2009/72/EC – United Kingdom (Northern Ireland) – SONI / NIE).

¹⁰ The Commission for Regulation of Utilities is the Regulatory Authority in Ireland.

¹¹ The Utility Regulator is the Regulatory Authority in Northern Ireland.

 $^{{\}tt 12} \underline{\ \, https://www.entsoe.eu/major-projects/network-code-development/Pages/default.aspx}$

¹³ https://www.entsoe.eu/about-entso-e/market/long-term-market-design/Pages/default.aspx

¹⁴ Further information on the SEM is available on http://www.sem-o.com/isem/Pages/Home.aspx

There are also two 110 kV connections between Ireland and Northern Ireland:

- Letterkenny station in Co. Donegal (Irl) and Strabane station in Co. Tyrone (NI); and
- Corraclassy station in Co. Cavan (Irl) and Enniskillen station in Co. Fermanagh (NI).

Generation on the transmission systems of Ireland and Northern Ireland are dispatched on an allisland basis. The TYTFS transmission network models are also dispatched in this manner, to reflect how the all-island transmission system is operated.

1.2. Data Management

Transmission system development is continuously evolving. A data freeze date of July 2018 applies to TYTFS 2018, with all information correct at that date. All data for system model files, and sequence data for use with short circuit current level analysis, was collected on this date. A data freeze date enables us to:

- Perform analyses:
- · Update system models; and
- Update the appendices of TYTFS 2018.

Since the data freeze, a number of changes in the following areas have emerged. The capital approval (CP) numbers enable readers to cross reference transmission projects in Ireland with the TDP.

The following transmission system developments have been initiated as projects:

- CP1040 Rosspile 110 kV New Station;
- CP1041 Timahoe North 110 kV New Station;
- CP1043 Gafney 110 kV New Station Temporary Connection;
- CP1048 Richmond 110 kV Station Power Flow Control Scheme;
- CP1051 Gallanstown 110 kV New Station;
- CP1052 Knocknamona 110 kV New Station;
- CP1055 Harristown 110 kV New Station;
- CP1057 Derrycarney 110 kV New Station; and
- Additional Shunt Reactors at Substations in Northern Ireland.

The expected completion date of the following transmission system developments have changed by one year or more:

- CPo585 Laois Kilkenny Reinforcement;
- CPo692 Inchicore 220 kV Redevelopment;
- CP0792 Finglas 220 kV Redevelopment;
- CPo799 Louth Station Redevelopment;
- CPo8o8 Maynooth Station Redevelopment;
- CPo933 Thurles Statcom;
- CPo934 Ballynahulla Statcom;

- CPo935 Ballyvouskil Statcom;
- CP0949 New 110 kV Station close to Kilbarry 110 kV Station;
- CPo972 Wexford 110 kV Busbar Uprate; and
- Omagh Main Dromore Restring.

Some of the reasons for delays are as follows:

- Difficulty in facilitating lengthy outages particularly for complex station projects that impact on security of supply;
- Difficulty gaining access to land particularly for line uprate projects;
- Changes in the scope of a project due to unforeseen complexities post intrusive site investigations; and
- Third party construction issues or delays impacting construction timelines which disrupt the outage programme.

EirGrid and SONI continuously review the need for a project as it goes through our respective grid development planning processes. If a project is no longer needed we cancel it.

The following transmission system developments have been cancelled as projects:

- Coleraine Reactive Compensation;
- Omagh Reactive Compensation; and
- Tamnamore Reactive Compensation.

The following transmission system developments have been completed:

- CPo6o6 Knockacummer Windfarm Permanent Connection;
- CPo756 Cauteen Tipperary 110 kV Line Uprate;
- CPo760 Poolbeg 220 kV Station Reactors;
- CPo830 Raffeen Trabeg No. 1 110 kV Line Uprate;
- CPo870 Carrick-on-Shannon Arigna T Corderry 110 kV Line Uprate;
- CPo926 Slievecallan 110 kV New Station;
- CPo987 Snugborough 110 kV New Station; and
- Curraghmulkin Cluster Substation.

The following transmission system developments are under review:

Not applicable.

1.3. Other Information

Potential users of the transmission system should also be aware of the following key documents:

- SONI Grid Code¹⁵;
- EirGrid Grid Code¹⁶;

¹⁵ http://www.soni.ltd.uk/customer-and-industry/general-customer-information/grid-code/

¹⁶ http://www.eirgridgroup.com/site-files/library/EirGrid/GridCodeVersion6.pdf

- SONI Transmission System Security and Planning Standards¹⁷;
- The Electricity Safety, Quality and Continuity Regulations¹⁸ (Northern Ireland) 2012;
- EirGrid Transmission System Security and Planning Standards¹⁹;
- EirGrid Operating Security Standards²⁰;
- SONI Transmission Connection Charging Methodology Statement²¹;
- EirGrid Transmission Connection Charging Methodology Statement 2008²²;
- EirGrid Statement of Charges 2018/2019²³;
- Statement Of Charges For Use of Northern Ireland Electricity Ltd Transmission System²⁴;
- All-Island Generation Capacity Statement 2018-2027²⁵;
- EirGrid Transmission Development Plan for Ireland²⁶; and
- SONI Transmission Development Plan for Northern Ireland²⁷.

1.4. Publication

The TYTFS 2018 is available in pdf format on our websites:

- www.eirgridgroup.com; and
- www.soni.ltd.uk/.

For a hard-copy version, please send a request to info@eirgrid.com or enquiries@soni.ltd.uk.

Transmission system model files are also available on both websites.

¹⁷ http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf

¹⁸ http://www.legislation.gov.uk/nisr/2012/381/pdfs/nisr 20120381 en.pdf

¹⁹ http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf

²⁰ http://www.eirgridgroup.com/site-files/library/EirGrid/Operating-Security-Standards-December-2011.pdf

 $^{{\}tt 21\,http://www.soni.ltd.uk/media/SONl-Transmission-Connection-Charging-Methodology-Statement-Effective-1-Sept-2016-Approved-by-UR.pdf}$

²² http://www.eirgridgroup.com/site-files/library/EirGrid/Connection-Charging-Statement.pdf

²³ http://www.eirgridgroup.com/site-files/library/EirGrid/CER-Approval-Statement-of-Charges-2018 19.pdf

 $^{{\}bf 24 \ http://www.soni.ltd.uk/media/documents/Customers/TUOS/Charging-Statements/Final\%2oTUoS\%2oStatement\%2oof\%2oCharges\%2o2017-18.pdf}$

²⁵ http://www.eirgridgroup.com/site-files/library/EirGrid/Generation Capacity Statement 2018.pdf

²⁶ http://www.eirgridgroup.com/site-files/library/EirGrid/TDP 2017 Final for Publication.pdf


²⁷ http://www.soni.ltd.uk/the-grid/projects/tdpni-2018-27/the-project/



All-Island Ten Year

Transmission Forecast
Statement 2018

2. The Electricity Transmission System

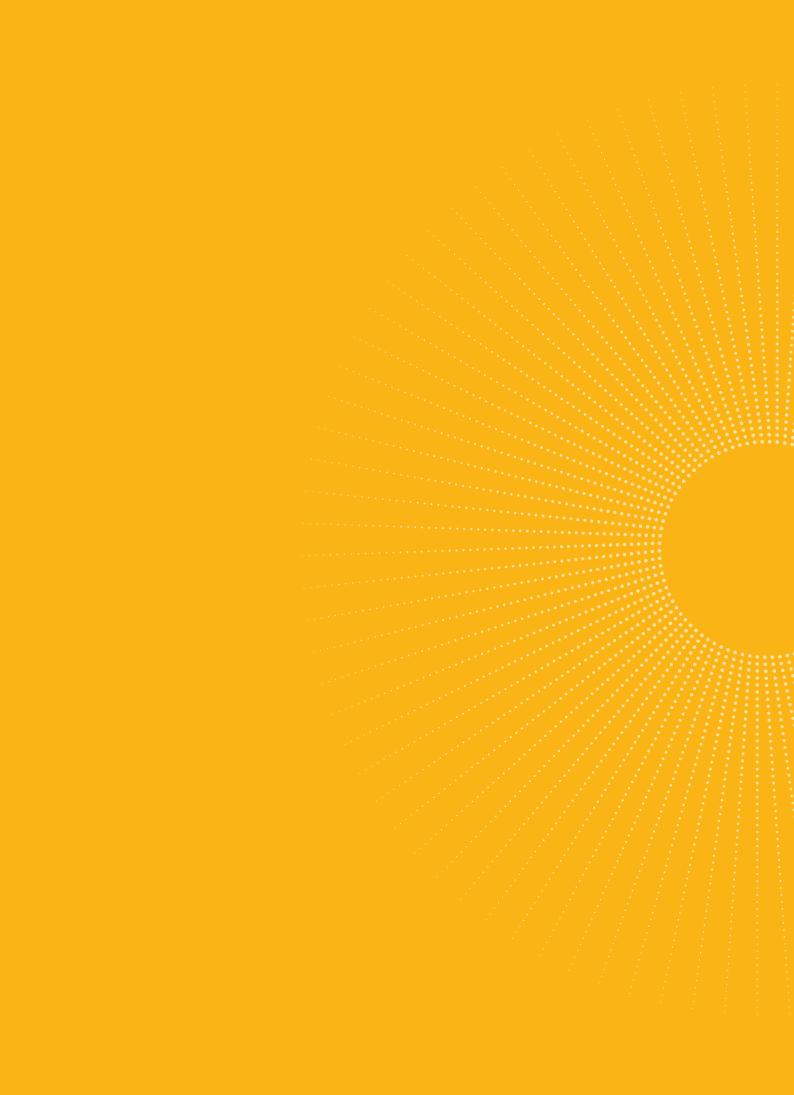

2. The Electricity Transmission System

2.1. Overview of the All-Island Electricity Transmission System

The transmission system in Ireland and Northern Ireland plays a vital role in the supply of electricity. It provides the means to transport energy from generators to demand centres across the island.

The transmission system in Northern Ireland is operated at 275 kV and 110 kV. The transmission system in Ireland is operated at 400 kV, 220 kV and 110 kV. The two transmission systems are connected by means of one 275 kV double circuit, from Louth station in Co. Louth (Irl) to Tandragee station in Co. Armagh (NI). There are also two 110 kV connections:

- Letterkenny station in Co. Donegal (Irl) to Strabane station in Co. Tyrone (NI); and
- Corraclassy station in Co. Cavan (Irl) to Enniskillen station in Co. Fermanagh (NI).

See Section 2.2 below for further information on the existing transmission connections between Ireland and Northern Ireland.

EirGrid and SONI together operate the transmission systems - North and South - on an all-island basis.

The 400 kV, 275 kV and 220 kV networks form the backbone of the transmission system. They have higher power carrying capacity and lower losses than the 110 kV network.

In Ireland, the 400 kV network provides a high capacity link between the Moneypoint generation station on the west coast and Dublin on the east. We are planning a new 400 kV interconnector between Ireland and Northern Ireland called the North South Interconnector. For the purposes of the 2018 TYTFS analysis, this project was anticipated to be installed by the end of 2023.

In Northern Ireland the 275 kV network is comprised of:

- A double circuit ring;
- A double circuit spur to Coolkeeragh Power Station; and
- A double circuit spur southwards into Co. Louth, in Ireland.

In Ireland the transmission network is comprised of single circuit lines which are interconnected to cover the wider geographical distances between stations. Typically large generation stations (greater than 200 MW) are connected to the 220 kV or 400 kV networks.

The 110 kV²⁸ circuits provide parallel paths to the 220 kV, 275 kV and 400 kV networks and are the most extensive element of the all-island transmission system, reaching into every county on the island of Ireland.

The all island transmission system is generally comprised of overhead lines. There are exceptions to this, such as in the city centres of Belfast, Cork and Dublin, where underground cables are used. Table 2-1 presents the total lengths of overhead lines²⁹ and cables at the different voltage levels. Revision of individual line lengths may change following completion of network development projects.

²⁸ A number of radial 110 kV circuits in Ireland and the 110 kV lines and cables within Dublin City are operated by the Distribution System Operator (DSO). The DSO licence is held by ESB Networks. Details of the distribution network in Dublin are not included in this All-Island Ten Year Transmission Forecast Statement.

²⁹ Some lines may contain short sections of cable.

Table 2-1: Total Length of Existing Transmission System Circuits as at the Data Collection Freeze Date (July 2018)

Voltage Level (kV)	Total Circuit Lengths (km)
400	439
275	877
220	1,946
110	6,639

Transformers located at substations link the different voltage networks together providing paths for power flow between voltage levels. The total transformer capacity between the different voltage levels on the all-island system is presented in Table 2-2.

Table 2-2 Total Transmission System Transformer MVA Capacity as at the Data Collection Freeze Date (July 2018)

Voltage Levels (kV)	Capacity (MVA)	Number of transformers
400/220	3,550	7
275/220	1,200	3
275/110	4,080	17
220/110	13,174	64

Reactive compensation devices are used to improve transmission system voltages in local areas. Existing reactive compensation devices connected to the transmission system include shunt capacitors, static var compensators (SVCs) and shunt reactors.

Capacitors and SVCs help to support local voltages in areas where low voltages may otherwise occur. Shunt reactors suppress voltages in areas where they would otherwise be too high, most likely during periods of low demand and/or high wind. Table 2-3 displays the reactive compensation on the all-island transmission system.

Table 2-3 Total Reactive Compensation³⁰ as at the Data Collection Freeze Date (July 2018)

Voltage Level (kV)	Туре	Capacity (Mvar)	Number of Devic- es
400	Line Shunt Reactor	160	2
400	Voltage Source Converter Interconnector	+/- 175	1
275	Shunt Capacitor	236	4
220	Shunt Reactor	150	2
440	Static Var Compensator	90	2
110	Shunt Capacitor	816	46
38	Shunt Reactor	100	5
33	Shunt Capacitor	29	5
	Shunt Reactor	210	7
22	Shunt Capacitor	125	5
	Shunt Capacitor	75.4	14
20	Shunt Reactor	9	1

2.2. Existing Connections Between Ireland and Northern Ireland Transmission Systems

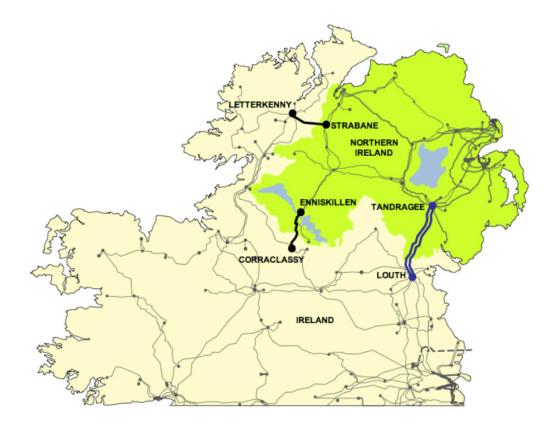


Figure 2-1 Existing Cross-Border Circuits

³⁰ Details of existing reactive compensation devices are provided in Table B-6 in Appendix B. This table includes reactive compensation not on the transmission system but modelled in the studies used in the TYTFS.

As illustrated in Figure 2-1, the transmission systems of Ireland and Northern Ireland are connected via a double circuit 275 kV line. This line connects the Northern Irish transmission system at Tandragee to the Irish transmission system in Louth. There are three 275/220 kV transformers in Louth station, one 600 MVA unit and two ganged³¹ 300 MVA units.

The design capacity of each of the 275/220 kV cross-border circuits is 600 MVA. However, the actual capacity of the circuits to accommodate transfers between the two systems at any time depends on the prevailing system conditions on either side of the border. This includes the ability to deal with system separation.

In addition to the main 275/220 kV double circuit, there are two 110 kV connections:

- One between Letterkenny, Co. Donegal and Strabane, Co. Tyrone; and
- One between Corraclassy, Co. Cavan and Enniskillen, Co. Fermanagh.

The purpose of these 110 kV circuits is to provide support to either system in certain system conditions. Phase shifting transformers (PSTs) in Strabane and Enniskillen are used to control the power flow under normal conditions.

2.3. Interconnection with Great Britain and Europe

Transmission grids are often interconnected so that energy can flow from one country to another. By linking to other transmission systems, we can:

- Increase the diversity and security of energy supplies;
- Facilitate competition in the European market; and
- Aid the transition to a low carbon energy sector by integrating renewable sources.

This helps provide a safe, secure, reliable and affordable energy supply for everybody.

The East West Interconnector links the electricity grids in Ireland and Wales, while the Moyle Interconnector links the electricity grids in Northern Ireland and Scotland.

Power can be either imported or exported on the interconnectors. Interconnector power flows have system impacts that need to be managed operationally. For example, during times of import conventional generation is displaced by these non-synchronous power sources. This reduces the all-island system inertia³². Interconnector flows can also have implications for the system frequency and transmission system stability and operation. Frequency changes are faster in transmission systems with low rotational inertia, making frequency control and system operation more challenging.

The Moyle Interconnector also increases the dynamic reactive support required by the transmission system as the link does not have dynamic reactive power export capability³³.

SONI acts as Interconnector Administrator (IA) for the East West and Moyle interconnectors.

Interconnector capacity is auctioned by the IA on behalf of EirGrid Interconnector DAC (EIDAC)³⁴ and Moyle Interconnector Limited (MIL)³⁵. The capacity is purchased by market participants and utilised in the wholesale electricity markets on the islands of Ireland and Great Britain. Figure 2-2 shows the location of the Moyle Interconnector and EirGrid East-West Interconnector.

³¹ Plant connected in parallel through common switchgear.

³² System inertia is also reduced by the increased wind penetration (another form of non-synchronous generation).

³³ Unlike Moyle the East West Interconnector has dynamic reactive power export capability.

³⁴ http://www.eirgridgroup.com/customer-and-industry/interconnection/

³⁵ http://www.mutual-energy.com/electricity-business/

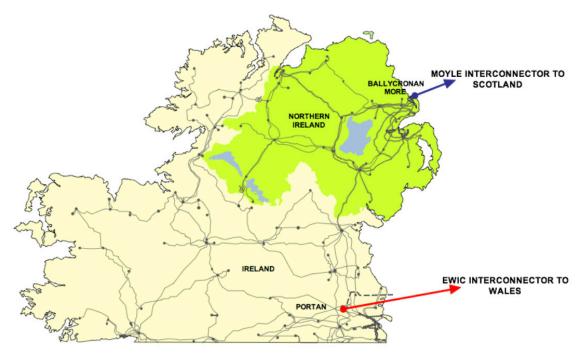


Figure 2-2 Existing Interconnectors

The amount of power that is permitted to be traded between Ireland and Wales across the East-West Interconnector is detailed in Table 2-4.

The available capacity is measured at the ISEM and BETTA market reference point in Deeside 400 kV station in Wales.

Table 2-4 Contracted Capacity on EWIC Interconnector

Direction	Summer (MW)	Winter (MW)
WAL – IRL	500	500
IRL – WAL	500	500

The amount of power that can be traded between Northern Ireland and Scotland across the Moyle Interconnector is detailed in Table 2-5.

Table 2-5 Capacity on Moyle Interconnector

Direction	Direction	Direction	Direction
	May – August	80 – 287 MW	NG/ GB System
West to East	September – April	80 – 295 MW	NG/ GB System SONI/NI System
Fact to Wast	April - October	410 MW	SONI/NI System
East to West	November - March	450 MW	NG/ GB System

2.3.1. Moyle Interconnector

The Northern Ireland transmission system is currently connected to Scotland via a 500 MW High Voltage Direct Current (HVDC) link, the Moyle Interconnector. It is a Line Commutated Converter (LCC) HVDC link, which commenced full commercial operation in 2002.

It is constructed as a dual monopole HVDC link with two coaxial sub-sea cables from Ballycronan More in Islandmagee, Northern Ireland to Auchencrosh in Ayrshire, Scotland. The link has a physical installed capacity of 500 MW. The link has the capacity to provide reserve of up to 75 MW should the frequency on the island drop below 49.4 Hz.

The convertor station at Ballycronan More is looped into one of the 275 kV Ballylumford to Hannahstown circuits. The Moyle link is self-compensating for reactive power losses. There are 4×59 Mvar capacitor banks at the Ballycronan More converter station with three of these capacitor banks acting as filters.

Where there are faults on the transmission system, effects are limited to a brief distortion of the HVDC 50 Hz AC synchronous waveform in import mode. The rapid response means that the HVDC link can have a net stabilising effect on the transmission system in the event of generation loss.

2.3.2. East-West Interconnector

The East-West Interconnector is a 500 MW HVDC link which runs between Woodland, County Meath in Ireland and Deeside in North Wales. The link comprises approximately 186 km of sub-sea cable and 76 km of land underground cable.

The East-West Interconnector uses Voltage Source Converter (VSC) technology. VSC technology offers independent and rapid control of active and reactive power. It does not suffer from commutation failures, and is capable of offering emergency power control in the event of low or high frequency events.

In addition, due to the VSC technology, the East-West Interconnector provides black start capability. The link can operate in either voltage control or reactive power control mode independently in both converter stations. It can supply or absorb up to 175 Mvar at Portan 400 kV station which is connected directly to Woodland 400 kV station. The East-West Interconnector commenced commercial operation in December 2012.

2.3.3. Future European Interconnection

Currently, there are two proposed interconnectors that are deemed Projects of Common Interest (PCIs) by the European Commission. While no connection offers were in place for further interconnection at the data freeze date, EirGrid is processing these two interconnector applications following a CRU direction. The two applications are the proposed Celtic Interconnector between Ireland and France, and the proposed Greenlink Interconnector between Ireland and Great Britain. PCIs are intended to help the EU achieve its energy policy and climate objectives: affordable, secure and sustainable energy for all citizens.

2.4. Transmission Development Plans

EirGrid's Transmission Development Plan (TDP)³⁶ and SONI's Transmission Development Plan Northern Ireland (TDPNI)³⁷ detail the transmission system development projects that have been initiated by us. They also discuss further developments that may arise in the period of the plans. The TDP and TDPNI describe projects that are required to:

- Facilitate demand growth;
- Provide new generation and demand connections³⁸;
- Ensure the transmission system is in compliance with the EirGrid and SONI Transmission System Security and Planning Standards (TSSPS);
- Provide interconnection capacity; and
- Refurbish or replace existing assets.

The planned transmission system developments presented in this statement are based on those projects that have received internal approval by the data freeze date³⁹. Appendix B outlines these developments. These projects are currently scheduled to be completed at various stages between now and 2027. It should be noted that the information presented in later chapters on transmission system transfer capabilities and opportunities is dependent on the completion of these development projects in the assumed timeframe.

Information presented in the TDP, TDPNI and TYTFS documents represent a snapshot of an evolving transmission system development plan. While we are considering other reinforcements, these are not at the stage of maturity required for inclusion in this statement.

The Transmission Development Plans includes details of major transmission system developments planned for the transmission system of Ireland and Northern Ireland. Each planned development is illustrated in the maps and schematics in Appendix A. New generation connections and new transmission interface stations are described in Sections 2.8 and 2.9 respectively.

2.5. Ireland Transmission System Developments

2.5.1. Grid Development Strategy

EirGrid published an updated Grid Development Strategy "Your Grid, Your Tomorrow"⁴⁰ in January 2017. The GDS documents our strategy for the long-term development of the network and includes three strategy statements:

- Inclusive consultation with local communities and stakeholders will be central to our approach;
- We will consider all practical technology options; and
- We will optimise the existing grid to minimise the need for new infrastructure.

The GDS aims to achieve a balance between the costs and impact of new infrastructure, while maximising the capability of the existing network.

³⁶ The latest TDP can be obtained from the EirGrid website http://www.eirgridgroup.com/

³⁷ SONI published the first TDPNI (covering 2018-2027) for public consultation in 2018. It will be finalised in 2019.

³⁸ For example data centres or large industrial sites.

^{39 1} July 2018

⁴⁰ http://www.eirgridgroup.com/the-grid/irelands-strategy/

2.5.2. Reviewing and Improving our Public Consultation Process

Following a review of our public consultation process, we promised to improve the way we consult with the public and other stakeholders. We have produced a summary guide of our improved consultation process - Have Your Say⁴¹. It explains why we develop the electricity grid, and how we consult with the public and other stakeholders to get feedback on our plans.

This guide tells you what to expect from us, and what we would like from you. There is one very important principle that is at the heart of our consultation process. The earlier you get involved in our projects, the more influence you can have on them.

The new approach comprises a 6-step process that provides an "end-to-end" structure for all our grid projects. It ensures an appropriate balance between technical, economic, environmental, social and community considerations, with significant provision for stakeholder engagement at all stages. A general structure of the process is set out in Figure 2-3 below.

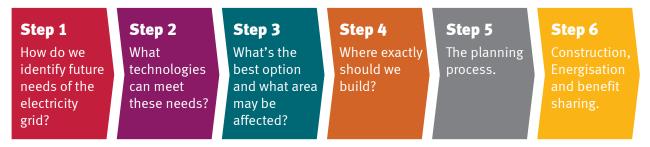


Figure 2-3 General structure of the 6-step process for our grid projects

2.5.3. Tomorrow's Energy Scenarios

In July 2017 we published 'Tomorrow's Energy Scenarios 2017', the result of extensive consultations with stakeholders in planning our energy future. In March 2018 we launched 'Tomorrow's Energy Scenarios 2017 Locations Consultation', providing more information on our locational assumptions for future electricity demand and supply. Following this, we analysed how the existing and planned transmission grid performs under each of the scenarios over a range of timeframes. The results of this analysis were published in Tomorrow's Energy Scenarios System Needs Assessment (TESNA) report in December 2018. The needs identified in the TES process are brought through our 6-step process for developing the grid. As needs and projects progress through the 6-step process they are included in TDPs and TYTFSs. Tomorrow's Energy Scenarios 2019 will be consulted on in 2019. We encourage all stakeholders to engage fully with this consultation to help inform the scenarios and ensure the inputs to the scenario are appropriate.

2.5.4. Project Delivery

The development of the transmission network is subject to delivery risk. We use risk management plans and processes to identify, analyse, monitor and manage project and programme risks. These plans and processes facilitate the management of project dependencies and critical path issues within the context of a changing environment.

Project completion dates in the TYTFS are forecasts based on the best project information available at the time of the data freeze date. Certainty with regard to completion dates increases as a project moves through the various phases in its lifecycle, as represented below in Figure 2-4.

⁴¹ http://www.eirgridgroup.com/the-grid/have-your-say/

The project schedule at the concept stage is developed based on standard lead-times for generic project types. As a project moves forward from the concept phase a detailed schedule is developed, milestones are defined and there is therefore greater certainty regarding the completion date.



Figure 2-4 Relationship between Phases in Project Lifecycle and Completion Date Certainty

The level of certainty or risk in a project also varies by project type as shown in Figure 2-5.



Figure 2-5 Project Certainty Depending on Project Type

We differentiate between moderate and high risk projects based on project type and project phase. Thus, line and station busbar uprate projects which are due to be completed by 2019 are considered to be within the moderate risk category. Large scale linear developments, scheduled to be completed post 2020 have a higher level of risk. Projects that are due for completion in the near-term generally carry less risk than those due for completion in later years.

The region or location of a project also has an impact on its risk profile. When interdependent projects are on-going at the same time, care has to be taken scheduling the required outages. In this case we will prioritise projects according to our prioritisation processes. This programme risk review may drive changes to the way projects are sequenced and the timing of project delivery in a region.

We review the network development programme on an on-going basis, which may result in project delivery changes for the reasons cited above. In such cases we endeavour to communicate with, and mitigate impacts on, customers.

In summary, completion dates are subject to change and the level of change typically depends on:

- The type of project;
- · Phase-specific project and programme risks; and
- The region a project is in.

All developments included in this section have received internal EirGrid approval.

2.5.5. Historical Transmission Developments

Table 2-5 below shows the level of transmission system developments delivered by EirGrid (together with ESB Networks and independent contestable build contractors) that have been completed over the past six years.

Year	Circuit Uprate (km)	New Line Build (km)	New Station Build
2011	340	76	3
2012	215	128	2
2013	225	38	3
2014	167	79	2
2015	76	14	3
2016	35	8	2
2017	81	24	3

Table 2-5 Recent Historical Level of Transmission Developments

2.5.6. Descriptions of Ireland Development Projects

Aghada 220 kV Redevelopment

The 220 kV busbar in Aghada 220 kV station will be reconfigured from the existing double busbar into a 'C' configuration. The 110 kV busbar will also be uprated. The project will increase security of supply, increase operational flexibility and improve maintainability of station equipment. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2022.

Ballynahulla Station STATCOM

A new ±100 Mvar STATCOM will be installed and commissioned on the 110 kV busbar at Ballynahulla. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2020.

Ballyvouskill Station STATCOM

A new ±100 Mvar STATCOM on the 110 kV busbar at Ballyvouskill will be installed and commissioned. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2020.

Belcamp Phase 1 220 kV Development⁴²

Belcamp 220 kV station, in north Co. Dublin, will be connected to the 220 kV network by an underground cable from Finglas in order to facilitate new demand connections to the system in the North East Dublin area. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

Belcamp Phase 2 220/110 kV Development

A 220 kV cable will connect Shellybanks station to Belcamp station, by utilising the existing Shellybanks – Finglas 220 kV and Finglas – Dardistown 110 kV cables before continuing on to Belcamp. This will lead to a revision in the feeding arrangements of the underlying Finglas and Belcamp 110 kV network. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2021.

Capital Project 966

This project will involve reinforcement of the network between Dunstown and Woodland 400 kV stations.

We are progressing this project in line with our 6-step process for our grid projects. The 6-step process is introduced above and outlined in our Have Your Say⁴³ document. For the most up to date information on the project please visit the project website on the EirGrid website⁴⁴.

Carrickmines 220 kV Redevelopment

This project involves installation of a fourth 220/110 kV transformer at Carrickmines 220 kV station as well as upgrading to Gas Insulated Switchgear (GIS) and reconfiguration of the existing busbar. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

Castlebagot 220 kV Development

Castlebagot 220 kV station, in west Co. Dublin, will be connected into the existing Inchicore-Maynooth No. 1 and No. 2 220 kV lines. A number of the existing 110 kV circuits in the area will be connected to the new Castlebagot station. This development will offload demand from Inchicore 220 kV station. It will also ensure compliance with the distribution system planning standards as new demand connects to the system in the West Dublin area. For the purpose of the 2018 TYTFS analysis, it is expected to be completed in 2020.

Clashavoon - Macroom Second 110 kV Circuit

A new 110 kV circuit will be constructed between Clashavoon and Macroom substations. The existing 220/110 kV transformer at Clashavoon substation will be replaced with one of higher capacity. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

Finglas 220 kV Redevelopment

The 220 kV and 110 kV busbars in the existing Finglas 220 kV station will be reconfigured and redeveloped into a ring busbar arrangement. This project will address the following issues: ability to accommodate future load growth; security of supply to north Dublin; asset condition of existing equipment; inadequate circuit breaker ratings and the need to upgrade the protection systems. The project will also increase operational flexibility and improve maintainability of station equipment. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2022.

⁴³ http://www.eirgridgroup.com/the-grid/have-your-say/

⁴⁴ http://www.eirgridgroup.com/the-grid/projects/capital-project-966/the-project/

Inchicore 220 kV Redevelopment

The oldest section of the existing Inchicore 220 kV station, in Co. Dublin will be replaced with a new GIS compound. This project will address issues with the condition of existing equipment, inadequate circuit breaker ratings, and the need to upgrade the protection systems. The new GIS compound will increase operational flexibility, improve maintainability of station equipment and allow for future 220 kV expansion. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2022.

A new 110 kV Station close to Kilbarry 110 kV Station

A new 110 kV substation will be constructed adjacent to the existing station. This will facilitate more demand in the area and also improve security of supply. Some of the existing circuits connecting into the existing Kilbarry 110 kV station will be transferred into the new station. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2022.

Knockanure Station Reactor

A new 50 Mvar reactor will be installed on the 220 kV busbar at Knockanure. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2020.

Knockraha 220 kV Reconfiguration

The 220 kV busbar in Knockraha 220 kV station will be reconfigured from the existing double busbar configuration to a ring busbar arrangement. The third Knockraha 220/110 kV transformer will be decommissioned resulting in the station having two 220/110 kV transformers. The project will resolve issues regarding security of supply, operational flexibility and improve maintainability of station equipment. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2021.

Lanesboro 110 kV Station Redevelopment

This project involves the replacement of the busbar at Lanesboro 110 kV station with a new busbar equipped with air-insulated switchgear. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2024.

Laois-Kilkenny Reinforcement Project 45

This project involves a new 400/110 kV station to be located near Portlaoise, Co. Laois, with an associated 110 kV circuit to Kilkenny 110 kV station via Ballyragget station. The 400/110 kV station will be looped into the existing Dunstown-Moneypoint 400 kV line and the existing Athy-Portlaoise 110 kV line. The proposed infrastructure will improve quality of supply to the south-east. It will also increase capacity in the region. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2020.

Louth Station Redevelopment

Louth station comprises three voltage levels, 275 kV, 220 kV and 110 kV. The station will undergo a major refurbishment of assets at all three voltage levels. The 110 kV busbar will be reconfigured from the existing double busbar configuration to ring busbar arrangement. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2023.

⁴⁵ http://www.eirgridgroup.com/the-grid/projects/laois-kilkenny/the-project/

Maynooth Station Redevelopment

This project involves refurbishment of the entire 220 kV and 110 kV busbars, reconfiguration of both the 220 kV and 110 kV busbars to an enhanced ring configuration, and an increase in the short circuit rating of both busbars. Series reactors will be incorporated into the 110 kV wing couplers to manage short circuit levels within limits. For the purposes of the 2018 TYTFS analysis, it is expected to be complete in 2025.

Moneypoint - Kilpaddoge - Knockanure 220 kV Development

There is a planned new 220 kV cable from Moneypoint in Co. Clare to Knockanure in north Co. Kerry, via Kilpaddoge also in north Co. Kerry. This will create a new path for power out of the South West to the existing 400 kV network. The project will comprise a submarine 220 kV cable under the Shannon and a 21 km 220 kV land cable. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

North Connacht 110 kV Reinforcement

This project includes a new 110 kV circuit to facilitate additional renewable generation in Co. Mayo. The North Connacht project is currently progressing through the 6-step process for our grid projects. We are investigating a number of possible solutions. At the data freeze date a best performing solution had not been identified. For the most up to date information on the project please visit the project website on the EirGrid website⁴⁶.

For the purpose of the 2018 TYTFS analysis, this project is assumed to be completed in 2024.

North-West Project

The cross-border Renewable Integration Development Project (RIDP)⁴⁷ identified that the existing network in the north west of the island is insufficient to accommodate the future wind generation in the area. The North-West project is one element of the original RIDP solution. It would connect the existing Srananagh 220 kV substation to the existing Clogher 110 kV substation in Donegal. However, alternative solutions to evacuate the wind generation from Co. Donegal are now being considered.

Should the North-West Project progress, an investigation of overhead and underground options utilising various technologies will be undertaken. For the purpose of the 2018 TYTFS analysis, this project is assumed to be completed in 2027.

Poolbeg Station Reactors

Two 50 Mvar shunt reactors will be installed in Poolbeg 220 kV station, in Co. Dublin. There has been an increase in the number of cable circuits and a reduction in the usage of the conventional generation in Dublin. This has made it more difficult to control voltage during low-demand periods. These reactors will help to adequately control the voltages, reducing the operational constraint of running generators outside of merit order. Installation of the first reactor is complete. For the purpose of the 2018 TYTFS analysis, the second reactor is expected to be completed in 2018.

⁴⁶ http://www.eirgridgroup.com/the-grid/projects/north-connacht/the-project/

⁴⁷ http://www.eirgridgroup.com/how-the-grid-works/ridp/

Regional Solution

The Regional Solution is made up of a number of projects, with the objective of improving security of supply in the south-east and facilitating connection of generation in the south-west.

(i) Cross-Shannon 400 kV Cable

A 400 kV cable crossing the Shannon estuary will be installed between Kilpaddoge and Moneypoint stations. The cable length is estimated at approximately 6 km consisting of approximately 3 km land cable and approximately 3 km marine cable. A new 400/220 kV 500 MVA transformer will also be required at Kilpaddoge station. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2022.

(ii) Great Island - Wexford 110 kV Line Uprate

The entire Great Island - Wexford 110 kV line will be uprated. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

(iii) Great Island - Kilkenny 110 kV Line Uprate

The entire Great Island - Kilkenny 110 kV line will be uprated. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2021.

(iv) Wexford 110 kV Busbar Uprate

For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2019.

(v) Dunstown, Moneypoint and Oldstreet Series Compensation

Series capacitors will be installed at Dunstown, Moneypoint and Oldstreet 400 kV stations to compensate the Coolnabacky-Moneypoint, Coolnabacky -Dunstown and Oldstreet-Woodland 400 kV lines. For the purpose of the 2018 TYTFS analysis, these projects are expected to be completed in 2022.

Tievebrack/Ardnagappary 110 kV Development

A 110 kV station will be constructed at Tievebrack, near Glenties in Co. Donegal. This will be looped into the existing Binbane – Letterkenny 110 kV line. New 110/38 kV transformers will be installed at Ardnagappary in Derrybeg and connected via a new 110 kV distribution overhead line to the Tievebrack station. For the purpose of the 2018 TYTFS analysis, this project is assumed to be complete in 2019.

Thurles Station STATCOM

One of the existing 15 Mvar capacitor banks on the 110 kV busbar at Thurles will be removed and replaced with a new ±30 Mvar STATCOM. For the purpose of the 2018 TYTFS analysis, this project is expected to be completed in 2020.

2.6. Northern Ireland Transmission System Developments

This section details the transmission system projects that are planned to take place in Northern Ireland over the period covered by this forecast statement. Projects have been included using completion dates assessed to be appropriate at the time of the data freeze (July 2018).

2.6.1. Grid Development Process

SONI recently updated the Northern Ireland Grid Development Process⁴⁸. This is a three part process which includes stakeholder and public participation (as appropriate) in the development of projects, see Figure 2-6.

SONI's Grid Development Process

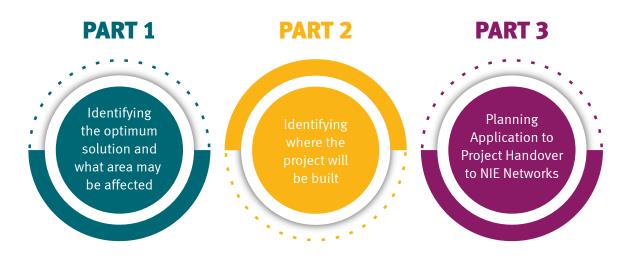


Figure 2-6 SONI's Grid Development Process

The approach taken to developing the grid is described by the following:

- The projects listed here have all progressed through either the SONI approval and governance process or have been identified to SONI by NIE Networks. In cases where the project is at an early stage, i.e. Part 1, this approval may be limited to the investigation of feasibility of several options prior to shortlisting and selection of preferred option and identification of study areas. Therefore, the outline design that progresses to the consents stage may vary from that assumed in the forecast statement study files;
- Developments are based on assumptions relating to the forecast change in demand and generation; and
- Studies have concluded that the following projects are required to address forecast non-compliance with standards, subject to the forecast change in demand and generation. However, further cost benefit analysis may result, in some cases, in the identification of alternative solutions or operational interventions.

Further projects for which a need has been identified but approval has not yet been granted have not been included in the TYTFS analysis. These are discussed in more detail in Transmission Development Plan Northern Ireland 2018 - 2027. We published TDPNI for public consultation in 2018. It will be finalised in 2019.

⁴⁸ http://www.soni.ltd.uk/media/SONIs-Powering-The-Future-Grid-Development-Process-brochure.pdf

2.6.2. Description of Northern Ireland Development Projects

Donegall Main (North)

The 60 MVA transformer TxB at Donegall North is to be replaced by a new 90 MVA unit. For the purpose of the 2018 TYTFS this work is expected to be complete by summer 2021.

Omagh Main - Dromore restring

With the connection of Curraghamulkin cluster substation to Omagh South it will be necessary to restring the Omagh Main – Dromore tower line with a higher capacity conductor. For the purpose of the 2018 TYTFS analysis, this work is assumed to be complete by summer 2020.

Reactive Compensation

(i) Omagh Reactive Compensation

It is planned to install reactive support at Omagh Main. Approximately 120 Mvar of reactive support will be installed, connected to the 110 kV bus from 2022.

(ii) Tamnamore Reactive Compensation

It is planned to install reactive support at Tamnamore. Approximately 200 Mvar of reactive support will be installed, connected to the 110 kV bus from 2022.

(iii) Coleraine Reactive Compensation

It is planned to install reactive support at Coleraine. Approximately 150 Mvar of reactive support will be installed, connected to the 110 kV bus from 2022. The existing 36 Mvar Capacitor at Coleraine will be recovered.

Airport Road Main

It is planned to construct a new 110/33 kV substation including 2 x 60 MVA transformers and a 33 kV switchboard in the Belfast Harbour Estate, close to Airport Road. The substation will be connected as a teed transformer feeder arrangement from Rosebank Main 110 kV. The substation will supply both Airport Road and Queens Road 33 kV substations which are to be transferred from Cregagh Main. For the purpose of the 2018 TYTFS, this work is assumed to be completed by winter 2022.

Ballylumford - Eden 110 kV Circuit Uprate

The conductor on the existing tower line will be replaced and uprated. For the purpose of the 2018 TYTFS, this project is assumed to be complete by winter 2021.

Ballylumford Switchgear

The existing 110 kV switchgear at Ballylumford is to be replaced with a new 110 kV GIS double busbar and the 110 kV circuits diverted accordingly. For the purpose of the 2018 TYTFS, this project is assumed to be completed by winter 2021. Currently one 275/110 kV interbus transformer at Ballylumford is operated out of service to ensure the fault level is kept within existing switchgear fault rating. After this work is complete, this restriction can be removed.

Castlereagh IBTx 1

The interbus transformer IBTX 1 at Castlereagh is to be replaced. The replacement transformer will have a 240 MVA primary winding and a 60 MVA tertiary winding. For the purpose of the 2018 TYTFS, this project is assumed to be complete by 2020.

Castlereagh – Knock 110 kV Cable Uprate

The cable sealing ends at Castlereagh will be replaced along with a section of cable in order to improve capacity and fault rating. For the purpose of the 2018 TYTFS, this project is assumed to be complete by 2021.

Coolkeeragh-Magherafelt 275 kV Circuits

It is planned to replace the conductor on the existing double circuit tower line. The rating of the replacement conductor will be defined as part of the redesign of the circuit. For the purpose of the 2018 TYTFS, this work is assumed to be complete by winter 2022.

Kells-Rasharkin New 110 kV Circuit

As a result of increasing growth in renewable generation there will be a need to construct a second 110 kV circuit between Kells and Rasharkin 110/33 kV cluster substations. This circuit will be required to have a minimum rating of approximately 190 MVA. For the purpose of the 2018 TYTFS, this project is assumed to be complete by 2024.

Windfarm Clusters Development

(i) Agivey (formerly Garvagh) 110 kV Cluster

It is planned to establish a 110/33 kV cluster substation at Agivey, near Garvagh, connected to the Rasharkin cluster via a portal overhead line. For the purpose of the 2018 TYTFS, this work is assumed to be complete by winter 2021.

(ii) Kells 110/33 kV Cluster

It is planned to establish a 110/33 kV cluster substation near Kells, connected to the existing Kells station via an overhead line. For the purpose of the 2018 TYTFS, this work is assumed to be complete by 2022.

2.6.3. Projects Not Included in the 2018 TYFTS Analysis

A number of projects have not been included in the TYTFS analysis due to uncertainty at this time over either:

- The case of need; and/or
- Scope; and/or
- Timescales.

These projects are described in more detail in Transmission Development Plan Northern Ireland 2018-2027 which we published on the SONI website for consultation in 2018.

2.7. Joint Ireland and Northern Ireland Approved Transmission System Developments

This section includes transmission system developments which both EirGrid and SONI have identified the need for.

We are proposing a new 400 kV circuit which will connect Woodland 400/220 kV station in County Meath (Irl) and Turleenan 400/275 kV station in County Tyrone (NI). A new 400 kV station at Turleenan is required.

At present, the transmission transfer capacity between Ireland and Northern Ireland is not sufficient. Due to the risk of a forced outage, we must limit power flows across the border to prevent stress on the grid and risk to security of supply. The North South Interconnector would deliver a more secure and reliable electricity supply throughout the island of Ireland. It would bring about major cost savings and address significant issues around the security of electricity supply. This is particularly the case in Northern Ireland.

A key benefit is that it would remove bottlenecks between the two systems. This would enable the two systems to work together as if they were a single network. This would benefit residents and businesses on both sides of the border. Other benefits would include cost savings for consumers, as larger electricity systems operate more efficiently than smaller ones.

The North South Interconnector would also allow for greater connection of renewable generation. This would help Ireland and Northern Ireland achieve their renewable energy targets.

For the purpose of the 2018 TYTFS analysis, this project is planned to be completed by winter 2023. Once this connection is established, the constraints on the existing Tandragee-Louth 275 kV double circuit will be significantly reduced.

2.8. Connection of New Generation Stations

New generators will connect over the period covered by this statement. Table 2-6 lists the transmission system developments associated with future generation. New generators are included in the appropriate network models according to their expected connection date. Details of these generators and their expected connected dates are given in Section B.2 in Appendix B.

Table 2-6 Transmission System Station Development to Facilitate the Connection of Future Generation

Generator	Planned Connection Method	Location
Athea Wind Farm (Extension)	Connected into the existing Athea 110 kV substation	Ireland
Carrigdangan Wind Farm (formerly Barnadivane)	New Carrigdangan 110 kV station, connected into Dunmanway 110 kV station	Ireland
Castletownmoor Wind Farm	New Castletownmoor 110 kV station, connected into Gorman 220 kV substation	Ireland
Clahane Wind Farm (Extension)	Connected into the existing Clahane 110 kV substation	Ireland
Grousemount Wind Farm	New Coomataggart 110 kV station, connected into Ballyvouskill 220 kV substation	Ireland
Carrickaduff Wind Farm (formerly Croaghbrack and Cronacarkfree)	New Carrickaduff and Carricklangan 110 kV stations,	Ireland
Carrickalangan Wind Farm (formerly Cronacarkfree)	connected into Clogher 110 kV substation	
Agivey Cluster	Future Agivey 110/33 kV cluster substation is planned to be connected via a loop in to the Rasharkin – Brockaghboy 110 kV circuit.	Northern Ireland
Kells Cluster	Future Kells 110/33 kV cluster substation is planned to be tail-connected into Kells 275/110 kV switching station at 110 kV.	Northern Ireland
Knockacummer Wind Farm	Permanent connection of Knockacummer 110 kV substation, connected into Ballynahulla 220 kV substation	Ireland
Oriel Wind Farm	New Oriel 220 kV station, connected into the existing Louth-Woodland 220 kV circuit	Ireland
Oweninny Wind Farm	New Srahnakilly 110 kV station, connected into Bellacorick 110 kV substation	Ireland

2.9. Connection of New Interface Stations

Transmission interface stations are the points of connection between the transmission system and the distribution system or connecting 110 kV connected customers.

Table 2-7 lists the planned new 110 kV stations connecting the distribution system to the transmission system, for the period covered by this statement. These stations are included in the network models according to their expected connection date. Details of the connections and dates are given in Section B.2, Appendix B.

Table 2-7 Planned Transmission Interface Stations

Station	Code		Nearest Main Town or Load Centre	County
Airport Road	AIR	2 X 90	Belfast	Down
Tievebrack	TIV	n/a	Glenties	Donegal
Ballyragget	BGT	31.5	Ballyragget	Kilkenny
Belfast North Main	BNM	2 X 90	Belfast	Antrim
New station near Kilbarry	KBY 2	2 X 31.5	Cork	Cork

2.10. Detailed Transmission Network Information

The all-island network schematic diagrams in Appendix A show snapshots of the transmission system as at July 2018 and the planned transmission system expected by the end of 2027. The diagrams indicate stations, circuits, transformers, generation, reactive devices and phase shifting transformers.


Figure A-1 in Appendix A presents a geographical map of the all-island transmission system as at the end of 2018. Figure A-2 in Appendix A presents a geographical map of the planned all-island transmission system expected by the end of 2027.

The electrical characteristics and capacity ratings of the existing and planned transmission system are included in Appendix B. Characteristics of existing and planned overhead lines, underground cables, transformers and reactive compensation devices are provided.

All-Island Ten Year

Transmission Forecast Statement 2018

3. Demand

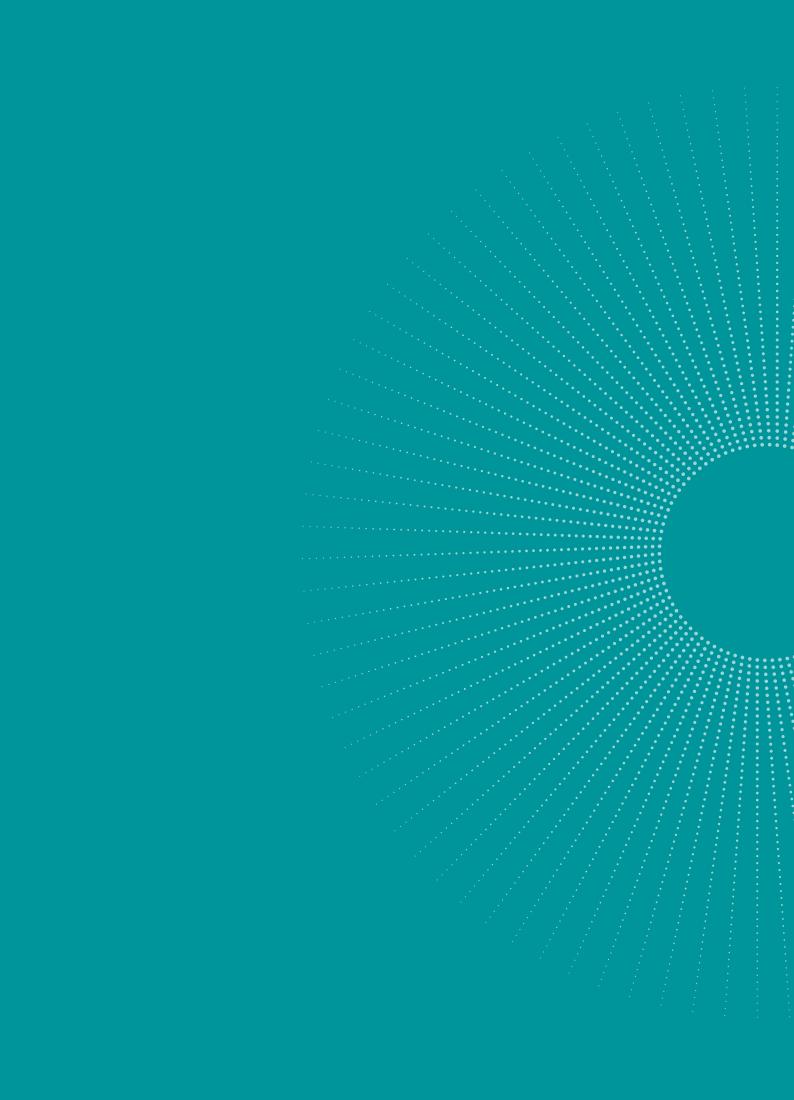

3. Demand

This chapter provides information on the all-island, Ireland and Northern Ireland demand forecasts.

The forecasts are taken from the All-Island Generation Capacity Statement 2018-2027 (GCS)⁴⁹ which was published by EirGrid and SONI in October 2018. GCS 2018 contains forecasts of future energy consumption and demand levels between 2018 and 2027.

This chapter also provides an introduction to the anticipated large demand increase in the Dublin area. This anticipated demand increase is associated primarily with the connection of new data centres. The impact of these data centres on the future all-island demand forecast is also discussed.

3.1. All-Island, Ireland and Northern Ireland Peak Transmission Demand

Table 3-1 presents the median all-island, Ireland and Northern Ireland, winter peak demand forecasts over the period 2018-2027, as published in the GCS.

It is difficult to accurately predict a peak demand figure for a particular year in the future. This is due to a number of factors that can cause fluctuations in the forecast. These factors include weather conditions, economic activity, electricity usage patterns and government policy.

The annual peak demand figures listed in Table 3-1 are expected to occur during the winter period of each year. For example, we would expect that the 2018 peak demand forecast of 6.78 gigawatts (GW) would occur in winter 2018/2019. In Ireland and Northern Ireland, the winter peak demand usually occurs between 17:00 and 19:00 on a weekday evening. However, the peak demand in each jurisdiction generally does not occur on the same day.

The demand forecast represents an average annual increase in all-island winter peak demand of 2.0% over the period of GCS 2018-2019⁵⁰. This represents a significant increase in demand forecast since GCS 2017-2026, when the forecast average annual increase in all-island winter peak demand was 1.0%⁵¹.

	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
Northern Ireland (GW)	1.72	1.73	1.73	1.74	1.74	1.76	1.78	1.79	1.79	1.80	1.80
Ireland (GW)	5.02	5.12	5.27	5.48	5.66	5.98	6.18	6.26	6.32	6.38	6.42
All-island (GW)	6.67	6.78	6.93	7.15	7.34	7.68	7.89	7.98	8.04	8.11	8.15

Table 3-1: All-island, Ireland and Northern Ireland Peak Demand Forecast

As well as winter peak forecasts, we also develop summer peak and summer valley forecasts for Ireland and Northern Ireland, and spring/autumn peak forecasts for Northern Ireland only.

The summer peak refers to the average peak demand levels that are forecast to occur during the summer period of each year. The Ireland and Northern Ireland summer peaks are combined to produce an all-island summer peak.

⁴⁹ http://www.eirgridgroup.com/site-files/library/EirGrid/Generation Capacity Statement 2018.pdf

The TYTFS 2017 references documents that where published at the July 2017 data freeze date. The All-Island Generation Capacity Statement 2018-2027 is due to be published. The information in the 2018 GCS however does not fundamentally impact the study results presented in the 2017 TYTFS.

⁵⁰ The cumulative forecast increase in demand over the period of GCS 2018-2027 is 22%.

⁵¹ The cumulative forecast increase in demand over the period of GCS 2017-2026 was 11%.

The overall transmission system power flows are usually lower in summer than in winter. However, this may not be the case for flows on all circuits. The capacity of overhead lines is lower during the summer period because of higher ambient temperatures. Network maintenance is also usually carried out during the summer/autumn period. Both of these factors can restrict the network, reducing its capability to transport power.

The annual minimum expected demand is referred to as the summer valley. It represents the lowest annual demand that is forecast, and is expected to occur during the summer period of each year. The Ireland and Northern Ireland summer valley demands are combined to produce an all-island summer valley demand. The summer valley cases examine the impact of the combination of low demand and low levels of conventional generation on the transmission system.

This minimum condition is of particular interest when assessing the capability of the transmission system to connect new generation. This is because with local demand at a minimum, the connecting generator will export more of its power across the transmission system.

The summer peak and valley demands occur between May and August. The spring/autumn peak demand refers to the peak demand value expected in the spring and autumn season. The spring/autumn peak occurs between September-October and March-April.

Summer peak, summer valley and autumn peak demand forecasts can be expressed in terms of percentage of winter peak demand. These are shown in Table 3-2.

Table 3-2: Ireland and Northern Ireland Seasonal Demand Forecast as a Percentage of Winter Peak Demand

Season	Ireland seasonal demand forecast as a percentage of winter peak (%)	Northern Ireland seasonal demand forecast as a percentage of winter peak (%)
Winter Peak	100	100
Spring/Autumn Peak	N/A	86
Summer Peak	80	79
Summer Valley	35	30

These figures are consistent with historical demand data.

3.1.1. Large Demand Increases in the Dublin Area

Background

In recent years there has been an increase in the level of connections and enquiries for connection to the transmission system in the Dublin area. This document includes information on both current demand connections and future demand opportunities at the freeze date of July 2018. Our assessment of demand opportunities is presented in Chapter 8 and includes a section focused on the Dublin area.

The level of enquiries in the Dublin area is principally driven by the need for Information, Communications and Technology (ICT) industries and high-tech manufacturing companies to connect to a high quality power supply in the Dublin area.

Data Centres

Ireland is an attractive business location and continues to attract world-class investments. Industrial Development Authority (IDA) Ireland has cited access to a high-quality electricity grid as critically important for attracting new investment. This is particularly important in the ICT and high-tech manufacturing sectors.

Some of the world's best known companies have chosen Ireland as the location for their European data centre operations. Factors such as a temperate climate, stable power sources, internet connectivity and a skilled workforce have influenced their decisions. This is emphasised by nine out of the top 10 global software companies and US ICT companies locating strategic business activities in Ireland⁵².

At the end of 2018, connected data centres had a combined total power demand of approximately 256 MVA. The total contracted maximum import capacity (MIC) for these sites is 625 MVA. This includes connections to the transmission and distribution systems. In addition to the connected sites, a further 437 MVA of contracts are in place for new data centre connections. Applications are being processed for a further 894 MVA of data centre contracts in the Dublin region.

There continues to be ongoing enquiries regarding further large demand connections in the Dublin region.

To put this in context, the current winter peak demand on the all-island transmission system is approximately 6,800 MW. If all applicants currently being processed were to connect, the data centre load could account for approximately 29% of the all-island system peak demand.

What is a data centre?

A data centre is a facility used to house computer systems and associated components, such as telecommunications and storage systems. They underpin the operations of companies in the broad ICT sector, particularly those in social media and cloud computing. The size of the individual electricity demand connections depends on the scale of the business operation. These have varied from 20 MW with some possibly extending to 250 MW in the final stages of development. Their use of electricity tends to be constant throughout the year. The modern world increasingly requires the retention and use of vast volumes of data, so this trend is likely to continue for the foreseeable future.

Impact on the System Demand Forecast

The potential connection of data centre demand on the scale discussed is equivalent to decades of historical natural demand growth. This will have an impact on the all island system demand forecast and generation capacity adequacy. This is assessed and discussed in the GCS.

The focus of the majority of the connection enquiries have been in the greater Dublin area. Depending on the number and scale of projects that materialise, new transmission solutions will be required to strengthen the grid to facilitate these connections. These transmission solutions are now under initial investigations and could vary from short lead-time to longer lead-time developments. The impact of these Dublin demand connections are described in greater detail in Chapter 8, Section 8.3.

^{52 &}lt;a href="http://www.idaireland.com/business-in-ireland/industry-sectors/ict/">http://www.idaireland.com/business-in-ireland/industry-sectors/ict/

3.2. Demand Data

Electricity usage follows some generally accepted patterns. For example, annual peak demand occurs between 17:00 - 19:00 hrs on winter weekday evenings. Minimum usage usually occurs during summer weekend night-time hours.

3.2.1. Generated Peak Demand Profiles

Figure 3-1 shows the generated peak demand profiles of Ireland and Northern Ireland on the day of the 2017 all-island winter peak on 11 December 2017. The individual peaks for Ireland and Northern Ireland did not occur on the same day. Peak demand for Ireland occurred on 13 December 2017, while peak demand occurred in Northern Ireland on 12 January 2017.

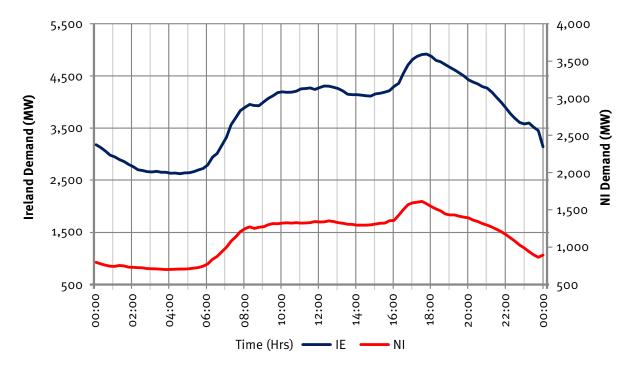


Figure 3-1 Generated Peak Demand Profiles for 2017

3.2.2. All-Island Demand Profiles

Figure 3-2 shows the profiles of the 2017 all-island winter peak, summer peak and summer valley. The percentage demand attributable to each jurisdiction during the peak and valley scenarios is also shown.

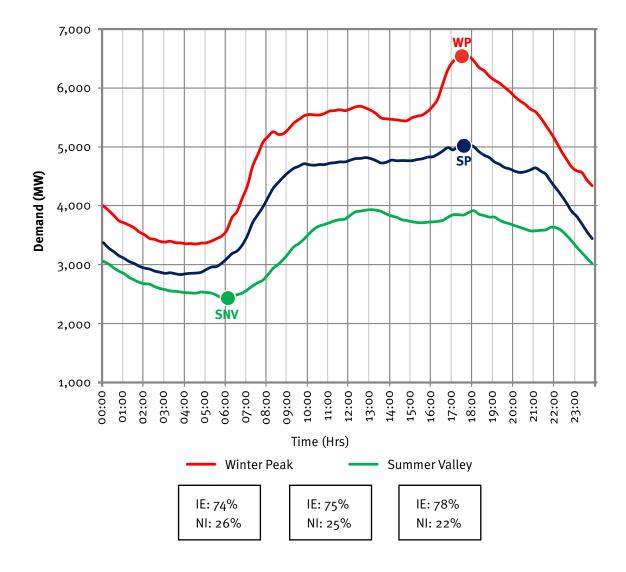


Figure 3-2 All-Island Daily Demand Profiles for Year 2017

Table 3-3: Ireland and Northern Ireland Peak and Minimum Demand, 2017

2017	Irela	nd	Northern Ireland			
2017	Date and Time	Demand (MW)	Date and Time	Demand (MW)		
Winter Peak	13/12/2017 17:30	4,939	12/01/2017 17:30	1,668		
Summer Peak	22/08/2017 17:45	3,791	22/08/2017 17:45	1,230		
Minimum Demand	06/08/2017 06:00	1,929	15/10/2017 04:00	457		

Minimum demand is normally seen during the summer. However, the minimum 2017 demand seen in Northern Ireland occurred during the early stages of Storm Ophelia in October 2017. This is because the demand reported here is that which was seen at the transmission system Bulk Supply Points (BSP), which does not count the effect of small scale generation such as rooftop solar panels. These are not metered in the same way as larger sources of generation and serve to reduce the demand observed rather than increasing the generation. At the time of the 2017 NI minimum demand, small scale wind generation would have been high, offsetting some of the (already low) demand. Excluding Storm Ophelia, the lowest demand seen in Northern Ireland in 2017 was 464 MW at 06:00 on 30 April 2017.

3.2.3. All-Island Weekly Demand Peaks

Figure 3-3 shows the profile for the all-island, Northern Ireland and Ireland weekly peaks across the year for 2017.

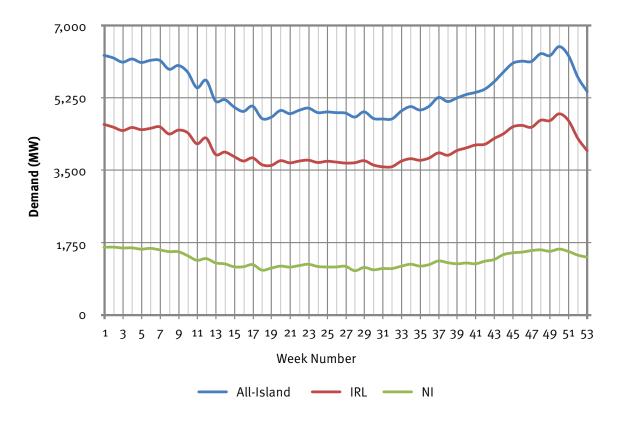


Figure 3-3 Weekly Demand Peak Values for Year 2017

3.2.4. Load Duration Curves

Figures 3-4 and 3-5 show the Ireland and Northern Ireland 2017 load duration curves, respectively. The curves show the percentage of time in the year that a particular demand value was exceeded. For example, demand exceeded 3,000 MW for 60% of the year in Ireland. Demand in Northern Ireland exceeded 1,000 MW for 42% of the year.

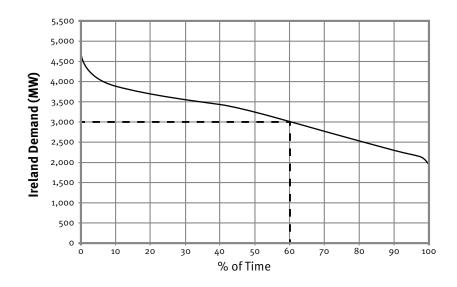


Figure 3-4 Ireland Load Duration Curve 2017

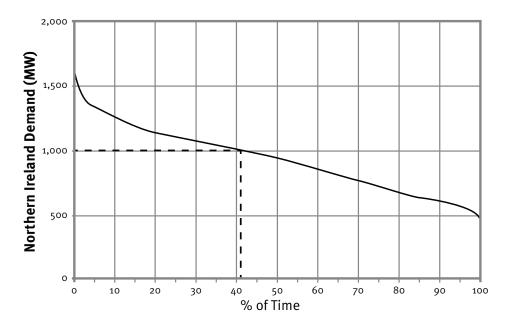


Figure 3-5 Northern Ireland Load Duration Curve 2017

3.3. Forecast Demand at Transmission Interface Stations in Ireland

Transmission interface stations are the points of connection to the transmission system. These interfaces include:

- · Connections between the transmission and the distribution systems; and
- Customers connected at 110 kV.

The interfaces are mostly 110 kV stations. In Dublin city, where the Distribution System Operator (DSO) operates the 110 kV network, the interface is usually at 220 kV stations.

Appendix C lists forecast demands at each transmission interface station. The forecast demands are given for winter peak, summer peak and summer valley for all years from 2018-2027. Demand projections at individual transmission stations are developed from the system demand forecasts on a top-down⁵³ basis.

The forecasting process includes regular monitoring and review of consumption trends in all parts of the country. The allocation of the system demand forecast to each station is pro-rata. This is based on an up-to-date measurement of actual peak demand at each station. Account is taken of planned transfers of demand between stations, as agreed with ESB Networks⁵⁴. In this way, changes in the geo-diversity of electricity consumption are captured. This process provides a station demand forecast and by extension a regional demand forecast for the short to medium term.

The system-wide demand forecasts, presented in Table 3-1, include transmission losses whereas the individual station demand forecasts do not. Transmission losses therefore account for the difference between system-wide demand and the sum of the demand at each interface station. The demand at each interface is given in Appendix C.

⁵³ This approach takes the overall demand forecast and breaks it down - using transmission system information, including historical data - to gain better knowledge of the sub-components of the demand forecast.

⁵⁴ ESB Networks is the Distribution System Operator (DSO) in Ireland.

Demand forecasts for the small number of directly-connected customers are the current best estimates of requirements. In some cases, the estimates may be less than contracted MIC values. These values are chosen to give a better projection of expected demand on a system-wide basis. However, when analysing the capacity for new demand in a particular area, the MIC values of local directly-connected customers are assumed. These values are assumed to ensure that the contracted MIC is preserved.

A demand-side unit (DSU) consists of one or more demand sites that can be instructed by EirGrid and SONI to reduce electricity demand. DSUs are usually medium to large industrial premises. A DSU uses a combination of on-site generation or plant shutdown to deliver a demand reduction. Providing this dispatch availability means that the DSU is eligible for capacity payments in the Single Electricity Market (SEM).

It is noted that DSUs may reduce some customers' demands from time to time over winter peak hours. However, normal demand levels are included in the winter peak demand forecasts shown in Table C-1 in Appendix C. Normal demand levels are also used in the power flow diagrams in Appendix H. These normal demand levels are used since they are more indicative of general power flows.

3.4. Forecast Demand at Northern Ireland Bulk Supply Points (BSP)

The 110/33 kV BSP demand forecasts are provided by NIE Networks⁵⁵. These forecasts are based on demand trends at an individual nodal level and adjusted to align with system average cold spell (ACS)⁵⁶ forecasts. Consideration is also given to future block load transfers from one BSP to another. Tables and information relating to demand forecasts are contained in Appendix C.


⁵⁵ NIE Networks is the DSO in Northern Ireland.

⁵⁶ Demand trends are based on historical information. ACS analysis produces a peak demand which would have occurred had conditions been averagely cold for the time of year. This ACS adjustment to each winter peak seeks to remove any sudden changes caused by extremely cold or unusually mild weather conditions.

All-Island Ten Year

Transmission Forecast Statement 2018

4. Generation

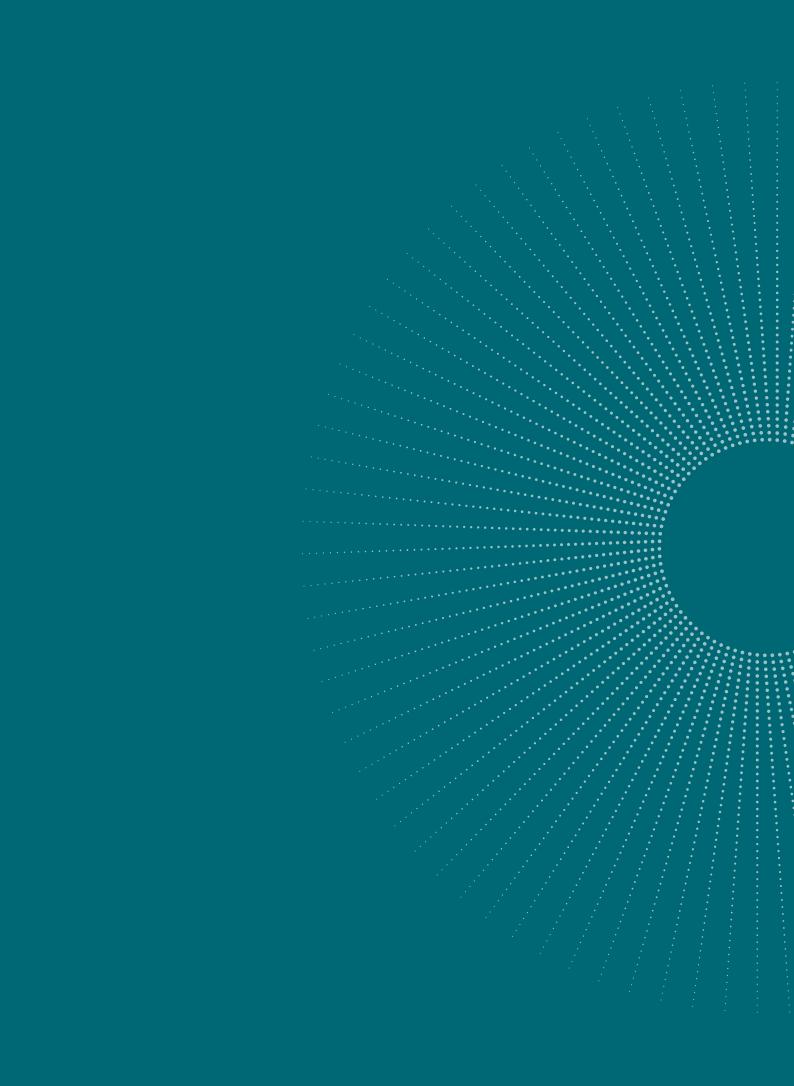

4. Generation

This chapter gives information about existing generation capacity. The chapter also defines future projections for the ten years 2018 to 2027. All generation capacity and dispatch figures in this statement are expressed in exported or net terms. This is the generation unit output less the unit's own auxiliary load.

In Ireland, renewable energy policy is driven by a binding European legal requirement. The requirement is for 16% of the country's total energy consumption to be met by renewable energy sources (RES) by 2020.

The Irish Government aims to achieve 40% renewable electricity, 12% renewable heat and 10% renewable transport to meet this overall requirement. Between 3,900 - 4,400 MW of on-shore wind generation will be needed to meet the renewable electricity target. Other renewable energy sources, including hydro generation, solar, bio-energy and renewable Combined Heat and Power (CHP) energy production, will also contribute to meeting the renewable electricity target.

In addition, in March 2019 the Irish Minister for Communications, Climate Action and Environment, Richard Bruton, announced that he intends to set a target of 70% of electricity from renewable energy sources by 2030. In order to meet this target, investment will be needed in new renewable generation capacity, system service infrastructure and electricity networks.

The Strategic Energy Framework (SEF)⁵⁷ 2010 for Northern Ireland sets the renewable energy policy in Northern Ireland. It states that 40% of electricity consumption in Northern Ireland should come from renewable sources by the year 2020.

Currently SONI, along with NIE Networks, are working to facilitate the connection of the renewable generation required to meet the 40% target by the year 2020. This 40% government target translates into approximately 1,600 MW of renewable generation capacity in Northern Ireland⁵⁸.

A freeze date for data was applied when compiling this TYTFS. A freeze date enables transmission system analyses to be carried out for inclusion in the document. The data freeze date for TYTFS 2018 is July 2018.

4.1. Generation in Ireland

At the data freeze date 11,613 MW of generation capacity was installed in Ireland, as detailed in Table 4-1.

Table 4-1 Installed Generation Capacity in Ireland

Transmission System	Distribution System	Ireland Total Generation
Connected (MW)	Connected (MW)	Capacity (MW)
9,302	2,311	11,613

4.1.1. Existing and Planned Transmission Connected Generation

Table 4-2 lists planned generators that have executed transmission connection agreements, along with their expected energisation dates if they were available at the data freeze date.

 $^{57\ \}underline{https://www.economy-ni.gov.uk/articles/strategic-energy-framework-2010}$

Note that the SEF expires in 2020 and there is currently no enrgy policy in place in northern Ireland beyond this date. 58 This is approximately equal to the currently installed level of renewable generation in Northern Ireland.

Table 4-2 Contracted Transmission Generation

Gonorator	Generation Type	Generation	Expected
Generator	Generation Type	Capacity (MW)	Energisation Date
Grousemount	Wind	114	2019
Oweninney Power 1	Wind	89	2019
Oweninney Power 2	Wind	83	2019
Carrigdangan (formerly Barnadivane)	Wind	60	Date unavailable
Beenanaspock and Tobertooreen Wind Farm (formerly Athea Phase 2)	Wind	34	Date unavailable4
Buffy	Wind	64	Date unavailable4
Cahernagh Mid Merit	OCGT	20	Date unavailable4
Castletownmoor	Wind	120	Date unavailable4
Cordal	Wind	11	Date unavailable4
Carrickaduff	Wind	66	Date unavailable4
Carrickalangan	Wind	72	Date unavailable4
Oriel	Wind	210	Date unavailable4
Oweninney 5	Wind	50	Date unavailable4
Blundlestown	Solar	80	Date unavailable
Gallanstown	Solar	85	Date unavailable
Harristown	Solar	42	Date unavailable
Knocknamona	Wind	34	Date unavailable
Lumcloon	Battery	100	Date unavailable
Monatooreen	Solar	26	Date unavailable
Rosspile	Solar	95	Date unavailable
Shannonbridge A	Battery	100	Date unavailable
Shannonbridge B	Battery	97	Date unavailable
Timahoe North	Solar	70	Date unavailable

4.1.2. Planned Closure of Generation Plant

The closure of generation plant could have a significant impact on the ability of the transmission system to comply with standards. The EirGrid Grid Code specifies the minimum length of notice a generator must give the TSO before retirement or divestiture. The closure of a generator with capacity less than or equal to 50 MW requires at least 24 months' notice. Generators with larger capacity than this must give at least 36 months' notice.

Some older generators will come to the end of their lifetimes over the next ten years. These generators are noted in All-Island Generation Capacity Statement 2018-2027 (GCS) and are listed in Table 4-4.

Table 4-4 Closure of Conventional Generation

Generator	Generation Capacity (MW)	Expected to close by end of year
Aghada AD1	258	2018
Aghada AT1	90	2023
Marina CC	85	2018
North Wall 5	104	2023
Tarbert 1, 2, 3, 4	590	2022

4.1.3. Wind Generation

Over the past two decades wind power generation in Ireland has increased significantly. The level of wind generation in Ireland is expected to continue to grow over the period of this TYTFS. The expected growth in wind generation is displayed in Figure 4-1. The information presented in Figure 4-1 is a combination of connected and contracted wind generation⁵⁹.

7,000 6,000 Installed Capacity (MW) 5,000 4,000 3,000 2,000 1,000 2018 2019 2020 2021 2022 2023 2024 2025 2026 2027

Expected Growth in Wind Capacity in Ireland

Figure 4-1 Expected Growth in Wind Capacity, 2018 to 2027

Year

Total —— Total TSO —— Total DSO

Table 4-5 shows the existing and committed wind generation capacity totals expected to be connected by the end of each year⁶⁰. These wind farms have signed connection agreements and are committed to connecting to either the transmission or distribution system over the next few years.

Table 4-5 Existing and Committed Wind Capacity Totals (MW)

Connection	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
Transmission	1673	1673	1673	1673	1673	2585	2653	2653	2653	2653
Distribution	2045	2542	2654	2654	2654	3108	3108	3187	3187	3187
Total	3718	4215	4327	4327	4327	5693	5761	5840	5840	5840

⁵⁹ Detailed information on these figures is presented in Tables D-2 and D-3 in Appendix D.

⁶⁰ The individual wind farm details are included in Tables D-2 and D-3 of Appendix D. These figures are either the currently installed capacity or the Maximum Export Capacity (MEC) of wind farms, whichever is higher.

4.1.4. Offshore Generation

Currently there is one offshore generation unit in Ireland, a 25 MW offshore wind farm at Arklow bank. In February 2014, the Irish Government published an Offshore Renewable Energy Development Plan (OREDP)⁶¹. The aim of this work is to implement a framework for the sustainable development of offshore renewable generation in Ireland. The OREDP identifies three high level goals:

- 1. That Ireland harnesses the market opportunities presented by offshore renewable energy to achieve economic development, growth and jobs;
- 2. To increase awareness of the value, opportunities and societal benefits of developing offshore renewable energy; and
- 3. That offshore renewable energy development does not adversely impact our rich marine environment and its living and non-living resources¹¹.

The OREDP will also provide a structure through which Ireland can input to the development of the:

- European Blue Energy Strategy; and
- US/Ireland Memorandum of Understanding (MoU) on Ocean Energy.

The Department of Communications, Climate Action and Environment (DCCAE) is leading the implementation of OREDP. It has developed a robust governance structure to deliver on the aims of the plan. EirGrid sits on the steering group and are on a number of OREDP working groups.

4.1.5. Demand Side Units

As at the data freeze date, in Ireland nine demand side units (DSU) had entered the Single Electricity Market. These DSUs have a combined dispatchable capacity of 358 MW.

4.1.6. Embedded Generation

Table 4-6 below details the amount of embedded generation plant as at the data freeze date. This includes plant connected to the distribution system or to the system of a directly-connected demand customer. This figure comprises of small conventional and renewable units. Conventional units include CHP schemes and small industrial thermal units.

Renewable generation included in this figure consists of:

- Wind;
- Small Hydro;
- Land-fill gas (LFG);
- Biogas; and
- Biomass.

Table 4-6 details the existing embedded generation capacity totals by generation type.

⁶¹ http://www.dcenr.gov.ie/energy/en-ie/Renewable-Energy/Pages/OREDP-Landing-Page.aspx

Table 4-6 Existing Embedded Generation in Ireland

	Wind	Small Hydro	Biomass/ LFG	СНР	Diesel	Solar	Total
Net Capacity (MW)	2,031	26	76	150	14	< 1	2297,

Embedded generators reduce the demand supplied through Transmission Interface Stations. Forecasts of demand levels at individual Transmission Interface Stations are presented in Appendix C. These forecasts take account of the contribution of the existing non-wind embedded generators⁶².

Table 4-7 shows details of embedded non-wind generation capacity committed to the distribution system at the freeze date of July 2018.

Table 4-7 Contracted Non-Wind Embedded Generation in Ireland

Technology	Connection Year	Capacity (MW)
	2018	6
Biomass, Biogas and Anaerobic Digestion	2019	34
biolitass, biogas and Anaerobic Digestion	2020	16
	>2020	22
	2018	0.5
Combined Heat and Power (CHP)	2020	49
	>2020	0.6
Flywheel	2018	4
Hydro	>2020	4.2
Landfill Gas	>2020	3.3
Solar	>2020	353
Wave	2019	10
wave	>2020	5.4

4.2. Generation in Northern Ireland

At the data freeze date 3,846 MW of generation capacity was installed in Northern Ireland, as detailed in Table 4-8.

Table 4-8 Northern Ireland Installed Generation Capacity

Transmission System Connected (MW)	Distribution System Connected (MW)	Total Generation Capacity (MW)
2,225	1,621	3,846

⁶² Because of the variability of wind, a fixed contribution from embedded wind farms is not taken into account in the calculation of the peak transmission flow forecasts. Rather a number of wind scenarios are considered in the TYTFS analyses.

The 2,225 MW connected to the transmission system consists of:

- Conventional generation;
- · Brockaghboy Wind Farm; and
- Slieve Kirk Wind Farm.

4.2.1. Existing and Planned Transmission Connected Generation

Existing Conventional Generation

In Northern Ireland, conventional thermal generation plant can be split into two contractual categories:

- Plant contracted to Power NI Energy Limited via their Power Procurement Business (PPB) (Contracted Plant); and
- Independent Market Participants (IMP) (Non-Contracted Plant).

Table D-6 in Appendix D provides a list of contracted and non-contracted generators connected to the Northern Ireland Transmission System.

Contracted Conventional Generation

Plant contracted to PPB under pre-vesting contracts, or contracts negotiated thereafter, totals 593 MW. It is measured as output capacity at generator terminals. Details of capacity and contract information for individual generators can be seen in Tables D-1 and D-6 in Appendix D. The contracts contain expiry dates, though the Utility Regulator may cancel contracts at earlier cancellation dates.

The Power Purchasing Agreements (PPA) or Generating Unit Agreements (GUAs) cover availability, operating characteristics, payments, metering etc. These agreements cover matters such as outage planning, emissions and fuel stocks.

Independent Market Participants (IMP)

The Utility Regulator has a duty to promote competition in the generation and supply of electricity. This is in line with the EU IME Directive (concerning common rules for the internal market in electricity 2003/54/EC). This directive was introduced in June 2003. As of July 2018 there is 1,486 MW of IMP capacity in Northern Ireland.

4.2.2. Planned Retirement/Divestiture of Generation

In line with the information available to SONI at the data freeze date of July 2018, the following assumptions have been made. In 2016, AES Ballylumford entered into a Local Reserve Services Agreement (LRSA) with SONI for the provision of 250 MW of local reserve. This ensures Ballylumford ST4 and ST5 remain connected (at reduced capacity) until the end of 2018 with an option for SONI to extend this by a further 2 years if deemed required. As of the freeze date of July 2018, SONI had not been informed of any proposed change to the operation of these units beyond the end of the LRSA⁶³.

⁶³ Ballylumford ST4 and ST5 ceased generating and were decommissioned subsequent to the freeze date, at the end of December 2018.

The generation output of Kilroot ST1 and ST2 is anticipated to be restricted. The restriction is due to the Industrial Emissions Directive (IED)⁶⁴. The restriction includes limited emissions each year from 2016-2020, followed by severely restricted running hours from 2021-2022. As noted in GCS 2018 Kilroot ST1 and ST2 are assumed unavailable after 2024.

4.2.3. Northern Ireland Renewable Generation

Existing/Approved Renewable Generation

Existing and approved renewable generation in NI is shown geographically in Figure 4-2. The totals are derived from locational and capacity information⁶⁵ on:

- Large scale renewable generation schemes that are connected to the Northern Ireland network;
- Small scale renewable generation schemes with installed capacity at each BSP greater than 0.5 MW;
- Large scale schemes that are currently in construction; and
- Schemes approved by the planning service.

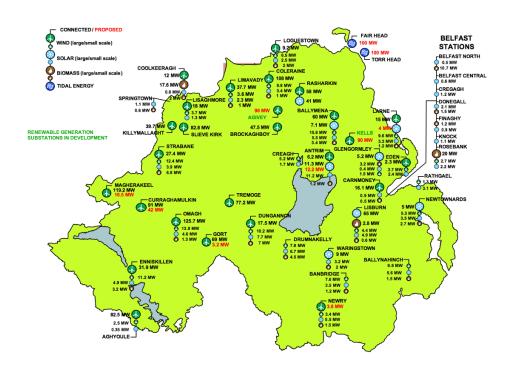


Figure 4-2 Existing and Committed Northern Ireland Renewable Generation (installed capacity greater than 0.5 MW)

The map indicates points at which renewable generation is connected to or is assumed to connect to. These points include 110/33 kV Bulk Supply Points (BSPs) and 110/33 kV Cluster substations.

In line with the criteria set out in the NIE Distribution Charging Statement⁶⁶, NIE Networks, in its role as Distribution Network Owner (DNO), identified a number of Cluster⁶⁷ substations that they wished to develop.

⁶⁴ http://ec.europa.eu/environment/industry/stationary/ied/legislation.htm

⁶⁵ As at data freeze date –July 2018

 $^{66\,}Statement\,of\,Charges\,for\,Connection\,to\,the\,Northern\,Ireland\,Electricity\,Networks'\,Distribution\,System:$

http://www.nienetworks.co.uk/documents/connections/statement-of-charges

⁶⁷ A 110/33kV substation in the vicinity of a number of distribution generator locations.

These distribution generators connect into the cluster at the 33 kV level. SONI is responsible for the delivery of the transmission elements of the Cluster substation. Cluster substations already exist at Magherakeel, Tremoge, Gort, Rasharkin, Curraghmulkin and Brockaghboy, with a further two planned at Agivey and Kells (see Chapter 2).

Unapproved Renewable Generation

A number of renewable generation projects are assumed to be commissioned in Northern Ireland between 2018 and 2027. These assumptions have been derived from a number of sources. The sources include:

- NIE Networks;
- The Strategic Energy Framework (SEF) for Northern Ireland⁶⁸;
- The Strategic Environmental Assessment of offshore wind and marine renewable energy⁶⁹; and
- The Onshore Renewable Electricity Action Plan (OREAP)70.

Renewable generation included in the TYTFS study files is detailed in Appendix D.

Offshore Renewable Generation

Our assumptions regarding the level and location of offshore generation connected to the NI transmission system are based on best information available at the data freeze date.

For the purpose of TYTFS analyses we assume that by 2027 there will not be any offshore wind connected. However, development rights are in place for tidal sites in Northern Ireland's coastal waters.

The development rights were announced for two 100 MW tidal developments along the north coast. The developers granted these developments rights have been in contact with SONI regarding the connection of off-shore renewable generation.

4.2.4. Demand Side Units

As at the data freeze date, in Northern Ireland five demand side units (DSU) had entered the Single Electricity Market. These DSUs have a combined dispatchable capacity of 67 MW.

^{68 &}lt;a href="https://www.economy-ni.gov.uk/articles/strategic-energy-framework-2010">https://www.economy-ni.gov.uk/articles/offshore-renewable-electricity
https://www.economy-ni.gov.uk/articles/offshore-renewable-electricity

4.2.5. Embedded Generation

Existing Embedded Generation

Table 4-9 shows a breakdown of the existing Northern Ireland embedded generation.

Table 4-9 Northern Ireland Embedded Generation

Generation	Net Capacity (MW)
Large Scale Wind	1,017
Small Scale Wind	162
Large Scale Biomass	23
Small Scale Biomass, CHP and Landfill Gas	61
Large Scale Solar	143
Small Scale Solar	102
Small Scale Hydro	6
Large Scale Landfill Gas	3
CHP	30
AGU	74 (86)
Total	1,621

There is a total of 86 MW of Aggregated Generating Units (AGUs) in Northern Ireland registered in the SEM by three parties.

Two of these AGUs, iPower and EmPower, consist of mostly distribution connected diesel generator sets located around Northern Ireland. The third, ContourGlobal, consists of CHP gas generation. These units currently participate in the ISEM.

There is currently 6 MW of small-scale hydro generation installed on the waterways of Northern Ireland. This is a mature technology. Due to the lack of suitable new locations, limited increase in the small-scale hydro is expected in the foreseeable future.

Peak load Reduction

A number of customers have been reducing energy consumption at times of peak demand. This is achieved by load shifting or by running private generation. SONI has tended to view this generation as non-permanent due to a number of factors:

- The operation of this plant is not as reliable as conventional contracted plant;
- Variable generation costs, e.g. diesel and hire charges; and
- Variable tariff price signals.

Generation of this type is estimated to total 25 MW.

4.2.6. Northern Ireland Generation Mix

The chart in Figure 4-3 shows all existing and planned generation in NI over the ten year period covered by this TYTFS. Superimposed onto the chart is the median demand forecast for NI²¹. The chart illustrates a surplus of generation in relation to the demand from a deterministic point of view. However, factors such as economic dispatch, wind variability, reserve requirements and actual HVDC interconnector flows are not taken into account.

Northern Ireland Generation Mix 5,000 4,500 4,000 3,500 3,000 2,500 2,000 1,500 1,000 500 2018 2019 2020 2021 2022 2023 2024 2025 2026 Year MOYLE CCGT COAL GAS/HFO OCGT

Figure 4-3 Northern Ireland Generation Mix

OTHER RENEWABLE UNAPPROVED RENEWABLE --- DEMAND

BATTERY


WIND

⁷¹ As in the All-Island Generation Capacity Statement 2018-2027.

All-Island Ten Year

Transmission Forecast Statement 2018

5. Transmission System Performance

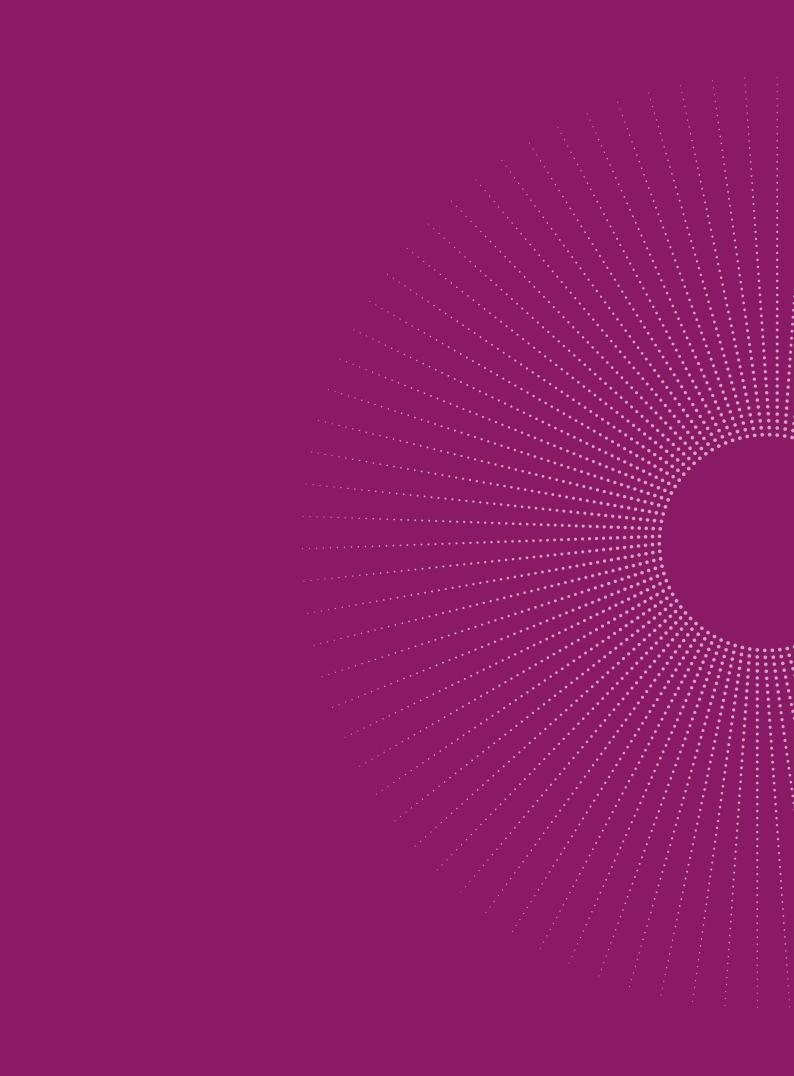

5. Transmission System Performance

This chapter describes the future performance of the transmission system in terms of compliance with planning standards⁷². System performance levels are assessed using:

- Forecast power flows; and
- Short circuit⁷³ current levels.

The power flow and short circuit analyses results presented in this document are based on updated information, which includes changes to:

- The existing and planned transmission system;
- Demand projections; and
- Generation connections.

This updated information is based on the best information available at the data freeze date, July 2018.

5.1. Forecast Power Flows

The power flows on the all-island transmission system, at any given time, depend on:

- The transmission system configuration;
- Demand levels; and
- The output from each generator.

There are many possible combinations of generator dispatches that can meet the demand requirements. There are also many demand scenarios that may occur on the transmission system.

Renewable generation connected to the all-island transmission and distribution system has the effect of altering power flows. The increase in renewable generation⁷⁴ is one of the main factors behind recent changes to power flows on the transmission system.

When examining transmission system performance a range of economic generation dispatches are considered. The generation dispatches used in our power flow analysis are prepared on an allisland basis⁷⁵. Power flows across the existing 275 kV and planned 400 kV internal⁷⁶ interconnectors are modelled to operate within transfer limits. The dispatch scenarios also consider imports and exports of power across the existing Moyle and East-West interconnectors.

Transmission system power flows are shown on the schematic diagrams found in Appendix H. The power flow diagrams show the flow of real and reactive power on the transmission system under normal conditions.

As can be seen in Appendix H, the level of renewable generation increases over the ten year period. As renewable generation increases, power flows from the West of the Island to the East can be seen to increase. This is because renewable power generated in the Western regions is supplying the larger demand levels in the East (Belfast and Dublin). These increased power flows are more significant at times of minimum demand and high renewable generation output.

⁷² Please note that different planning standards are applied in Ireland and Northern Ireland.

⁷³ Short circuit analysis was carried out on both the Ireland and Northern Ireland transmission systems.

⁷⁴ Projected levels of renewable generation connections are detailed in Tables D-2 and D-3 in Appendix D.

⁷⁵ This is reflective of how generation is dispatched in the Integrated Single Electricity Market.

⁷⁶ Internal to the all-island transmission system. These are the interconnectors between Ireland and Northern Ireland. This type of interconnector is also known as a tie line.

Another effect that can be seen in Appendix H is the effect of increased renewable generation levels on reactive power requirements on the transmission system. At high levels of renewable generation, reactive power support is needed to keep voltages within planning standard⁷⁷ limits. The power flow diagrams show the following:

- In the 2018 winter case there is 868 Mvar of reactive power support in service.
- In the winter 2027 case this figure increases to 1324 Mvar of reactive power support in service⁷⁸.

5.2. Compliance with Planning Standards

The transmission system is planned and operated to technical requirements and standards in Ireland and Northern Ireland. These requirements are laid out in the Transmission System Security and Planning Standards (TSSPS⁷⁹) documents. These standards are in line with international standards.

The standards are deterministic⁸⁰ – as are those generally used throughout the world in transmission planning. They set out an objective standard which delivers an acceptable compromise between the cost of development and service delivered. Rather than conducting subjective benefit analysis in each case, it is preferable to plan to meet an objective standard and carry out analysis of the options available to meet the standard.

The need for transmission system development is identified when the simulation of future conditions indicates that the TSSPS would be breached.

5.2.1. Ireland

Our view of future transmission needs and our plan to develop the Irish network through specific projects to meet these needs over the next ten years is presented in our Transmission Development plan (TDP81). The TDP presents the projects which are currently being advanced to solve the needs of the transmission network. In addition, future needs that drive future potential projects are also discussed. We issue the TDP annually.

It is possible that changes will occur in the need for; scope of; and timing of the developments in the TDP. Similarly, it is likely, given the continuously changing nature of electricity requirements, that new developments will emerge that could impact the plan as presented. The long-term development of the network is under review on an on-going basis.

TYTFS 2018 includes transmission system development projects that have received capital approval. Details of these projects can be found in Chapter 2 and in the TDP.

5.2.2. Northern Ireland

The Northern Ireland transmission projects included in TYTFS 2018 are based on the Transmission Development Plan Northern Ireland (TDPNI). Capital projects are mainly driven by increases in Northern Ireland demand and renewable generation connection levels. Planned developments include load related and asset replacement projects. These projects mainly impact on the rating of switchgear⁸² and circuits. Details of these projects can be found in Chapter 2 and in the TDPNI.

⁷⁷ This refers to the Ireland and Northern Ireland planning standards. (TSSPS Ireland applies to the Irish transmission system and TSSPS Northern Ireland applies to the NI transmission system).

⁷⁸ This is in addition to reactive power that is supplied by online generation.

⁷⁹ The Irish transmission system is developed in accordance with the TSSPS Ireland: http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-Iransmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf

The Northern Irish Transmission System is developed in accordance with the TSSPS Northern Ireland:

http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf

⁸⁰ The deterministic methodology is often referred to as the N-1 criterion. The system must have sufficient capacity so that in the eventuality of a probable system outage, there are no resulting system problems such as overloading, under-voltage, over-voltage or instability.

⁸¹ This is not an all-island document. The latest version of the Irish Transmission Development Plan is available at www.eirgridgroup.com.

⁸² Devices used to control, protect and isolate electrical equipment.

5.3. Short Circuit Current Levels

Short circuit currents⁸⁴ occur during a fault condition on the transmission system. Depending on the type of fault, these short circuit currents can be very high. All transmission system equipment must be capable of carrying these very high currents.

Protection devices, in particular circuit breakers, must be capable of closing onto high currents created by a fault on the transmission system. They must also be capable of interrupting high currents to isolate a fault. Correct operation is essential for minimising risk to personnel and preventing damage to transmission equipment. Correct operation of protection devices is also necessary for maintaining system stability, security and quality of supply.

Short circuit current levels must be considered as the transmission system is developed and as new generation or demand is connected. In Ireland the EirGrid Grid Code specifies short circuit current levels; these values are shown in Table 5-1. Users connecting to the transmission system are required to design their plant and apparatus to these specified levels. Equipment at lower voltage levels must also be designed to withstand short circuit current levels.

Voltage Level (kV)	Short Circuit Current Levels (kA)		
	Ireland		Northern Ireland
400	50		50
275	n/a		40
220	40		n/a
110	Countrywide	25	40
	Designated sites	31.5	

Table 5-1: Short Circuit Current Levels

Table 5-1 also includes short circuit requirements for new users connecting to the Northern Ireland transmission system. Northern Ireland system users are recommended to design their plant and apparatus to withstand short circuit current levels set out in Table 5-1, as a minimum. The design of a user's plant is also subject to detailed short circuit current level assessment.

Changes to the transmission system or the addition of generation can increase the short circuit current levels at nearby⁸⁵ stations. Forecast increases in short circuit current levels can indicate transmission system equipment at risk of having its rating exceeded. Should this be the case, it may be necessary to replace this equipment with higher rated plant. Risk mitigation measures may also be implemented to reduce short circuit current levels. Short circuit current levels are calculated for all transmission system nodes in accordance with engineering recommendation G74⁸⁶. Engineering recommendation G74 is based on international standards.

The analysis was carried out for single and three phase faults, for winter peak and summer valley studies. Short circuit current levels were assessed for the years 2018, 2021 and 2024, and the results are presented in Section 5.3.1. A description of the calculation methods used are given in Appendix E. Appendix E also provides the results of the short circuit analysis alongside an explanation of the terms used in short circuit discussions in this document.

⁸³ Short circuit currents are also known as "fault levels".

⁸⁴ A short circuit current is an abnormal current that flows along an unintended, low resistance path. Short circuit currents can be extremely high and may cause harm to personnel or damage equipment.

⁸⁵ This means stations that are electrically nearby, which does not necessarily mean those geographically closest.

⁸⁶ IEC 60909 was an international standard issued in 1988 which provided guidance on the manual calculation of short circuit currents in a three phase AC system. The conservative results produced by this method could result in over investment and Engineering Recommendation G74 was introduced as an outline procedure for computer-based derivation of short circuit currents.

Winter peak analysis is carried out to represent the most onerous transmission system conditions, where maximum short circuit currents on the transmission system are most likely to occur. During winter peak analysis, generators that are not providing real or reactive power are switched on in the study and dispatched at o MW. This measure ensures short circuit current contributions from all generator sources are considered in the studies. This ensures the most onerous, but credible, conditions are used for the calculation of short circuit current levels at each bus.

Analysis of summer valley is carried out to indicate minimum short circuit currents on the transmission system based on intact network conditions. The minimum short circuit current at each bus is dependent on generation dispatch and transmission system conditions. Those requiring the expected minimum short circuit current level at a particular bus are advised to contact us directly. During summer valley analysis, generators that were not dispatched were not connected to the system.

Both the maximum and minimum short circuit current level studies assume that the transmission system is in the normal intact condition. The economic generation dispatches for the winter peak and summer valley studies are presented in Appendix D.

The results presented in Section 5.3.1 are the total busbar short circuit current levels. Short circuit current that could flow through each individual circuit breaker may be less than the total busbar short circuit current. This is dependent on network configuration and conditions.

5.3.1. Assessment of Short Circuit Current Levels in Ireland

The transmission system in Ireland is designed and operated to maintain short circuit current levels below the levels in Table 5-1. In planning the system a 10% margin is applied (for example 220 kV short circuit currents will be kept below 36 kA). This is done for security reasons.

As Table 5-1 indicates, while most 110 kV stations in Ireland are designated as 25 kA, the EirGrid Grid Code stipulates that certain 110 kV stations may be designated as 31.5 kA. A new station could be designated as 31.5 kA from the start, or an existing 25 kA station may be changed to 31.5 kA. When a station changes from 25 kA to 31.5 kA, the equipment at that station may need to be modified. Station equipment at lower voltages also needs to be replaced in order to comply with this design rating.

The stations currently designated with a 31.5 kA 110 kV equipment rating are: Barnahely, Cloghran, College Park, Corduff, Finglas, Kilbarry, Knockraha, Louth, Marina, Raffeen, Tarbert and Trabeg. EirGrid will annually publish an updated list of designated stations.

Short circuit current results are presented in Appendix E. The results for Ireland include X/R ratios, transient AC (lk') and subtransient AC (lk'') currents. These results provide an indication of the strength of the transmission system.

5.3.2. Assessment of Short Circuit Current Levels in Northern Ireland

The Northern Ireland transmission system is designed and operated to maintain short circuit current levels below equipment ratings. These ratings are listed in the tables in Appendix E, Section E.6.3. The individual substation ratings are based on the lowest rated equipment at each substation.

The Northern Ireland results in Appendix E include transmission substation ratings for:

- AC & DC X/R Ratios;
- Initial Short Circuit Current (I");
- Peak Make Current (ip) and
- RMS Break Current (IB).

The I" and ip values are used to assess the necessary rating of electrical equipment required to close onto short circuit currents.

The IB values are used to assess the capability of electrical equipment required to open and break short circuit current.

5.3.3. Maximum Short Circuit Current Results

Short circuit current results show that a number of Northern Ireland transmission nodes are experiencing short circuit current levels close to their current rated capability. Careful management of these issues is needed to ensure levels remain within their current rated capability.

In general throughout Ireland short circuit currents are well within standard ratings. However, there are a number of stations where short circuit current levels are above 80% of standard levels, see Figure 5-1. We will continue to monitor short circuit current levels at all stations and if required we will put mitigation plans and measures in place to ensure that they remain within safety standards mitigations include operational measures such as sectionalising parts of the network and investing in new equipment.

Figure 5-1 indicates the locations where short circuit current levels are high in 2024. In Ireland the short circuit current level results are represented as a percentage of the levels specified in the Grid Code as follows:

- 25 kA on the 110 kV system generally this is the countrywide rating noted in Table 5-1;
- 40 kA on the 220 kV system; and
- 50 kA on the 400 kV system.

In Northern Ireland the short circuit level results are represented as a percentage of actual equipment ratings.

Three short circuit level ranges are represented in Figure 5-1:

- Yellow dots represent substations where short circuit current results are between 80% and 90% of the ratings;
- Orange dots represent substations where short circuit current results are between 90% and 100% of the ratings; and
- Red dots indicate substations where the short circuit current results exceed ratings.

Several substations have been found to experience short circuit current levels that exceed 100% of their relevant level. These substations are discussed below.

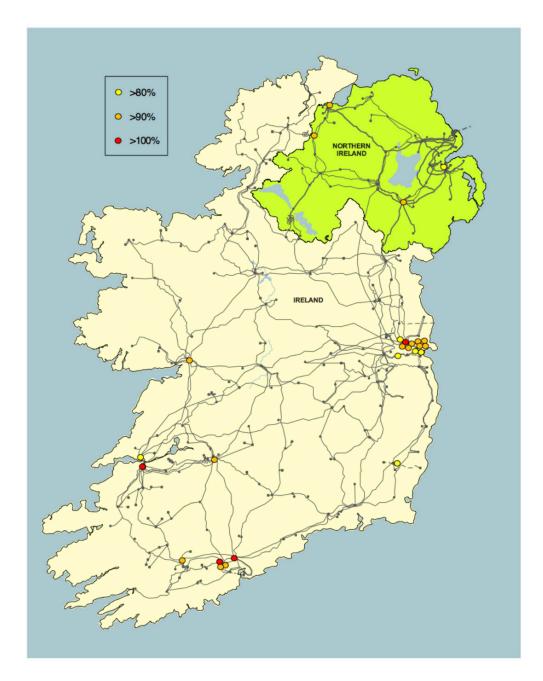


Figure 5-1: Short Circuit Current Levels for Winter Peak 2024

Rating (%)	2018	2021	2024
>100	BPS 110 kV	CDU 110 kV	CDU 110 kV
	CDU 110 kV	KBY 110 kV	KBY 110 kV
		KPG 110 kV	KPG 110 kV
		KRA 110 kV	KRA 110 kV
>90	CLG 110 kV	BLC 110 kV	BLC 110 kV
	COL (I) 110 kV	CLA 110 kV	CLA 110 kV
	CSH 110 kV	CLG 110 kV	CLG 110 kV
	KBY 110 kV	COL (I) 110 kV	COL (I) 110 kV
	KLN 110 kV	CPS 110 kV	CPS 110 kV
	KPG 110 kV	CSH 110 kV	CSH 110 kV
	KRA 110 kV	FIN (I) 110 kV	DRN 110 kV
	MR 110 kV	KLM 110 kV	DTN 110 kV
	TAN 110 kV	KLN 110 kV	FIN (I) 110 kV
	TBG 110 kV	MR 110 kV	KLM 110 kV
		STR 110 kV	KLN 110 kV
		TAN 110 kV	MR 110 kV
		TBG 110 kV	STR 110 kV
			TAN 110 kV
			TBG 110 kV

Stations Where the Rating has been Exceeded

i) Ireland Stations where the rating has been exceeded

Short circuit current levels at Corduff, Kilpaddoge, Kilbarry and Knockraha 110 kV stations exceed 100% of the level specified in the Grid Code for the 110 kV system – 25 kA. However, Corduff is a designated station with 110 kV equipment designed to 31.5 kA and Kilpaddoge has equipment designed to 40 kA.

We will continue to monitor and manage short circuit current levels at Kilbarry and Knockraha stations. Our calculation methodology and approach outlined in Appendix E is prudent. We will continue to monitor short circuit current levels and if required we will take measures to prevent such conditions occurring in order to maintain short circuit current levels at safe levels.

ii) Northern Ireland Stations Where the Rating Has Been Exceeded

Ballylumford 110 kV

Short circuit current levels at the Ballylumford 110 kV node exceed the existing substation ratings. This occurs under maximum generation conditions when both of the 275/110 kV interbus transformers are in service.

The existing substation is programmed to be replaced with a substation incorporating a new 110 kV GIS switchboard. This work is planned to be completed by 2021. In the interim, we manage this risk by operating with one interbus transformer out of service. This reduces the short circuit current level below the equipment rating.

5.3.4. Minimum Short Circuit Current Results

The minimum short circuit current results are presented in Appendix E. These results indicate minimum short circuit currents on the transmission system based on intact network conditions. These results are representative of the assumed generation dispatch and transmission system conditions.

Any parties requiring the expected minimum short circuit current level at a particular bus are advised to contact us directly.


The Moyle Interconnector has a minimum operating requirement of 1,500 MVA. This is equivalent to a short circuit current level of 3.15 kA. Below this short circuit current level the high voltage direct current (HVDC) interconnector fails to commutate⁸⁷. However, as shown in Appendix E, this is not an issue over the period covered by this TYTFS.

⁸⁷ Commutation is the process of reversing the direction of electric current. It is commonly used when turning alternating current to a direct current.



Transmission Forecast Statement 2018

6. Overview of Transmission System Capability Analyses

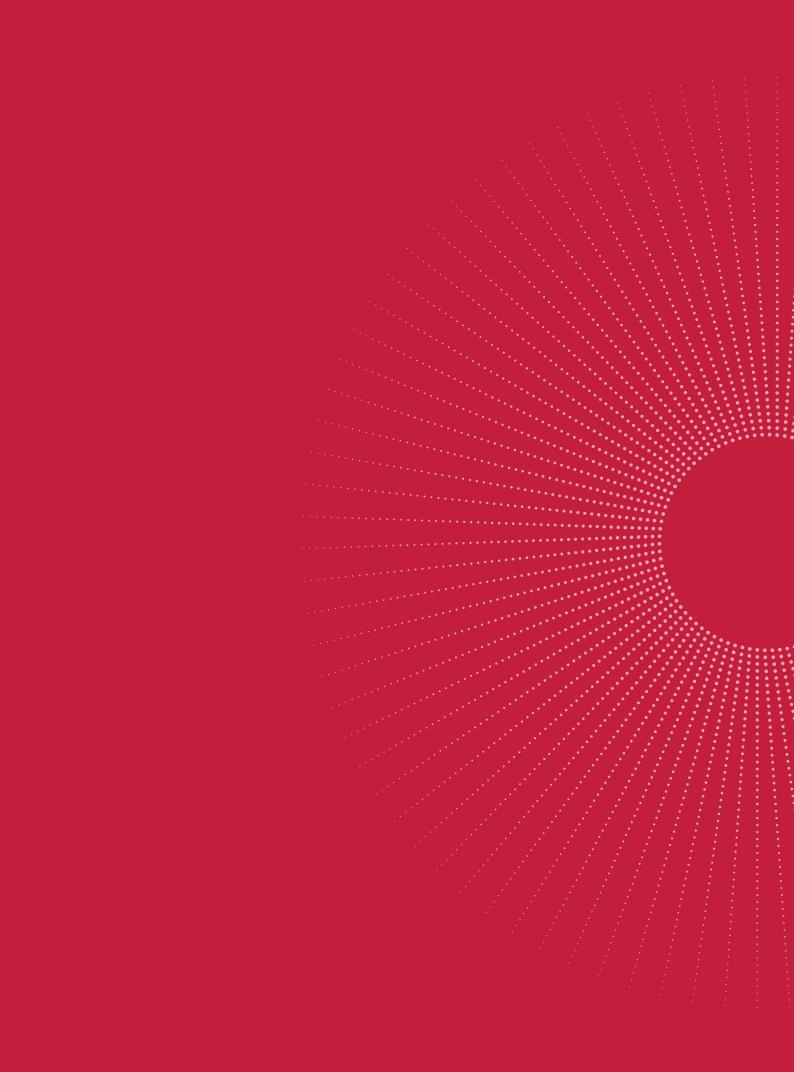

6. Overview of Transmission System Capability Analyses

This chapter describes analyses carried out to determine the capability of the transmission system to accommodate additional demand and generation. The results of these analyses⁸⁸ provide the basis for the statements of opportunity⁸⁹ discussed in Chapter 7 and Chapter 8.

6.1. All-Island Demand Opportunity Analysis

This section describes the demand opportunity analysis performed on the Ireland and Northern Ireland power systems. This analysis is used to determine the capability of the transmission system to accommodate additional demand connections at the defined areas. The statements of opportunity presented in Chapter 8 are a result of this demand opportunity analysis.

The all-island demand opportunity analysis is carried out for a single year, 2024. This year gives developers a useful indication as to the demand opportunities that exist in the medium-term on the transmission system. Studies are carried out for the summer period and the winter period of 2024/2025.

In Northern Ireland the demand opportunity analysis provides an indication of capability of the backbone⁹⁰ transmission network to accommodate additional demand. In Ireland, the locations analysed for new demand have been carefully chosen based on feedback from industry sources. The chosen stations have been tailored to align with potential areas that are of interest to customers seeking connection to the transmission system.

It should be noted that the results of these studies are dependent on:

- Generation assumptions;
- Demand assumptions; and
- Completion dates of transmission system development projects.

Factors that may influence the results are discussed in Section 6.3.

6.1.1. Approach for Calculation of Demand Opportunity

The transmission system is planned to meet forecast demand levels at all stations in Ireland and Northern Ireland. The demand forecast for each 110 kV station is a proportion of the overall system demand forecast. This forecast is based on historical demand distributions. Future demand customers that have signed connection agreements are also included in station demand forecasts as presented in Chapter 3.

Additional demand connections above the forecast levels are not explicitly catered for in transmission system development plans. However, capacity for additional demand on the transmission system may exist at certain locations. For example, the addition of transmission system infrastructure generally provides a step increase in transmission system capacity. This addition may permit demand connections higher than forecast levels, as illustrated in Figure 6-1.

http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/

⁸⁸ It is important to note that the statements of opportunity are not only based on these analyses, but also with information presented in other chapters of this document.

⁸⁹ Information on how to become a customer can be accessed at the EirGrid and SONI websites as follows

http://www.soni.ltd.uk/customer-and-industry/becoming-a-customer/

⁹⁰ The backbone transmission system connects local area networks together, enabling the efficient bulk transfer of electricity around the country and beyond.

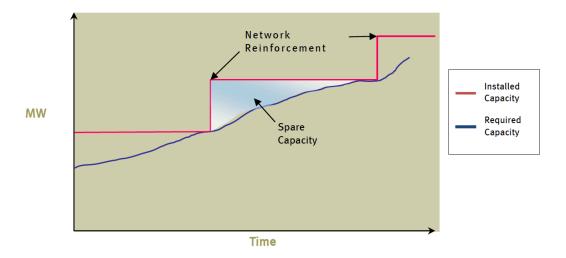


Figure 6-1: Illustration of Typical Step Change in System Capacity Due to the Addition of Transmission System Infrastructure

In Figure 6-1 the blue line represents the required MW capacity at a particular location on the transmission system. The red line represents the installed transmission system capacity. As Figure 6-1 shows, changes in installed capacity generally appear as a step increase following completion of a network reinforcement project. Therefore, following a network reinforcement project there is spare capacity available on the transmission system for a period of time.

In general, demand for electricity increases over time. Figure 6-2 below displays the typical demand growth profile of a typical station. The blue line represents the demand forecast at the station. The blue bars represent potential new step increases in demand that could potentially be accommodated at this typical station.

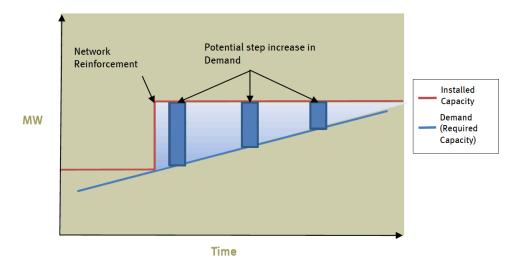


Figure 6-2: Forecast Demand Profile of a Typical Station and Station Potential to Accommodate Additional Step Increase in Demand

The analysis examines the transmission system's capability to accept such increased demand above forecast levels. Capability to accept additional demand is examined at a number of 110 kV, 220 kV and 275 kV stations. The stations analysed are distributed throughout Ireland and Northern Ireland, as shown in Figure 8-1 in Chapter 8. The results of this analysis are useful in identifying opportunities for the connection of new or increased demand.

The opportunity value calculated is a measure of the transfer capability remaining in the physical transmission system. It provides an indication of the flexibility of the transmission system to accommodate future demand increases before additional reinforcements are required.

The transfer analysis is intended as a pre-feasibility indication of opportunity for increased demands. The method for determining capacity closely aligns with pre-feasibility study techniques.

In Ireland, the Irish Transmission System Security and Planning Standards (TSSPS)⁹¹ have been applied in the analyses of demand opportunities. The transmission system is assessed for the loss of any single item of plant (N-1). Unlike generators, demand stations are typically not dispatchable. It is therefore necessary to assess the transmission system performance against standards for maintenance-trip contingencies (N-1-1) in the analysis of increased demand in Ireland.

In Northern Ireland, the Northern Irish Transmission System Security and Planning Standards (TSSPS)⁹² have been applied for analyses of demand opportunities. The transmission system is assessed for loss of any single item of transmission plant (N-1) and loss of a double circuit (N-DCT) all year round. During the summer season the Northern Ireland transmission system is also assessed for maintenance-trip (N-1-1) contingencies for specific cases.

Voltage analysis is performed as part of the demand capacity studies in both Ireland and Northern Ireland. This is because the addition of demand is likely to impact on local voltages levels.

6.1.2. Method for Calculating Limits for Increased Demand Connections

An AC load flow linear algorithm is used to screen critical contingencies for thermal overloads or voltage limitations.

What is a load flow?

A load flow is a numerical analysis of the flow of electric power in an interconnected system. Load flow analysis is performed on a power system model to determine steady-state (normal operation) values such as voltages, voltage angles, real power and reactive power.

What is a linear algorithm?

A linear algorithm uses an interactive approach to find the solution to a numerical problem, such as determining voltages on the power system. A linear algorithm is a simple and robust method of finding a solution.

Power transfers are considered using dispatch scenarios typically experienced on the transmission system. While these dispatches are typical, we chose them for our analysis to stress the network in terms of power transfers.

By analysing different scenarios that stress the transmission system, we can reasonably ensure that the demand opportunities reported in our analysis will not breach our Transmission System Security and Planning Standards.

The conventional units selected for each dispatch scenario align with market projections for the study year 2024.

⁹¹ http://www.eirgridgroup.com/site-files/library/EirGrid/EirGrid-Transmission-System-Security-and-Planning-Standards-TSSPS-Final-May-2016-APPROVED.pdf

⁹² http://www.soni.ltd.uk/media/Northern-Ireland-TSSPS-September-2015.pdf

Modelling Details

For single (N-1) and double circuit (N-DC) contingency studies

- Generators are modelled with their maximum output equivalent to their Maximum Export Capacity (MEC); and
- Local wind generation is switched out in the vicinity of the test station⁹³.

For maintenance-trip studies (N-1-1)

- Generators are modelled with their maximum output equivalent to their Maximum Export Capacity (MEC); and
- Some centrally-dispatchable generation local to the test station is maximised to its MEC value⁹⁴.

To calculate the opportunity, demand at 0.90 power factor is added to a test station in increasing amounts. This is balanced by an increase in generation⁹⁵ outside the local test area. This is illustrated in Figure 6-3 below.

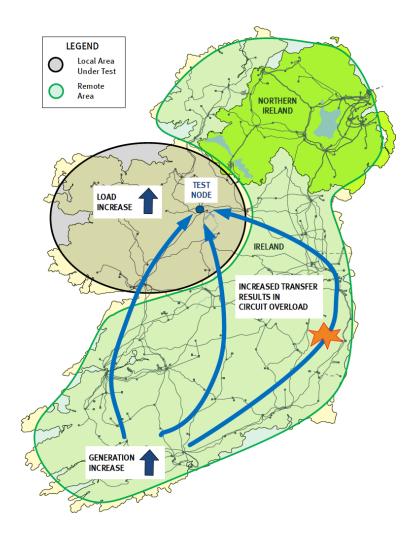


Figure 6-3: Illustration of Incremental Transfer Capability Study Method for Demand

⁹³ As renewable generation is classified as an intermittent energy source, it cannot be relied upon to serve demand.

⁹⁴ This is implemented to create a more favourable dispatch for the maintenance case.

⁹⁵ Generation increased as per merit order.

The limit for increased transfers to the test station is then established. This is achieved by checking the post-contingency performance of the transmission system against thermal and voltage standards. This process is carried out for each dispatch scenario studied. Issues on the transmission system are not considered limiting unless they are sensitive to the incremental transfers under examination.

Calculation of Results

As noted above we undertake a range of contingency studies (N-1, N-1-1, N-DCT) to calculate the capability for increased demand at each station studied.

For the maintenance-trip studies (N-1-1) in Ireland, less onerous generation dispatches can be scheduled to accommodate maintenance outages.

The results of this analysis are reported in Chapter 8. The demand opportunity reported is the lowest demand increase achieved from the range of studies undertaken. It is important to note that results of the demand opportunity analysis are indicative only. Demand opportunity is tested at each station on an individual basis. As such, the opportunities presented are not cumulative. If new demand connects in an area that is currently shown to have capacity, this will then use up some or all of the available capacity in that area.

Potential demand customers should not be discouraged by choosing a site in which there appears to be a lack of transmission system capacity. Early consultation with us is encouraged so that we can work jointly to explore options relating to any potential proposals and enable timely decision making. Customers considering connecting demand to the transmission system are advised to contact us as early in the project as possible.

6.1.3. Calculation of Capability for Demand in Dublin

The Dublin region is the largest demand centre on the all-island transmission system. Dublin has been and remains the focus of continual interest for the connection of new large demand.

There has been a significant increase in the number of enquiries and applications for new demand connections in the Dublin region and its environs in recent years. Many of these requests are for data centres. Data centres present relatively flat load profiles that impact on both the minimum and maximum demand requirements in the region. If all of these enquiries were to materialise and connect, the maximum demand of Dublin could exceed 3,000 MW (see Chapter 3 Demand).

The Dublin 220 kV transmission network is operated by EirGrid, the transmission system operator (TSO). The radial 110 kV circuits are operated by ESB Networks, the distribution system operator (DSO). System development and operation in the area requires both system operators to work closely together. This is to ensure power flows are optimised and to facilitate new connections.

Due to the volume of demand enquiries and applications received for the Dublin area, and their potential impact, Section 8.3 of this document focuses on the demand opportunities in the Dublin region.

The Dublin region has been divided into three geographic zones (see Figure 8-3 in Chapter 8), namely the North, West and South clusters. This is aimed at providing a more detailed insight into the available connection capacity. This takes into account the three main corridors servicing the main bulk supply points⁹⁶.

⁹⁶ These main bulk supply points act as the transmission to distribution interfaces in the region.

The methodology used to consider demand opportunities in the Dublin region is based on the existing transmission system. It also includes criteria, such as:

- How each zone is expected to develop; and
- The associated lead times for project delivery.

6.1.4. Calculation of Capability for Demand at Any Station Outside Dublin

This section provides a general example of the analysis of the capability of any station studied in Chapter 8 to accept additional new demand. The station is tested to accommodate increased demand in summer peak 2024.

The assessment is carried out by simulating the transmission system for summer peak 2024. The relevant demand forecasts and generator dispatches are used.

Due to its variable nature, wind generation cannot be relied on to meet the demand at all times. Therefore, all wind generation in the vicinity of the test station is switched off. Studies are carried out according to the dispatch scenario assumed. The extra demand in each study is met by increasing generation according to the merit order. For each study in turn, a test demand (for example 100 MW) is added to the station under study. The power system is then analysed using an AC load flow linear algorithm.

The analysis tested an exhaustive range of N-1 contingencies (individual circuit/transformer or generator outages) to identify any resultant TSSPS violations. Thus TSSPS violations identify a capacity limit. Some contingencies cause violations of thermal overload or voltage standards at the maximum capacity. In these cases, the analysis reverts to o MW and performs the test in increasing steps, 10 MW in size. The test runs in increasing steps until a violation of thermal overload or voltage standards occurs. The preceding step value is then the calculated capacity value.

In assessing opportunities for new demand, the TYTFS considers the capability of the transmission system only. The capability of the distribution system is not addressed in Ireland or Northern Ireland. The implications for generation adequacy of demand growth above the median forecast levels are dealt with separately in the All-Island Generation Capacity Statement 2018-2027 (GCS) which is available on the EirGrid and SONI websites.

6.2. All-Island Generator Opportunity Analysis

This section describes the generation opportunity analysis performed on the Ireland and Northern Ireland power systems. This analysis is used to determine the capability of the transmission system to accommodate additional generation connections at the defined areas. The statements of opportunity presented in Chapter 7 are a result of this generation opportunity analysis⁹⁷.

The generation opportunity for a selection of nodes across the all-island transmission network is presented in Chapter 7. The final year of this forecast statement, 2027, is used in the analysis. The analysis is performed using an AC load flow linear algorithm, the same approach used in the demand opportunity analysis. The methodology is described in Section 6.2.1.

We have included information on the harmonised all-island Transmission Use of System (TUoS) charge and Transmission Loss Adjustment Factor (TLAF) arrangements in SEM in this TYTFS. The all-island TUoS and TLAF arrangements have an objective to provide locational signals to generators that reflect the costs they impose on the transmission system⁹⁸.

⁹⁷ It is important to note that the statements of opportunity are not only based on these analyses, but also with information presented in other chapters of this document.

⁹⁸ This is not the only objective of the charges and losses arrangements in SEM.

We describe the changing connection capacity locations, the impact on network power flows and the resulting effect on TUoS charges and TLAFs. These TUoS and TLAF values have an impact on power generation costs.

This information is provided to help generators make informed decisions when exploring potential transmission network connection locations.

All information relating to generation opportunity presented in Chapter 7 is indicative only. Connection applications are required to follow the connection offer process.

6.2.1. Approach for Calculation of Generation Opportunity

Generation opportunity at a node is assessed via the use of an AC load flow linear algorithm. It is based on the premise that new generation at a particular point on the network will displace generation at a different point on the network. Figure 6-4 presents a simple illustration of the calculation methodology used for the generator opportunity analysis.

All existing generation, and all generation planned to connect in Ireland and Northern Ireland during the period covered by the TYTFS, is considered for dispatch before assessing any further generation opportunity on the all-island transmission network.

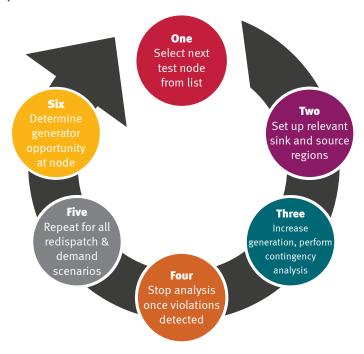


Figure 6-4: Generator Opportunities Analysis Methodology

We compiled a list of 110 kV, 220 kV, 275 kV and 400 kV nodes for generation opportunity analysis. These nodes are distributed across the all-island network so that potential users can understand how opportunities vary across the network.

When testing a node, existing generation in the area around the node is maximised; this group of generators is referred to as the source region. The remaining generation required to meet the demand is dispatched based on a merit order. Finally, the test generator is then dispatched.

As the output of the test generator increases, the output from other generation in a separate area of the network - the sink area - is reduced. This forces power flows along specific corridors of the transmission network.

For each incremental increase in new generation capacity at the test node, an AC load flow linear algorithm is used to test the network for compliance with the TSSPS. The generation opportunity is determined once overloads are detected on the network.

For the generation opportunity analysis, single (N-1) and double circuit (N-DCT) contingency studies only are considered.

For each node assessed, three different analyses are performed. Figure 6-5 demonstrates an example of this approach.

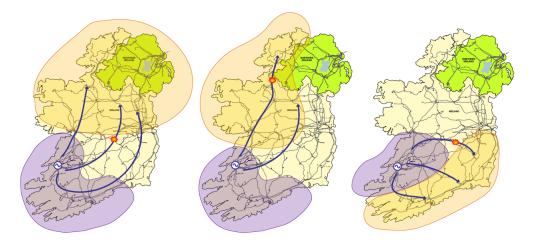


Figure 6-5: Illustration of Incremental Transfer Capability Study Method for Generation

For each scenario, the purple area represents the source region, where generation is maximised. The test generator is then increased, and generation in the orange area - the sink region - is reduced. The blue arrows represent the resulting power flows. These three scenarios are then repeated for the following network demand scenarios:

- Winter peak;
- Autumn peak (Northern Ireland only);
- Summer peak; and
- Summer valley.

The lowest result from all of the scenarios analysed is used to determine the capacity of the node under test. By analysing several scenarios across different demand scenarios that stress the transmission system, we can reasonably ensure that the generation opportunities reported in our analysis will not breach our Transmission System Security and Planning Standards.

It is important to note that results of the generation opportunity analysis are indicative only. The results of the analysis are not cumulative, as the capability of a node to accept new generation capacity is tested individually.

The transmission system is planned to meet forecast generation levels at all stations in Ireland and Northern Ireland. Additional generation connections above the forecast levels are not explicitly catered for in transmission system development plans. However, capacity for additional generation on the transmission system may exist at certain locations.

Because of the relative size of individual generators, changes in generation installations, whether new additions or closures can have a more significant impact on power flows than demand. New generation capacity will inevitably alter the power flows across the network, which has the potential to create overload problems deep into the network. Problems deep into the network are resolved by network reinforcements known as deep reinforcements.

The generation opportunity analysis presents the level of generation that can be accommodated on the planned transmission system without the need for deep reinforcements to allow full network access.

6.3. Factors Impacting On Results

The results⁹⁹ of the analyses described in this chapter are based on a set of assumptions. These assumptions are associated with:

- Future demand growth;
- · Generation connections; and
- Transmission system developments.

The key forecast factors on which the results depend are dynamic. Therefore, the reality that emerges will not exactly match the forecasts. Consequently, the results, while reasonably indicative, should not be interpreted as definitive projections.

The factors likely to have an impact on the outcomes include:

- The signing of a connection agreement by a new generator;
- Delays in connection of committed new generation stations;
- Closure of existing generation stations;
- Changes in the economy which give rise to consequential changes in the overall demand for electricity;
- Changes in demand in a particular region or area, arising from new industry developments or closures;
- Delays in the provision of transmission system reinforcements; and
- Selection and construction of new transmission system reinforcement developments which may significantly increase transmission system capacity.

⁹⁹ These results are presented in Chapter 7 and Chapter 8.



All-Island Ten Year

Transmission Forecast Statement 2018

7. Transmission System Capability for New Generation



7. Transmission System Capability for New Generation

7.1. Summary of analysis

The results of the generation opportunity analysis for this statement are broadly similar to those from the previous statement. With significant quantities of renewable generation connected across the island, there is little to no opportunity for additional generation in northern and western parts of the all-island transmission network.

The areas with the greatest opportunity for additional generation are at nodes on the 275 kV ring in Northern Ireland, and 220 kV stations in the Dublin area. Nodes in the south-eastern part of the allisland network also show capability for additional generation.

7.2. Background

In this chapter we provide the results of the detailed generation capacity opportunity analysis, of which the calculation methodology is described in Chapter 6.

The analysis considers the final year of this statement – 2027 – and details the opportunity for connecting further generation beyond the assumed installed generation portfolio. The results provide potential network users with a guide to the ability of the all-island transmission system to accept new generation. It must be stressed that this analysis is indicative only; the actual transmission network capacity can only be determined during the connection offer process. This process requires detailed network assessments to determine the optimal connection arrangement that complies with the Transmission System Security and Planning Standards (TSSPS) in Ireland and Northern Ireland. EirGrid has completed a separate East Coast Generation Opportunity Assessment study¹⁰⁰ which provides information on the capacity available for new generation on the east coast and also the available space in existing substations for new connections.

Significant changes to generation dispatch patterns and the geographical location of generation impact on all-island transmission network power flows. As a consequence, Generator Transmission Use of System (GTUoS) tariffs and Transmission Loss Adjustment Factors (TLAFs) have changed, resulting in an impact on the economics and location of power generation. Resulting regional changes in GTUoS and TLAFs are described to help generators make informed decisions when exploring potential transmission network connection locations.

7.3. New Generation Capacity

The level of generation expected to connect to the all-island transmission system is described in detail in Chapter 4 of this statement.

The largest recent generation capacity increase has been wind generation. At the freeze date of July 2018 there was about 4,700 MW connected to the all-island transmission system. Depending on project completion rates this all-island figure could increase to approximately 7,300 MW of wind generation capacity over the period of this statement (see Chapter 4).

This generation is mainly connected in remote locations in the South-West, West and North-West of the island of Ireland. At times of high wind generation this can result in very high power flows on transmission circuits supplying power to the large demand centres on the East coast of Ireland and Northern Ireland.

100 http://www.eirgridgroup.com/site-files/library/EirGrid/East-Coast-Generation-Opportunity-Assessment.pdf

In contrast there are a number of large conventional power stations due for retirement or to have restricted output due to the EU Industrial Emissions Directive. These are detailed in All-Island Generation Capacity Statement 2018-2027 and noted in Chapter 4 of this document.

7.4. Generation Opportunity

7.4.1. At Selected 220 kV, 275 kV and 400 kV Stations

This section provides the opportunities for additional generation on the 220 kV, 275 kV and 400 kV networks in 2027. For these high voltage stations, new generation of up to 500 MW in size was considered for assessment. Figure 7-1 illustrates the stations selected across the all-island network, and their resultant generation opportunity. It is important to note that the results are not cumulative, as the opportunity at each station is assessed individually. The capacities shown are relevant to the station tested, but also provide an indication of the opportunities available at neighbouring stations.

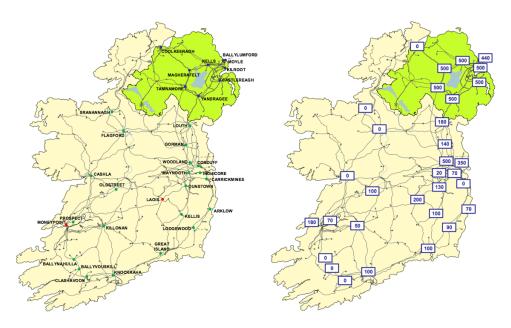


Figure 7-1: Generation opportunity at 220 kV, 275 kV and 400 kV stations in 2027

In general, there is no opportunity for new generation in the North and West of Ireland, and very limited opportunity in the South-West of Ireland. The transmission network in these areas is mainly comprised of 110 kV circuits; these areas also have significant levels of connected and planned renewable generation. As a result, there is little to no additional capacity available. The only exception is the area around Moneypoint, located close to the 400 kV network. In the East and South East regions, there is increased opportunity for new generation, being located closer to the large demand centres.

With the potential development of large data centres in the Dublin area, there will be increased generation opportunities at stations around Dublin beyond that indicated in this analysis. Further details on the generation opportunities created by increased load in Dublin are provided in the East Coast Generation Opportunity Assessment study.

In Northern Ireland, there is currently very little opportunity for new generation in the North-West region, although this may change in future. Similar to Ireland, this area has significant levels of renewable generation, both connected and planned, and the transmission network is almost entirely comprised of 110 kV circuits. However, there is significant opportunity on the 275 kV network towards the South and East, with 500 MW of capability at many of the nodes on the 275 kV network.

7.4.2. At Selected 110 kV Stations

A number of 110 kV stations were also analysed to complement the higher voltage stations analysed in Section 7.4.1. For these stations, new generation of up to 200 MW in size was considered for assessment. The stations, and their resultant generation opportunity, are displayed in Figure 7-2.

As in the previous section, the results are not cumulative, as the opportunity at each station is assessed individually. The capacities shown are relevant to the station tested, but also provide an indication of the opportunities available at neighbouring stations.

As expected, there is very little opportunity for generation connection at 110 kV. By 2027 in Ireland, there is a high level of renewable generation connected to both the transmission and distribution systems. This is concentrated in the North-West, West and South-West, and the installed capacities exceed the demand in these areas. As a result, there is little to no opportunity available anywhere in those areas.

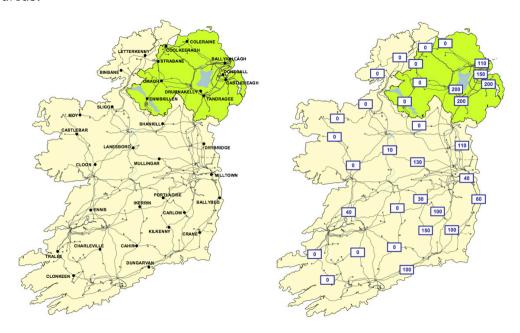


Figure 7-2: Generation opportunity at 110 kV stations in 2027

Towards the South-East and East of Ireland, there is opportunity available at 110 kV nodes. The largest demand centres are located in these areas, and the transmission network is stronger. Additionally, renewable generation penetration is lower in these areas. Connection studies would be required to determine the available capacity and connection arrangements.

Not dissimilar to Ireland, Northern Ireland is connecting high levels of renewable generation, with more planning to connect to the transmission and distribution systems by 2027. This generation in the North and West of Northern Ireland is greater than local demand and causes congestion on the transmission network.

In the East of Northern Ireland, opportunities for generation connection are possible, with a less congested transmission network and higher demand density. Again, detailed connection studies would be required to determine the available capacity and connection arrangements.

7.5. Generation Locational Signals and Their Impact on Transmission Network Capacity

Harmonised transmission arrangements provide locational signals to users reflecting the costs they impose on the transmission system. TLAFs and GTUoS tariffs, as part of harmonised transmission arrangements, can provide generators with locational signals informing their decision on where to connect to the grid and incentivise efficient generation dispatch.

Electrical losses, which occur as electricity is transported along transmission circuits, are accounted for in the settlement process with the application of TLAFs. Some units are responsible for proportionally more transmission losses than others, depending on their point of connection to the grid and use of transmission network capacity.

The methodology used by the transmission system operators (TSOs) to calculate the TLAFs has been approved by the regulatory authorities¹⁰¹.

The most efficient way to transfer power in terms of losses is to minimise the distance between generation and demand, and not to heavily load lines. Due to the locality and amount of demand and generation, power can be transmitted over sizeable distances. If the power generated in a region is in excess of the demand in that region, the excess generation will be utilised some distance away from the source.

The transmission network consists of high voltage overhead lines and cables ranging from 110 kV to 400 kV. When current flows across these circuits, some energy is lost as heat. The higher the power transmitted on a line, the higher the current. Current has a squared relationship to power losses, therefore if the power on a line is doubled, the losses will increase by a factor of four. In general, transmitting power on a higher voltage level will lower the associated current. The associated losses will be dependent on how congested the line is; increasing power on an already congested line will result in greater losses than increasing power on a similar less congested line.

The Transmission Use of System (TUoS) tariff is the main tariff for transporting power in bulk across the power system. Generator Transmission Use of System (GTUoS) tariffs contains a locational component, which provides a signal of the costs associated with a generator's use of the transmission network.

Such signals provide a commercial incentive for generators to make informed decisions (both siting/entry and exit decisions) concerning their use of the transmission system. This is intended to improve efficiency in respect of both the use of, and investment in, the transmission system.

7.5.1. TLAFs

Generator TLAFs are reflective of their contribution to transmission losses. The principle is that market participants that contribute more to transmission losses, due to their location, should have a lower TLAF, than those generators who contribute less to transmission losses. The regional average 2018/19 TLAF values are shown in Figure 7-3, and are based on the published approved 2018/19 TLAF values.

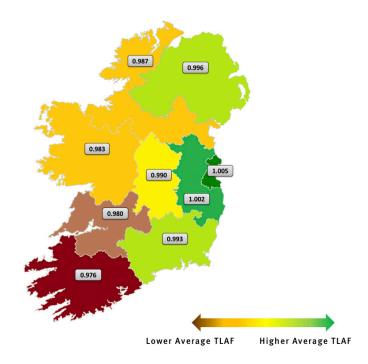


Figure 7-3: All-island 2018/19 regional average TLAF values

Figure 7-4 shows the change in TLAFs between 2017/18 and 2018/19. These changes are influenced by yearly dispatch, demand and topology changes.

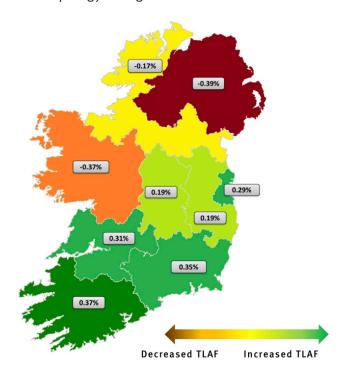


Figure 7-4 – Percentage TLAF change between 2017/18 & 2018/19

The information presented in Figures 7-3 and 7-4 should be used as regional indicators. For example in Northern Ireland (NI), Figure 7-4 shows the average TLAF value has decreased between 2017/18 and 2018/19; however, as shown in Figure 7-3, the average TLAF value remains high and above average when considering all-island TLAFs. TLAFs for the Dublin region are relatively high as there tends to be local use of generation, with an increasing demand. These considerations should be taken into account when reviewing year on year TLAF changes for generators. Further information on the 2018/19 TLAFs can be found on the EirGrid and SONI websites¹⁰².

7.5.2. GTUoS

The regional average 2018/19 GTUoS tariffs are shown in Figure 7-5, and are based on the approved 2018/19 GTUoS tariffs. Higher GTUoS tariffs are reflective of transmission investment costs linked to a generator's use of the system. This promotes efficient use of the transmission system by generators, which should, in turn, facilitate efficient investment in the transmission system.

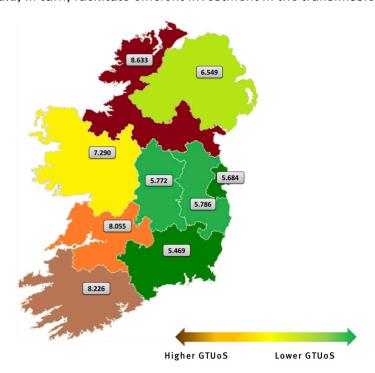


Figure 7-5: All-island 2018/19 regional average GTUoS values

Figure 7-6 shows the change in GTUoS tariffs between 2017/18 and 2018/19.

¹⁰² http://www.eirgridgroup.com/site-files/library/EirGrid/1819-Approved-TLAFs-Accompanying-Note-v1.o.pdf

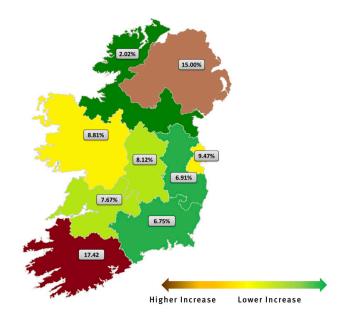


Figure 7-6: GTUoS change between 2017/18 & 2018/19

For 2018/19, there is an overall increase in tariffs due to an increase in the all-island revenue of 12.4%; regional changes are attributed to changes in network flows. The annual revenue is the amount allowed to build, operate and maintain the transmission network, and this has increased in Ireland and Northern Ireland for 2018/19. GTUoS tariffs have increased on average by 12.3% from those of 2017/18, which aligns with the revenue change. The base flows are relatively similar to those of 2017/18 and as a result there are similar trends to those of 2017/18. As shown in Figure 7-6, GTUoS tariffs for Northern Ireland have increased more than others; this is due to the further impact of network flows from 2017/18. It should be noted that they are still around 7.6% lower than the average Ireland GTUoS tariff.

7.6. Assumptions behind the TLAF and GTUoS models

7.6.1. TLAFs

The assumptions used to determine TLAFs are essentially a snapshot of a particular study year, comprised of complex and detailed data. This data is collected up to a data freeze point just before the calculation process; this ensures they are as reflective as reasonably practicable for the study year.

For the level of detail involved specifically for calculating TLAFs, the assumptions are only valid for the study year.

Due to the complexity and variability of these assumptions, their collective impact on TLAFs is neither predictable nor forecastable. Looking beyond the study year, assumption data becomes increasingly speculative and could not be considered as reasonable data for the TLAF model.

7.6.2. GTUoS

The GTUoS model includes an element of 'looking to the future' by adopting the principle of incorporating future network. Looking at the future network involves including the next five years of network files in the model; the network files are consistent with the information published in the latest version of this document available at the time of calculation. Indicative asset costs for a 12 year window are also included in the GTUoS model (looking five years forward and seven years back); under normal circumstances this starts when the asset first appears in the 'Year+5' network file, until seven years post-commissioning. GTUoS tariffs are calculated on an all-island basis, assumptions or network changes from one jurisdiction can have an impact on the other. For example, if the revenue to recover in Ireland significantly increased, but the revenue to recover in Northern Ireland remained the same as the previous year, the all-island tariff average would increase as there is a greater all-island pot to recover; local variations would then be related to changes in network flows. Another example could be when looking at interconnector flows, where an assumption for Moyle impacts flows in Ireland, and an assumption for EWIC impacts flows in Northern Ireland.

Although there is an element of forecasting in the GTUoS model by looking at future network and associated costs, alongside this are many assumptions and variables that only apply for the study year.

7.7. How to Use the Information for Generation


Generation developers wishing to use the information contained within this section when considering where to connect should follow these steps:

- Consult the maps in Appendix A to find the nearest transmission station to the proposed development. Also, review the regions and nodes identified in Section 7.3 which are indicating opportunity for generation connections.
- Consult the forecasted increase and retirement of generation within a region shown in Appendix D.
- Review assumptions in Chapters 2 to 4 and consider the impact of changes to the transmission system since the analysis was carried out. Chapter 5 and Appendix E should also be considered to determine short circuit levels at the nearest transmission station.
- Consult with EirGrid and SONI on the proposed location as early as possible as well as consulting the EirGrid application process and SONI application process.

All-Island Ten Year

Transmission Forecast Statement 2018

8. Transmission System Capability for New Demand

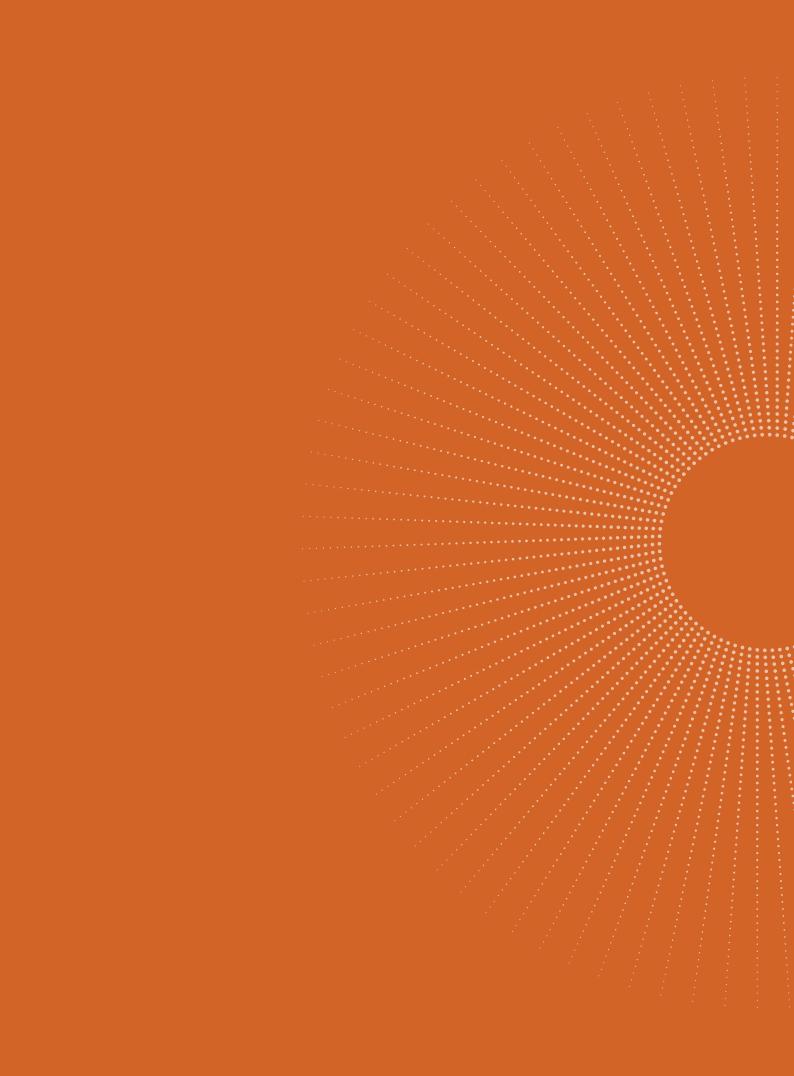

8. Transmission System Capability for New Demand...

This chapter presents demand opportunity analysis which assesses the capability of the existing and planned transmission system to accommodate increased demand. Opportunities for further demand connections in Ireland and Northern Ireland are discussed.

Analysis of the 2024 transmission system indicates that all regions studied across the island have opportunities to connect demand at 275 kV, 220 kV and 110 kV stations.

There continues to be a significant volume of enquiries and applications for the connection of data centres in the Dublin region (see Chapter 3). This is addressed in Section 8.3, in which a qualitative approach to describe demand opportunities in the Dublin area is presented.

8.1. Transmission System Demand Capability Obligations

This chapter of the TYTFS is published in order to meet the requirements of EirGrid's Section 38 of the 1999 Electricity Act and Condition 33 of SONI's TSO licence.

The analysis illustrated in Chapter 8 is presented to provide a high-level indication of transmission network capacity for developers. Results from demand capability studies are based on a specific set of assumptions (see Chapter 6) which may be subject to change. Developers wishing to connect to the transmission system will therefore require further detailed studies.

The TYTFS is not intended to have any legal effect on the negotiation of contractual terms for transmission system connections. Before making any commercial decisions developers should contact us for discussions on their proposed developments.

8.2. All-Island Transmission System Capability for New Demand

As detailed in Chapter 6, the transmission system's capability to accommodate new demand is assessed using demand opportunity analysis. The study was performed for 2024 winter and summer peaks.

Data used for the demand opportunity analysis is based on the best available information at the July 2018 data freeze date. The results of the demand opportunity analysis presented in this chapter are based on the following assumptions:

- Year 2024 demand forecast was used (see Appendix C);
- Only transmission reinforcements with capital approval (Ireland) which are planned to be completed by 2024 were included in the analysis (see Chapter 2);
- Planned generation up until 2024 was included in the analysis (see Appendix D);
- Variable generation cannot be relied upon to serve demand. As such, variable generation local to the test station was switched out; and
- The 2024 transmission system was assessed for the loss of a single transmission asset (N-1), maintenance-trip (N-1-1) and loss of a double transmission circuit (N-DC, Northern Ireland) contingencies.

103 Information for potential Demand Connections can be accessed at the following addresses: http://www.eirgridgroup.com/ uuid/463e7512-d115-4d94-b1ab-79b8cb366f73/index.xml and http://www.soni.ltd.uk/ uuid/463e7512-d115-4d94-b1ab-79b8cb366f73/index.xml

We analysed 41 transmission stations throughout Ireland and Northern Ireland. These consisted of twenty-six 110 kV stations, five 220 kV stations and ten 275 kV stations. These stations were analysed to help identify locations that are potentially suitable for major industrial load centres with large power requirements. The stations examined and their accompanying results are shown in Figure 8-1.

It should be noted that demand opportunity is tested at each station on an individual basis. As such, the opportunities presented are not cumulative. If new demand connects in an area that is currently shown to have capacity, this will then use up some or all of the available capacity in that area.

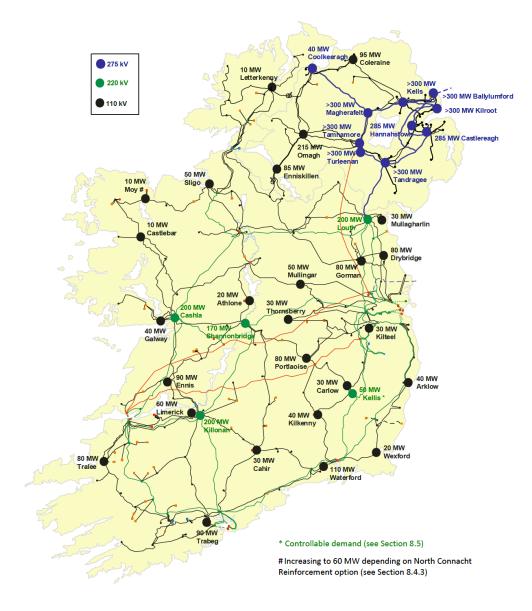


Figure 8-1 Capability for Additional Demand at 275 kV, 220 kV and 110 kV Stations in 2024

As a general rule, demand opportunity at a particular station would tend to reduce over time. This is due to normal demand growth using up available capacity. Yet, in many cases demand opportunities can improve as a result of planned transmission system or generation developments.

The results of the analysis are presented on a regional basis below. The results indicate that in 2024 there will be opportunities at all the stations examined.

8.3. Opportunities for New Demand in the Dublin Area

8.3.1. Context

Dublin is the largest load centre on the island of Ireland. We have expanded this section due to the considerable interest and number of enquiries for connection to the grid around Dublin (see Chapter 3 Demand). The volume of enquiries and the uncertainty of their final power requirements and interaction require us to make a qualitative assessment of demand opportunities for the future.

The scale of individual demand connection enquiries to the transmission system vary from 20 MW to some possibly extending to over 250 MW in the final stages of development. The enquiries are mainly comprised of data centres that support the information, communications and technology (ICT) infrastructure of large multinational companies.

At the end of 2018, connected data centres had a combined total power demand of approximately 256 MVA. The total contracted maximum import capacity (MIC) for these sites is 625 MVA. This includes connections to the transmission and distribution systems. In addition to the connected sites, a further 437 MVA of contracts are in place for new data centre connections. Applications are being processed for a further 894 MVA of data centre contracts in the Dublin region. There continues to be ongoing enquiries regarding further data centre applications.

To put this in context, the current winter peak demand on the all-island transmission system is approximately 6,780 MW. If all applicants currently being processed were to connect, the data centre load would sum to around 29% of the all-island system peak demand.

Loads of this scale typically require connections to the 220 kV or 110 kV network. EirGrid is working with customers and the distribution system operator, ESB Networks, to meet their individual needs and to ensure optimal network development and solutions.

8.3.2. The Dublin Network

The diagram in Figure 8-2 represents the 220 kV backbone transmission system in the greater Dublin area. There also exists a 110 kV network in the Dublin area; however, for clarity we have not shown it in Figure 8-2.

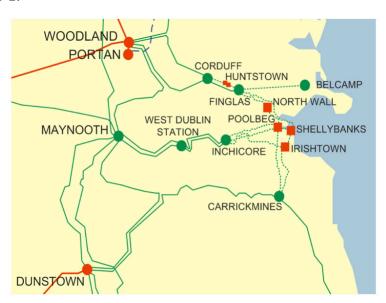


Figure 8-2: Dublin area 220 kV transmission system

Electricity is supplied within Dublin via a 220 kV network arranged in a figure of eight. A combination of operational arrangements and network devices can create open points that effectively divide the Dublin 220 kV network into North and South rings as required.

This network configuration is primarily used to maintain fault currents at safe levels should a network fault occur. It also prevents excessive power flows through the Dublin region. Dublin is then fed via the underlying 110 kV distribution infrastructure which is mainly arranged radially from transmission bulk supply point (BSP) interface stations (220/110 kV).

The larger Dublin power stations are located at Huntstown, which is made up of two separate generators, in North Dublin and one each at Irishtown and Shellybanks in Dublin Bay. The combined capacity of these four stations is approximately 1,600 MW. The 500 MW East West Interconnector is connected to Woodland 400 kV station on the periphery of North Dublin.

Analysis is carried out to ensure compliance with the Transmission System Security and Planning Standards (TSSPS) for all new connections to the transmission system.

This ensures the co-ordinated development of a reliable, efficient, and economical system for transmission system users. EirGrid must ensure the performance requirements of the TSSPS are met. For example, the thermal capacity limits of equipment must be maintained for all operating conditions.

To ensure the optimised, efficient and economic development of the network, EirGrid aims to make maximum use of existing assets. This can be achieved by using generation output to help offset power flows on the network and avoid the need for reinforcement. The cost of using generation in this way is compared to the cost of new network reinforcements.

There are primarily three limitations that can restrict the availability of transmission capacity in Dublin:

- 1. Limitations at the 220/110 kV interface stations, these can include restrictions due to the 220/110 kV transformers or spatial constraints;
- 2. Power flow limitations on local transmission circuits within Dublin; and
- 3. Limited capacity on circuits outside Dublin in terms of facilitating large power flows across the transmission network.

Generation dispatch is critical in assessing the capability of the network and can have a significant impact on (2) and (3) above, especially in the case of Dublin.

The power delivered to Dublin demand centres can originate from power sources located within or outside Dublin or a combination of both. This is dependent on wholesale electricity market generation costs in the Single Electricity Market (SEM)¹⁰⁴ as well as network or system issues.

Recently there has been a tendency for increased high power flows into Dublin from generation located outside the area. This is a result of the increased penetration of wind generation and the commissioning of other high merit order generators outside of Dublin.

In some instances these high power flows from outside the Dublin area can be reduced when power is generated inside Dublin. This could release network capacity for transmission users. However, as more demand has sought to connect in Dublin our analysis indicates an increased requirement for existing generation in Dublin to offset high power flows into, and around, Dublin.

¹⁰⁴ A new wholesale electricity market for the island of Ireland, known as I-SEM, was introduced in 2018.

8.3.3. Dublin Transmission Development Plans

Figure 8-3 below describes the areas of focus for demand connections in Dublin and the scale of interest in each zone. The connections fall into three zones: North, West and South Dublin.

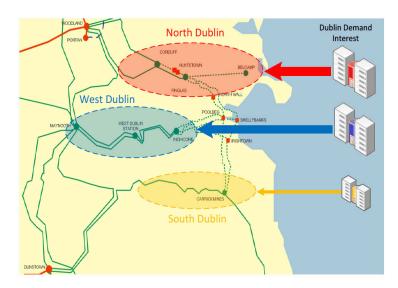


Figure 8-3: Dublin potential demand connections

Depending on the level of future demand connections, new large scale generation, transmission solutions, demand side response and/or storage will be required to ensure continued security of supply.

Each zone is described below with consideration given to existing transmission infrastructure, transmission network projects and lead-times.

Should the reader require more detailed transmission network project information please read our updated grid development strategy "Your Grid, Your Tomorrow." published in January 2017¹⁰⁵, the current Transmission Development Plan¹⁰⁶ and the latest Associated Transmission Reinforcement (ATR) update¹⁰⁷.

8.3.4. North Dublin

North Dublin has two 220/110 kV interface stations at Corduff and Finglas with another planned at Belcamp. The level of interest for connection in North Dublin is the highest of all Dublin areas.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-1 below.

¹⁰⁵ http://www.eirgridgroup.com/the-grid/irelands-strategy/

¹⁰⁶ The latest TDP can be found on the EirGrid website http://www.eirgridgroup.com/

¹⁰⁷ The latest ATR update can be found on the EirGrid website http://www.eirgridgroup.com/

Table 8-1: North Dublin projects

North Dublin		
Project Name / Number	Project Description	Estimated Delivery Date
Cloghran-Corduff (CPo859)	New 110 kV cable	2016 (complete)
Belcamp (CPo437)	New 220/110 kV station	2019
Finglas (CPo646)	110 kV station redevelopment	2020
Belcamp Phase 2 (CPo984)	Additional 220/110 kV transformer and second circuit	2021
Finglas (CP0792)	220 kV station redevelopment	2022

Facilitating further high levels of demand connections will require additional network reinforcement in the area. As noted in our Transmission Development Plan we have confirmed the need for such investment in north Dublin, the future potential project is called North Dublin Corridor Reinforcement (CP1021). This could be in the form of increased network connectivity with Woodland 400 kV station for example. Typically, such major projects delivering additional network capacity have significant lead times (five to ten years) which are dependent on the chosen technology.

8.3.5. West Dublin

West Dublin has one main 220/110 kV interface station at Inchicore with another planned at Castlebagot. These stations are supported by the Maynooth 220/110 kV station on the outer rim of the Dublin region.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-2 below.

Table 8-2: West Dublin projects

West Dublin		
Project Name / Number	Project Description	Estimated Delivery Date
Inchicore-Maynooth (CPo667)	Uprate 220 kV No.1 & No.2 lines	2015 (complete)
Maynooth-Ryebrook (CP0747)	Uprate 110 kV line	2015 (complete)
Poolbeg (CPo760)	Installation of 100 Mvar reactive support	2018
Ryebrook-Corduff (CPo668)	Uprate 110 kV line	2019
Ryebrook (CPo789)	110 kV station redevelopment	2017 (complete)
Castlebagot (CPo872)	New 220/110 kV station	2020
Inchicore (CPo692)	220 kV station upgrade	2022
Maynooth (CPo8o8)	220/110 kV station redevelopment	2025

As noted in our Transmission Development Plan we have confirmed the need for investment in this area. In response, we are progressing Capital Project 966 which seeks to increase the strength of the link between two existing 400 kV stations at Dunstown and Woodland.

8.3.6. South Dublin

South Dublin has one main 220/110 kV interface station at Carrickmines. Carrickmines is connected at 220 kV to Dunstown 400 kV station and Arklow 220 kV station.

A number of transmission projects are in place to increase the network capacity and security of supply in this area. They are summarised in Table 8-3 below.

Table 8-3: South Dublin projects

South Dublin		
Project Name / Number	Project Description	Estimated Delivery Date
Dunstown (CPo683)	New 400/220 kV 500 MVA transformer	2016 (complete)
Carrickmines (CPo580)	New 220/110 kV 250 MVA transformer & GIS development	2019

As noted in our Transmission Development Plan, currently we do not see an imminent need to reinforce this area.

8.3.7. Impact of Additional Generation & Flexible Demand on North, West and South Dublin

As described in Chapter 7, there are generation opportunities in the Dublin region, particularly in north Dublin. If additional generation was to locate in the Dublin area this would generally improve the network capacity available for transmission system users in North, West and South Dublin zones.

However, the specific location of any proposed additional generation would have to be assessed to fully understand its full impact on the network.

Similarly, if major demand customers can ensure demand side flexibility during low probability system events this would also improve the capability of the network to accommodate further demand increases.

8.3.8. Looking Forward

In January 2017 we published an updated grid development strategy for the long-term development of the network. In the strategy paper¹⁰⁸, we explain the role of electricity transmission infrastructure in supporting new investments and jobs as well as ensuring competitiveness by offering cost-effective power capacity.

The strategy puts forward a number of major projects to upgrade the transmission network. The Regional Solution (see Chapter 2) and Capital Project 966 have many system benefits, which include providing additional network capacity and improving security of supply for the eastern side of Ireland.

The Regional Solution involves a new circuit across the Shannon Estuary and the installation of series compensation equipment on the 400 kV circuits that extend from Moneypoint 400 kV power station in the West of Ireland towards Woodland and Dunstown 400 kV stations located on the western outskirts of Dublin.

This project will greatly enhance the capability of the existing 400 kV circuits to transfer bulk power generated in the South-West and West to Dublin and other demand centres in the East as illustrated in Figure 8-4.

108 http://www.eirgridgroup.com/the-grid/irelands-strategy/

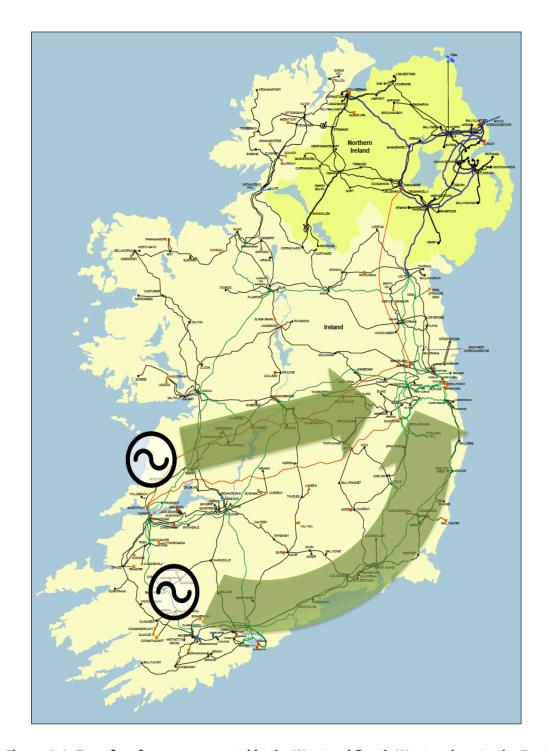


Figure 8-4: Transfer of power generated in the West and South-West regions to the East

Capital Project 966 is at an early point in the project life-cycle. The project will increase the strength of the link between two 400 kV stations at Dunstown and Woodland. This will provide benefits by reducing power flows that pass through the Dublin 220 kV transmission network, thus releasing network capacity on several key constrained circuits.

To maintain system stability and facilitate significant inter-regional power flows we are also developing a number of voltage support solutions across Ireland.

In addition, as noted in our Transmission Development Plan, we have confirmed the need for investment in north Dublin. The future potential project is called North Dublin Corridor Reinforcement (CP1021).

8.3.9. Summary

New transmission solutions will be required to strengthen the grid. These solutions are now under initial investigation.

We continue to apply a strategic approach to network development and we are continuously considering the approach to the level of demand enquires. Our strategic approach takes account of the following:

- Companies developing data centres operate in a rapid and dynamic environment. Their
 business requires connection timescales that are short relative to time taken for transmission
 reinforcement. Most are considering being operational within two to three years and growing
 their power usage rapidly thereafter.
- We are working to understand the needs of these developers and their impact in terms of our grid development strategy. We are publishing information on the system adequacy, grid needs and opportunities to ensure transparency so that the impacts of this sector and its developments are known.
- To date, we have been able to facilitate connections for developers who have applied. We will
 continue to examine innovative solutions and technologies in response to future requests.
 However, as interest in connecting additional demand has developed into contracted
 connections, the available capacity on the existing transmission network for further large scale
 demand connections has largely been depleted.

It is advised that any potential new demand consumers contact EirGrid early so that we can work jointly to achieve a connection solution. This facilitates the optimisation of transmission reinforcements so that the requested capacity can be delivered.

It is also recommended to locate any new large scale data centres in close proximity to existing 220 kV stations or circuits as this may help expedite the provision of a suitable connection.

As a prudent system operator, EirGrid ensures that adequate spare capacity for regional and national demand growth is available, while avoiding unnecessary over investment in grid capability. Therefore, a balance is maintained between the reasonable expectations placed on the network and the cost of grid development and maintenance. Delivering an efficient transmission grid requires that this balance of investment is maintained.

8.4. Transmission System Capability for New Demand in Ireland

Demand opportunities available on an Ireland regional basis are discussed in Sections 8.4.1 to 8.4.5. Results presented in Section 8.4 are based on the assumptions detailed in Chapter 6.

8.4.1. Opportunities for New Demand in the Midlands and West

The demand opportunities available in the Midlands and West are shown in Figure 8-5. It is shown that there are potential demand opportunities available for new customers at all stations examined in the region¹⁰⁹. In particular, Cashla and Shannonbridge 220 kV stations would be suitable connection points for major industrial load centres. Both of these stations are capable of accommodating significant additional demand without additional network reinforcements.

¹⁰⁹ Please note that the demand opportunities results are not cumulative. Each station is assessed individually, taking account of forecast demand growth only at stations outside of the test node. These figures are indicative only, with further detailed assessment of each station required. Customers considering connecting demand to the Irish transmission system are advised to contact EirGrid as early in the project as possible.

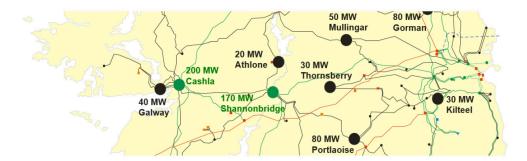


Figure 8-5 Capability for Additional Demand in Midlands and West Regions

8.4.2. Opportunities for New Demand in the North-East

The demand opportunities available for the North-East region are shown in Figure 8-6. It is shown that there are potential demand opportunities available for industrial customers at all stations examined in the region. The delivery of the North-South interconnector aids demand opportunity in the North-East. The North-South interconnector provides a route for large power transfers to flow between Northern Ireland and Ireland via the North-East region of Ireland. The North-South interconnector will benefit potential demand customers connecting in this region by releasing more capacity on the underlying 110 kV network.

Potential overloading of the Louth – Mullagharlin 110 kV line is responsible for limiting the opportunity at Mullagharlin (30 MW). The overload occurs during winter and summer peaks for single circuit outage conditions. This is a local issue as only two circuits supply the load at Mullagharlin. Drybridge is more interconnected with four circuits supplying the station. Thus, it has a higher demand opportunity (80 MW). Demand opportunity studies were performed at Louth and Gorman 220/110 kV stations. Both of these stations are capable of accommodating significant additional demand without additional network reinforcements.

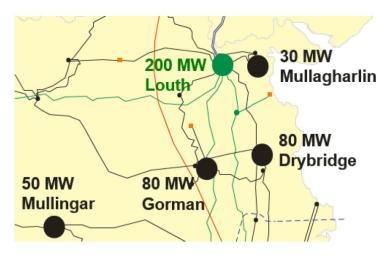


Figure 8-6 Capability for Additional Demand in North-East Region

8.4.3. Opportunities for New Demand in the North-West

The demand opportunities available for the North-West region are shown in Figure 8-7. It shows that there are potential demand opportunities available for industrial customers at all stations examined in the region. The potential demand opportunity at Castlebar is 10 MW. Analysis has shown that the Castlebar – Cloon 110 kV line could overload as power tries to flow to Castlebar under certain maintenance-trip scenarios (see Chapter 6). The uprate of Castlebar – Cloon 110 kV line would allow for more demand opportunity at Castlebar.

Demand opportunity studies were performed at Moy 110 kV station. In our studies we identified an opportunity for 10 MW. However, depending on the North Connacht Reinforcement solution option this could increase to 60 MW.

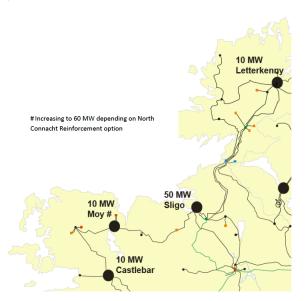


Figure 8-7 Capability for Additional Demand in North-West Region

8.4.4. Opportunities for New Demand in the South-East

The demand opportunities available for the South-East region are shown in Figure 8-8. It is shown that there are potential opportunities available for industrial customers at all stations examined in the region.

The demand opportunity at Kellis 220 kV station is limited to 50 MW due to the maintenance-trip scenario (see Chapter 6) where both 220 kV lines supplying Kellis are assumed to be out of service. This scenario means that demand at Kellis 220 kV station must be supplied by the underlying 110 kV network, which does not have the capacity to carry as much power as the 220 kV network.

However, should a demand facility wishing to connect at Kellis 220 kV station implement a 'Controllable Demand' strategy there would be potential for much greater capacity of demand to connect to Kellis 220 kV. This is explained further in Section 8.5 on 'Controllable Demand'.

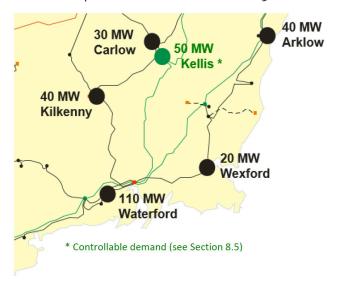


Figure 8-8 Capability for Additional Demand in the South-East Region

8.4.5. Opportunities for New Demand in the South-West

The demand opportunities available for the South-West region are shown in Figure 8-9. It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region.

In particular the Killonan 220 kV station would be a suitable connection point for a major industrial load centre, with the capability of accommodating in excess of 200 MW without additional network reinforcements.

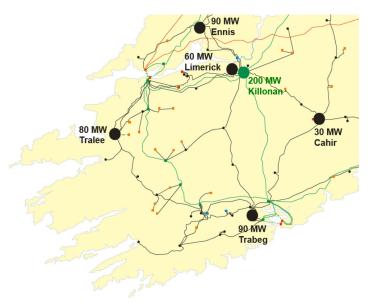


Figure 8-9 Capability for Additional Demand in South-West Region

8.5. Controllable Demand

Kellis 220 kV station is a good example to demonstrate the potential to increase the assessed capacity of a station through the concept of 'controllable demand'. In the case of Kellis 220 kV station, demand opportunity is limited to 50 MW due to a maintenance-trip scenario where both 220 kV lines supplying Kellis 220 kV station are assumed to be out of service. The next limiting scenario after the outage of both 220 kV lines supplying Kellis would allow for much greater demand opportunity at Kellis 220 kV station.

Maintenance-trip contingency planning forms part of a suite of contingencies considered by EirGrid for prudent planning of the transmission system. However, it is also recognised in the Transmission System Security and Planning Standards (TSSPS) that exposure to maintenance-trip events is much less than the other contingency events considered.

This means that under certain circumstances, potential demand customers may enter an agreement with EirGrid to connect a higher level of demand at a particular station, on the condition that the customer would reduce load if certain contingencies occurred.

Using Kellis 220 kV station as an example, a potential demand customer may enter an agreement with EirGrid to connect 200 MW of load at Kellis, but drop to 50 MW if either of the 220 kV lines supplying Kellis is out of service.

It should be noted that Kellis has been used as an example. Depending on reliability requirements, this type of agreement may not be suitable for all types of demand facilities or locations. We encourage any potential customers to discuss the possibility of controllable demand with us at an early stage of project planning and development.

8.6. Transmission System Capability for New Demand in Northern Ireland

Section 8.6.1 discusses the demand opportunities available in the Eastern region of Northern Ireland. Section 8.6.2 discusses the demand opportunities available in the Western region. These results are based on the assumptions detailed in Chapter 6.

8.6.1. Opportunities for New Demand in East of Northern Ireland

The demand opportunities available in the Eastern region are shown in Figure 8-10.

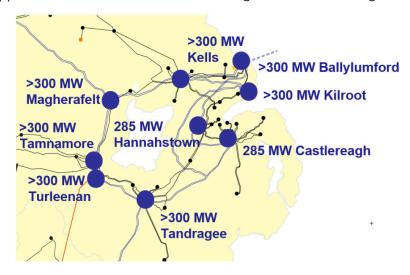


Figure 8-10 Capability for Additional Demand (MW) in the East of Northern Ireland

It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region. Each of the 275 kV stations in the East of Northern Ireland would be suitable connection points for major industrial load centres. Each of these stations is capable of accommodating in the order of 300 MW¹¹⁰ of additional demand without additional network reinforcements.

8.6.2. Opportunities for New Demand in West of Northern Ireland

The demand opportunities available for the West of Northern Ireland are shown in Figure 8-11.

¹¹⁰ Please note that the demand opportunities results are not cumulative. Each station is assessed individually, taking account of forecast demand growth only at stations outside of the test node. These figures are indicative only, with further detailed assessment of each station required. Customers considering connecting demand to the NI transmission system are advised to contact SONI as early in the project as possible.

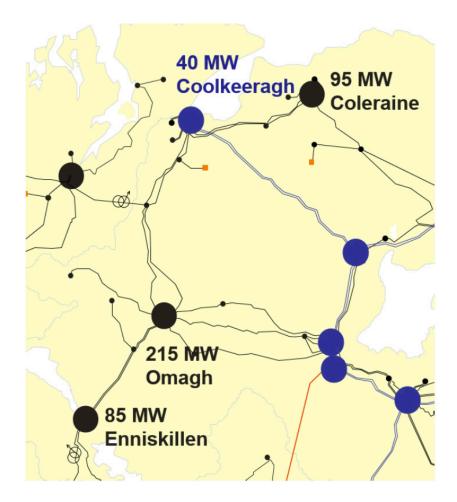


Figure 8-11 Capability for Additional Demand in the West of Northern Ireland

It can be seen that there are potential opportunities available for industrial customers at all stations examined in the region. It should be noted that the North-West of Northern Ireland requires specific assessment in line with the TSSPS (see Chapter 6). As the North-West is connected by a single double circuit 275 kV spur, an N-1-1 contingency is performed as a credible contingency.

Under N-1-1 the demand capability of Coolkeeragh is limited to 40 MW. This is under the following conditions:

- The loss of the Coolkeeragh-Magherafelt 275 kV double circuit; and
- Coolkeeragh steam and gas units are out on maintenance.

Enniskillen station represents the lowest capability of the 110 kV nodes assessed. Enniskillen 110 kV is connected to Omagh South station via two 110 kV circuits. The loss of one of these circuits creates a thermal overload on the other. This limits demand connection capability.

8.7. How to Use the Information for Demand

Although not every station was considered, the results presented can be regarded as a guide to opportunities at other stations in the same area.

Customers wishing to use the demand opportunity results described in this chapter when considering where to connect should follow these steps:

- 1. Consult the maps in Appendix A to find the nearest transmission station to the proposed development. Also, the nearest station for which opportunity has been assessed (Sections 8.4 and 8.6) should be identified, where it differs from the nearest transmission station.
- 2. The anticipated demand growth at the relevant station can be obtained from the demand forecasts presented in Appendix C. The transmission system is being planned to meet this level of demand increase.
- 3. Review assumptions in Chapters 2 to 4 and consider the impact of changes to the transmission system since the analysis was carried out.
- 4. Consult with EirGrid and SONI on the proposed location as early as possible as well as consulting the EirGrid application process¹¹¹ and SONI application process¹¹².

Potential demand customers should not be discouraged by choosing a site in which there appears to be a lack of transmission system capacity. Early consultation with us is encouraged so that we can work jointly to explore options relating to any potential proposals and enable timely decision making.

^{111 &}lt;a href="http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/">http://www.eirgridgroup.com/customer-and-industry/becoming-a-customer/


¹¹² http://www.soni.ltd.uk/Customers/howconnected/



All-Island Ten Year

Transmission Forecast
Statement 2018

Appendix A

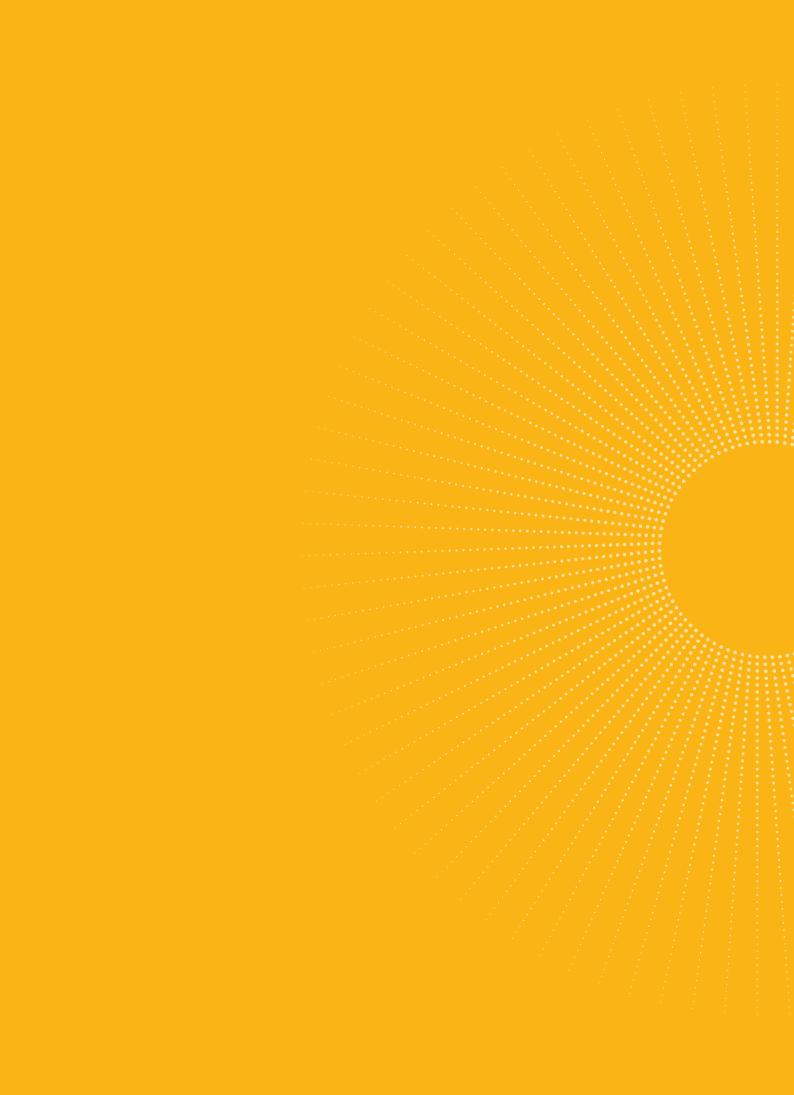

Appendix A Maps and Schematic Diagrams


Appendix A contains geographical maps of the All-Island Transmission System and short bus codes for every transmission voltage node on the island. Geographical maps are presented illustrating the All-Island Transmission System in 2018 and as planned for in 2027.


A.1 Network Maps

This section includes two network maps:

- Figure A-1 is a map of the expected All-Island Transmission System as at December 2018; and
- Figure A-2 is a map of the planned All-Island Transmission System in 2027.

Note: There are a number of network reinforcement projects that do not have a finalised reinforcement solution. They are shown on the Transmission System Map as a transparent bubble in Figure A-2. The solution that will be used for these projects have not yet been finalised.

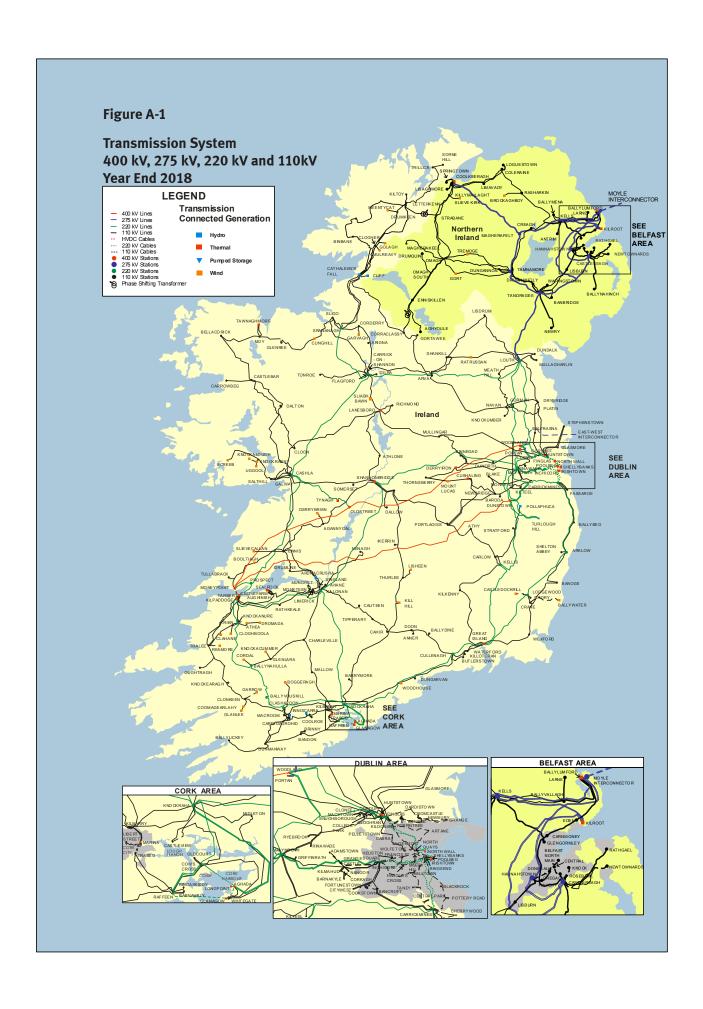

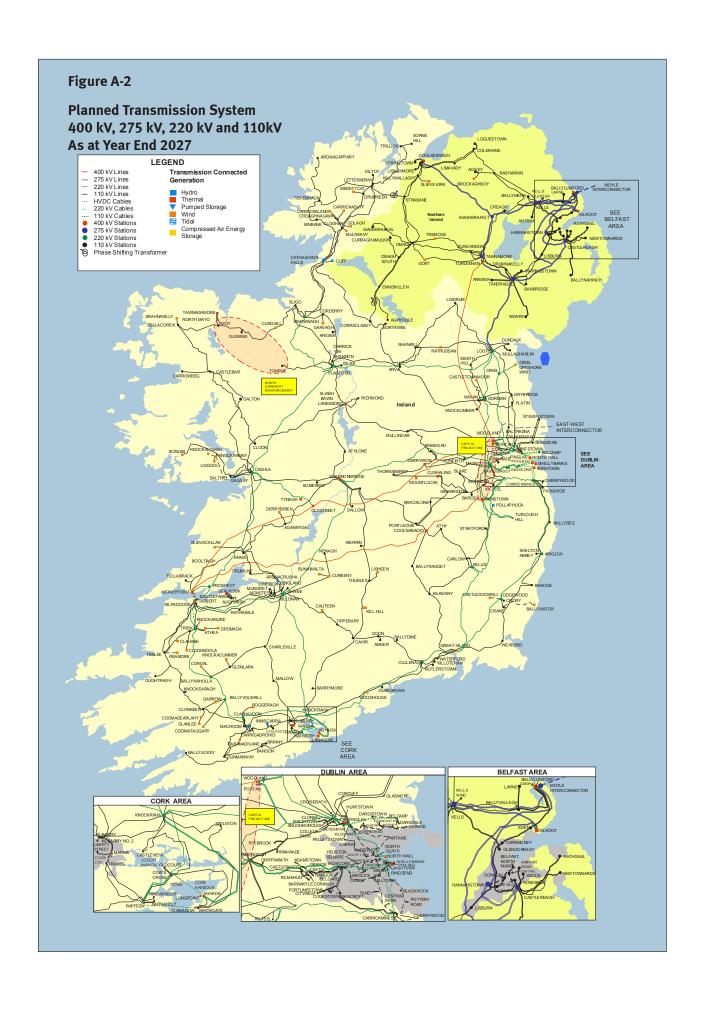

A.2 Short Bus Codes

The following table associates full station names with the two or three letter codes used in the schematic diagrams in Section A.3, in the tables in Appendices B and C, and the power flow diagrams in Appendix H. Stations in Northern Ireland and Ireland with the same three letter bus code are distinguished with (N) for Northern Ireland and (I) for Ireland.

Table A-1 Short Bus Codes

Short Bus Code	Full Name
AA	Ardnacrusha
AD	Aghada
ADM	Adamstown
AGH	Aghyoule Main
AGL	Agannygal
AGI	Agivey Cluster
AGY	Ardnagappary
AHA	Ahane
AIR	Belfast - Airport Road Main
ANR	Anner
ANT	Antrim Main
ARI	Arigna
ARK	Arklow
ARM	Armagh Main
ART	Artane
ARV	Arva
ATE	Athea
ATH	Athlone
ATY	Athy
AUG	Aughinish
BAL	Baltrasna
BAN (I)	Bandon
BAN (N)	Banbridge Main
BAR	Barrymore
ВСТ	Bancroft
BDA	Baroda
BDN	Ballydine
BDV	Barnadivane
BEG	Ballybeg
BGD	Belgard Road
BGH	Boggeragh
BGT	Ballyragget
BIN	Binbane

Short	Full Name
Bus	
Code	D. II I
BK	Bellacorick
BKM	Bunkimalta
BKY	Barnakyle
BLA	Blackrock
BLC	Belcamp
BLI	Ballylickey
BLK	Blake
BLP	Blackpool
ВМА	Ballymena Mesh (Rural)
ВМА	Ballymena SWBD (Town)
BNH	Ballynahinch Main
BNM	Belfast - Belfast North Main
BOG	Banoge
BOL	Booltiagh
BPS	Ballylumford Power Station
BRA	Bracklone
BRI	Brinny
BRO	Brockaghboy Main
BRY	Barnahely
BUF	Buffy
BUT	Butlerstown
BVG	Ballyvallagh
BVK	Ballyvouskill
BWR	Ballywater
BY	BallaKelly
BYC	Ballycronan More (Moyle)
BYH	Ballynahulla
CAB	Cabra

Short	Full Name
Bus	
Code	CAEC
CAE	CAES
CAG	Carrickalang
CAH	Cahir
CAM	Cam Cluster
CAR	Belfast -
	Carnmoney Main
CAS	Castlereagh Main
CBG	Carrowbeg
CBL	Cloghboola
CBR	Castlebar
CBT	Castlebagot
CD	Carrigadrohid
CDF	Carrickaduff
CDK	Castledockrill
CDL	Cordal
CDN	Carrigdangan
CDU	Corduff
CDY	Corderry
CEN	Belfast - Belfast
	Central Main
CF	Cathaleen's Fall
CFM	Castlefarm
CGL	Coomagearlahy
CHA	Charleville
CHE	Cherrywood
CKG	Corkagh
CKM	Carrickmines
CKN	Clonkeen
CL	Cliff
CLA	Clashavoon
CLE	Clonee
CLG	Cloghran
CLH	Clahane
CLN	Cloon
	1

Table A-1 Short Bus Codes

Short	Full Name
Bus Code	
CLO	Clogher
CLS	Clonshaugh
CLW	Carlow
CMK	Curraghmulkin
	Cluster
CNB	Coolnabacky
CNN	Croaghnagawn
COL (I)	College Park
COL (N)	Coleraine Main
COO	Cookstown
COR	Corraclassy
COS	Carrick-on-
	Shannon
COW	Cow Cross
СРК	Central Park
CPS	Coolkeeragh
CD.4	Power Station
CRA	Crane
CRE	Belfast -
CRF	Cregagh Main Cronacarkfree
CRG	Creagh Main
CRH	Cruiserath
CRM	Cromcastle
CRN	Croaghaun
CRO	Coolroe
CRY	Crory
CSH	Cashla
CTG	Coomataggart
CTN	Cauteen
CTR	Castletownmoor
CTY	City West
CUL	Cullenagh
CUN	Cunghill
CUR	Cureeny
CUS	Cushaling
CVW	Castleview
DAL	Dallow
DRN	Darndale
DDK	
אטע	Dundalk

Bus Code	
U01012	
DRN	Darndale
DDK	Dundalk
DER	Derryiron
DFR	Dunfirth
DGN	Dungarvan
DLN	Derrylyn
DLT	Dalton
DMY	Dunmanway
DON	Belfast -
	Donegall Main
D00	Doon
DRM	Drumkeen
DRO	Dromada
DRO (N)	Dromore
DRU (I)	Drumline
DRU (N)	Drumnakelly Main
DRY	Drybridge
DSN	Dunstown
DTN	Dardistown
DUN	Dungannon Main
DYN	Derrybrien
EDE	Eden Main
ENN (I)	Ennis
ENN (N)	Enniskillen Main
FAS	Fassaroe
FAS E	Fassaroe East
FIN (I)	Finglas
FIN (N)	Belfast - Finaghy Main
FLA	Flagford
FRN	Francis Street
GAE	Glanlee
GAL	Galway
GAR	Garvagh
GCA	Grange Castle
GGO	Glanagow
GI	Great Island
GIL	Gilra

Short Bus	Full Name
Code	
GLA	Glasmore
GLE (I)	Glenlara
GLE (N)	Belfast -
	Glengormley Main
GLR	Glenree
GLR	
GLI	Glentane- macelligot
GOL	Golagh
GOR (I)	Gorman
GOR (N)	Gort Cluster
GRA	Grange
GRI	Griffinrath
GRO	Garrow
GWE	Gortawee
HAN	Hannastown
HAR	Harolds Cross
HEU	Heuston Square
HN	Huntstown
IA	Inniscarra
IKE	Ikerrin
INC	Inchicore
ISH	Irishtown
KBY	Kilbarry
KCR	Knockacummer
KLD	Kildonan
KEL	Kells Main
KLC	Kells Cluster
KER	Knockearagh
KHL	Kill Hill
KIN	Kinnegad
KKY	Kilkenny
KLH	Knockalough
KLM	Kilmore
KLN	Killonan
KLS	Kellis
KMT	Killymallaght
KNO	Belfast -
	Knock Main

Table A-1 Short Bus Codes

Short	Full Name
Bus Code	
KNR	Knockanure
KNV	Knockanana
KNY	
KPG	Knockranny
KPG	Kilpaddoge
KPS	Killinaparson Kilroot Power
KP3	Station
KRA	Knockraha
KTL	Kilteel
KTN	Killoteran
KUD	Kilmahud
KUR	Knockumber
LA	Lanesboro
LAR	Larne Main
LET	Letterkenny
LIB	Liberty Street
LIM (I)	Limerick
LIM (N)	Limavady Main
LIS (I)	Lisdrum
LIS (N)	Lisburn Main
LMR	Lisaghmore Main
LOG	Loguestown Main
LOU	Louth
LPT	Longpoint
LSN	Lisheen
LWD	Lodgewood
MAC	Macroom
MAG	Magherafelt
MAL	Mallow
MAY	Maynooth
MCD	McDermott
MCE	Macetown
MEE	Meentycat
MHL	Misery Hill
MID	Midleton
MIL	Milltown
MKL	Magherakeel Cluster
MLC	Mountlucas

Short Bus Code MLN Mullagharlin MON Monread MOY Moy MP Moneypoint MR Marina MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen RAT (I) Rathkeale		
MLN Mullagharlin MON Monread MOY Moy MP Moneypoint MR Marina MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	Bus	Full Name
MON Monread MOY Moy MP Moneypoint MR Marina MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		Mullagharlin
MOY Moy MP Moneypoint MR Marina MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		_
MP Moneypoint MR Marina MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
MRY Mulreavy MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
MTH Meath Hill MTN Moneteen MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
MTN Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		-
MUL Mullingar MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
MUN Mungret NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
NAN (I) Nangor NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		_
NAR Newtownards Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		_
Main NAV Navan NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		_
NBY Newbury NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NAR	
NEN Nenagh NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NAV	Navan
NEW (I) Newbridge NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NBY	Newbury
NEW (N) Newry Main NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NEN	Nenagh
NQS North Quays NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NEW (I)	Newbridge
NST Newtownstewart Cluster NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NEW (N)	Newry Main
NW North Wall OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NQS	North Quays
OLD Oldcourt OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NST	
OMA Omagh Main ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	NW	North Wall
ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	OLD	Oldcourt
ORL Oriel OST Oldstreet OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	OMA	Omagh Main
OUG Oughtragh OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	ORL	_
OWN Oweninney PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	OST	Oldstreet
PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	OUG	Oughtragh
PA Pollaphuca PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen		
PB Poolbeg PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	PA	,
PLA Platin PLS Portlaoise POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	РВ	-
POP Poppintree POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	PLA	Platin
POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	PLS	Portlaoise
POT Pottery Road PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	POP	Poppintree
PRO Prospect PRT Portan PTN Pelletstown RAF Raffeen	POT	
PRT Portan PTN Pelletstown RAF Raffeen	PRO	
RAF Raffeen	PRT	•
RAF Raffeen		Pelletstown
RAT (I) Rathkeale	RAF	
	RAT (I)	Rathkeale

RAT (N) Rathgael Main RE Ringsend REM Reamore RIC Richmond RNW Rinawade ROS Belfast - Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	Short Bus Code	Full Name
REM Reamore RIC Richmond RNW Rinawade ROS Belfast - Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg		Rathgael Main
RIC Richmond RNW Rinawade ROS Belfast - Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg		Ringsend
RNW Rinawade ROS Belfast - Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	REM	Reamore
ROS Belfast - Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RIC	Richmond
Rosebank Main RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RNW	Rinawade
RRU Ratrussan RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	ROS	Belfast -
RSK Rasharkin Cluster RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg		Rosebank Main
RSY Ringaskiddy RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RRU	Ratrussan
RYB Ryebrook SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RSK	Rasharkin Cluster
SAL Salthill SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RSY	Ringaskiddy
SBH Snugborough SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	RYB	Ryebrook
SBN Strabane SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SAL	Salthill
SCR Screeb SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SBH	Snugborough
SH Shannonbridge SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SBN	Strabane
SHE Shelton Abbey SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SCR	Screeb
SHL Shellybanks SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SH	Shannonbridge
SK Sealrock SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SHE	Shelton Abbey
SKL Shankill SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SHL	Shellybanks
SKY Srahnakilly SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SK	Sealrock
SLB Sliabh Bawn SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SKL	Shankill
SLC Slievecallan SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SKY	Srahnakilly
SLI Sligo SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SLB	Sliabh Bawn
SLK Slieve Kirk SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SLC	Slievecallan
SNG Singland SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SLI	Sligo
SOM Somerset SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SLK	Slieve Kirk
SOR Sorne Hill SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SNG	Singland
SPR Springtown Main SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SOM	Somerset
SRA Srananagh STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SOR	Sorne Hill
STR (I) Stratford STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SPR	Springtown Main
STR (N) Strabane Main SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	SRA	Srananagh
SVN Stevenstown TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	STR (I)	Stratford
TAN Tandragee TAW Tawnaghmore TB Tarbert TBG Trabeg	STR (N)	Strabane Main
TAW Tawnaghmore TB Tarbert TBG Trabeg	SVN	Stevenstown
TB Tarbert TBG Trabeg	TAN	Tandragee
TBG Trabeg	TAW	Tawnaghmore
	ТВ	Tarbert
<u> </u>	TBG	Trabeg
TBK Tullabrack	TBK	Tullabrack

Table A-1 Short Bus Codes

Short Bus Code	Full Name
TH	Turlough Hill
THU	Thurles
TID	Tidal
TIP	Tipperary
TIV	Tievebrack
TLK	Trillick
TLY	Tanley
TMN	Tamnamore
TON	Tonroe
TRE	Tremoge Cluster
TRI	Trien
TRL	Tralee

Short Bus Code	Full Name
TRN	Trinity
TSB	Thornsberry
TUR	Turleenan
TYN	Tynagh
UGL	Uggool
WAR	Waringstown Main
WAT	Waterford
WEX	Wexford
WH	Woodhouse
WHI	Whitegate
WOL	Wolfe Tone
WOO	Woodland


A.3 Schematic Diagrams of the All Island Transmission System


Schematic diagrams of the All-Island Transmission System are included to assist users in understanding the transmission system and in the identification of the changes outlined in Appendix B. Lines, cables, transformers, station busbars and reactive compensation devices are illustrated in the diagrams. The type of generation (thermal, wind, hydro or solar) at a station is also displayed. Table A-2 indicates the diagram conventions.

The schematic diagram for 2018 shows the expected transmission system as of December 2018. The schematic diagram for 2027 shows the planned transmission system due to be completed by the end of 2027.

Table A-2 Schematic Legend

Symbol	Network Element Represented
	110 kV circuit
	220 kV circuit
	275 kV circuit
	400 kV circuit
	System Link
\bigcirc	110 kV Busbar
	220 kV Busbar
	275 kV Busbar
	400 kV Busbar
	Busbar with Thermal Generation
	Busbar with Wind Generation (>5 MW)
	Busbar with Hydro Generation
	Busbar with Solar Generation (>5 MW)
	Busbar with Wind and Thermal Generation
	Busbar with Wind and Hydro Generation
	Busbar with Wind and Solar Generation
	Capacitor
<u></u>	Static Var Compensator/STATCOM
60	Reactor
PST	Phase Shifting Transformer
$-\infty$	Transformer
—_NO	Normally Open Point
——sc—	Series Compensation

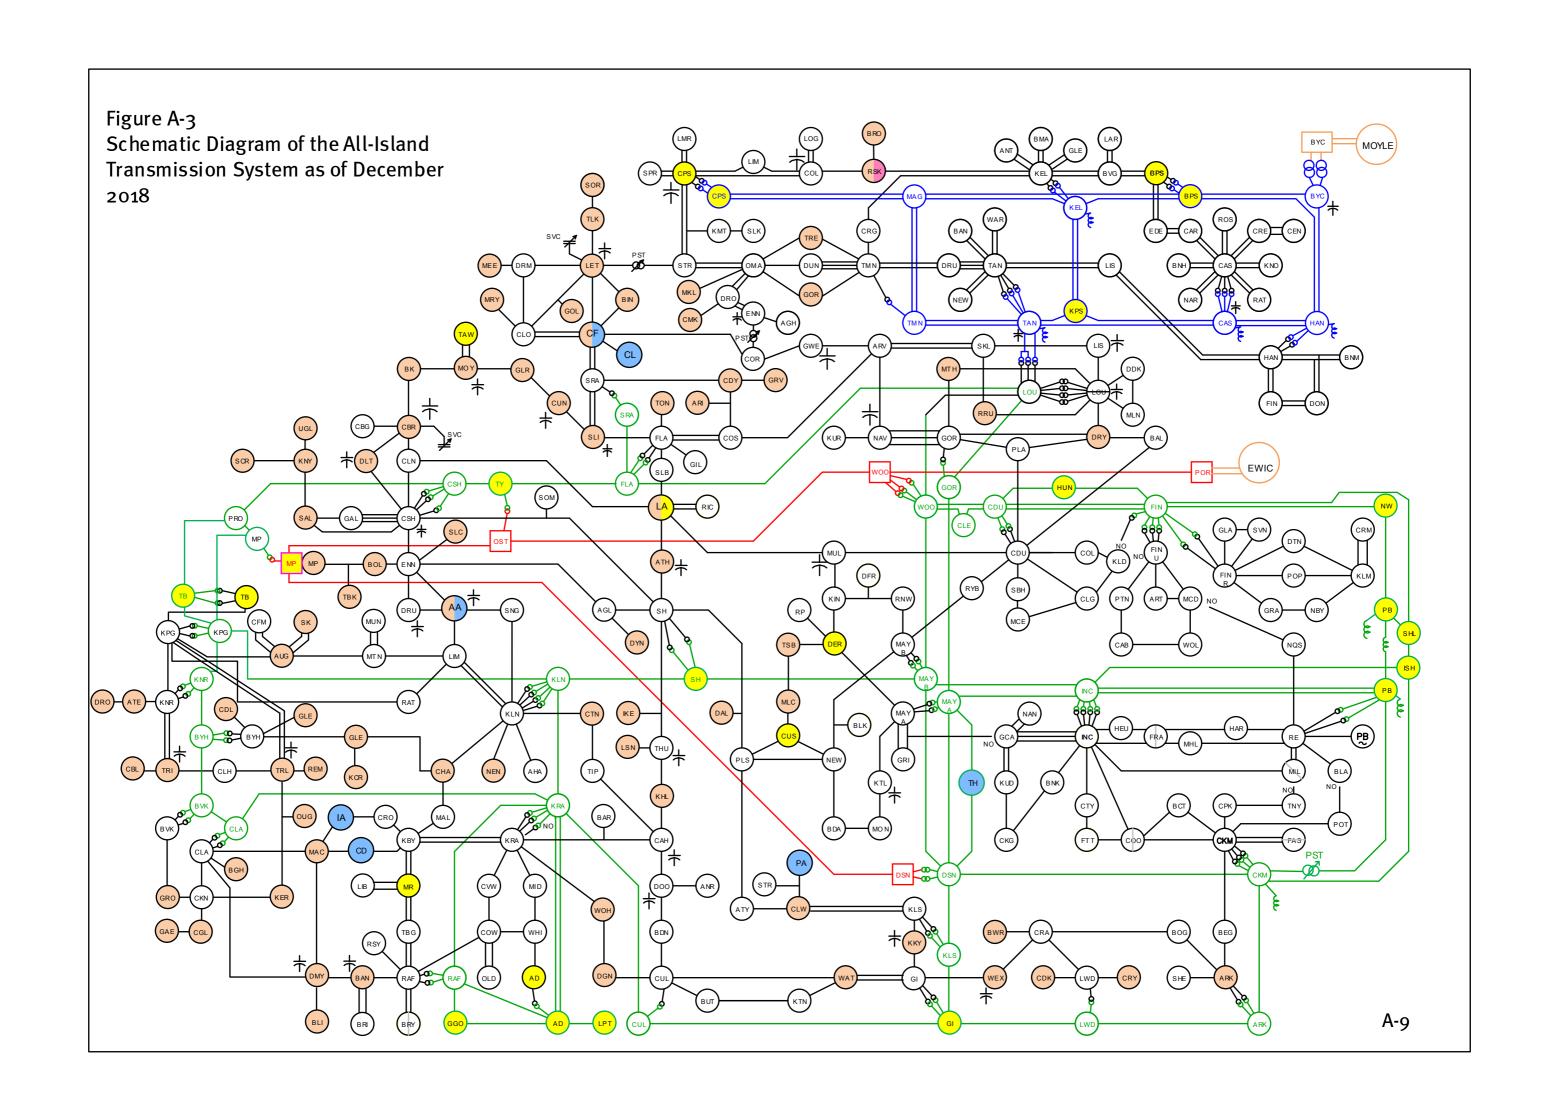


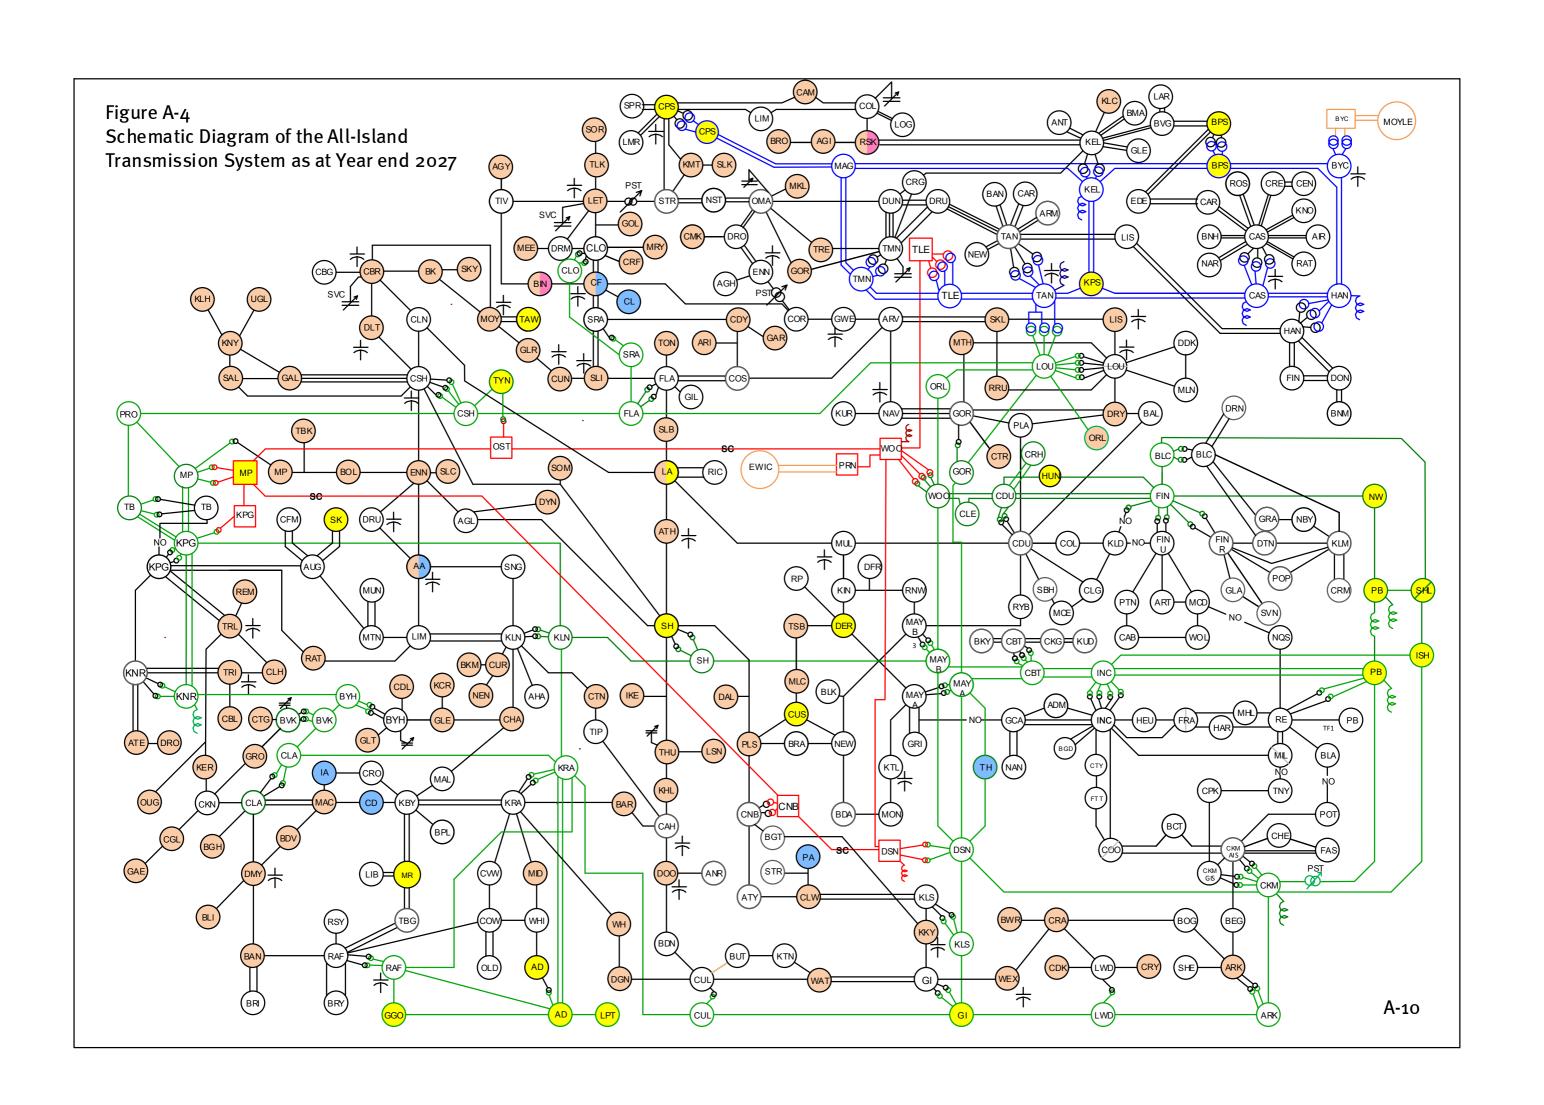

All-Island Ten Year

Transmission Forecast Statement 2018

Appendix B

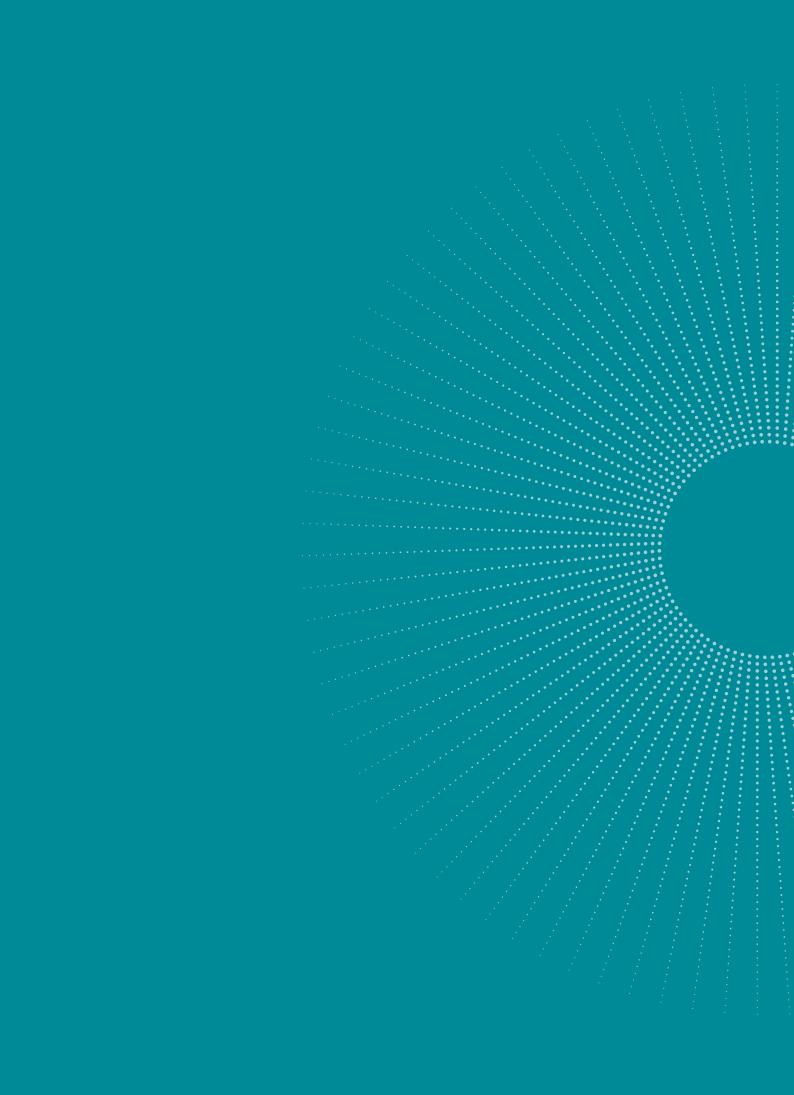

Appendix B Transmission System Characteristics

This appendix presents details of the physical and electrical characteristics of the all-island transmission system in tabular form:

- Section B.1 details the data for the existing 113 transmission system; and
- Section B.2 details the data for planned transmission system developments¹¹⁴.

Section 1.2 in Chapter 1 of the main text provides information on project developments since the data freeze.

The following is a list of tables in Section B.1:

- Table B-2 Characteristics of Existing Transmission Circuits;
- Table B-3 Characteristics of Existing Transformers in Ireland;
- Table B-4 Characteristics of Existing 3 Winding Transformers in Northern Ireland;
- Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland;
- Table B-6 Characteristics of Existing Power Flow Controllers; and
- Table B-7 Characteristics of Existing Reactive Compensation.

The following is a list of tables in Section B.2:

- Table B-8 Expected Changes in Transmission Circuits;
- Table B-9 Expected Changes in Transformers in Ireland;
- Table B-10 Expected Changes in 3 Winding Transformers in Northern Ireland;
- Table B-11 Expected Changes in 2 Winding Transformers in Northern Ireland; and
- Table B-12 Expected Changes in Reactive Compensation.

Tables B-2 and B-8 include the ratings for lines and cables in MVA for winter and summer reference temperature conditions at 1 per unit (pu) voltage. The higher ambient temperature in summer dictates a reduced thermal rating for overhead lines. The rating is the maximum permissible power that the circuit can transport on a continuous basis.

Reference ambient temperatures are:

- winter: 11°C¹¹⁵; and
- summer: 25°C.

The electrical characteristics of the all-island transmission system at the four nominal voltage levels are documented. They are represented in per unit values; with a 100 MVA base; and the applicable reference voltage. Table B-1 below displays the four nominal and reference voltage levels on the all-island transmission system.

¹¹³ As at summer 2018.

¹¹⁴ Includes transmission system reinforcement projects and developments necessary to connect new generation and demand.

¹¹⁵ ESB Networks previously calculated winter ratings based on an assumed winter temperature of 5°C. In 2018 this was changed to 11°C.

Table A-1 Short Bus Codes

Nominal Voltage Level (kV)	Reference Voltage (kV)					
400	400					
275	275					
220	220					
110	110					

In some cases equipment associated with a line or cable may be lower rated than the circuit or line. However, this equipment¹¹⁶ is easier to upgrade than lines and cables and is therefore not expected to restrict access to the transmission system.

A small number of 110 kV stations are connected to the transmission system via a tee. A tee is an un-switched connection into an existing line between two other stations. For the purposes of describing the various sections of lines in the following tables, tee points are identified by the name of the tee'd 110 kV station with a suffix "T" added.

¹¹⁶ For example, current transformers.

B.1 Characteristics of the Existing Transmission System (Summer 2018)

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)		Ra	ting (MVA)	
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
400	DSN	MP	1	208.5	0.004	0.047	1.049	1577	1749	1867
400	MP	OST	1	105	0.002	0.023	0.53	1577	1749	1867
400	OST	WOO	1	125	0.002	0.028	0.631	1577	1749	1867
275	LOU	TAN	1	50	0.003	0.021	0.127	710	820	881
275	LOU	TAN	2	50	0.003	0.021	0.127	710	820	881
275	BPS	HAN	2	45.5	0.002	0.019	0.114	710	820	881
275	BPS	KEL	1	34.5	0.002	0.014	0.089	710	820	881
275	BPS	MAG	1	65.5	0.003	0.027	0.169	710	820	881
275	CAS	HAN	1	0.8	0.001	0.008	0.046	710	820	881
275	CAS	HAN	2	18.4	0.001	0.008	0.046	710	820	881
275	CAS	KPS	1	18.4	0.003	0.028	0.171	710	820	881
275	CAS	TAN	1	66.8	0.002	0.019	0.114	710	820	881
275	CPS	MAG	1	45.6	0.006	0.025	0.151	412	477	513
275	CPS	MAG	1	56	0.006	0.025	0.151	412	477	513
275	HAN	BYC	1	56	0.002	0.019	0.112	710	820	881
275	KEL	KPS	1	44.7	0.001	0.012	0.075	710	820	881
275	KEL	KPS	2	29	0.001	0.012	0.075	710	820	881
275	KEL	MAG	1	29	0.001	0.013	0.08	710	820	881
275	KPS	TAN	1	31.1	0.004	0.034	0.206	710	820	881
275	MAG	TMN	1	80.8	0.001	0.011	0.065	710	820	881
275	MAG	TMN	2	25.8	0.001	0.011	0.065	710	820	881
275	TAN	TMN	1	25.8	0.001	0.011	0.065	710	820	881
275	TAN	TMN	2	25.8	0.002	0.011	0.065	710	820	881
220	AD	KRA	1	25.8	0.003	0.022	0.034	393	429	468
220	AD	RAF	1	14.4	0.003	0.009	0.245	434	481	513
220	AD	GGO	1	3.8	0	0.002	0.104	573	573	536
220	AD	KRA	2	25.6	0.003	0.022	0.034	393	429	468
220	ARK	CKM	1	53.3	0.006	0.046	0.07	434	481	513
220	ARK	LWD	1	39	0.005	0.034	0.051	434	481	513
220	BVK	CLA	1	16.8	0.002	0.014	0.025	740	769	792
220	BVK	BYH	1	28.6	0.003	0.025	0.05	434	473	513
220	BLC	FIN (I)	1	10	0	0.002	0.332	-	-	570
220	CLE	CDU	1	5.1	0.001	0.004	0.007	434	481	513
220	CLE	WOO	1	13.5	0.002	0.012	0.018	393	429	468
220	CLA	KRA	1	45	0.006	0.038	0.061	644	716	788
220	CSH	FLA	1	88.1	0.01	0.076	0.115	271	295	318

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedan	ce on 100 I (pu)	00 MVA Base Rating (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
220	CSH	PRO	1	88.5	0.01	0.077	0.116	392	436	482
220	CSH	TYN	1	33.8	0.005	0.029	0.046	761	780	794
220	CKM	DSN	1	41.6	0.005	0.036	0.054	434	481	513
220	CKM	ISH	1	11.5	0	0.004	0.315	593	593	593
220	CUL	GI	1	23.3	0.003	0.02	0.045	746	746	803
220	CUL	KRA	1	86	0.012	0.073	0.117	646	704	765
220	CDU	FIN (I)	1	3.7	0.001	0.003	0.005	434	481	513
220	CDU	HN	1	4.5	0	0.002	0.123	593	593	593
220	CDU	FIN (I)	2	3.7	0.001	0.003	0.005	434	481	513
220	CDU	WOO	2	17.8	0.002	0.015	0.023	434	481	513
220	DSN	KLS	1	59.3	0.007	0.051	0.078	393	429	468
220	DSN	MAY	1	36.3	0.004	0.032	0.048	350	393	436
220	DSN	MAY	2	30.5	0.004	0.026	0.04	350	393	436
220	DSN	TH	1	26.6	0.003	0.022	0.144	351	351	351
220	FLA	LOU	1	110.1	0.013	0.095	0.144	327	393	462
220	FLA	SRA	1	55	0.006	0.048	0.072	434	481	513
220	FIN (I)	SHL	1	13.4	0.001	0.005	0.367	536	589	589
220	FIN (I)	NW	1	11.9	0.001	0.004	0.68	332	332	332
220	GI	KLS	1	69.3	0.008	0.06	0.091	434	481	513
220	GI	LWD	1	47.9	0.006	0.041	0.063	434	481	513
220	GOR	LOU	1	32.4	0.004	0.028	0.042	434	481	513
220	GOR	MAY	1	42.2	0.005	0.037	0.055	350	393	436
220	GGO	RAF	1	9.5	0	0.005	0.414	570	570	570
220	INC	ISH	1	12.1	0	0.005	0.33	593	593	593
220	INC	MAY	2	19.2	0.003	0.016	0.026	793	811	824
220	KNR	BYH	1	47	0.006	0.04	0.064	660	660	660
220	KNR	KPG	1	21.4	0.003	0.015	0.054	660	660	660
220	KRA	KLN	1	82.4	0.015	0.073	0.107	512	536	556
220	KRA	RAF	1	23.4	0.003	0.02	0.031	353	405	454
220	KLN	SH	1	89.7	0.014	0.079	0.115	269	322	354
220	KLN	TB	1	70.6	0.008	0.061	0.092	434	481	513
220	KPG	MP	1	5.4	0	0.002	0.236	660	660	660
220	KPG	ТВ	1	2.8	0	0.002	0.026	761	761	802
220	LOU	WOO	1	61.2	0.007	0.053	0.08	350	393	436
220	MAY	TH	1	53.1	0.006	0.044	0.184	351	351	351
220	MAY	INC	1	19.1	0.003	0.016	0.026	793	811	824
220	MAY	SH	1	105.6	0.017	0.094	0.135	269	322	354
220	MAY	WOO	1	22.3	0.003	0.02	0.03	350	393	436

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
220	MP	PRO	1	12.7	0.001	0.009	0.021	393	429	468
220	NW	PB	1	4.5	0	0.001	0.261	332	332	332
220	OST	TYN	1	14.5	0.002	0.013	0.019	434	481	513
220	PB	CKM	1	14.5	0.001	0.005	0.618	267	267	267
220	PB	INC	1	12.5	0.001	0.004	0.504	267	267	267
220	PB	INC	2	11.3	0.001	0.003	0.722	351	351	351
220	PRO	TB	1	10.2	0.001	0.007	0.173	467	467	467
220	TB	KPG	2	2.8	0	0.002	0.028	660	660	660
110	AA	DRU	1	18.4	0.029	0.067	0.006	99	111	123
110	AA	ENN (I)	1	33	0.021	0.107	0.012	178	197	210
110	AA	LIM (I)	1	11.7	0.007	0.037	0.012	161	176	191
110	AD	WHI	1	3.1	0.005	0.011	0.001	99	111	123
110	AGL	DYN	1	8	0.013	0.028	0.003	105	116	123
110	AGL	ENN (I)	1	38.2	0.059	0.131	0.012	99	111	123
110	AGL	SH	1	46.2	0.072	0.159	0.015	105	116	123
110	AHA	KLN	1	3.8	0.004	0.012	0.004	112	112	112
110	ADM	INC	1	10.5	0.009	0.027	0.024	103	123	134
110	ADM	KUD	1	0	0.001	0.002	0.011	140	140	140
110	ANR	DOO	1	2	0.003	0.007	0.001	105	116	123
110	ARK	BEG	1	21.9	0.01	0.079	0.007	136	150	159
110	ARK	BOG	1	29	0.021	0.095	0.01	178	197	210
110	ARK	SHE	2	2.2	0.003	0.008	0.001	34	46	57
110	ATE	DRO	1	5.5	0.003	0.003	0.064	140	140	140
110	ATE	KNR	1	9	0.006	0.029	0.003	178	197	210
110	ATH	LA	1	35.8	0.054	0.123	0.012	99	110	121
110	ATH	SH	1	21.6	0.013	0.07	0.011	107	119	130
110	AUG	CFM	1	0.6	0.001	0.002	0.001	96	96	96
110	AUG	KPG	1	32.8	0.021	0.107	0.012	178	197	210
110	AUG	MTN	1	27.5	0.017	0.089	0.01	178	197	210
110	AUG	SK	3	1	0.001	0.001	0.006	120	120	131
110	AUG	SK	4	1	0.001	0.001	0.006	120	120	131
110	AUG	CFM	2	0.7	0.001	0.002	0.001	96	96	96
110	ARV	COS	1	43	0.067	0.148	0.014	99	111	123
110	ARV	GWE	1	30.6	0.019	0.099	0.011	178	197	210
110	ARV	NAV	1	65.5	0.041	0.213	0.023	178	197	210
110	ARV	SKL	1	18.5	0.012	0.06	0.007	178	197	210
110	ARV	SKL	2	23.6	0.015	0.076	0.01	178	197	210
110	ART	FIN (I)	1	9	0.005	0.01	0.055	120	120	131
110	ART	MCD	1	4.9	0.003	0.005	0.03	120	120	131

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			ting (MVA)	
(kV)	From	То	No.	(km)	R	X	В	Summer	Autumn	Winter
110	BVK	GRO	1	4.9	0.002	0.002	0.033	195	201	220
110	ATY	CLW	1	25	0.039	0.086	0.008	99	111	123
110	ATY	PLS	1	26.6	0.041	0.091	0.009	99	111	123
110	BWR	CRA	1	21.9	0.011	0.03	0.137	116	116	116
110	BOL	ENN (I)	1	24.7	0.016	0.08	0.009	178	197	210
110	BOL	TBKT	1	18.3	0.011	0.059	0.007	178	197	210
110	BAL	CDU	1	15.9	0.011	0.055	0.006	128	144	160
110	BAL	DRY	1	20	0.013	0.065	0.007	178	197	210
110	BLI	DMY	1	27.6	0.043	0.094	0.01	105	116	123
110	BEG	CKM	1	32.3	0.015	0.116	0.01	136	150	159
110	CDL	BYH	1	9.5	0.002	0.011	0.105	195	201	220
110	BLK	BLK	1	0.5	0.001	0.002	0	136	150	159
110	BIN	CF	1	34.3	0.053	0.118	0.011	105	116	123
110	BIN	LET	1	69	0.072	0.23	0.023	136	150	159
110	BDA	MON	1	12.5	0.012	0.037	0.031	99	111	130
110	BDA	NEW (I)	1	7.9	0.007	0.021	0.03	120	124	130
110	BDN	CUL	1	21.8	0.031	0.075	0.007	196	216	217
110	BDN	DOO	1	11.3	0.007	0.037	0.004	178	197	210
110	BRY	RAF	1	1.7	0.003	0.006	0.001	63	82	92
110	BRY	RAF	2	1.8	0.002	0.006	0.001	105	116	123
110	BK	CBR	1	37-4	0.053	0.128	0.014	195	202	227
110	BK	MOY	1	27	0.017	0.088	0.01	80	95	110
110	BGD	INC	1	6.5	0.005	0.01	0.065	140	140	140
110	BGD	INC	2	6.5	0.005	0.01	0.065	140	140	140
110	BLA	RE	1	7.7	0.003	0.006	0.136	119	119	119
110	BAN	BRI	1	2.6	0.004	0.009	0.001	105	116	123
110	BAN	DMY	1	25.9	0.04	0.089	0.008	99	111	123
110	BAN	RAF	1	26.9	0.041	0.091	0.012	105	112	123
110	BAN	BRI	2	2.5	0.004	0.009	0.001	105	116	123
110	CLG	CDU	1	2.5	0.001	0.003	0.028	187	206	219
110	CLG	FIN (I)	1	3.6	0.004	0.011	0.007	124	124	124
110	CLG	MCE	1	0	0.005	0.015	0.005	98	111	124
110	BAR	BAR	1	0.3	0	0.001	0	136	150	159
110	BUT	CUL	1	12.3	0.008	0.038	0.013	192	192	192
110	BUT	KTN	1	2.7	0.004	0.01	0.001	200	209	216
110	KNG	TRI	1	13.8	0.009	0.029	0.09	124	124	124
110	BOG	CRA	1	24.7	0.018	0.081	0.009	178	197	210
110	BGH	CLA	1	13.5	0.008	0.04	0.039	178	197	210
110	CAB	PTN	1	2.7	0.002	0.007	0.005	80	105	119

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	CAB	WOL	1	4.7	0.002	0.005	0.029	120	120	131
110	CLA	CKN	1	29.8	0.019	0.097	0.01	178	197	210
110	CLA	DMY	1	35	0.022	0.114	0.012	178	197	210
110	CLA	MAC	1	5.7	0.004	0.018	0.002	160	178	196
110	CKN	KER	1	20.3	0.013	0.066	0.007	178	197	210
110	CRO	IA	1	2.7	0.004	0.01	0.001	196	216	217
110	CRO	KBY	1	14.4	0.009	0.047	0.005	178	197	210
110	CDY	GRV	1	5.8	0.004	0.019	0.003	132	137	150
110	CDY	SRA	1	12.6	0.02	0.043	0.004	99	111	123
110	CDY	ARI T	1	13.7	0.009	0.045	0.005	136	197	210
110	CSH	CLN	1	22.8	0.014	0.074	0.008	178	197	210
110	CSH	DLT	1	60.8	0.075	0.205	0.02	99	111	123
110	CSH	ENN (I)	1	53.5	0.034	0.174	0.019	178	197	210
110	CSH	GAL	1	13.8	0.021	0.047	0.004	99	111	123
110	CSH	GAL	2	11.3	0.018	0.039	0.004	99	111	123
110	CSH	GAL	3	11.3	0.018	0.039	0.004	99	111	123
110	CSH	SAL	1	24.9	0.025	0.072	0.068	99	111	105
110	CSH	SOM	1	50	0.078	0.172	0.016	99	111	123
110	CLH	TRI	1	9	0.014	0.031	0.003	99	111	123
110	CLH	TRL	1	13.5	0.02	0.045	0.025	105	116	123
110	CBR	CLN	1	57-5	0.089	0.198	0.02	99	111	123
110	CBR	CBG	1	26.5	0.038	0.083	0.052	99	111	123
110	CBR	DLT	1	27.8	0.043	0.095	0.009	99	111	123
110	CD	KBY	1	32.1	0.02	0.104	0.011	178	197	210
110	CD	MAC	1	2.4	0.002	0.008	0.001	178	197	210
110	CPK	TNY	1	5.6	0.003	0.006	0.072	100	100	100
110	CPK	CPK	1	3.4	0.002	0.004	0.025	100	100	100
110	CF	CL	1	5.5	0.006	0.018	0.002	136	150	159
110	CF	COR	1	61.3	0.039	0.199	0.022	135	147	159
110	CF	SRA	1	53	0.065	0.179	0.021	190	190	190
110	CF	CLO	2	25.9	0.037	0.094	0.009	187	206	217
110	CRM	KLM	2	1.4	0.001	0.002	0.014	140	140	140
110	CAH	DOO	1	15.7	0.01	0.051	0.006	178	197	210
110	CAH	KHL	1	18	0.011	0.058	0.006	178	197	210
110	CAH	TIP	1	18.1	0.011	0.059	0.006	178	197	210
110	CAH	BAR	1	43.7	0.065	0.15	0.014	105	116	123
110	CRM	KLM	1	1.4	0.001	0.002	0.014	140	140	140
110	CKM	CHE	1	4	0.004	0.008	0.03	105	116	123
110	CKM	POT	1	3.2	0.001	0.002	0.057	119	119	119

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedan	ce on 100 I (pu)	MVA Base	Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	BRA	NEW (I)	1	9.3	0.01	0.031	0.003	-	-	159
110	BRA	PLS	1	19.3	0.03	0.067	0.006	-	-	123
110	C00	ВСТ	1	15.1	0.014	0.045	0.027	130	130	130
110	CO0	CKM	2	16	0.013	0.042	0.06	130	130	130
110	CLN	LA	1	64.8	0.095	0.222	0.021	63	78	92
110	SCR	KNY	1	33.3	0.033	0.106	0.042	136	140	140
110	CRA	LWD	1	8	0.005	0.026	0.003	178	197	210
110	CRA	WEX	1	21.3	0.022	0.071	0.007	136	150	159
110	COS	FLA	1	3.4	0.005	0.012	0.001	99	111	123
110	COS	FLA	2	3.3	0.005	0.011	0.001	99	111	123
110	COS	ARI T	1	20.7	0.013	0.067	0.007	178	197	210
110	COL (I)	FIN (I)	1	5	0.003	0.013	0.037	104	124	124
110	COL (I)	CDU	1	2.7	0.001	0.004	0.02	130	130	130
110	CHA	GLE	1	30	0.047	0.103	0.01	105	116	123
110	CHA	KLN	1	36.9	0.038	0.123	0.013	136	150	159
110	CHA	MAL	1	22.5	0.014	0.073	0.008	178	197	210
110	CLW	KLS	1	5.4	0.008	0.019	0.002	99	111	123
110	CLW	KLS	2	5.3	0.008	0.019	0.002	99	111	123
110	CLW	STR	1	17.6	0.027	0.061	0.006	105	116	123
110	COW	CVW	1	17.2	0.025	0.054	0.018	99	111	123
110	COW	OLD	1	2.3	0.004	0.008	0.001	105	116	123
110	COW	OLD	2	2.2	0.003	0.008	0.001	105	116	123
110	COW	RAF	1	6.9	0.01	0.024	0.003	99	111	123
110	COW	WHI	1	17.8	0.027	0.062	0.006	105	116	123
110	CUN	GLR	1	26.3	0.037	0.096	0.009	99	110	121
110	CUN	SLI	1	21.1	0.03	0.073	0.007	99	110	121
110	CUS	MLC	1	13.7	0.015	0.048	0.005	136	150	159
110	CUS	NEW (I)	1	24.6	0.026	0.082	0.008	136	150	159
110	CUS	PLS	1	42.1	0.044	0.14	0.014	136	150	159
110	CVW	KRA	1	7.6	0.012	0.026	0.004	99	111	123
110	CGL	GAE	1	2	0.001	0.003	0.015	130	130	130
110	CGL	CKN	1	6.3	0.004	0.021	0.003	178	197	210
110	COR	GWE	1	10.9	0.007	0.036	0.004	178	197	210
110	COR	ENN (N)	1	27.5	0.043	0.107	0.009	99	110	121
110	CDK	LWD	1	6.6	0.003	0.009	0.041	116	116	116
110	CUL	DGN	1	34.2	0.021	0.109	0.02	178	192	192
110	CUL	WAT	1	13.1	0.006	0.033	0.055	178	197	210
110	CTY	INC	1	8.9	0.011	0.03	0.003	103	116	123
110	CDU	MUL	1	73.3	0.088	0.237	0.041	105	116	123

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	CDU	PLA	1	37	0.023	0.12	0.013	178	197	210
110	CDU	RYB	1	13	0.012	0.039	0.021	103	123	128
110	KNY	UGL	1	3.4	0.001	0.004	0.047	228	228	228
110	KNY	GAL	1	26.5	0.005	0.031	0.363	228	228	228
110	KNY	KLH	1	9.9	0.002	0.011	0.109	190	190	190
110	KNY	SAL	1	28.3	0.019	0.063	0.081	187	206	223
110	DDK	MLN	1	7.5	0.012	0.026	0.002	105	116	123
110	DDK	LOU	1	16.8	0.026	0.058	0.005	105	116	123
110	DRU	ENN (I)	1	17.4	0.027	0.06	0.006	99	111	123
110	DGN	WHO	1	8.6	0.006	0.028	0.003	178	197	210
110	DRY	GOR	1	19.4	0.029	0.067	0.006	99	111	123
110	DRY	LOU	1	31.9	0.02	0.104	0.011	99	110	121
110	DRY	PLA	1	5.3	0.008	0.018	0.002	105	116	123
110	DMY	MAC	1	26.2	0.037	0.096	0.009	120	127	128
110	DAL	DAL	1	12.2	0.019	0.042	0.004	105	116	123
110	DTN	FIN (I)	1	9.2	0.002	0.014	0.111	140	140	140
110	DTN	KLM	1	3.2	0.002	0.005	0.032	140	140	140
110	DER	KIN	1	15.1	0.012	0.05	0.005	99	111	130
110	DER	MAY	1	43	0.027	0.139	0.018	74	84	93
110	DER	TSB	1	19.7	0.031	0.068	0.006	99	110	121
110	DRM	LET	1	8.3	0.013	0.028	0.003	105	116	123
110	DRM	MEE	1	5	0.008	0.017	0.002	99	110	121
110	DRM	CLO	1	27	0.039	0.091	0.015	103	116	123
110	ENN (I)	SLC	1	31	0.003	0.047	0.271	195	201	220
110	KHL	THU	1	21.2	0.013	0.069	0.007	178	197	210
110	MLC	TSB	1	19.2	0.012	0.063	0.007	135	147	159
110	CKG	BKY	1	3	0.001	0.003	0.033	187	206	223
110	FAS	FAS	1	5	0.008	0.017	0.002	105	116	123
110	FAS	CKM	1	7.5	0.012	0.026	0.002	105	116	123
110	FLA	GIL	1	10.6	0.016	0.036	0.003	105	116	123
110	FLA	SLI	1	50.5	0.079	0.174	0.016	99	111	123
110	FLA	TON	1	32.3	0.05	0.111	0.01	98	111	126
110	FLA	SLB	1	21.7	0.034	0.075	0.007	105	116	123
110	FRA	HAR	1	2.3	0.002	0.004	0.03	107	107	107
110	FRA	TRN	1	2.8	0.002	0.004	0.028	140	140	140
110	FRA	HEU	1	2.4	0.002	0.004	0.024	140	140	140
110	FRA	INC	1	5.6	0.004	0.01	0.073	107	107	107
110	FIN (I)	MCD	1	7.9	0.003	0.007	0.141	119	119	119
110	FIN (I)	PTN	1	3.5	0.003	0.01	0.006	80	105	119

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	FIN (I)	GLA	1	14	0.022	0.048	0.005	105	116	123
110	FIN (I)	GRA	1	13.2	0.005	0.012	0.236	119	119	119
110	FIN (I)	POP	1	4.3	0.002	0.005	0.026	120	120	131
110	FIN (I)	SVN	1	32.2	0.039	0.104	0.056	105	115	115
110	FTT	C00	1	4.4	0.004	0.011	0.019	124	124	132
110	GLA	SVN	1	18	0.017	0.055	0.052	136	150	154
110	GRI	GRI	1	1	0.002	0.004	0	105	116	123
110	GI	KKY	1	49.2	0.076	0.169	0.016	99	111	123
110	GI	WAT	1	11.7	0.007	0.038	0.004	178	197	210
110	GI	WAT	2	12.9	0.008	0.042	0.005	178	197	210
110	GI	WEX	1	34.5	0.054	0.119	0.011	99	111	123
110	GRA	NBY	1	5.1	0.002	0.005	0.089	119	119	119
110	GRO	CKN	1	15.2	0.008	0.014	0.139	120	120	120
110	GAL	SAL	1	6.1	0.002	0.007	0.067	105	105	105
110	GOL	GLT	1	3.9	0.006	0.014	0.001	105	116	123
110	GOR	MTH	1	27.3	0.028	0.09	0.013	99	111	130
110	GOR	NAV	1	5.3	0.008	0.019	0.002	80	95	110
110	GOR	NAV	2	6.3	0.009	0.022	0.002	99	111	123
110	GOR	NAV	3	6.5	0.007	0.022	0.002	99	111	130
110	GOR	PLA	1	19.7	0.03	0.068	0.006	99	111	123
110	GCA	INC	1	8.1	0.008	0.025	0.009	103	123	134
110	GCA	INC	2	8.1	0.008	0.025	0.009	103	123	134
110	GCA	KUD	2	2.1	0.002	0.003	0.021	140	140	140
110	GCA	NAN	1	1.8	0.001	0.002	0.011	120	120	131
110	GCA	NAN	2	1.7	0.001	0.002	0.011	120	120	131
110	CLO	MRY	1	7.4	0.005	0.011	0.074	124	124	124
110	CLO	CF	1	26.5	0.016	0.085	0.016	178	197	210
110	GLT	BYH	1	9.3	0.006	0.03	0.003	178	197	210
110	HAR	RE	1	5.6	0.004	0.01	0.073	107	107	107
110	HEU	INC	1	3.6	0.003	0.005	0.036	140	140	140
110	IA	MAC	1	18.6	0.027	0.068	0.006	196	213	217
110	INC	MIL	1	8.4	0.004	0.009	0.051	120	120	131
110	INC	BKY	1	10	0.002	0.011	0.11	187	206	223
110	KNR	KPG	1	14.9	0.015	0.05	0.005	136	150	159
110	KNR	TRI	1	4.4	0.005	0.017	0.002	120	127	128
110	KNR	TRI	2	5.7	0.004	0.019	0.002	178	197	210
110	KRA	KBY	1	11.9	0.008	0.039	0.004	178	197	210
110	KRA	BAR	1	19.5	0.02	0.065	0.007	136	150	159
110	KRA	MID	1	10.7	0.017	0.037	0.004	99	111	123

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length				Rating (MVA)			
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter	
110	KRA	WHO	1	41.5	0.026	0.135	0.015	178	197	210	
110	KRA	KBY	2	12.5	0.018	0.043	0.004	99	111	123	
110	KTL	MAY	1	21.4	0.022	0.072	0.007	99	111	130	
110	KTL	MON	1	8.9	0.009	0.03	0.003	136	150	159	
110	REM	TRL	1	12	0.006	0.018	0.12	106	106	106	
110	KKY	KLS	1	34.3	0.053	0.118	0.011	99	111	123	
110	KLN	LIM (I)	1	9	0.014	0.031	0.003	99	111	123	
110	KLN	CUR	1	14.8	0.011	0.048	0.005	136	150	159	
110	KLN	SNG	1	4.1	0.003	0.013	0.003	135	147	159	
110	KER	OUG T	1	22.6	0.014	0.073	0.008	178	197	210	
110	KUR	NAV	1	6.1	0.009	0.021	0.002	105	116	123	
110	BYH	GLE	1	12.5	0.005	0.024	0.244	178	197	210	
110	KIN	MUL	1	27	0.017	0.088	0.01	178	197	210	
110	KIN	DFR	1	29.3	0.021	0.096	0.01	99	111	130	
110	KCR	GLE	1	11.1	0.008	0.017	0.115	140	140	140	
110	KTN	WAT	1	5	0.004	0.007	0.05	99	111	130	
110	KLM	NBY	1	1.2	0.001	0.001	0.02	119	119	119	
110	KLM	POP	1	6	0.003	0.007	0.036	120	120	131	
110	KPG	RAT (I)	1	32.4	0.033	0.107	0.018	136	150	159	
110	KPG	TRL	1	39.4	0.06	0.135	0.013	105	116	123	
110	KPG	TRL	2	43.6	0.027	0.14	0.023	178	197	210	
110	LA	MUL	1	46.3	0.072	0.16	0.015	105	116	123	
110	LA	RIC	1	15.7	0.024	0.054	0.007	105	116	123	
110	LA	RIC	2	12.5	0.02	0.043	0.005	105	116	123	
110	LA	SLB	1	9.1	0.014	0.031	0.003	105	116	123	
110	LOU	MLN	1	13	0.02	0.045	0.004	99	110	121	
110	LOU	RRU	1	37.5	0.058	0.129	0.012	95	103	112	
110	LIM (I)	MTN	1	6.5	0.005	0.024	0.003	178	197	210	
110	LIM (I)	RAT (I)	1	29.1	0.044	0.101	0.012	99	111	123	
110	LIM (I)	KLN	2	11.7	0.018	0.04	0.009	80	95	110	
110	LIS	SKL	1	39.3	0.061	0.135	0.013	105	116	123	
110	LIS	LOU	1	40.4	0.063	0.139	0.013	105	116	123	
110	LET	TLK	1	34.8	0.054	0.12	0.013	105	116	123	
110	LET	GLT	1	38.4	0.058	0.132	0.012	103	116	123	
110	LET	STR (N)	1	22.3	0.035	0.076	0.007	105	116	123	
110	LIB	MR	1	2.7	0.001	0.003	0.016	100	100	100	
110	LIB	MR	2	2.7	0.002	0.003	0.017	120	120	131	
110	LSN	THU	1	10.4	0.016	0.036	0.003	99	111	123	
110	CUR	NEN	1	18.8	0.029	0.065	0.006	105	116	123	

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Rating (MVA)			
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter	
110	CUR	BKM	1	17.3	0.004	0.019	0.192	190	190	190	
110	MHL	RE	1	3	0.002	0.004	0.03	140	140	140	
110	MHL	TRN	1	1.4	0.001	0.002	0.014	140	140	140	
110	MCE	SBH	1	4.7	0.005	0.015	0.005	-	111	130	
110	MCE	CDU	1	0	0.003	0.01	0.016	98	111	124	
110	MCD	WOL	1	1.4	0.001	0.002	0.009	120	120	131	
110	MID	WHI	1	20	0.03	0.069	0.007	99	111	123	
110	MTH	LOU	1	15.1	0.023	0.052	0.005	99	111	123	
110	MAY	GRI	1	2.2	0.002	0.007	0.002	103	120	120	
110	MAY	GRI	1	2.2	0.003	0.009	0.001	105	116	123	
110	MAY	RYB	1	9	0.009	0.03	0.005	178	197	219	
110	MAY	RNW	1	7.1	0.008	0.024	0.002	103	116	123	
110	MAY	BLK	1	30.9	0.032	0.103	0.011	99	110	121	
110	MIL	RE	1	4.9	0.003	0.005	0.075	100	100	100	
110	MIL	RE	2	5.6	0.003	0.006	0.034	120	120	131	
110	MTN	MUN	1	0.7	0.001	0.002	0	105	116	123	
110	MTN	MUN	2	0.7	0.001	0.002	0	105	116	123	
110	MP	TBKT	1	7.3	0.005	0.024	0.003	178	197	210	
110	MR	TBG	1	3.3	0.001	0.004	0.036	178	198	219	
110	MR	TBG	2	3.3	0.001	0.004	0.036	178	198	219	
110	MR	KBY	1	4	0.004	0.013	0.003	99	111	130	
110	MR	KBY	2	4	0.004	0.013	0.003	99	111	130	
110	MAL	KBY	1	29.2	0.018	0.095	0.01	178	197	210	
110	MOY	GLR	1	14	0.022	0.048	0.004	99	111	123	
110	MOY	TAW	1	8.4	0.013	0.029	0.003	99	111	123	
110	MOY	TAW	2	8.3	0.011	0.028	0.012	187	206	217	
110	BCT	CKM	1	3.1	0.002	0.005	0.031	140	140	140	
110	NEW (I)	BLK	1	12.2	0.013	0.041	0.004	136	150	159	
110	NQS	RE	1	2.1	0.001	0.002	0.038	119	119	119	
110	OUG	OUG T	1	11	0.017	0.038	0.004	105	116	123	
110	PA	STR	1	22.4	0.035	0.077	0.007	105	116	123	
110	PB	RE	3	1.4	0	0.002	0.046	269	269	269	
110	PB	RE	4	1.4	0	0.002	0.046	269	269	269	
110	PLS	DAL	1	54.7	0.034	0.178	0.019	178	197	210	
110	RE	PB	1	1.2	0.001	0.001	0.016	112	112	112	
110	RAF	TBG	1	11	0.016	0.037	0.005	105	194	209	
110	RAF	RSY	1	2.1	0.003	0.007	0.001	63	82	92	
110	RAF	TBG	2	9.5	0.006	0.031	0.005	99	110	121	
110	RNW	DFR	1	25.9	0.02	0.085	0.009	99	111	123	

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Ra	ting (MVA)
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	RRU	SKL	1	14.5	0.023	0.05	0.005	99	111	123
110	SH	DAL	1	12	0.007	0.039	0.007	178	197	210
110	SH	IKE T	1	53.9	0.034	0.175	0.019	178	197	210
110	SH	SOM	1	13.8	0.021	0.047	0.006	105	116	123
110	SLI	SRA	1	11.1	0.017	0.038	0.004	99	111	123
110	SLI	SRA	2	12	0.019	0.041	0.004	99	111	123
110	SOR	TLK	1	4.4	0.007	0.015	0.002	105	116	123
110	SOM	SOM	1	2	0.003	0.007	0.001	105	116	123
110	SRA	CF	2	49.2	0.031	0.16	0.017	178	197	210
110	STR	STR	1	2	0.003	0.007	0.001	105	116	123
110	SNG	AA	1	5.5	0.003	0.017	0.007	178	197	210
110	SBH	CDU	1	4.1	0.003	0.01	0.016	-	111	130
110	TBK	TBKT	1	2.9	0.005	0.01	0.001	105	116	123
110	CTN	KLN	1	29.2	0.018	0.095	0.01	178	197	210
110	CTN	TIP	1	13.1	0.008	0.043	0.005	178	197	210
110	TRL	OUG T	1	11.3	0.007	0.037	0.004	178	197	210
110	THU	IKE T	1	25.7	0.016	0.083	0.009	178	197	210
110	CKM	FAS	1	2.9	0.005	0.01	0.001	105	116	123
110	BKM	CUR	1	7.3	0.004	0.007	0.072	120	120	120
110	AGH	ENN (N)	1	31.1	0.039	0.095	0.019	109	114	124
110	ANT	KEL	1	8.9	0.012	0.03	0.003	82	95	103
110	ANT	KEL	2	8.9	0.012	0.03	0.003	82	95	103
110	BPS	BVG	1	17.3	0.023	0.058	0.006	82	95	103
110	BPS	BVG	2	17.3	0.023	0.058	0.006	82	95	103
110	BPS	EDE	1	15.1	0.023	0.054	0.005	69	80	86
110	BPS	EDE	1	15.1	0.023	0.053	0.005	70	81	87
110	BMA	KEL	1	10	0.013	0.035	0.003	109	119	124
110	BMA	KEL	2	11.5	0.015	0.04	0.004	109	119	124
110	BAN (N)	TAN	1	18.4	0.024	0.062	0.006	82	95	103
110	BAN (N)	TAN	2	14.2	0.019	0.049	0.005	82	95	103
110	BVG	KEL	1	21.2	0.028	0.073	0.007	109	119	124
110	BVG	KEL	2	20.3	0.027	0.07	0.007	109	119	124
110	BVG	LAR	1	7.1	0.007	0.023	0.002	79	79	113
110	BVG	LAR	2	7.1	0.007	0.023	0.002	79	79	113
110	BNH	CAS	1	21.2	0.028	0.071	0.007	82	95	103
110	BNH	CAS	2	21.2	0.028	0.071	0.007	82	95	103
110	BNM	DON	1	6	0.005	0.005	0.053	75	75	82
110	BNM	DON	2	6	0.005	0.005	0.053	75	75	82
110	BRO	RSK	1	17.4	0.01	0.062	0.02	178	197	210

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Rating (MVA)		
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	CAR	CAS	1	24.7	0.037	0.087	0.008	69	80	86
110	CAR	EDE	1	12.4	0.019	0.043	0.004	70	70	87
110	CAR	CAS	1	24.7	0.037	0.086	0.008	70	81	87
110	CAR	EDE	1	12.4	0.019	0.044	0.004	69	80	86
110	CAS	CRE	1	3	0.001	0.004	0.061	132	132	145
110	CAS	CRE	2	3	0.001	0.004	0.061	132	132	145
110	CAS	KNO	1	4.5	0.005	0.004	0.044	66	66	73
110	CAS	KNO	2	4.5	0.005	0.004	0.044	66	66	73
110	CAS	NAR	1	18	0.015	0.04	0.071	109	109	124
110	CAS	NAR	2	19.8	0.018	0.046	0.07	109	124	124
110	CAS	RAT (N)	1	18.9	0.025	0.064	0.006	82	95	103
110	CAS	RAT (N)	2	18.9	0.025	0.064	0.006	82	95	103
110	CAS	ROS	1	1.9	0.001	0.003	0.015	144	144	152
110	CAS	ROS	2	1.9	0.001	0.003	0.015	144	144	152
110	CEN	CRE	1	4.2	0.001	0.004	0.03	144	144	144
110	CEN	CRE	2	4.2	0.001	0.004	0.03	144	144	144
110	COL (N)	CPS	1	46.7	0.061	0.161	0.015	82	95	103
110	COL (N)	LIM (N)	1	18.6	0.024	0.064	0.006	82	95	103
110	COL (N)	LOG	1	8.1	0.011	0.027	0.003	82	95	103
110	COL (N)	LOG	2	8.1	0.011	0.027	0.003	82	95	103
110	COL (N)	RSK	1	21.3	0.024	0.069	0.007	185	191	193
110	CPS	KMT	1	14.5	0.011	0.048	0.005	143	158	166
110	CPS	LIM (N)	1	29.5	0.039	0.101	0.01	82	95	103
110	CPS	LMR	1	9	0.012	0.03	0.003	82	95	103
110	CPS	LMR	2	9	0.012	0.03	0.003	82	95	103
110	CPS	SPR	1	9.2	0.011	0.029	0.012	82	95	103
110	CPS	SPR	2	9.4	0.011	0.029	0.013	82	95	103
110	CPS	STR (N)	1	27	0.018	0.053	0.017	143	158	166
110	CRG	KEL	1	23.1	0.029	0.077	0.013	82	95	103
110	CRG	TMN	1	36.2	0.045	0.119	0.022	109	114	124
110	DON	HAN	1	5.8	0.002	0.005	0.14	144	144	158
110	DON	HAN	2	5.8	0.002	0.005	0.14	144	144	158
110	DON	FIN (N)	1	3.7	0.004	0.011	0.008	69	81	86
110	DON	FIN (N)	2	3.7	0.004	0.011	0.007	69	80	86
110	DRO	CMK	1	8.8	0.007	0.045	0.004	167	167	188
110	DRO	ENN (N)	1	24.6	0.026	0.066	0.007	82	95	103
110	DRO	ENN (N)	2	24.6	0.026	0.066	0.007	82	95	103
110	DRO	OMA	1	9.23	0.018	0.047	0.005	82	95	103
110	DRO	OMA	2	9.23	0.018	0.047	0.005	82	95	103

Table B-2 Characteristics of Existing Transmission Circuits

Voltage				Length	Impedance on 100 MVA Base (pu)			Rating (MVA)		
(kV)	From	То	No.	(km)	R	Х	В	Summer	Autumn	Winter
110	DRU (N)	TAN	1	4.4	0.004	0.014	0.002	79	96	113
110	DRU (N)	TAN	2	4.4	0.004	0.014	0.002	79	96	113
110	DRU (N)	TAN	3	4.1	0.005	0.014	0.001	96	96	119
110	DRU (N)	TMN	1	22.7	0.028	0.073	0.012	82	95	103
110	DRU (N)	TMN	2	21.5	0.029	0.075	0.008	82	95	103
110	DUN	TMN	1	5.82	0.004	0.017	0.005	139	144	152
110	DUN	TMN	2	6.53	0.009	0.023	0.002	139	144	152
110	DUN	OMA	1	36.1	0.042	0.124	0.012	186	191	193
110	DUN	TMN	3	6	0.004	0.02	0.019	186	191	193
110	FIN (N)	HAN	1	3.1	0.001	0.003	0.022	144	144	144
110	FIN (N)	HAN	2	3.1	0.001	0.003	0.022	144	144	144
110	GLE (N)	KEL	1	21.4	0.027	0.068	0.027	82	82	90
110	GLE (N)	KEL	1	21.4	0.027	0.068	0.027	82	82	90
110	GOR (N)	OMA	1	17.1	0.011	0.066	0.006	188	204	213
110	GOR (N)	TMN	1	34.8	0.021	0.131	0.013	188	204	213
110	HAN	LIS (N)	1	9.2	0.01	0.026	0.018	82	95	103
110	HAN	LIS (N)	2	9.2	0.009	0.026	0.018	80	93	100
110	KEL	RSK	1	36	0.039	0.133	0.013	185	190	193
110	KMT	SLK	1	6.2	0.007	0.018	0.006	98	100	110
110	KMT	STR (N)	1	11.2	0.008	0.037	0.004	143	158	166
110	LIS (N)	TAN	1	31	0.04	0.106	0.01	82	95	103
110	LIS (N)	TAN	2	29.2	0.034	0.1	0.009	80	93	100
110	MKL	OMA	1	37.5	0.028	0.113	0.015	139	150	157
110	NEW (N)	TAN	1	24.1	0.031	0.08	0.008	82	95	103
110	NEW (N)	TAN	2	24	0.031	0.08	0.008	82	95	103
110	OMA	STR (N)	1	35.5	0.046	0.123	0.012	109	119	124
110	OMA	STR (N)	2	36.1	0.047	0.125	0.012	82	95	103
110	OMA	TRE	1	21.5	0.025	0.073	0.007	186	191	193
110	TAN	WAR	1	12.9	0.013	0.042	0.005	79	96	113
110	TAN	WAR	2	12.9	0.013	0.042	0.005	79	96	113
110	TRE	TMN	1	42.9	0.025	0.082	0.025	186	191	193

Table B-3 Characteristics of Existing Transformers in Ireland

		Rating		Impedance on 100 MVA Base (pu)		Voltage Rat Rar	
Station	Transformer	(MVA)	HV/LV (kV)	R	X	+	-
DSN	T4201	500	400/220	0.0002	0.0317	1%	16%
DSN	T4202	500	400/220	0.0003	0.027	10%	7%
MP	T4202	500	400/220	0.0002	0.0329	1%	16%
OST	T4201	500	400/220	0.0003	0.027	10%	8%
WOO	T4201	500	400/220	0.0002	0.0316	1%	16%
WOO	T4202	550	400/220	0.0002	0.027	N,	/A
WOO	T4204	500	400/220	0.0002	0.0316	1%	16%
LOU	AT1	300	275/220	0.0008	0.03	15%	15%
LOU	AT2	600	275/220	0.0008	0.015	15%	15%
LOU	AT3	300	275/220	0.0008	0.0303	15%	15%
AD	T2101	125	220/110	0.001	0.124	10%	18%
ARK	T2101	63	220/110	0.007	0.18	23%	19%
ARK	T2102	125	220/110	0.0021	0.1237	9%	18%
BVS	T2101	250	220/110	0.001	0.064	10%	18%
BVS	T2102	250	220/110	0.001	0.064	10%	18%
BYH	T2101	250	220/110	0.001	0.064	10%	18%
BYH	T2102	250	220/110	0.001	0.064	10%	18%
CLA	T2101	125	220/110	0.001	0.124	10%	18%
CLA	T2102	250	220/110	0.0013	0.0647	10%	18%
CSH	T2101	238	220/110	0.0004	0.0631	10%	18%
CSH	T2102	250	220/110	0.0004	0.0631	10%	18%
CSH	T2104	175	220/110	0.0021	0.1332	22%	18%
CKM	T2101	250	220/110	0.001	0.0646	10%	18%
CKM	T2102	250	220/110	0.001	0.0646	10%	18%
CKM	T2103	250	220/110	0.001	0.0646	10%	18%
CUL	T2101	250	220/110	0.0005	0.064	9%	18%
CDU	T2101	250	220/110	0.00093	0.06152	10%	18%
CDU	T2102	250	220/110	0.00066	0.061	10%	18%
FLA	T2101	125	220/110	0.0027	0.128	10%	18%
FLA	T2102	125	220/110	0.0008	0.1331	10%	18%
FIN (I)	T2101	250	220/110	0.0013	0.0651	10%	18%
FIN (I)	T2102	250	220/110	0.0013	0.0648	10%	18%
FIN (I)	T2103	250	220/110	0.001	0.064	10%	18%
FIN (I)	T2104	250	220/110	0.001	0.0638	10%	18%
FIN (I)	T2105	250	220/110	0.001	0.064	10%	18%
GI	T2101	125	220/110	0.0026	0.1331	10%	18%
GI	T2102	125	220/110	0.0023	0.1237	23%	18%
GOR (I)	T2101	250	220/110	0.001	0.064	10%	18%
INC	T2101	T2101	220/110	0.001	0.0564	10%	18%

Table B-3 Characteristics of Existing Transformers in Ireland

		Rating		Impedance on 100 MVA Base (pu)		_	tio Tapping nge	
Station	Transformer	(MVA)	HV/LV (kV)	R	Х	+	-	
INC	T2102	250	220/110	0.001	0.0564	10%	18%	
INC	T2103	250	220/110	0.0001	0.06	10%	18%	
INC	T2104	250	220/110	0.0001	0.06	10%	18%	
KNR	T2101	250	220/110	0.001	0.064	10%	18%	
KNR	T2102	250	220/110	0.001	0.064	10%	18%	
KRA	T2101	250	220/110	0.0013	0.0647	10%	18%	
KRA	T2102	250	220/110	0.0013	0.0652	10%	18%	
KRA	T2103	250	220/110	0.0013	0.0652	10%	18%	
KLN	T2101	63	220/110	0.0065	0.2453	23%	18%	
KLN	T2102	63	220/110	0.0095	0.2473	23%	18%	
KLN	T2103	250	220/110	0.0004	0.0631	10%	18%	
KLN	T2104	120	220/110	0.001	0.123	10%	18%	
KLS	T2101	125	220/110	0.00132	0.1237	10%	18%	
KLS	T2102	125	220/110	0.0008	0.1237	10%	18%	
KPD	T2101	250	220/110	0.0004	0.0631	10%	18%	
KPD	T2102	250	220/110	0.0004	0.0631	10%	18%	
LOU	T2101	125	220/110	0.0022	0.1331	23%	18%	
LOU	T2102	125	220/110	0.0022	0.1324	23%	18%	
LOU	T2103	125	220/110	0.0023	0.1324	23%	18%	
LOU	T2104	250	220/110	0.001	0.064	10%	18%	
LWD	T2101	250	220/110	0.001	0.064	10%	18%	
MAY	T2101	125	220/110	0.0021	0.1339	23%	18%	
MAY	T2102	238	220/110	0.001	0.064	10%	18%	
MAY	T2103	125	220/110	0.0021	0.1324	23%	18%	
MAY	T2104	250	220/110	0.001	0.064	10%	18%	
MP	T4201	500	380/220	0.0003	0.027	10%	8%	
MP	T2101	250	380/220	0.001	0.064	10%	18%	
MP	T4202	500	380/220	0.0002	0.0329	1%	16%	
PB	TF3	250	220/110	0.0013	0.059	9%	17%	
PB	TF4	250	220/110	0.0013	0.0609	9%	17%	
RAF	T2101	238	220/110	0.001	0.064	10%	18%	
RAF	T2102	250	220/110	0.00045	0.0558	10%	18%	
SH	T2101	125	220/110	0.00574	0.1237	10%	18%	
SH	T2102	125	220/110	0.00131	0.1237	10%	18%	
SRA	T2101	250	220/110	0.001	0.064	10%	18%	
TB	T2101	238	220/110	0.00099	0.0554	10%	18%	
TB	T2102	238	220/110	0.00099	0.0554	10%	18%	

Table B-4 Characteristics of Existing 3 Winding Transformers in Northern Ireland

		Ir	Impedance pu on 100 MVA base				e	Rati	ng (M	VA)		minal	No.
Substation/		W 1	1-2	W	2-3	_	W3-1				Ratio	(pu)	of Taps
Transformer	HV/LV	R	Х	R	Х	R	Х	W1	W2	W3	Upper	Lower	тарз
BPS IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
BPS IBTx 2	275/110	0.0018	0.0641	0.0018	0.2059	0	0.128	240	240	30	1.15	0.85	19
CAS IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	60	1.15	0.85	19
CAS IBTx 2	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	30	1.15	0.85	19
CAS IBTx 3	275/110	0.0018	0.0656	0.0018	0.2375	0	0.1593	240	240	30	1.15	0.85	19
CPS IBTx 1	275/110	0.0018	0.0609	0.0018	0.1273	0	0.057	240	240	60	1.15	0.85	19
CPS IBTx 2	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	30	1.15	0.85	19
HAN IBTx 1	275/110	0.0018	0.0591	0.0018	0.1261	0	0.056	240	240	45	1.15	0.85	19
HAN IBTx 2	275/110	0.0018	0.0591	0.0018	0.1261	0	0.056	240	240	45	1.15	0.85	19
HAN IBT x 3	275/110	0.0014	0.0639	0.0014	0.2236	0	0.1449	240	240	60	1.15	0.85	19
KEL IBTx 1	275/110	0.0018	0.0609	0.0018	0.1273	0	0.057	240	240	45	1.15	0.85	19
KEL IBTx 2	275/110	0.0018	0.0607	0.0018	0.1317	0	0.057	240	240	45	1.15	0.85	19
TAN IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
TAN IBTx 2	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
TAN IBTx 3	275/110	0.0014	0.0639	0.0018	0.2375	0	0.1575	240	240	60	1.15	0.85	19
TMN IBTx1	275/110	0.0014	0.0644	0.0037	0.2236	0	0.1514	240	240	60	1.15	0.85	19
TMN IBTx2	275/110	0.0014	0.0644	0.004	0.2315	0	0.15	240	240	60	1.15	0.85	19
BPS IBTx 1	275/110	0.0018	0.0641	0.0018	0.2092	0	0.1325	240	240	30	1.15	0.85	19
KPS IBTx1	275/11.5	0	0.1635	0	0.3040	0	0.1635	110	55	55	1.15	0.938	33

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland 117

		Rating		pu on rating se	Off nomi	inal ratio	No. of taps
Station	HV/LV (kV)	(MVA)	R	Х	Upper	Lower	
AGH	110/33	90	0.0039	0.2464	1.1	0.8	19
ANT	110/33	90	0.0039	0.2464	1.1	0.8	19
ANT	110/33	90	0.0039	0.2473	1.1	0.8	19
ВМА	110/33	90	0.0039	0.2447	1.1	0.8	19
ВМА	110/33	60	0.0065	0.2893	1.1	0.8	19
ВМА	110/33	90	0.0039	0.2463	1.1	0.8	19
ВМА	110/33	60	0.0065	0.2867	1.1	0.8	19
BAN (N)	110/33	30	0.0171	0.4133	1.1	0.8	15
BAN (N)	110/33	30	0.0171	0.4133	1.1	0.8	15
BAN (N)	110/33	30	0.019	0.4167	1.1	0.8	15
BAN (N)	110/33	30	0.019	0.4167	1.1	0.8	15
BNH	110/33	90	0.0037	0.2419	1.1	0.8	19
BNH	110/33	90	0.0038	0.2413	1.1	0.8	19
BNM	110/33	90	0.0039	0.2461	1.1	0.8	19
BNM	110/33	90	0.0039	0.2461	1.1	0.8	19
BRO	110/34	100	0.0035	0.16	1.1	0.9	33
CAR	110/33	90	0.0039	0.248	1.1	0.8	19
CAR	110/33	90	0.0039	0.248	1.1	0.8	19
CEN	110/33	90	0.0037	0.2422	1.1	0.8	19
CEN	110/33	90	0.0038	0.2419	1.1	0.8	19
CKM	110/33	90	0.0039	0.2461	1.1	0.8	19
COL (N)	110/33	60	0.0074	0.2512	1.1	0.8	19
COL (N)	110/33	60	0.0074	0.2512	1.1	0.8	19
CPS	110/33	90	0.0087	0.2559	1.1	0.8	19
CPS	110/33	90	0.0087	0.2559	1.1	0.8	19
CRG	110/33	60	0.0074	0.2515	1.1	0.8	19
CRG	110/33	60	0.0074	0.2515	1.1	0.8	19
CRE	110/33	75	0.0091	0.1953	1.1	0.8	19
CRE	110/33	75	0.0091	0.1967	1.1	0.8	19
DON	110/33	90	0.004	0.2403	1.1	0.8	19
DON	110/33	60	0.0119	0.3658	1.1	0.8	19
DON	110/33	60	0.0119	0.3607	1.1	0.8	19
DON	110/33	60	0.0119	0.3658	1.1	0.8	19
DRU (N)	110/33	90	0.0061	0.2423	1.1	0.8	19
DRU (N)	110/33	90	0.0061	0.2423	1.1	0.8	19
DUN	110/33	90	0.0087	0.2566	1.1	0.8	19
DUN	110/33	90	0.0087	0.2566	1.1	0.8	19

^{117 110/33} kV transformers in Northern Ireland are included here as these are controlled by SONI. 110/38 kV transformers in Ireland are not included here as these are controlled by ESB Networks.

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland

		Rating		pu on rating se	Off nomi	nal ratio	No. of taps
Station	HV/LV (kV)	(MVA)	R	Х	Upper	Lower	
EDE	110/33	45	0.0125	0.2733	1.1	0.8	19
EDE	110/33	45	0.0123	0.2738	1.1	0.8	19
ENN (N)	110/33	45	0.0126	0.272	1.1	0.8	19
ENN (N)	110/33	45	0.0126	0.272	1.1	0.8	19
ENN (N)	110/33	45	0.0126	0.272	1.1	0.8	19
FIN (N)	110/33	45	0.0076	0.2533	1.1	0.8	19
FIN (N)	110/33	45	0.0076	0.2549	1.1	0.8	19
GLE (N)	110/33	60	0.0119	0.2692	1.1	0.8	19
GOR (N)	110/33	90	0.0039	0.2461	1.1	0.8	19
KMT	110/33	90	0.0039	0.2461	1.1	0.8	19
KNO	110/33	90	0.0039	0.2461	1.1	0.8	19
KNO	110/33	90	0.0039	0.2461	1.1	0.8	19
LAR	110/33	45	0.0116	0.2778	1.1	0.8	15
LAR	110/33	45	0.0116	0.2771	1.1	0.8	15
LIM (N)	110/33	45	0.0125	0.2809	1.1	0.8	15
LIM (N)	110/33	45	0.0125	0.2809	1.1	0.8	15
LIS (N)	110/33	90	0.0087	0.254	1.1	0.8	19
LIS (N)	110/33	90	0.0086	0.2569	1.1	0.8	19
LMR	110/33	45	0.0076	0.254	1.1	0.8	19
LMR	110/33	45	0.0076	0.2533	1.1	0.8	19
LOG	110/33	45	0.0126	0.2738	1.1	0.8	19
LOG	110/33	45	0.0128	0.28	1.1	0.8	19
MKL	110/33	90	0.0039	0.2502	1.1	0.8	19
MKL	110/33	90	0.0039	0.2502	1.1	0.8	19
NAR	110/33	60	0.0075	0.2505	1.1	0.8	19
NAR	110/33	60	0.0073	0.25	1.1	0.8	19
NEW (N)	110/33	90	0.0038	0.2427	1.1	0.8	19
NEW (N)	110/33	90	0.0038	0.2419	1.1	0.8	19
OMA	110/33	90	0.0039	0.2481	1.1	0.8	19
OMA	110/33	90	0.0039	0.2481	1.1	0.8	19
RSK	110/33	90	0.0039	0.2461	1.1	0.8	19
RAT (N)	110/33	90	0.0087	0.2549	1.1	0.8	19
RAT (N)	110/33	90	0.0046	0.2402	1.1	0.8	19
ROS	110/33	90	0.0087	0.2576	1.1	0.8	19
ROS	110/33	90	0.0087	0.2533	1.1	0.8	19
SLK	110/20	100	0.0035	0.16	1.1	0.9	33
SPR	110/33	90	0.0039	0.247	1.1	0.8	19
SPR	110/33	90	0.0039	0.2471	1.1	0.8	19
STR (N)	110/33	45	0.0076	0.2522	1.1	0.8	19

Table B-5 Characteristics of Existing 2 Winding Transformers in Northern Ireland

		Rating		pu on rating se	Off nomi	inal ratio	No. of taps
Station	HV/LV (kV)	(MVA)	R	Х	Upper	Lower	
STR (N)	110/33	45	0.0076	0.2522	1.1	0.8	19
TRE	110/33	90	0.0039	0.2461	1.1	0.8	19
WAR	110/33	90	0.0039	0.2481	1.1	0.8	19
WAR	110/33	90	0.0039	0.2488	1.1	0.8	19

Table B-6 Characteristics of Existing Power Flow Controllers

	Voltage		Rating	Impedance Base			e Range (elec- degrees)
Station	(kV)	Circuit	(MVA)	R	Х	+	٠
CKM	220	CKM – PB	350	0.000	0.029	15.3	15.3
ENN (N)	110	ENNK -COR	125	0.000	0.0213	1.2	0.8
STR (N)	110	STRA – LET	125	0.000	0.0213	1.2	0.8

Table B-7 Characteristics of Existing Reactive Compensation

			Capabilit	y (Mvar)
Station	Voltage (kV)	Plant	Generate	Absorb
ARD	110	1 Capacitor	30	
ATH	110	3 Capacitors (1 Mobile)	90	
BAN (I)	110	1 Capacitor	15	
BYC	275	4 Capacitors (4 x 59)	236	
CAH	110	4 Capacitors (4 x 15)	60	
CAS	22	3 Capacitors (3 x 25)	75	
CAS	22	1 Shunt Reactor		30
CBR	110	1 Capacitor	30	
CBR	110	1 Static Var Compensator	60	10
CF	110	1 Capacitor	15	
CGL	20	3 Capacitors (3 x 1)	3	
CKM	38	1 Shunt Reactor		20
CKM	220	1 Shunt Reactor		100
COL (N)	110	1 Capacitor	36	
CPS	110	1 Capacitor	40	
CSH	110	2 Capacitors (2 x o)	80	
CUN	38	2 Capacitors (2 x 2)	4	
DLN	33	1 Capacitor	5	
DLT	110	1 Capacitor	15	
DMY	110	1 Capacitor	15	
D00	110	1 Capacitor	15	
DRU (I)	110	1 Capacitor	15	
DSN	400	1 Shunt Reactor		80
DYN	20	2 Capacitors (2 x 3.25)	6.5	
ENN (N)	33	4 Capacitors (4 x 6)	24	
FIN (I)	38	1 Shunt Reactor		20
GIL	20	1 Capacitor	12	
GWE	110	1 Capacitor	15	
HAN	22	2 Shunt Reactors (2 x 30)		60
INC	38	2 Shunt Reactors (2 x 20)		40
KEL	22	2 Shunt Reactors (2 x 30)		60
KNY	110	1 Capacitor	30	
KKY	110	2 Capacitor (2 x 15)	30	
KTL	10	1 Capacitor	30	
LET	110	2 Capacitor (1 Mobile)	45	
LET	110	1 Static Var Compensator	30	
LIS (I)	110	2 Capacitors (2 x 15)	30	
LOU	110	1 Capacitor	30	
LSN	20	1 Capacitor	4	

Table B-7 Characteristics of Existing Reactive Compensation

			Capabili	ty (Mvar)
Station	Voltage (kV)	Plant	Generate	Absorb
MOY	110	2 Capacitors (2 x 15)	30	
MUL	20	1 Capacitor	4	
MUL	110	2 Capacitors (2 x 15)	30	
NAV	110	1 Capacitor (1 Mobile)	30	
PB	220	1 Shunt Reactor		50
POR	400	EWIC HVDC	175	175
RAF	110	1 Capacitor	60	
RE	38	1 Shunt Reactor		20
SKL	110	1 Capacitor (1 Mobile)	30	
SLB	20	1 Capacitor	15	
SLI	110	1 Capacitor	15	
SLK	20	1 Capacitor	13	
TAN	22	2 Capacitors (2 x 25)	50	
TAN	22	2 Shunt Reactors (2 x 30)		60
THU	110	2 Capacitor (2 x 15)	30	
TRI	110	1 Capacitor	30	
TRL	110	1 Capacitor	30	
WEX	110	2 Capacitors (2 x 15)	30	
WOO	400	1 Shunt Reactor		80

B.2 Transmission System Developments

Future developments of the transmission system are listed in this section according to the year in which they are expected to be completed. The network changes related to each development project are grouped together and collectively headed by a Capital Project (CP) number and title. The physical and electrical characteristics of future transmission plant or changes to the characteristics brought about by planned developments are listed in the tables. These characteristics are indicative at this stage and will be reviewed when the item of plant is commissioned.

Table B-8 Expected Changes in Transmission Circuits¹¹⁸

	Voltage				Length		ince on 10 Base (pu)		Rating	(MVA)	
Action	(kV)	From	То	No.	(km)	R	Х	В	Summer	Winter	Year
Add	110	ADM	INC	1	10.5	0.0091	0.0273	0.0237	103	134	2018
Add	110	ADM	KUD	1		0.0008	0.0016	0.0106	140	140	2018
Add	220	BLC	FIN (I)	1	10.0	0.0004	0.0015	0.3320	570	570	2018
Add	110	BRA	NEW (I)	1	9.3	0.0097	0.0310	0.0032	136	159	2018
Add	110	BRA	PLS	1	19.3	0.0300	0.0665	0.0062	105	123	2018
Add	110	KNY	KLH	1	9.9	0.0022	0.0108	0.1095	190	190	2018
Add	110	MLC	TSB	1	19.2	0.0121	0.0625	0.0068	135	159	2018
Add	110	KNR	TRI	1	4.4	0.0046	0.0166	0.0015	120	128	2018
Add	110	KBY	KBY	1	0.2	0.0001	0.0004	0.0015	130	130	2018
Add	110	KLN	CUR	1	14.8	0.0109	0.0484	0.0052	136	159	2018
Add	110	CUR	NEN	1	18.8	0.0293	0.0648	0.0061	105	123	2018
Add	110	CUR	BKM	1	17.3	0.0039	0.0189	0.1921	190	190	2018
Add	110	MCE	SBH	1	4.7	0.0047	0.0151	0.0054	99	130	2018
Add	110	SBH	CDU	1	4.1	0.0027	0.0099	0.0163	99	130	2018
Add	110	BKM	CUR	1	7.3	0.0038	0.0069	0.0722	120	120	2018
Add	110	DRO (N)	CMK	1	8.8	0.0072	0.0449	0.0043	167	188	2018
Add	110	DRO (N)	ENN (N)	1	24.6	0.0257	0.0663	0.0067	82	103	2018
Add	110	DRO (N)	ENN (N)	2	24.6	0.0257	0.0663	0.0067	82	103	2018
Add	110	DRO (N)	OMA	1	9.2	0.0183	0.0471	0.0048	82	103	2018
Add	110	DRO (N)	OMA	2	9.2	0.0183	0.0471	0.0048	82	103	2018
Amend	110	ARV	SKL	1	18.5	0.0117	0.0602	0.0066	178	210	2018
Amend	220	BVK	CLA	1	16.8	0.0020	0.0145	0.0250	740	792	2018
Amend	220	BVK	BYH	1	28.6	0.0035	0.0246	0.0503	434	513	2018
Amend	110	BOL	ENN (I)	1	24.7	0.0156	0.0802	0.0087	178	210	2018
Amend	110	BOL	TBKT	1	18.3	0.0115	0.0594	0.0065	178	210	2018
Amend	110	CDL	BYH	1	9.5	0.0020	0.0109	0.1055	195	220	2018
Amend	110	BK	CBR	1	37-4	0.0533	0.1284	0.0143	195	217	2018
Amend	220	CLE	CDU	1	5.1	0.0006	0.0044	0.0067	434	513	2018
Amend	220	CLE	WOO	1	13.5	0.0016	0.0117	0.0177	393	468	2018
Amend	110	CDY	GRV	1	5.8	0.0037	0.0188	0.0033	132	150	2018
Amend	110	CDY	ARI T	1	13.7	0.0086	0.0445	0.0049	136	210	2018
Amend	110	cos	ARI T	1	20.7	0.0130	0.0673	0.0073	178	210	2018
Amend	220	DSN	KLS	1	59.3	0.0069	0.0514	0.0776	393	468	2018
Amend	110	ENN (I)	SLC	1	31.0	0.0032	0.0475	0.2710	195	220	2018

118 The winter ratings of a significant number of transmission circuits have changed slightly since TYTFS 2017. ESB Networks previously calculated winter ratings based on an assumed winter temperature of 5°C. In 2018 this was changed to 11°C and thus a number of circuits have had their winter ratings reduced. These changes are not included as amendments in this table.

Table B-8 Expected Changes in Transmission Circuits

	Voltage				Length		ince on 10 Base (pu)		Rating	(MVA)	
Action	(kV)	From	То	No.	(km)	R	Х	В	Summer	Winter	Year
Amend	110	KPG	RAT (I)	1	32.4	0.0332	0.1067	0.0183	136	159	2018
Amend	110	KPG	TRL	2	43.6	0.0271	0.1405	0.0231	178	210	2018
Amend	110	MP	TBKT	1	7.3	0.0046	0.0237	0.0026	178	210	2018
Amend	110	RAF	TBG	1	11.0	0.0164	0.0374	0.0048	178	209	2018
Amend	110	SNG	AA	1	5.5	0.0033	0.0171	0.0069	178	210	2018
Amend	110	CTN	KLN	1	29.2	0.0184	0.0950	0.0103	178	210	2018
Remove	110	ATY	PLS	1							2019
Remove	110	THU	THU	1							2019
Remove	275	TAN	TMN	1							2019
Remove	275	TAN	TMN	2							2019
Add	110	BIN	TIV	1	23.2	0.0242	0.0774	0.0079	136	159	2019
Add	110	BLC	CLS	1		0.0004	0.0021	0.0257	228	228	2019
Add	110	BLC	CLS	2		0.0004	0.0021	0.0257	228	228	2019
Add	110	AGY	TIV	1	35.0	0.0544	0.1204	0.0112	105	123	2019
Add	220	CDU	CRH	1		0.0000	0.0002	0.0415	570	570	2019
Add	220	CDU	CRH	2		0.0000	0.0002	0.0415	570	570	2019
Add	110	CKG	WDU	1	0.8	0.0002	0.0009	0.0083	187	223	2019
Add	220	INC	WDU	2	14.3	0.0020	0.0123	0.0195	761	794	2019
Add	220	KNR	KPG	2	20.0	0.0004	0.0096	0.9709	660	660	2019
Add	220	KLN	KPG	1	70.6	0.0085	0.0609	0.1136	434	513	2019
Add	220	KPG	MP	2	5.4	0.0001	0.0017	0.2362	660	660	2019
Add	220	WDU	MAY	1	11.7	0.0019	0.0115	0.0183	761	794	2019
Add	220	WDU	MAY	2	11.7	0.0016	0.0100	0.0159	761	794	2019
Add	220	WDU	INC	1	14.3	0.0015	0.0091	0.0144	761	794	2019
Add	110	LET	TIV	1	45.2	0.0471	0.1508	0.0154	136	159	2019
Add	110	MAC	CLA	2	9.0	0.0021	0.0099	0.0993	192	192	2019
Add	110	CNN	CLO	1	18.0	0.0114	0.0585	0.0064	178	210	2019
Add	110	CNN	CAG	1	7.0	0.0017	0.0085	0.0772	140	140	2019
Add	110	CTG	BVK	1	31.7	0.0060	0.0358	0.3856	228	228	2019
Add	110	BK	OWN	1	4.0	0.0010	0.0044	0.0440	187	223	2019
Add	110	ВК	CRN	1	3.3	0.0021	0.0108	0.0012	178	210	2019
Amend	110	BK	MOY	1	27.0	0.0170	0.0877	0.0096	178	210	2019
Amend	110	CDU	RYB	1	13.0	0.0135	0.0434	0.0045	178	219	2019
Amend	110	GI	WEX	1	34.5	0.0217	0.1121	0.0122	178	210	2019
Remove	110	ADM	KUD	1							2020

Table B-8 Expected Changes in Transmission Circuits

	Voltage				Length		ince on 10 Base (pu)		Rating	(MVA)	
Action	(kV)	From	То	No.	(km)	R	Х	В	Summer	Winter	Year
Remove	220	BLC	FIN (I)	1							2020
Remove	380	DSN	MP	1							2020
Remove	110	CKG	BKY	1							2020
Remove	110	GCA	KUD	2							2020
Remove	110	INC	BKY	1							2020
Remove	110	KRA	KRA	1							2020
Remove	110	BRO	RSK	1							2020
Remove	110	COL (N)	COL (N)	1							2020
Add	110	ATY	LSE	1	21.9	0.0138	0.0713	0.0078	178	210	2020
Add	110	BGT	KKY	1	22.0	0.0139	0.0715	0.0078	178	210	2020
Add	110	BGT	LSE	1	28.0	0.0176	0.0910	0.0099	178	210	2020
Add	110	DMY	CDN	1	10.9	0.0155	0.0397	0.0036	211	217	2020
Add	220	KNR	KNR	1		0.0001	0.0001	0.0001	761	794	2020
Add	110	KPG	СН	1	22.6	0.0236	0.0754	0.0077	136	159	2020
Add	110	LSE	PLS	1	8.4	0.0051	0.0261	0.0083	178	210	2020
Add	110	CNN	CAG	1	5.5	0.0013	0.0067	0.0607	140	140	2020
Add	380	WOO	TUR	1		0.0027	0.0311	0.7066	1424	1731	2020
Add	275	TAN	TUR	1		0.0009	0.0086	0.0514	710	881	2020
Add	275	TAN	TUR	2		0.0009	0.0086	0.0514	710	881	2020
Add	275	TMN	TUR	1		0.0002	0.0023	0.0135	710	881	2020
Add	275	TMN	TUR	2		0.0002	0.0023	0.0135	710	881	2020
Amend	220	BVK	BYH	1	14.5	0.0020	0.0126	0.0193	434	794	2020
Amend	110	CDY	SRA	1	12.7	0.0198	0.0437	0.0041	99	210	2020
Amend	220	KNR	BYH	1	47.0	0.0064	0.0402	0.0639	660	794	2020
Amend	110	DRO (N)	OMA	1		0.0183	0.0471	0.0048	82	195	2020
Amend	110	DRO (N)	OMA	2		0.0183	0.0471	0.0048	82	195	2020
Remove	220	CSH	PRO	1							2021
Remove	220	CSH	TYN	1							2021
Remove	220	DSN	MAY	2							2021
Remove	220	GOR	MAY	1							2021
Remove	220	LOU	WOO	1							2021
Add	110	ADM	GCA	1	2.5	0.0018	0.0038	0.0251	140	140	2021
Add	110	BLC	DTN	2	8.0	0.0041	0.0089	0.0486	140	143	2021
Add	110	BLC	GRA	1	4.3	0.0025	0.0053	0.0309	140	140	2021
Add	110	BLC	KLM	1	4.0	0.0023	0.0050	0.0291	140	140	2021
Add	220	BLC	SHL	1	23.4	0.0010	0.0034	0.7769	570	570	2021
Add	380	DSN	LSE	1	44.8	0.0009	0.0100	0.2260	1577	1867	2021

Table B-8 Expected Changes in Transmission Circuits

	Voltage				Length		ince on 10 Base (pu)	DO MVA	Rating	(MVA)	
Action	(kV)	From	То	No.	(km)	R	Х	В	Summer	Winter	Year
Add	110	CKG	WDU	2	0.8	0.0002	0.0009	0.0083	187	223	2021
Add	110	GCA	INC	3	7.7	0.0047	0.0044	0.0939	124	124	2021
Add	110	KUD	WDU	1	0.8	0.0002	0.0009	0.0083	187	223	2021
Add	110	WDU	BKY	1	1.0	0.0003	0.0011	0.0110	187	223	2021
Add	110	WDU	BKY	2	0.6	0.0003	0.0011	0.0110	187	223	2021
Add	380	LSE	MP	1	170.0	0.0033	0.0378	0.8580	1577	1867	2021
Add	110	BRO	AGI	1		0.0027	0.0164	0.0047	178	210	2021
Add	110	AGI	RSK	1		0.0098	0.0590	0.0167	178	219	2021
Amend	110	GI	KKY	1	49.2	0.0309	0.1599	0.0174	178	210	2021
Amend	110	BPS	EDE	1	15.1	0.0228	0.0536	0.0049	143	166	2021
Amend	110	BPS	EDE	1	15.1	0.0227	0.0529	0.0049	143	166	2021
Add	220	CSH	CNF	1		0.0010	0.0077	0.0116	392	482	>2021
Add	220	CSH	CNF	2		0.0005	0.0029	0.0046	761	804	>2021
Add ¹¹⁹	110	CBR	MOY	1	37.0	0.0233	0.1202	0.0131	178	210	>2021
Add	220	DSN	MAY	2	30.6	0.0036	0.0265	0.0400	434	513	>2021
Add120	380	DSN	WOO	1	58.0	0.0011	0.0129	0.2928	1577	1867	>2021
Add	220	GOR	WOO	1	27.0	0.0032	0.0356	0.1437	434	513	>2021
Add121	220	CLO	SRA	1	83.0	0.0097	0.0719	0.1085	434	513	>2021
Add	380	KPG	MP	1	6.0	0.0008	0.0002	0.5489	1210	1210	>2021
Add	220	LOU	ORL	1	14.5	0.0017	0.0126	0.0190	434	513	>2021
Add	220	PRO	CNF	1		0.0093	0.0690	0.1042	392	482	>2021
Add	220	TYN	CNF	1		0.0041	0.0260	0.0413	761	804	>2021
Add	220	WOO	ORL	1	49.2	0.0058	0.0427	0.0644	434	513	>2021
Add	220	ORL	ORL	1	20.1	0.0007	0.0079	0.5502	593	593	>2021
Add	220	ORL	ORL	1	15.9	0.0007	0.0023	0.5279	570	570	>2021
Add	110	AIR	ROS	1		0.0131	0.0341	0.0034	82	103	>2021
Add	110	AIR	ROS	1		0.0131	0.0341	0.0034	82	103	>2021
Add	110	KEL	KLC	1		0.0003	0.0013	0.0080	144	144	>2021
Add	110	KEL	RSK	2		0.0217	0.1344	0.0129	188	213	>2021
Add	110	KLC	KLC	1		0.0050	0.0312	0.0030	126	156	>2021
Amend	220	DSN	MAY	1	30.6	0.0036	0.0265	0.0399	434	513	>2021
Amend	380	DSN	LSE	1	44.8	0.0009	0.0030	0.2260	1577	1944	>2021
Amend	380	LSE	MP	1	170.0	0.0033	0.0113	0.8580	1577	1944	>2021

¹¹⁹ As noted in Chapter 2, North Connacht 110 kV Reinforcement includes a new 110 kV circuit. We are progressing this project through our 6-step process for developing the grid. We are investigating a number of possible solutions. At the data freeze date a best performing solution had not been identified. The amendments to the network described above do not represent a preferred option for development. For the most up to date information on the project please visit the project website here: www.eirgridgroup.com/the-grid/projects/north-connacht/the-project/
120 As noted in Chapter 2, Capital Project 966 will involve reinforcement of the network between Dunstown and Woodland. We are progressing this project through our 6-step process for developing the grid. The amendments to the network described above are included only to create a stable base case for network analysis and do not represent a preferred option for development. For the most up to date information on the project please visit the project website here: www.eirgridgroup.com/thegrid/ projects/capital-project-966/the-project/

121 As noted in Chapter 2, alternative solutions to the North West Project are being considered. Should the project progress, overhead and underground options will be investigated in line with our 6-step process for developing the grid. The amendments to the network described above do not represent a preferred option for development.

Table B-8 Expected Changes in Transmission Circuits

	Voltage			Length Impedance on 100 MVA Rating (MVA) Base (pu)						(MVA)	
Action	(kV)	From	То	No.	(km)	R X B			Summer	Winter	Year
Amend	110	MR	KBY	1	4.0	0.0026	0.0130	0.0015	178	210	>2021
Amend	380	OST	WOO	1		0.0024	0.0080	0.6309	1577	1944	>2021
Amend	275	CPS	MAG	1	45.6	0.0021	0.0236	0.1404	811	905	>2021
Amend	275	CPS	MAG	1	45.6	0.0021 0.0236 0.1404			811	905	>2021

Table B-9 Expected Changes in Transformers in Ireland

			Rating		Impedano MVA Ba			e Ratio g Range	
Action	Station	Transformer	(MVA)	HV/LV (kV)	R	Х	+	-	Year
Add	BLC	T2101	250	220/110	0.001	0.0646	0.09	0.17	2018
Add	DSN	T4202	500	400/220	0.0003	0.027	0.11	0.08	2018
Remove	KLN	T2101	63	220/110	0.0065	0.2453	0.09	0.18	2019
Remove	KLN	T2102	63	220/110	0.0095	0.2473	0.09	0.18	2019
Add	CKM	T2104	250	220/110	0.0004	0.0631	0.09	0.18	2019
Add	WDU	T2101	250	220/110	0.001	0.0646	0.09	0.17	2019
Add	WDU	T2102	250	220/110	0.001	0.0646	0.1	0.1	2019
Add	WDU	T2103	250	220/110	0.001	0.0646	0.1	0.1	2019
Add	WDU	T2104	250	220/110	0.001	0.0646	0.1	0.1	2019
Amend	INC	T2103	250	220/110	0.0001	0.06	0.1	0.1	2019
Remove	KRA	T2103	250	220/110	0.0013	0.0652	0.09	0.17	2020
Amend	KLN	T2103	250	220/110	0.0004	0.0631	0.09	0.18	2020
Add	BLC		250	220/110	0.001	0.0646	0.1	0.1	2021
Add	LSE	T4102	250	400/110	0.00048	0.072	0.15	0.15	2021
Add	LSE	T4101	250	400/110	0.00048	0.072	0.15	0.15	2021
Add	CLO	T2101	250	220/110	0.0004	0.0631	0.1	0.18	>2021
Add	CLO	T2102	250	220/110	0.0004	0.0631	0.1	0.18	>2021
Add	KPG		100	400/220	0.0003	0.027	0.11	0.08	>2021

Table B-10 Expected Changes in 3 Winding Transformers in Northern Ireland


	Substa-		Ī	mpedanc	e on 100 l	MVA Ba	se (pu)		Rating (MVA)			Off			
	tion/		W1	l-2 W2-3		3	W3-1					Nominal		No.	
Action	Trans- former	Voltage (kV)	R	Х	R	Х	R	Х	W1	W2	W3	Upr	Lwr	of Taps	Year
Add	TUR IBTx 1	275/400	0.0003	0.026	0.0001	0.18	0.0001	0.2	500	500	60	1.1	0.9	15	2020
Add	TUR IBTx 2	275/400	0.0003	0.026	0.0001	0.18	0.0001	0.2	500	500	60	1.1	0.9	15	2020
Add	TUR IBTx 3	275/400	0.0003	0.026	0.0001	0.18	0.0001	0.2	500	500	60	1.1	0.9	15	2020

Table B-11 Expected Changes in 2 Winding Transformers in Northern Ireland

		HV/LV	Rating	Impedance pu on rating base		Off nomi	nal ratio	No. of	
Action	Station	(kV)	(MVA)	R	Х	Upper	Lower	taps	Year
Add	CMK	110/33	90	0.0039	0.2461	1.1	0.8	19	2018
Add	SLK	110/33	52	0.0041	0.1019	1.1	0.9	33	2018
Add	AGI	110/33	90	0.0039	0.2461	1.1	0.8	19	2021
Amend	DON	110/33	90	0.0039	0.2461	1.1	0.8	19	2021
Add	AIR	110/33	60	0.0073	0.25	1.1	0.8	19	>2021
Add	AIR	110/33	60	0.0073	0.25	1.1	0.8	19	>2021
Add	KLC	110/33	90	0.0039	0.2461	1.1	0.8	19	>2021
Add	KLC	110/33	90	0.0039	0.2461	1.1	0.8	19	>2021

Table B-12 Expected Changes in Reactive Compensation


				Mvar Ca	pability	
Action	Station	Voltage	Plant	Generate	Absorb	Year
Remove	THU	110	2 Capacitor (2 x 15)	30		2019
Add	PB	220	2 Reactor (2 x 50)		100	2019
Remove	COL (N)	110	1 Capacitor	40		2020
Add	BVK	110	Statcom	100	100	2020
Add	KNR	220	1 Reactor		50	2020
Add	BNH	110	1 Statcom	100	100	2020
Add	THU	110	1 Statcom	30	30	2020
Add	COL (N)	110	1 Statcom	150	150	>2021
Add	OMA	110	1 Statcom	120	120	>2021
Add	TMN	110	1 Statcom	200	200	>2021

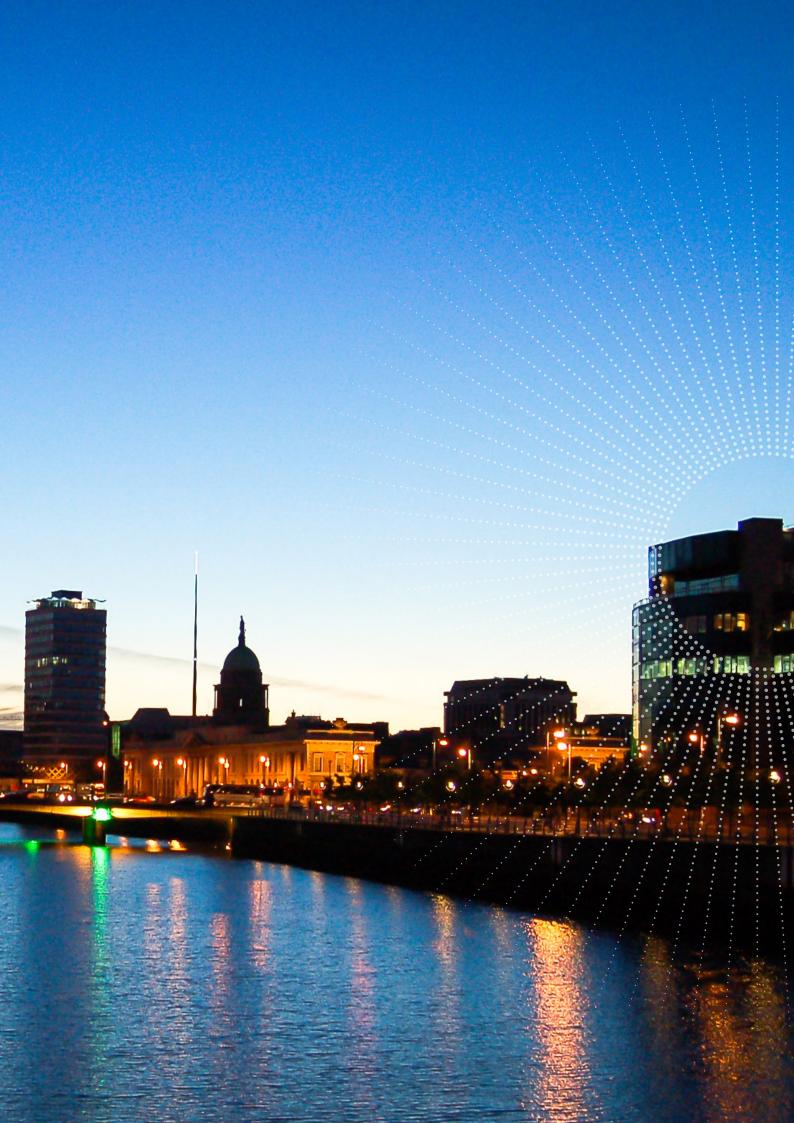

All-Island Ten Year

Transmission Forecast Statement 2018

Appendix C

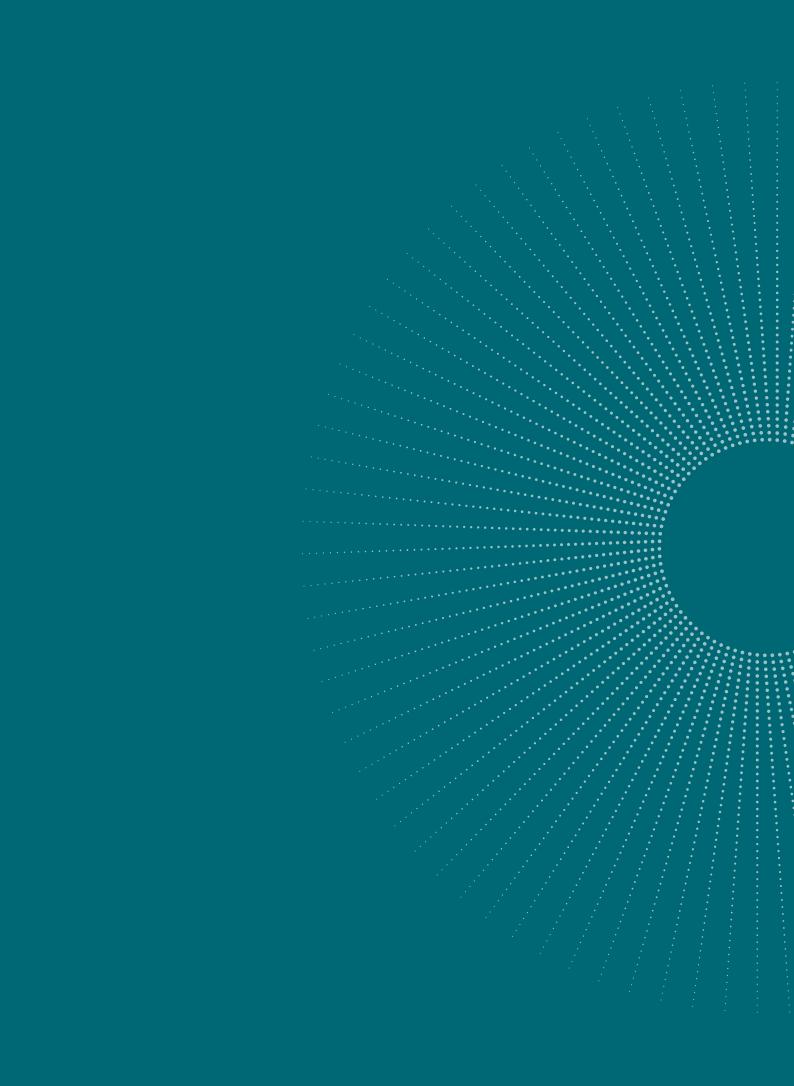

Appendix C Demand forecasts at individual transmission interface stations

Transmission Interface Stations and Bulk Supply Points are connection points to the transmission system. These connection points include transmission system connections to the distribution system or directly-connected customers. Table C-1 to Table C-4 list the demand forecasts at each Transmission Interface Station and Bulk Supply Point. The forecasts are noted for each node between 2018 and 2027 at the winter peak, summer peak, and summer valley. The autumn peak forecasts are also given for Northern Ireland.

The station demand values do not include transmission losses. Demand values at stations that interface with the distribution system do include distribution losses.

Transmission Interface Stations are generally 110 kV stations. The exceptions to this are four 220/110 kV interface stations that supply the Dublin City networks. These four interface stations, namely Carrickmines, Finglas, Inchicore and Poolbeg, are operated by the DSO. Two new 220/110 kV stations, Belcamp and Castlebagot with estimated energisation dates of 2019 and 2020 respectively, are currently being developed in the Dublin region.

Only stations feeding demand (generation stations are not included) are included in the tables below.

Table C-1 Demand Forecasts at Time of Winter Peak

Bus		Power	Power Demand Forecast (MW)									
Code	Bus Name	Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
AA	Ardnacrusha	0.993	68.87	67.95	70.11	71.54	76.54	79.66	80.91	81.85	82.78	83.41
AGH	Aghyoule	0.990	13.99	14.1	14.22	14.35	14.47	14.6	14.95	15.08	15.22	15.33
AGY	Ardnagappary	0.985	-	15.32	15.8	16.13	17.25	17.96	18.24	18.45	18.66	18.8
AHA	Ahane	0.991	4.94	4.88	5.03	5.13	5.49	5.72	5.81	5.87	5.94	5.98
AIR	Airport Road (Belfast)	0.990	-	-	-	-	28.12	28.76	31.04	32.38	33.93	37.79
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	42.17	42.3	42.5	42.71	42.83	43.02	43.87	44.04	44.22	44.33
ARI	Arigna	0.965	2.35	2.32	2.39	2.44	2.61	2.72	2.76	2.79	2.83	2.85
ARK	Arklow	0.997	26.96	26.59	27.44	28	29.96	31.18	31.67	32.04	32.39	32.64
ATH	Athlone	0.976	66.61	65.72	67.81	69.19	74.03	77.05	78.26	79.16	80.07	80.67
ATY	Athy	0.989	21.19	20.9	21.57	22.01	23.55	24.51	24.89	25.18	25.47	25.66
BAL	Baltrasna	0.983	13.03	12.85	13.26	13.53	14.48	15.07	15.31	15.48	15.66	15.78
BAN (I)	Bandon	0.977	52.92	52.25	53.84	54.9	58.6	60.9	61.82	62.52	63.2	63.66
BAN (N)	Banbridge	0.990	39.53	39.66	39.84	40.03	40.15	40.31	41.11	41.26	50.93	41.52
BAR	Barrymore	0.994	32.29	31.86	32.87	33.54	35.89	37-35	37-94	38.38	38.82	39.11
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.971	17.35	17.19	17.55	17.79	18.61	19.13	19.33	19.49	19.64	19.74
BEG	Ballybeg	0.997	14.09	13.91	14.35	14.64	15.66	16.3	16.56	16.75	16.94	17.07
BGD	Belgard Road	0.950	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.977	-	-	25.95	26.48	28.33	29.49	29.95	30.29	30.64	30.87
BIN	Binbane	0.974	24.03	13.41	13.84	14.12	15.11	15.72	15.97	16.15	16.34	16.46
BK	Bellacorick	0.979	5.76	5.68	5.86	5.98	6.4	6.66	6.76	6.84	6.92	6.97
BKY	Barnakyle	0.951	9.93	9.79	10.1	48.31	49.03	49.48	49.66	49.8	49.93	50.02
BLI	Ballylickey	0.977	14.42	14.22	14.68	14.98	16.02	16.68	16.94	17.13	17.33	17.46
BLC	Belcamp	0.950	-	45.6	60.8	107.92	107.92	107.92	107.92	107.92	107.92	107.92
BLK	Blake	0.993	12.14	11.98	12.36	12.61	13.49	14.04	14.26	14.43	14.59	14.7
ВМА	Ballymena	0.978	84.3	84.56	84.97	85.35	85.62	85.98	87.68	88.01	88.36	88.58
BNH	Ballynahinch	0.990	57.46	57.63	57.89	58.14	58.3	58.52	59.66	59.87	60.09	60.22
BNM	Belfast North	0.990	50.53	50.66	50.91	51.14	51.29	51.5	52.52	52.72	52.92	53.05
BOG	Banoge	0.983	21.84	21.54	22.23	22.68	24.27	25.26	25.65	25.95	26.25	26.44
BRA	Bracklone	0.978	13.58	13.4	13.83	14.11	15.09	15.71	15.96	16.14	16.33	16.45
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.988	29.42	29.02	29.95	30.56	32.7	34.03	34.56	34.97	35.37	35.63
BUT	Butlerstown	0.995	39.48	38.95	40.19	41.01	43.88	45.67	46.38	46.92	47.46	47.81
BVG	Ballyvallagh	0.990	15.26	15.31	15.38	15.45	15.49	15.55	15.85	15.91	15.97	16
CAH	Cahir	0.982	26.6	26.24	27.08	27.63	29.56	30.77	31.25	31.61	31.97	32.21
CAR	Carnmoney	0.990	26.53	26.21	25.93	25.66	25.34	25.05	25.16	24.87	24.58	24.27
CBG	Carrowbeg	0.985	18.41	18.16	18.74	19.12	20.46	21.29	21.63	21.88	22.13	22.29
CBR	Castlebar	0.992	34.25	33.79	34.86	35.57	38.06	39.61	40.23	40.7	41.16	41.47
CEN	Belfast Central	0.990	53.32	53.57	53.91	54.25	54.5	54.83	56	56.3	56.63	56.86
CF	Cathaleen's Fall	0.995	18.4	18.15	18.73	19.11	20.45	21.28	21.61	21.86	22.11	22.28
CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8

Table C-1 Demand Forecasts at Time of Winter Peak

Bus		Dower				De	mand Fo	recast (N	IW)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
СНА	Charleville	0.980	16.02	15.8	16.3	16.64	17.8	18.53	18.82	19.03	19.25	19.4
CKG	Corkagh	0.950	66.88	66.88	90.44	90.44	90.44	90.44	90.44	90.44	90.44	90.44
CKM	Carrickmines	0.988	368.29	364.27	373.7	379.95	401.79	415.41	420.86	424.95	429.03	431.75
CLE	Clonee	0.950	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
CLN	Cloon	0.977	31.42	31	31.98	32.63	34.91	36.34	36.91	37.33	37.76	38.05
CLW	Carlow	0.989	62.68	61.85	63.81	65.11	69.67	72.51	73.64	74.5	75.35	75.91
COL (I)	College Park	0.988	26.01	25.67	26.48	27.02	28.91	30.09	30.56	30.92	31.27	31.5
COL (N)	Coleraine	0.990	43.12	43.24	43.43	43.63	43.75	43.92	44.78	44.93	45.09	45.19
COS	Carrick-on- Shannon	0.993	28.39	28.01	28.9	29.49	31.55	32.83	33.35	33.73	34.12	34.38
COW	Cow Cross	0.997	12.91	12.74	13.15	13.41	14.35	14.94	15.17	15.35	15.52	15.64
CPS	Cool	0.985	58.68	58.85	59.13	59.41	59.58	59.84	61.02	61.25	61.5	61.64
CRA	Crane	0.988	34.33	33.87	34.95	35.66	38.15	39.71	40.33	40.8	41.27	41.58
CRE	Cregagh	0.990	86.75	87.05	87.51	87.95	72.84	73.26	74.84	75.24	75.67	75.99
CRG	Creagh	0.990	25.09	25.17	25.29	25.4	25.47	25.57	26.07	26.17	26.27	26.33
CRH	Cruiserath	0.942	-	155	155	155	155	155	155	155	155	155
CRO	Coolroe	0.986	12.12	11.96	12.34	12.59	13.47	14.02	14.24	14.4	14.57	14.68
CVW	Castleview	0.986	25.51	25.17	25.97	26.5	28.35	29.51	29.97	30.32	30.67	30.9
DAL	Dallow	0.996	17.61	17.38	17.93	18.3	19.58	20.37	20.69	20.93	21.17	21.33
DDK	Dundalk	0.980	72.56	71.59	73.86	75.37	80.64	83.93	85.24	86.23	87.21	87.87
DFR	Dunfirth	0.996	9.96	9.82	10.14	10.34	11.07	11.52	11.7	11.83	11.97	12.06
DGN	Dungarvan	0.987	45.27	44.66	46.08	47.02	50.31	52.36	53.18	53.8	54.41	54.82
DLT	Dalton	0.986	25.74	25.4	26.21	26.74	28.61	29.78	30.24	30.59	30.94	31.18
DMY	Dunmanway	0.978	25.09	24.76	25.55	26.07	27.89	29.03	29.48	29.82	30.16	30.39
DON	Donegall	0.990	147.58	146.31	145.35	144.39	143.23	142.28	143.57	142.61	141.71	140.63
D00	Doon	0.979	30.8	30.39	31.35	31.99	34.23	35.63	36.18	36.6	37.02	37.3
DRU (I)	Drumline	0.979	30.08	29.68	30.62	31.24	33.43	34.79	35.34	35.75	36.15	36.43
DRU (N)	Drumnakelly	0.980	92.36	92.64	93.1	93.55	93.85	94.27	96.15	96.53	97.07	97-47
DRY	Drybridge	0.989	87.66	86.49	89.24	91.06	97.43	101.4	102.99	104.18	105.37	106.17
DUN	Dungannon	0.990	97.81	98.09	98.56	99.01	99.31	99.73	101.69	102.07	102.48	102.73
EDE	Eden	0.980	34.89	34.99	35.16	35.32	35.42	35.56	36.26	36.39	36.54	36.62
ENN (I)	Ennis	0.981	58.85	58.06	59.91	61.13	65.41	68.07	69.14	69.94	70.74	71.27
ENN (N)	Enniskillen	0.990	59.05	59.23	59.52	59.82	60	60.26	61.46	61.7	61.96	62.13
FIN (I)	Finglas	0.986	461.61	456.03	469.14	477.79	508.09	527.01	534-57	540.24	545.93	549.7
FIN (N)	Finaghy	0.990	31.24	31.33	31.47	31.61	31.7	31.83	32.45	32.57	32.69	32.77
FTT	Fortunestown	0.970	10.45	10.31	10.64	10.85	11.61	12.08	12.27	12.42	12.56	12.65
GAL	Galway	0.990	69.01	68.09	70.25	71.69	76.71	79.83	81.09	82.02	82.96	83.58
GI	Great Island	0.950	12.64	12.47	13.88	14.16	15.15	15.77	16.02	16.2	16.39	16.51
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.989	16.96	16.73	17.26	17.61	18.84	19.61	19.92	20.15	20.38	20.53
GLE (N)	Glengormley	0.977	31.99	31.96	31.99	32.01	31.98	32	32.51	32.51	32.52	32.49
GOR (N)	Gort	0.990	1.21	1.21	1.23	1.24	1.25	1.26	1.29	1.3	1.31	1.32

Table C-1 Demand Forecasts at Time of Winter Peak

Bus		Dower				De	mand Fo	recast (M	W)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
GRI	Griffinrath	0.994	55.99	55.24	57	58.16	62.22	64.76	65.78	66.54	67.3	67.8
GWE	Gortawee	0.953	31.84	21.1	32.03	32.26	33.04	33.52	33.72	33.86	34.01	34.11
IKE	Ikerrin	0.966	30.28	29.87	30.82	31.45	33.65	35.02	35.57	35.98	36.39	36.67
INC	Inchicore	0.989	290.43	298.15	294.27	298.74	314.31	324.05	327.94	330.83	324.24	335.69
KBY	Kilbarry	0.992	92.23	91	93.89	95.8	102.5	106.68	108.36	109.61	110.86	111.7
KER	Knockearagh	0.990	40.34	39.8	41.06	41.9	44.83	46.66	47.39	47.94	48.49	48.85
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	0.966	64.77	63.91	54.56	55.67	59.57	61.99	62.97	63.69	64.42	64.91
KNO	Knock	0.990	51.67	51.83	52.07	52.31	45.85	46.07	47.02	47.23	47.45	47.6
KTL	Kilteel	0.972	49.33	48.67	50.22	51.24	54.83	57.06	57.96	58.63	59.3	59.74
KTN	Killoteran	0.973	10.97	10.82	11.17	11.39	12.19	12.69	12.89	13.04	13.19	13.29
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.986	16.22	16.01	16.52	16.85	18.03	18.77	19.06	19.28	19.5	19.65
LAR	Larne	0.990	28.9	28.98	29.11	29.24	29.32	29.44	30.01	30.11	30.22	30.29
LET	Letterkenny	0.984	79.99	73.9	76.25	77.8	83.24	86.64	87.99	89.01	90.03	90.71
LIB	Liberty	0.989	20.71	20.43	21.08	21.51	23.01	23.95	24.33	24.61	24.89	25.08
LIM (I)	Limerick	0.987	77.61	76.58	79.01	80.62	86.26	89.78	91.18	92.24	93.29	93.99
LIM (N)	Limavady	0.990	24.96	25.04	25.15	25.27	25.33	25.43	25.92	26	26.11	26.16
LIS (I)	Lisdrum	0.969	25.39	25.05	25.84	26.37	28.22	29.37	29.83	30.17	30.52	30.75
LIS (N)	Lisburn	0.990	74.62	74.86	75.21	75.57	75.79	76.11	77.62	77.91	78.22	78.41
LMR	Lisaghmore	0.980	33.11	33.21	33.37	33.53	33.63	33.78	34.45	34.58	34.72	34.8
LOG	Loguestown	0.980	39.35	39.47	39.64	39.82	39.93	40.09	40.88	41.02	41.18	41.27
MAC	Macroom	0.949	11.99	11.83	12.21	12.46	13.33	13.87	14.09	14.25	14.42	14.52
MAL	Mallow	0.980	22.2	21.9	22.6	23.06	24.67	25.68	26.08	26.38	26.69	26.89
MCE	Macetown	0.978	32.84	32.46	33.35	33.94	35.99	37.27	37.78	38.16	38.55	38.8
MID	Midleton	0.985	41.13	40.58	41.88	42.73	45.71	47.58	48.32	48.88	49.44	49.81
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.989	13.24	13.06	13.48	13.75	14.71	15.31	15.55	15.73	15.91	16.03
MOY	Moy	0.990	27.47	27.1	27.96	28.53	30.53	31.77	32.27	32.64	33.01	33.26
MR	Marina	0.997	15.19	14.99	15.46	15.78	16.88	17.57	17.85	18.05	18.26	18.4
MTH	Meathhill	0.965	54.16	53.44	55.13	56.26	60.19	62.65	63.63	64.36	65.1	65.59
MUL	Mullingar	0.983	45.8	45.19	46.63	47.57	50.91	52.98	53.81	54.43	55.06	55.47
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	45.77	45.9	46.11	46.31	46.44	46.62	47.53	47.69	47.87	47.97
NAV	Navan	0.980	61.82	60.99	62.93	64.21	68.7	71.51	72.63	73.46	74.31	74.86
NEN	Nenagh	0.967	21.63	21.34	22.02	22.46	24.04	25.02	25.41	25.7	25.99	26.19
NEW (I)	Newbridge	0.992	27.76	27.39	28.26	28.83	30.85	32.11	32.61	32.99	33.37	33.62
NEW (N)	Newry	0.990	80.61	80.87	81.26	81.65	81.9	82.25	83.89	84.2	84.55	84.76
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	61.18	61.36	61.63	61.92	62.08	62.31	63.53	63.75	63.99	64.12
OUG	Oughtragh	0.994	25.88	25.53	26.34	26.88	28.76	29.93	30.4	30.75	31.11	31.34
PB	Poolbeg	0.989	201.75	199.04	205.38	209.55	224.22	233.35	237.01	239.76	242.5	244.31
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65

Table C-1 Demand Forecasts at Time of Winter Peak

Bus		Power				De	mand Fo	recast (M	W)			
Code	Bus Name	Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
PLS	Portlaoise	0.990	54.46	53.72	40.86	41.69	44.61	46.43	47.16	47.71	48.25	48.61
RAT (I)	Rathkeale	0.989	28.01	27.64	28.51	29.09	31.13	32.4	32.91	33.29	33.67	33.92
RAT (N)	Rathgael	0.990	58.34	58.51	58.78	59.05	59.21	59.45	60.62	60.83	61.07	61.21
RIC	Richmond	0.977	35.53	35.06	36.17	36.91	39.49	41.1	41.74	42.23	42.71	43.03
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13
ROS	Rosebank	0.990	30.68	30.76	30.9	31.03	27.97	28.09	28.66	28.76	28.88	28.96
RSY	Ringaskiddy	0.996	3.97	3.92	4.04	4.12	4.41	4.59	4.66	4.72	4.77	4.81
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52
SAL	Salthill	0.995	53.27	52.55	54.23	55.33	59.21	61.62	62.58	63.31	64.03	64.51
SBH	Snugborough	0.950	16.72	16.72	47.12	47.12	47.12	47.12	47.12	47.12	47.12	47.12
SCR	Screeb	0.972	28.05	27.68	28.56	29.14	31.18	32.45	32.96	33.34	33.72	33.97
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29
SKL	Shankill	0.966	57.63	56.86	58.67	59.86	64.05	66.66	67.7	68.49	69.27	69.79
SLI	Sligo	0.987	55.25	54.51	56.24	57.39	61.4	63.9	64.91	65.66	66.41	66.91
SNG	Singland	0.976	11.17	11.02	11.37	11.6	12.41	12.92	13.12	13.27	13.42	13.53
SOM	Somerset	0.990	21.51	21.22	21.9	22.34	23.91	24.88	25.27	25.56	25.86	26.05
SPR	Springtown	0.980	47.98	48.12	48.33	48.55	48.67	48.85	49.8	49.96	50.15	50.25
STR	Stratford	0.991	21.16	20.87	21.54	21.98	23.51	24.47	24.86	25.14	25.43	25.62
STR (N)	Strabane	0.990	42.7	42.82	43.01	43.2	43.32	43.48	44.32	44.47	44.63	44.73
TAN	Tandragee	0.990	66.79	66.98	67.28	67.58	67.76	68.02	69.34	69.57	69.83	69.98
TBG	Trabeg	0.993	73.05	72.08	74.36	75.88	81.19	84.49	85.82	86.81	87.81	88.46
TBK	Tullabrack	0.980	11.18	11.03	11.38	11.61	12.42	12.93	13.13	13.28	13.44	13.54
THU	Thurles	0.976	28.53	28.15	29.05	29.64	31.71	33	33.52	33.91	34.3	34.55
TIP	Tipperary	0.979	21.04	20.76	21.42	21.86	23.38	24.34	24.72	25.01	25.29	25.48
TLK	Trillick	0.989	20.56	20.29	20.93	21.36	22.85	23.78	24.16	24.43	24.71	24.9
TON	Tonroe	0.993	15.62	15.41	15.9	16.22	17.36	18.07	18.35	18.56	18.77	18.92
TRI	Trien	0.957	24.52	24.19	24.96	25.47	27.25	28.36	28.81	29.14	29.47	29.7
TRL	Tralee	0.995	56.42	55.66	57.43	58.6	62.7	65.26	66.28	67.05	67.81	68.32
TSB	Thornsberry	0.982	32.51	32.08	33.1	33.77	36.13	37.61	38.2	38.64	39.08	39.37
WAT	Waterford	0.978	56.6	55.85	56.61	57.77	61.81	64.33	65.33	66.09	66.85	67.35
WEX	Wexford	0.968	57.81	57.04	58.85	60.05	64.25	66.86	67.91	68.7	69.48	70
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9

Table C-2 Demand Forecasts at Time of Summer Peak

Bus		Dower				De	mand Fo	recast (M	IW)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
AA	Ardnacrusha	0.993	53.51	51.39	53.4	53.78	57.81	60.32	61.33	62.07	62.83	63.34
AGH	Aghyoule	0.990	11	11.08	11.18	11.28	11.37	11.48	11.75	11.85	11.96	12.05
AGY	Ardnagappary	0.985	-	11.59	12.04	12.13	13.03	13.6	13.83	14	14.16	14.28
AHA	Ahane	0.991	3.84	3.68	3.83	3.86	4.14	4.32	4.4	4.45	4.5	4.54
AIR	Airport Road (Belfast)	0.990	-	-	-	-	-	22.61	24.39	25.45	26.67	29.7
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	33.15	33.25	33.41	33.57	33.67	33.81	34.48	34.61	34.76	34.84
ARI	Arigna	0.966	1.83	1.75	1.82	1.84	1.97	2.06	2.09	2.12	2.14	2.16
ARK	Arklow	0.997	28.09	20.12	20.91	21.05	22.63	23.61	24.01	24.3	24.59	24.79
ATH	Athlone	0.976	51.76	49.7	51.65	52.02	55.91	58.34	59.31	60.04	60.77	61.25
ATY	Athy	0.989	16.46	15.81	16.43	16.54	17.78	18.55	18.86	19.1	19.33	19.48
BAL	Baltrasna	0.983	10.12	9.72	10.1	10.17	10.93	11.4	11.59	11.74	11.88	11.97
BAN (I)	Bandon	0.977	41.55	39.99	41.47	41.76	44.73	46.59	47.33	47.89	48.44	48.81
BAN (N)	Banbridge	0.990	31.07	31.17	31.32	31.46	31.56	31.69	32.31	32.43	32.56	32.64
BAR	Barrymore	0.994	25.09	24.09	25.03	25.21	27.1	28.28	28.75	29.1	29.45	29.69
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.971	14.81	14.46	14.79	14.85	15.52	15.93	16.1	16.22	16.34	16.43
BEG	Ballybeg	0.997	10.95	10.52	10.93	11.01	11.83	12.34	12.55	12.7	12.86	12.96
BGD	Belgard Road	0.950	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.977	-	-	-	19.91	21.4	22.33	22.7	22.98	23.26	23.44
BIN	Binbane	0.974	18.67	10.14	10.54	10.62	11.41	11.91	12.1	12.25	12.4	12.5
ВК	Bellacorick	0.979	4.47	4.29	4.46	4.49	4.82	5.03	5.12	5.18	5.24	5.28
ВКҮ	Barnakyle	0.951	7.71	7.41	7.7	45.75	46.33	46.69	46.84	46.95	47.06	47.13
BLC	Belcamp	0.950	-	45.6	60.8	107.92	107.92	107.92	107.92	107.92	107.92	107.92
BLI	Ballylickey	0.978	11.2	10.76	11.18	11.26	12.1	12.63	12.84	13	13.15	13.26
BLK	Blake	0.993	9.43	9.05	9.41	9.48	10.18	10.63	10.8	10.94	11.07	11.16
ВМА	Ballymena	0.978	66.26	66.47	66.78	67.09	67.29	67.59	68.91	69.18	69.46	69.63
BNH	Ballynahinch	0.990	45.17	45.3	45.5	45.7	45.82	46	46.9	47.05	47.23	47.33
BNM	Belfast North	0.990	39.72	39.82	40.02	40.2	40.31	40.49	41.28	41.44	41.6	41.69
BOG	Banoge	0.983	4.22	16.3	16.93	17.05	18.33	19.13	19.45	19.68	19.92	20.08
BRA	Bracklone	0.978	-	10.14	10.53	10.61	11.4	11.9	12.09	12.24	12.39	12.49
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.988	22.85	21.95	22.81	22.97	24.69	25.76	26.19	26.51	26.84	27.05
BUT	Butlerstown	0.995	30.69	29.47	30.63	30.84	33.15	34.59	35.17	35.6	36.03	36.32
BVG	Ballyvallagh	0.990	12	12.03	12.09	12.14	12.17	12.22	12.46	12.5	12.55	12.58
CAH	Cahir	0.982	20.66	19.84	20.62	20.77	22.32	23.29	23.68	23.97	24.26	24.45
CAR	Carnmoney	0.990	20.85	20.6	20.38	20.17	19.92	19.69	19.78	19.54	19.32	19.07
CBG	Carrowbeg	0.985	14.3	13.73	14.27	14.37	15.45	16.12	16.39	16.59	16.79	16.92
CBR	Castlebar	0.992	26.61	25.55	26.55	26.74	28.74	29.99	30.49	30.87	31.24	31.49
CEN	Belfast Central	0.990	41.91	42.11	42.37	42.64	42.84	43.1	44.02	44.26	44.51	44.69
CF	Cathaleen's Fall	0.995	14.29	13.72	14.26	14.36	15.44	16.11	16.37	16.58	16.78	16.91
CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8

Table C-2 Demand Forecasts at Time of Summer Peak

Bus		Power				De	mand Fo	recast (M	IW)			
Code	Bus Name	Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
СНА	Charleville	0.980	12.44	11.95	12.42	12.5	13.44	14.02	14.26	14.43	14.61	14.72
CKG	Corkagh	0.950	33.25	66.88	90.44	90.44	90.44	90.44	90.44	90.44	90.44	90.44
CKM	Carrickmines	0.986	301.28	292.02	300.79	302.45	320.03	331	335.38	338.67	341.95	344.14
CLE	Clonee	0.950	43.6	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
CLN	Cloon	0.977	24.41	23.44	24.36	24.53	26.37	27.51	27.97	28.31	28.66	28.89
CLW	Carlow	0.989	48.71	46.78	48.61	48.96	52.62	54.91	55.82	56.51	57.19	57.65
COL (I)	College Park	0.988	20.22	19.41	20.17	20.32	21.84	22.79	23.17	23.45	23.74	23.93
COL (N)	Coleraine	0.990	33.89	33.98	34.15	34.29	34.38	34.52	35.2	35.31	35.44	35.53
cos	Carrick-on- Shannon	0.993	22.05	21.18	22.01	22.16	23.82	24.86	25.27	25.58	25.89	26.1
COW	Cow Cross	0.997	10.03	9.63	10.01	10.08	10.83	11.3	11.49	11.63	11.77	11.87
CPS	Cool	0.985	46.12	46.26	46.48	46.7	46.84	47.04	47.97	48.14	48.34	48.45
CRA	Crane	0.988	32.27	25.61	26.61	26.8	28.81	30.06	30.56	30.94	31.31	31.56
CRE	Cregagh	0.990	68.19	68.43	68.78	69.13	57.24	57.58	58.82	59.15	59.48	59.73
CRG	Creagh	0.990	19.72	19.78	19.87	19.97	20.02	20.1	20.49	20.57	20.65	20.69
CRH	Cruiserath	0.942	-	155	155	155	155	155	155	155	155	155
CRO	Coolroe	0.986	9.41	9.03	9.39	9.46	10.16	10.6	10.78	10.91	11.05	11.13
CVW	Castleview	0.986	19.82	19.03	19.78	19.92	21.41	22.34	22.71	22.99	23.27	23.46
DAL	Dallow	0.996	13.68	13.14	13.65	13.75	14.78	15.42	15.68	15.87	16.06	16.19
DDK	Dundalk	0.980	56.38	54.15	56.27	56.67	60.91	63.56	64.62	65.41	66.2	66.73
DFR	Dunfirth	0.996	7.74	7.44	7.73	7.78	8.36	8.73	8.87	8.98	9.09	9.16
DGN	Dungarvan	0.987	35.17	33.78	35.1	35.35	38	39.65	40.31	40.8	41.3	41.63
DLT	Dalton	0.986	20	19.21	19.96	20.1	21.61	22.55	22.92	23.2	23.49	23.67
DMY	Dunmanway	0.978	19.49	18.72	19.45	19.59	21.06	21.97	22.34	22.62	22.89	23.07
DON	Donegall	0.990	116.01	115	114.25	113.49	112.58	111.84	112.84	112.1	111.39	110.53
D00	Doon	0.979	23.93	22.98	23.88	24.05	25.85	26.97	27.42	27.76	28.1	28.32
DRU (I)	Drumline	0.979	23.37	22.44	23.32	23.49	25.25	26.34	26.78	27.11	27.44	27.66
DRU (N)	Drumnakelly	0.980	72.59	72.82	73.17	73.53	73.76	74.1	75.57	75.87	76.3	76.61
DRY	Drybridge	0.989	68.11	65.41	67.98	68.46	73.58	76.78	78.06	79.02	79.98	80.62
DUN	Dungannon	0.990	76.88	77.1	77.46	77.82	78.05	78.39	79.93	80.23	80.55	80.75
EDE	Eden	0.980	27.42	27.5	27.63	27.76	27.84	27.95	28.5	28.61	28.72	28.79
ENN (I)	Ennis	0.981	45.73	43.91	45.63	45.96	49.4	51.55	52.4	53.05	53.69	54.12
ENN (N)	Enniskillen	0.990	46.41	46.55	46.79	47	47.16	47.36	48.31	48.5	48.7	48.83
FIN (I)	Finglas	0.985	398.96	355.71	367.91	370.21	394.61	409.82	415.93	420.49	425.04	428.07
FIN (N)	Finaghy	0.990	24.55	24.62	24.74	24.85	24.92	25.02	25.51	25.6	25.7	25.76
FTT	Fortunestown	0.970	8.12	7.8	8.1	8.16	8.77	9.15	9.3	9.42	9.53	9.61
GAL	Galway	0.990	53.62	51.49	53.51	53.9	57.92	60.45	61.44	62.21	62.97	63.46
GI	Great Island	0.950	9.82	9.43	9.8	10.65	11.45	11.94	12.14	12.29	12.44	12.54
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.989	13.17	12.65	13.15	13.24	14.23	14.85	15.1	15.28	15.47	15.59
GLE (N)	Glengormley	0.977	25.15	25.12	25.14	25.16	25.14	25.15	25.55	25.56	25.57	25.54
GOR (N)	Gort	0.990	0.95	0.95	0.96	0.97	0.98	0.99	1.01	1.02	1.03	1.04

Table C-2 Demand Forecasts at Time of Summer Peak

Bus		Dower				De	mand Fo	recast (M	IW)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
GRI	Griffinrath	0.994	43.5	41.77	43.41	43.72	46.99	49.03	49.85	50.46	51.07	51.48
GWE	Gortawee	0.950	29.44	29.11	29.42	29.48	30.11	30.5	30.66	30.78	30.89	30.97
IKE	Ikerrin	0.966	23.52	22.59	23.48	23.64	25.41	26.52	26.96	27.29	27.62	27.84
INC	Inchicore	0.987	229.05	235.98	242.25	243.44	255.98	263.8	266.92	269.28	271.61	273.19
KBY	Kilbarry	0.992	71.67	68.82	71.52	72.03	77.42	80.78	82.13	83.14	84.15	84.82
KER	Knockearagh	0.990	31.35	30.1	31.28	31.51	33.86	35.34	35.92	36.37	36.81	37.1
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	0.966	50.33	48.34	50.23	41.86	44.99	46.95	47.73	48.32	48.9	49.29
KNO	Knock	0.990	40.61	40.73	40.93	41.12	36.04	36.21	36.96	37.12	37.3	37.41
KTL	Kilteel	0.972	38.33	36.81	38.25	38.52	41.41	43.21	43.93	44.47	45	45.36
KTN	Killoteran	0.973	8.52	8.19	8.51	8.57	9.21	9.61	9.77	9.89	10.01	10.09
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.986	12.6	12.1	12.58	12.67	13.62	14.21	14.44	14.62	14.8	14.92
LAR	Larne	0.990	22.71	22.78	22.88	22.98	23.05	23.14	23.59	23.67	23.76	23.81
LET	Letterkenny	0.984	62.16	55.9	58.08	58.5	62.88	65.61	66.7	67.52	68.34	68.89
LIB	Liberty	0.990	16.1	15.46	16.06	16.18	17.39	18.14	18.44	18.67	18.9	19.05
LIM (I)	Limerick	0.987	60.31	57.92	60.19	60.62	65.15	67.98	69.12	69.97	70.81	71.38
LIM (N)	Limavady	0.990	19.62	19.69	19.77	19.86	19.91	19.98	20.38	20.45	20.52	20.56
LIS (I)	Lisdrum	0.969	19.73	18.95	19.69	19.83	21.31	22.24	22.61	22.89	23.16	23.35
LIS (N)	Lisburn	0.990	58.65	58.84	59.12	59.4	59.57	59.83	61.01	61.23	61.48	61.63
LMR	Lisaghmore	0.980	26.02	26.11	26.23	26.36	26.44	26.55	27.08	27.18	27.29	27.35
LOG	Loguestown	0.980	30.93	31.02	31.16	31.3	31.39	31.51	32.13	32.24	32.37	32.44
MAC	Macroom	0.949	9.32	8.95	9.3	9.36	10.06	10.5	10.68	10.81	10.94	11.03
MAL	Mallow	0.980	17.25	16.57	17.22	17.34	18.64	19.45	19.77	20.01	20.26	20.42
MCE	Macetown	0.979	26.54	25.67	26.5	26.65	28.3	29.33	29.75	30.06	30.36	30.57
MID	Midleton	0.985	31.96	30.69	31.89	32.12	34.52	36.02	36.62	37.07	37.52	37.83
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.989	10.28	9.87	10.26	10.33	11.11	11.59	11.78	11.93	12.07	12.17
MOY	Moy	0.990	21.34	20.5	21.3	21.45	23.05	24.06	24.46	24.76	25.06	25.26
MR	Marina	0.997	11.8	11.33	11.78	11.86	12.75	13.3	13.53	13.69	13.86	13.97
MTH	Meathhill	0.965	42.08	40.42	42	42.3	45.46	47.44	48.23	48.82	49.41	49.81
MUL	Mullingar	0.983	35.59	34.18	35.52	35.77	38.45	40.12	40.79	41.29	41.78	42.12
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	35.97	36.08	36.24	36.4	36.5	36.64	37.36	37.48	37.62	37.71
NAV	Navan	0.980	48.03	46.13	47-93	48.28	51.89	54.14	55.04	55.72	56.4	56.85
NEN	Nenagh	0.967	16.8	16.13	16.76	16.88	18.14	18.93	19.25	19.48	19.72	19.88
NEW (I)	Newbridge	0.992	21.56	20.71	21.52	21.67	23.3	24.31	24.71	25.02	25.32	25.52
NEW (N)	Newry	0.990	63.36	63.57	63.87	64.18	64.38	64.65	65.93	66.18	66.46	66.62
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	48.08	48.22	48.45	48.67	48.79	48.98	49.94	50.1	50.29	50.4
OUG	Oughtragh	0.994	20.1	19.31	20.06	20.21	21.72	22.66	23.04	23.32	23.6	23.79
PB	Poolbeg	0.989	156.76	150.55	156.44	157.55	169.35	176.72	179.65	181.85	184.05	185.52
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65

Table C-2 Demand Forecasts at Time of Summer Peak

Bus		Dower				De	mand Fo	recast (M	IW)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
PLS	Portlaoise	0.990	42.31	40.63	42.22	31.34	33.69	35.15	35.74	36.18	36.62	36.91
RAT (I)	Rathkeale	0.989	21.76	20.9	21.71	21.87	23.5	24.53	24.93	25.24	25.55	25.75
RAT (N)	Rathgael	0.990	45.85	45.99	46.2	46.41	46.54	46.73	47.65	47.81	48	48.11
RIC	Richmond	0.977	27.6	26.51	27.55	27.74	29.82	31.11	31.63	32.02	32.41	32.67
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13
ROS	Rosebank	0.990	24.11	24.18	24.28	24.39	21.99	22.08	22.52	22.61	22.7	22.76
RSY	Ringaskiddy	0.996	3.09	2.96	3.08	3.1	3.33	3.48	3.54	3.58	3.62	3.65
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52
SAL	Salthill	0.995	41.39	39.76	41.31	41.61	44.72	46.66	47.44	48.02	48.6	49
SBH	Snugborough	0.950	-	16.72	16.72	47.12	47.12	47.12	47.12	47.12	47.12	47.12
SCR	Screeb	0.972	21.8	20.93	21.75	21.91	23.55	24.57	24.98	25.29	25.59	25.8
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29
SKL	Shankill	0.966	44.77	43	44.68	45	48.37	50.47	51.31	51.94	52.57	52.99
SLI	Sligo	0.987	42.93	41.22	42.84	43.14	46.37	48.39	49.19	49.8	50.4	50.8
SNG	Singland	0.976	8.68	8.33	8.66	8.72	9.37	9.78	9.94	10.07	10.19	10.27
SOM	Somerset	0.990	16.71	16.05	16.68	16.8	18.06	18.84	19.15	19.39	19.62	19.78
SPR	Springtown	0.980	37.72	37.82	37-99	38.16	38.25	38.4	39.14	39.27	39.41	39.49
STR	Stratford	0.991	16.44	15.79	16.41	16.52	17.76	18.53	18.84	19.07	19.3	19.46
STR (N)	Strabane	0.990	33.57	33.65	33.81	33.95	34.05	34.17	34.84	34.96	35.08	35.16
TAN	Tandragee	0.990	52.5	52.65	52.89	53.12	53.26	53.46	54.5	54.69	54.89	55
TBG	Trabeg	0.993	56.75	54.51	56.64	57.05	61.31	63.98	65.05	65.85	66.64	67.17
TBK	Tullabrack	0.980	8.69	8.34	8.67	8.73	9.38	9.79	9.96	10.08	10.2	10.28
THU	Thurles	0.976	22.16	21.28	22.12	22.28	23.94	24.98	25.4	25.71	26.02	26.23
TIP	Tipperary	0.979	16.36	15.71	16.33	16.44	17.67	18.44	18.75	18.98	19.21	19.36
TLK	Trillick	0.989	15.97	15.34	15.94	16.05	17.26	18.01	18.31	18.53	18.75	18.9
TON	Tonroe	0.993	12.14	11.66	12.11	12.2	13.11	13.68	13.91	14.08	14.25	14.36
TRI	Trien	0.957	19.05	18.29	19.01	19.14	20.58	21.47	21.83	22.1	22.37	22.54
TRL	Tralee	0.995	43.84	42.1	43.75	44.06	47.36	49.42	50.24	50.86	51.47	51.89
TSB	Thornsberry	0.983	25.26	24.26	25.21	25.39	27.29	28.47	28.95	29.3	29.66	29.89
WAT	Waterford	0.978	43.98	42.24	43.89	43.43	46.68	48.71	49.52	50.13	50.74	51.14
WEX	Wexford	0.968	44.92	43.13	44.83	45.14	48.52	50.63	51.47	52.1	52.73	53.16
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9

Table C-3 Demand Forecasts at Time of Summer Valley

Bus		Dower				De	mand Fo	recast (M	W)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
AA	Ardnacrusha	0.988	20.11	16.35	16.99	15.95	18.05	19.37	19.9	20.29	20.68	20.95
AGH	Aghyoule	0.990	4.1	4.13	4.17	4.2	4.24	4.28	4.38	4.42	4.46	4.49
AGY	Ardnagappary	0.984	-	2.85	2.96	2.78	3.14	3.37	3.47	3.53	3.6	3.65
AHA	Ahane	0.950	0.75	0.61	0.63	0.59	0.67	0.72	0.74	0.76	0.77	0.78
AIR	Airport Road (Belfast)	0.990	-	-	-	-	-	8.42	9.09	9.48	9.94	11.07
ANR	Anner	0.897	14	14	14	14	14	14	14	14	14	14
ANT	Antrim	0.980	12.35	12.39	12.45	12.51	12.55	12.6	12.85	12.9	12.95	12.98
ARI	Arigna	0.956	1.05	0.85	0.89	0.83	0.94	1.01	1.04	1.06	1.08	1.09
ARK	Arklow	0.961	5.62	2.88	2.99	2.8	3.17	3.41	3.5	3.57	3.64	3.68
ATH	Athlone	0.998	18.18	14.78	15.36	14.42	16.32	17.51	17.99	18.35	18.7	18.94
ATY	Athy	0.997	4.85	3.94	4.1	3.85	4.35	4.67	4.8	4.89	4.99	5.05
BAL	Baltrasna	0.979	3.21	2.61	2.72	2.55	2.89	3.1	3.18	3.24	3.31	3.35
BAN (I)	Bandon	0.980	16.67	13.93	14.39	13.64	15.17	16.13	16.52	16.8	17.09	17.28
BAN (N)	Banbridge	0.990	11.58	11.62	11.67	11.73	11.76	11.81	12.04	12.09	12.13	12.16
BAR	Barrymore	0.988	8.98	7.31	7.59	7.13	8.07	8.66	8.89	9.07	9.24	9.36
BDA	Baroda	0.988	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26	5.26
BDN	Ballydine	0.970	8.17	7.76	7.83	7.72	7.95	8.09	8.15	8.19	8.23	8.26
BEG	Ballybeg	0.997	2.97	2.42	2.51	2.36	2.67	2.86	2.94	3	3.06	3.1
BGD	Belgard Road	0.950	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2	53.2
BGT	Ballyragget	0.977	-	-	-	4.56	5.16	5.54	5.69	5.8	5.92	5.99
BIN	Binbane	0.962	6.55	3.41	3.54	3.33	3.77	4.04	4.15	4.23	4.32	4.37
ВК	Bellacorick	0.993	1.37	1.12	1.16	1.09	1.23	1.32	1.36	1.38	1.41	1.43
BKY	Barnakyle	0.950	2.24	1.82	1.89	39.78	40.01	40.16	40.22	40.26	40.3	40.33
BLC	Belcamp	0.950	-	45.6	60.8	107.92	107.92	107.92	107.92	107.92	107.92	107.92
BLI	Ballylickey	0.960	3.38	2.75	2.85	2.68	3.03	3.25	3.34	3.41	3.48	3.52
BLK	Blake	0.992	3.88	3.15	3.28	3.08	3.48	3.74	3.84	3.91	3.99	4.04
ВМА	Ballymena	0.978	24.69	24.78	24.88	25.01	25.08	25.18	25.68	25.77	25.88	25.94
BNH	Ballynahinch	0.990	16.83	16.88	16.95	17.03	17.08	17.14	17.48	17.53	17.6	17.64
BNM	Belfast North	0.990	14.8	14.84	14.91	14.98	15.03	15.09	15.39	15.44	15.5	15.54
BOG	Banoge	0.984	1.86	4.52	4.7	4.41	4.99	5.35	5.5	5.61	5.72	5.79
BRA	Bracklone	0.978	-	2.49	2.59	2.43	2.75	2.95	3.03	3.09	3.15	3.19
BRI	Brinny	0.971	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
BRY	Barnahely	0.984	16.92	13.76	14.29	13.42	15.19	16.3	16.75	17.07	17.41	17.63
BUT	Butlerstown	1.000	8.73	7.1	7.37	6.92	7.84	8.41	8.64	8.81	8.98	9.09
BVG	Ballyvallagh	0.990	4.47	4.48	4.5	4.52	4.54	4.55	4.64	4.66	4.68	4.69
CAH	Cahir	0.999	6.08	4.94	5.14	4.82	5.46	5.86	6.01	6.13	6.25	6.33
CAR	Carnmoney	0.990	7.77	7.68	7.59	7.51	7.42	7.34	7.37	7.28	7.2	7.11
CBG	Carrowbeg	0.993	6.62	5.38	5.59	5.25	5.94	6.38	6.55	6.68	6.81	6.9
CBR	Castlebar	0.987	8.48	6.89	7.16	6.72	7.61	8.17	8.39	8.56	8.72	8.83
CEN	Belfast Central	0.990	15.62	15.69	15.79	15.89	15.96	16.06	16.4	16.49	16.59	16.65
CF	Cathaleen's Fall	0.965	4.39	3.57	3.71	3.48	3.94	4.22	4.34	4.43	4.51	4.57
CFM	Castlefarm	0.901	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8	50.8

Table C-3 Demand Forecasts at Time of Summer Valley

Bus		Dower				De	mand Fo	recast (M	W)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
СНА	Charleville	0.998	3.74	3.04	3.16	2.97	3.36	3.61	3.7	3.78	3.85	3.9
CKG	Corkagh	0.950	33.25	66.88	90.44	90.44	90.44	90.44	90.44	90.44	90.44	90.44
СКМ	Carrickmines	0.975	138.86	125.57	127.83	124.14	131.59	136.26	138.12	139.52	140.91	141.85
CLE	Clonee	0.950	43.6	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48	55.48
CLG	Cloghran	0.950	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84	63.84
CLN	Cloon	0.995	6.58	5.35	5.56	5.22	5.9	6.34	6.51	6.64	6.77	6.85
CLW	Carlow	0.986	13.06	10.62	11.04	10.36	11.73	12.58	12.93	13.18	13.44	13.61
COL (I)	College Park	0.987	10.21	8.31	8.63	8.1	9.17	9.84	10.11	10.31	10.51	10.64
COL (N)	Coleraine	0.990	12.63	12.67	12.72	12.78	12.81	12.87	13.11	13.17	13.2	13.24
cos	Carrick-on- Shannon	0.994	6.53	5.31	5.52	5.18	5.87	6.3	6.47	6.6	6.72	6.81
COW	Cow Cross	0.970	1.25	1.01	1.05	0.99	1.12	1.2	1.23	1.26	1.28	1.3
CPS	Cool	0.985	17.19	17.24	17.32	17.4	17.45	17.52	17.87	17.94	18.01	18.05
CRA	Crane	1.000	5.97	3.53	3.67	3.45	3.9	4.19	4.3	4.38	4.47	4.53
CRE	Cregagh	0.990	25.4	25.5	25.64	25.76	21.34	21.46	21.92	22.04	22.17	22.26
CRG	Creagh	0.990	7.35	7.37	7.41	7.44	7.46	7.49	7.64	7.66	7.69	7.71
CRH	Cruiserath	0.942	-	-	155	155	155	155	155	155	155	155
CRO	Coolroe	1.000	4.05	3.29	3.42	3.21	3.64	3.9	4.01	4.09	4.17	4.22
CVW	Castleview	0.994	6.85	5.57	5.79	5.43	6.15	6.6	6.78	6.91	7.05	7.14
DAL	Dallow	0.993	3.51	2.85	2.96	2.78	3.15	3.38	3.47	3.54	3.61	3.65
DDK	Dundalk	1.000	12.83	10.44	10.84	10.18	11.52	12.36	12.7	12.95	13.2	13.37
DFR	Dunfirth	1.000	2.19	1.78	1.85	1.74	1.97	2.11	2.17	2.21	2.26	2.28
DGN	Dungarvan	0.999	9.41	7.65	7.95	7.46	8.45	9.06	9.31	9.49	9.68	9.8
DLT	Dalton	1.000	6.18	5.02	5.22	4.9	5.55	5.95	6.11	6.24	6.36	6.44
DMY	Dunmanway	0.961	6.68	5.43	5.65	5.3	6	6.44	6.61	6.74	6.87	6.96
DON	Donegall	0.990	43.22	42.86	42.57	42.3	41.96	41.69	42.06	41.77	41.5	41.2
D00	Doon	0.994	6.56	5.33	5.54	5.2	5.89	6.32	6.49	6.62	6.75	6.83
DRU (I)	Drumline	0.955	8.83	7.18	7.46	7	7.93	8.5	8.74	8.91	9.08	9.2
DRU (N)	Drumnakelly	0.980	27.05	27.14	27.27	27.4	27.49	27.61	28.16	28.27	28.43	28.55
DRY	Drybridge	0.995	18.83	15.31	15.91	14.93	16.9	18.14	18.63	19	19.37	19.62
DUN	Dungannon	0.990	28.64	28.73	28.87	29	29.09	29.21	29.78	29.9	30.01	30.09
EDE	Eden	0.980	10.22	10.25	10.3	10.34	10.37	10.42	10.62	10.66	10.7	10.73
ENN (I)	Ennis	0.997	13.68	11.13	11.56	10.85	12.29	13.18	13.54	13.81	14.08	14.26
ENN (N)	Enniskillen	0.990	17.29	17.35	17.43	17.51	17.58	17.65	18.01	18.07	18.15	18.2
FIN (I)	Finglas	0.982	173.35	124.53	127.65	122.53	132.88	139.34	141.92	143.86	145.77	147.08
FIN (N)	Finaghy	0.990	9.15	9.18	9.22	9.26	9.29	9.32	9.51	9.54	9.58	9.6
FTT	Fortunestown	0.970	2.36	1.92	1.99	1.87	2.12	2.27	2.33	2.38	2.42	2.46
GAL	Galway	1.000	20.82	16.92	17.59	16.51	18.68	20.05	20.59	21	21.41	21.69
GI	Great Island	0.950	3.54	2.88	2.99	2.98	3.38	3.62	3.72	3.79	3.87	3.92
GIL	Gilra	0.971	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42	11.42
GLE (I)	Glenlara	0.956	3.71	3.01	3.13	2.94	3.33	3.57	3.67	3.74	3.81	3.86
GLE (N)	Glengormley	0.977	9.37	9.36	9.37	9.37	9.37	9.37	9.52	9.52	9.52	9.52
GOR (N)	Gort	0.991	0.35	0.36	0.36	0.36	0.37	0.37	0.38	0.38	0.38	0.39

Table C-3 Demand Forecasts at Time of Summer Valley

Bus		Dower				De	mand Fo	recast (M	W)			
Code	Bus Name	Power Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
GRI	Griffinrath	0.948	12.49	10.16	10.56	9.91	11.22	12.04	12.36	12.61	12.85	13.02
GWE	Gortawee	0.943	26.02	21.1	25.26	25	25.52	25.84	25.97	26.07	26.16	26.23
IKE	Ikerrin	0.997	5.6	4.55	4.73	4.44	5.03	5.39	5.54	5.65	5.76	5.83
INC	Inchicore	0.973	124.89	130.75	128.74	125.49	132.04	136.14	137.77	139.01	140.22	141.06
KBY	Kilbarry	0.995	12.86	10.46	10.87	10.2	11.55	12.39	12.73	12.98	13.23	13.4
KER	Knockearagh	0.994	9.95	8.09	8.41	7.89	8.93	9.58	9.85	10.04	10.24	10.37
KIN	Kinnegad	0.973	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19	10.19
KKY	Kilkenny	1.000	12.6	10.25	10.64	7.99	9.05	9.71	9.97	10.17	10.37	10.5
KNO	Knock	0.990	15.13	15.18	15.25	15.32	13.43	13.49	13.77	13.83	13.9	13.94
KTL	Kilteel	0.988	10.98	8.93	9.28	8.71	9.86	10.58	10.87	11.09	11.3	11.45
KTN	Killoteran	0.976	3.57	2.9	3.02	2.83	3.21	3.44	3.53	3.6	3.67	3.72
KUR	Knockumber	0.907	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66	23.66
LA	Lanesboro	0.978	3.22	2.62	2.72	2.55	2.89	3.1	3.19	3.25	3.31	3.36
LAR	Larne	0.990	8.46	8.49	8.53	8.57	8.59	8.62	8.79	8.82	8.85	8.87
LET	Letterkenny	0.975	13.62	10.14	10.54	9.89	11.2	12.02	12.34	12.59	12.83	13
LIB	Liberty	0.981	5.55	4.51	4.69	4.4	4.98	5.35	5.49	5.6	5.71	5.78
LIM (I)	Limerick	1.000	21.31	17.33	18.01	16.9	19.14	20.53	21.09	21.51	21.93	22.21
LIM (N)	Limavady	0.990	7.31	7.34	7.37	7.4	7.42	7.45	7.59	7.62	7.65	7.66
LIS (I)	Lisdrum	0.988	6.74	5.48	5.7	5.35	6.05	6.5	6.67	6.8	6.94	7.03
LIS (N)	Lisburn	0.990	21.86	21.93	22.03	22.13	22.2	22.29	22.73	22.82	22.91	22.97
LMR	Lisaghmore	0.980	9.7	9.73	9.78	9.82	9.85	9.89	10.09	10.13	10.17	10.19
LOG	Loguestown	0.980	11.53	11.56	11.61	11.66	11.7	11.74	11.97	12.01	12.06	12.09
MAC	Macroom	0.990	6	4.88	5.07	4.76	5.39	5.78	5.94	6.05	6.17	6.25
MAL	Mallow	0.990	5.26	4.28	4.45	4.17	4.73	5.07	5.21	5.31	5.42	5.48
MCE	Macetown	0.998	12.21	10.79	11.03	10.64	11.44	11.94	12.14	12.29	12.43	12.54
MID	Midleton	0.988	14.2	11.55	12	11.27	12.76	13.68	14.06	14.33	14.62	14.8
MLN	Mullagharlin	0.958	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46	4.46
MON	Monread	0.993	3.25	2.64	2.75	2.58	2.92	3.13	3.22	3.28	3.34	3.39
MOY	Moy	1.000	5.95	4.84	5.03	4.72	5.34	5.73	5.89	6	6.12	6.2
MR	Marina	1.000	3.32	2.7	2.81	2.63	2.98	3.2	3.29	3.35	3.42	3.46
MTH	Meathhill	0.977	11.94	9.71	10.09	9.47	10.72	11.5	11.82	12.05	12.29	12.44
MUL	Mullingar	0.971	9	7.32	7.61	7.13	8.08	8.67	8.9	9.08	9.26	9.38
MUN	Mungret	0.871	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5
NAR	Newtownards	0.990	13.41	13.44	13.5	13.56	13.6	13.65	13.92	13.97	14.02	14.05
NAV	Navan	1.000	11.21	9.11	9.47	8.89	10.06	10.8	11.09	11.31	11.53	11.68
NEN	Nenagh	0.986	7.67	6.24	6.48	6.08	6.89	7.39	7.59	7.74	7.89	7.99
NEW (I)	Newbridge	0.992	4.01	3.26	3.39	3.18	3.6	3.86	3.96	4.04	4.12	4.17
NEW (N)	Newry	0.990	23.61	23.69	23.8	23.92	23.99	24.09	24.57	24.66	24.76	24.83
OLD	Oldcourt	0.949	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
OMA	Omagh	0.990	17.91	17.98	18.06	18.13	18.18	18.26	18.62	18.68	18.74	18.79
OUG	Oughtragh	0.997	7.06	5.74	5.96	5.6	6.34	6.8	6.98	7.12	7.26	7.35
PB	Poolbeg	0.995	53.58	43.58	45.25	42.49	48.09	51.6	53.01	54.07	55.11	55.81
PLA	Platin	0.960	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65	12.65

Table C-3 Demand Forecasts at Time of Summer Valley

Bus		Power											
Code	Bus Name	Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	
PLS	Portlaoise	0.999	11.08	9.01	9.36	6.23	7.05	7.56	7.77	7.92	8.07	8.17	
RAT (I)	Rathkeale	0.989	19.15	15.57	16.18	15.19	17.19	18.45	18.95	19.33	19.7	19.95	
RAT (N)	Rathgael	0.990	17.09	17.14	17.22	17.3	17.34	17.41	17.76	17.82	17.89	17.93	
RIC	Richmond	1.000	7.89	6.42	6.67	6.26	7.09	7.6	7.81	7.97	8.12	8.22	
RNW	Rinawade	0.988	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	9.13	
ROS	Rosebank	0.990	8.99	9.01	9.05	9.09	8.19	8.23	8.39	8.43	8.46	8.48	
RSY	Ringaskiddy	0.994	0.71	0.58	0.6	0.57	0.64	0.69	0.71	0.72	0.73	0.74	
RYB	Ryebrook	0.928	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	104.52	
SAL	Salthill	0.998	13.49	10.97	11.39	10.7	12.11	13	13.35	13.62	13.88	14.05	
SBH	Snugborough	0.950	-	-	16.72	47.12	47.12	47.12	47.12	47.12	47.12	47.12	
SCR	Screeb	0.971	7.4	6.02	6.25	5.87	6.64	7.13	7.32	7.47	7.61	7.71	
SHE	Shelton	0.956	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	2.29	
SKL	Shankill	0.997	11.43	9.29	9.66	9.06	10.26	11.01	11.31	11.53	11.76	11.91	
SLI	Sligo	1.000	13.36	10.86	11.28	10.59	11.99	12.87	13.22	13.48	13.74	13.92	
SNG	Singland	0.970	2.66	2.16	2.24	2.11	2.39	2.56	2.63	2.68	2.73	2.77	
SOM	Somerset	0.999	3.36	2.74	2.84	2.67	3.02	3.24	3.33	3.4	3.46	3.51	
SPR	Springtown	0.980	14.05	14.09	14.16	14.22	14.26	14.31	14.59	14.63	14.69	14.72	
STR	Stratford	1.000	3.55	2.89	3	2.82	3.19	3.42	3.51	3.58	3.65	3.7	
STR (N)	Strabane	0.990	12.51	12.55	12.6	12.65	12.69	12.75	12.99	13.02	13.08	13.1	
TAN	Tandragee	0.990	19.56	19.62	19.71	19.79	19.85	19.92	20.31	20.38	20.45	20.5	
TBG	Trabeg	0.988	22.76	18.51	19.23	18.05	20.43	21.93	22.52	22.97	23.42	23.72	
TBK	Tullabrack	0.972	3.09	2.51	2.61	2.45	2.77	2.97	3.05	3.11	3.17	3.21	
THU	Thurles	0.998	7.51	6.1	6.34	5.95	6.74	7.23	7.43	7.58	7.72	7.82	
TIP	Tipperary	0.995	5.26	4.28	4.45	4.17	4.73	5.07	5.21	5.31	5.42	5.48	
TLK	Trillick	0.953	4.22	3.43	3.57	3.35	3.79	4.07	4.18	4.26	4.34	4.4	
TON	Tonroe	0.975	4.29	3.49	3.63	3.4	3.85	4.14	4.25	4.33	4.42	4.47	
TRI	Trien	0.972	10.33	8.4	8.73	8.19	9.27	9.95	10.22	10.42	10.63	10.76	
TRL	Tralee	0.981	10.38	8.44	8.77	8.23	9.32	10	10.27	10.47	10.68	10.81	
TSB	Thornsberry	0.959	7.3	5.94	6.17	5.79	6.55	7.03	7.22	7.37	7.51	7.61	
WAT	Waterford	1.000	18.47	15.02	15.61	14.47	16.38	17.58	18.06	18.41	18.77	19.01	
WEX	Wexford	0.998	13.9	11.3	11.75	11.02	12.48	13.39	13.75	14.03	14.3	14.48	
WHI	Whitegate	0.870	9	9	9	9	9	9	9	9	9	9	


Table C-4 Demand Forecasts at Time of Autumn Peak – Northern Ireland only

Bus		Power												
Code	Bus Name	Factor	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027		
AGH	Aghyoule	0.990	12.16	12.25	12.36	12.47	12.57	12.69	12.99	13.11	13.22	13.32		
AIR	Airport Road (Belfast)	0.990	-	-	-	-	-	25	26.97	28.13	29.48	32.84		
ANT	Antrim	0.980	36.65	36.76	36.94	37.11	37.22	37.38	38.12	38.27	38.43	38.52		
BAN (N)	Banbridge	0.990	34.35	34.46	34.62	34.79	34.89	35.03	35.73	35.86	36	36.08		
ВМА	Ballymena	0.978	73.25	73.49	73.84	74.17	74.39	74.73	76.2	76.48	76.79	76.99		
BNH	Ballynahinch	0.990	49.94	50.08	50.3	50.53	50.66	50.86	51.85	52.02	52.22	52.33		
BNM	Belfast North	0.990	43.91	44.03	44.24	44.45	44.58	44.76	45.64	45.81	45.99	46.1		
BVG	Ballyvallagh	0.990	13.26	13.3	13.36	13.42	13.46	13.51	13.78	13.82	13.87	13.9		
CAR	Carnmoney	0.990	23.05	22.77	22.53	22.29	22.02	21.77	21.86	21.61	21.36	21.09		
CEN	Belfast Central	0.990	46.33	46.55	46.85	47.15	47.36	47.65	48.67	48.93	49.21	49.41		
COL (N)	Coleraine	0.990	37.46	37.58	37.74	37.91	38.02	38.17	38.9	39.04	39.18	39.27		
CPS	Cool	0.990	22.22	22.28	22.38	22.49	22.55	22.65	23.09	23.18	23.27	23.33		
CRE	Cregagh	0.990	75.38	75.65	76.05	76.44	63.29	63.67	65.04	65.39	65.76	66.03		
CRG	Creagh	0.990	21.81	21.87	21.97	22.07	22.13	22.22	22.66	22.74	22.83	22.88		
DON	Donegall	0.990	84.34	83.12	82.06	81.03	79.89	78.89	79.11	78.11	77.16	76.11		
DRU (N)	Drumnakelly	0.980	80.26	80.51	80.9	81.29	81.55	81.92	83.55	83.88	84.36	84.7		
DUN	Dungannon	0.990	84.99	85.25	85.65	86.04	86.29	86.67	88.37	88.69	89.05	89.27		
EDE	Eden	0.980	30.32	30.41	30.55	30.69	30.78	30.91	31.51	31.63	31.75	31.83		
ENN (N)	Enniskillen	0.990	51.3	51.48	51.73	51.97	52.14	52.38	53.41	53.62	53.84	53.99		
FIN (N)	Finaghy	0.990	27.14	27.22	27.35	27.47	27.55	27.66	28.2	28.3	28.41	28.48		
GLE (N)	Glengormley	0.977	27.8	27.77	27.8	27.81	27.79	27.81	28.25	28.25	28.26	28.24		
GOR (N)	Gort	0.990	1.05	1.06	1.07	1.07	1.08	1.09	1.12	1.13	1.14	1.15		
KNO	Knock	0.990	44.9	45.04	45.25	45.46	39.84	40.04	40.86	41.04	41.24	41.37		
LAR	Larne	0.990	25.11	25.18	25.3	25.41	25.48	25.58	26.08	26.17	26.27	26.32		
LIM (N)	Limavady	0.990	21.7	21.76	21.86	21.95	22.01	22.1	22.53	22.6	22.69	22.73		
LIS (N)	Lisburn	0.990	64.85	65.05	65.36	65.67	65.86	66.14	67.45	67.7	67.98	68.14		
LMR	Lisaghmore	0.980	28.77	28.86	29	29.14	29.23	29.35	29.93	30.05	30.17	30.24		
LOG	Loguestown	0.980	34.2	34.3	34.45	34.6	34.7	34.84	35.52	35.65	35.78	35.86		
NAR	Newtownards	0.990	39.77	39.89	40.07	40.24	40.35	40.51	41.3	41.44	41.6	41.69		
NEW (N)	Newry	0.990	70.05	70.28	70.62	70.96	71.17	71.48	72.9	73.17	73.47	73.66		
OMA	Omagh	0.990	53.18	53.32	53.57	53.8	53.94	54.16	55.21	55.4	55.61	55.73		
RAT (N)	Rathgael	0.990	50.7	50.85	51.08	51.31	51.46	51.67	52.68	52.86	53.07	53.19		
ROS	Rosebank	0.990	26.66	26.73	26.85	26.97	24.31	24.41	24.9	25	25.1	25.16		
SPR	Springtown	0.980	41.7	41.82	42	42.19	42.29	42.45	43.28	43.42	43.58	43.66		
STR (N)	Strabane	0.990	37.1	37.21	37.38	37-54	37.63	37.78	38.52	38.65	38.79	38.87		
TAN	Tandragee	0.990	58.04	58.21	58.47	58.73	58.88	59.11	60.26	60.46	60.68	60.81		

All-Island Ten Year

Transmission Forecast
Statement 2018

Appendix D

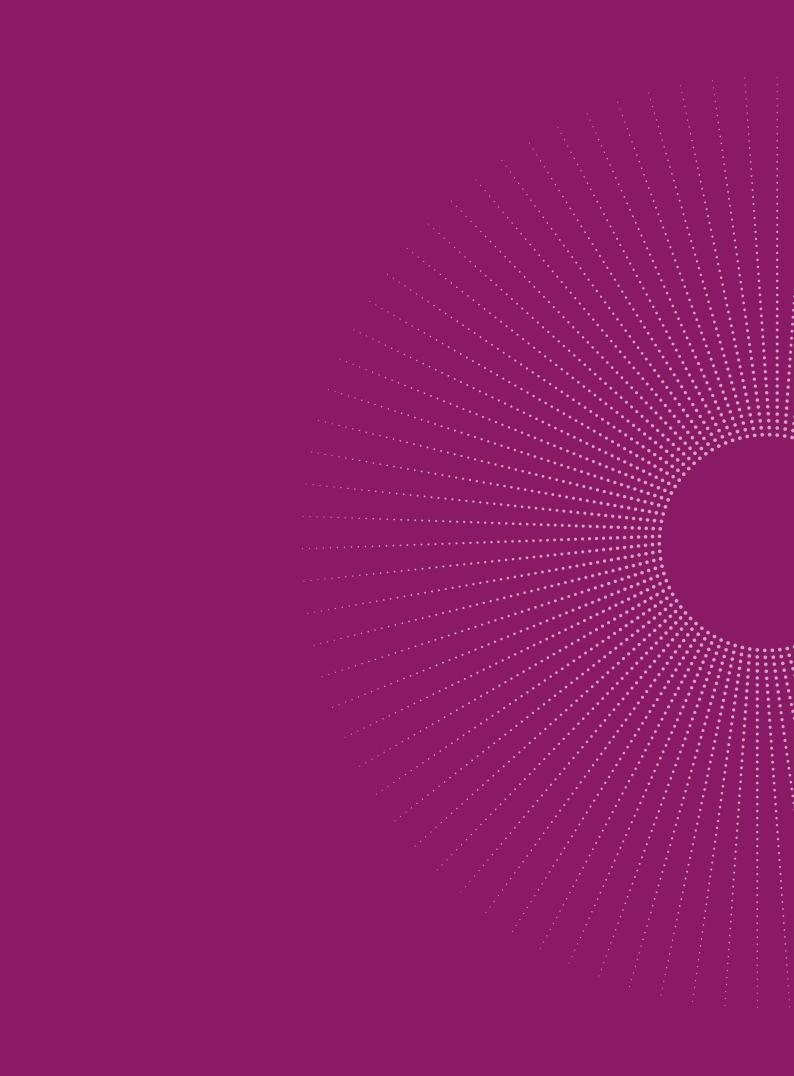

Appendix D Generation Capacity and Dispatch Details

D.1 Generation Capacity Details

Table D-1 lists existing and committed future transmission connected generation, their connection details and the Registered Capacity¹²² of each unit. All generation capacity figures in Table D-1 are expressed in exported terms. Exported terms are given by the generation unit output less the unit's own auxiliary load. The units are grouped in these tables on a geographical basis. Generation capacity figures are rounded to the nearest MW.

Table D-2 lists the existing and committed future wind generation. The wind generation included in this table is wind generation that feeds into each 110 kV transmission station, from the distribution system. The respective MW capacity over the period of the statement is included. Table D-2 is based on the wind farms that currently have signed connection agreements with the DSO. The connection agreements are based on the best available knowledge as at July 2018.

Table D-3 lists the existing and committed distribution connected generation in Ireland, excluding wind generation. Their respective MW capacity over the period of the statement is included.

Table D-4 lists the existing and committed non-embedded distribution connected renewable generation in Northern Ireland, excluding wind generation. Their respective MW capacity over the period of the statement is included.

Table D-5 lists the existing and proposed generating plant contract details in Northern Ireland.

Where dual fuel capability exists, the fuel type highlighted in red is utilised to meet peak demand.

¹²² The Registered Capacity of future units will not be known until the unit enters the Integrated Single Electricity Market. Therefore, for future units the Maximum Export Capacity of the unit appears in Table D-1.

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Carrickaduff		Mulreavy	110 kV	Wind	2020	33
	Carrickaduff (2)		Mulreavy	110 kV	Wind	2020	33
	Cronacarkfree		Mulreavy	110 kV	Wind	2019	72
	Castletownmoor		Castletownmoor	110 kV	Wind	2018	120
	Erne	ER ₃	Cathaleen's Fall	110 kV	Hydro		23
	Erne	ER4	Cathaleen's Fall	110 kV	Hydro		23
	Erne	ER1	Cliff	110 kV	Hydro		10
	Erne	ER2	Cliff	110 kV	Hydro		10
	Garvagh - Glebe		Garvagh	110 kV	Wind		26
	Garvagh - Tullynahaw		Garvagh	110 kV	Wind		22
Border	Golagh		Golagh	110 kV	Wind		15
	Kingsmountain (1)		Cunghill	110 kV	Wind		24
	Kingsmountain (2)		Cunghill	110 kV	Wind		11
	Meentycat (1)		Meentycat	110 kV	Wind		71
	Meentycat (2)		Meentycat	110 kV	Wind		14
	Mountain Lodge		Ratrussan	110 kV	Wind		31
	Mulreavy		Mulreavy	110 kV	Wind		95
	Mulreavy Ext		Mulreavy	110 kV	Wind		13
	Oriel		Oriel	110 kV	Wind	2022	210
	Carrickallen		Shankill	110 kV	Wind		22
	Ratrussan		Ratrussan	110 kV	Wind		48
			Border Area T	otal			925
	Dublin Bay Power	DB1	Irishtown	220 kV	Gas/DO		415
	Huntstown	HNC	Huntstown A	220 kV	Gas/DO		352
	Huntstown	HN2	Huntstown B	220 kV	Gas/DO		412
Dublin	North Wall	NW5	North Wall	220 kV	Gas/DO		109
	Dublin Waste to Energy	DW1	Whitebank	110 kV	Waste		61
	Poolbeg	PBC	Shellybanks	220 kV	Gas/DO		460
			Dublin Area T	otal			1809

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel Type 110 kV Hydro 110 kV Hydro		Connection Year (if future)	Maximum Export Capacity (MW)
71100	Liffey Hydro	Ll1	Pollaphuca		1	ratare)	15
	Liffey Hydro	Ll2	Pollaphuca		<u> </u>		15
	Liffey Hydro	LI4	Pollaphuca	110 KV	Hydro		4
Mid-East	Turlough Hill	TH1	Turlough Hill	220 kV	Hydro		73
mid Edst	Turlough Hill	TH2	Turlough Hill	220 kV	Hydro		73
	Turlough Hill	TH ₃	Turlough Hill	220 kV	Hydro		73
	Turlough Hill	TH4	Turlough Hill	220 kV	Hydro		73
	Turto agri Tint	14	Mid-East Area		1.1, 0.0		326
	F. I. D. I.	ED			Division 1		
	Edenderry Peaking	ED3	Cushaling	110 kV	Distillate		116
	Edenderry Power	ED1	Cushaling	110 kV	Peat		122
Midlands	Lough Ree Power	LR4	Lanesboro	110 kV	Peat		94
	Mountlucas		Mountlucas	110 kV	Wind		79
	Rhode PCP (1)	RP1	Derryiron	110 kV	Distillate		52
	Rhode PCP (2)	RP2	Derryiron	110 kV	Distillate		52
			Midlands Area	Total			514
	Aughinish	SK ₃	Aughinish	110 kV	Gas/DO		65
	Aughinish	SK4	Aughinish	110 kV	Gas/DO		65
	Ardnacrusha Hydro (1)	AA1	Ardnacrusha	110 kV	Hydro		22
	Ardnacrusha Hydro (2)	AA2	Ardnacrusha	110 kV	Hydro		22
	Ardnacrusha Hydro (3)	AA3	Ardnacrusha	110 kV	Hydro		21
	Ardnacrusha Hydro (4)	AA4	Ardnacrusha	110 kV	Hydro		21
	Moneypoint WF		Moneypoint	110 kV	Wind		22
	Booltiagh		Booltiagh	110 kV	Wind		19
Mid-West	Booltiagh Ext.		Booltiagh	110 kV	Wind		12
	Knockalassa		Slievecallan	110 kV	Wind		27
	Dromada (1)		Dromada	110 kV	Wind		29
	Dromada (1a)		Dromada	110 kV	Wind	2020	18
	Kill Hill		Kill Hill	110 kV	Wind		36
	Lisheen (1)		Lisheen	110 kV	Wind		36
	Lisheen (1a)		Lisheen	110 kV	Wind		19
	Loughaun North		Slievecallan	110 kV	Wind		45
	Moneypoint (1)	MP1	Moneypoint	400 kV	Coal		288
	Moneypoint (2)	MP2	Moneypoint	400 kV	Coal		288
	Moneypoint (3)	MP3	Moneypoint	400 kV	Coal		288
		,	Mid-West Area		,	•	1340

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Aron	Congration Station	Unit ID	Connected At	Fuel	Time	Connection Year (if future)	Maximum Export Capacity (MW)
Area	Generation Station Ballylumford B10	B ₁₀	Ballylumford	110 kV	Type Gas	Tuture)	98
	Ballylumford B4		Ballylumford		Gas		
	Ballylumford B5	B4	Ballylumford	275 kV			144
		B ₅		275 kV	Gas		147
	Ballylumford GT7	BGT1	Ballylumford	110 kV			58
	Ballylumford GT8	BGT2	Ballylumford	110 kV	DO		58
	Ballylumford B20	BGT20	Ballylumford	275 kV	Gas		479
	Coolkeeragh GT8	CGT8	Coolkeeragh	110 kV	Oil Co. (DO		53
	Coolkeeragh GT	C30 GT	Coolkeeragh	275 kV	Gas/DO		266
Northern	Coolkeeragh ST	C30 GS	Coolkeeragh	110 kV	Gas/DO		147
Ireland	Kilroot ST1	K1	Kilroot	275 kV	Coal/Oil		255
	Kilroot ST2	K2	Kilroot	275 kV	Coal/ <mark>Oil</mark>		258
	Kilroot GT1	KGT1	Kilroot	275 kV	DO		29
	Kilroot GT2	KGT2	Kilroot	275 kV	DO		29
	Kilroot GT3	KGT3	Kilroot	275 kV	DO		42
	Kilroot GT4	KGT4	Kilroot	275 kV	DO		42
	Kilroot Battery		Kilroot	275 kV	Battery		100
	Brockaghboy		Brockaghboy	110 kV	Wind		48
	Slieve Kirk	SLK	Killymallaght	110 kV	Wind		74
			Northern Ireland A	Area Total			2326
	Ballywater		Ballywater	110 kV	Wind		42
Cauth Fact	Castledockrell		Castledockrell	110 kV	Wind		41
South-East	Great Island CCGT	GI4	Great Island	220 kV	Gas		431
	Woodhouse		Woodhouse	110 kV	Wind		20
			South-East Are	a Total			534
	Aghada	AD1	Aghada	220 kV	Gas		258
	Aghada	AT1	Aghada	220 kV	Gas/DO		90
	Aghada	AT2	Aghada	220 kV	Gas/DO		90
	Aghada	AT4	Aghada	220 kV	Gas/DO		90
	Aghada CCGT	AD2	Longpoint	220 kV	Gas		431
	Athea		Athea	110 kV	Wind		34
	Athea B		Athea	110 kV	Wind	2021	34
	Boggeragh		Boggeragh	110 kV	Wind		57
C (1 W)	Boggeragh (2)		Boggeragh	110 kV	Wind		18
South-West	Killavoy		Boggeragh	110 kV	Wind		18
	Clahane		Clahane	110 kV	Wind		38
	Clahane (2)		Clahane	110 kV	Wind	2021	14
	Cloghboola		Cloghboola	110 kV	Wind		46
	Coomacheo		Garrow	110 kV	Wind		41
	Coomacheo (2)		Garrow	110 KV	Wind		18
	Coomagearlahy		Coomagearlahy	110 KV	Wind		43
	Coomagearlahy ext.		Coomagearlahy	110 KV	Wind		39

Table D-1 MEC of Existing and Committed Transmission-Connected Generation

Area	Generation Station	Unit ID	Connected At	Fuel	Туре	Connection Year (if future)	Maximum Export Capacity (MW)
	Coomataggart		Coomataggart	110 kV	Wind	2019	114
	Cordal		Cordal	110 kV	Wind	2022	90
	Glanlee (1)		Glanlee	110 kV	Wind		30
	Kelwin Power Plant		Kilpaddoge	110 kV	Hybrid	2021	42
	Barnadivane		Barnadivine	110 kV	Wind		60
	Cloghboola		Cloghboola	110 kV	Wind		46
	Lee Hydro	LE1	Carrigadrohid	110 kV	Hydro		15
South-West	Lee Hydro	LE2	Inniscarra	110 kV	Hydro		4
South-west	Lee Hydro	LE3	Inniscarra	110 kV	Hydro		8
			Marina	110 kV	Gas/DO		85
	Grousemount		Coomataggart	110 kV	Wind		114
	Tarbert	TB1	Tarbert	110 kV	HFO		54
	Tarbert	TB2	Tarbert	110 kV	HFO		54
	Tarbert	TB ₃	Tarbert	220 kV	HFO		241
	Tarbert	TB4	Tarbert	220 kV	HFO		241
	Whitegen CCGT	WG	Glanagow	220 kV	Gas/DO		445
			South-West Are	a Total			3000
	Oweninney (1)		Bellacorick	110 kV	Wind	2019	89
	Oweninney (2)		Bellacorick	110 kV	Wind	2019	83
	Oweninney (3)		Bellacorick	110 kV	Wind	2022	50
	Carrigdangan		Carrigdangan	110 kV	Wind	2020	60
	Derrybrien		Derrybrien	110 kV	Wind		60
	Tullynahaw		Garvagh	110 kV	Wind		22
	Knockalough		Knockalough	110 kV	Wind		34
West	Seecon		Knockranny	110 kV	Wind		108
	West Offaly Power	WO ₄	Shannonbridge	110 kV	Peat		154
	Tawnaghmore Peaking Plant	TP1	Tawnaghmore	110 kV	DO		52
	Tawnaghmore Peaking Plant	TP2	Tawnaghmore	110 kV	DO		52
	Tynagh	TY1	Tynagh	220 kV	Gas		268
	Tynagh	TY2	Tynagh	220 kV	Gas		268
	Ugool			110 kV	Wind		66
			West Area To	tal			1366

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

					Maximu	m Expor	t Capaci	ty (MEC)			
Area	110 kV Station	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Ardnagappary	-	22.9	22.9	22.9	22.9	22.9	22.9	22.9	22.9	22.9
	Bellacorick	9.0	9.0	9.0	9.0	101.1	101.1	101.1	101.1	101.1	101.1
	Binbane	40.3	40.3	71.6	108.0	108.0	108.0	108.0	108.0	108.0	108.0
	Cathaleen's Fall	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4	29.4
	Corderry	63.3	63.3	76.8	76.8	76.8	76.8	76.8	76.8	76.8	76.8
	Crane	7.5	7.5	7.5	11.5	11.5	11.5	11.5	11.5	11.5	11.5
	Drybridge	6.5	6.5	10.6	10.6	10.6	10.6	10.6	10.6	10.6	10.6
	Dundalk	0.5	0.5	0.5	15.5	15.5	15.5	15.5	15.5	15.5	15.5
	Dunmanway	24.8	24.8	24.8	49.7	52.7	52.7	52.7	52.7	52.7	52.7
	Garvagh	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0	34.0
	Glenree	34.2	77-3	77-3	77.3	77.3	77.3	77-3	77-3	77-3	77.3
Border	Gortawee	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0	3.0
	Letterkenny	45.0	45.0	46.5	80.9	80.9	80.9	80.9	80.9	80.9	80.9
	Lisdrum	-	-	16.1	16.1	49.2	49.2	49.2	49.2	49.2	49.2
	Meath Hill	45.6	45.6	45.6	72.6	72.6	72.6	72.6	72.6	72.6	72.6
	Moy	6.0	6.0	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
	Mulreavy	33.1	33.1	33.1	33.1	33.1	33.1	33.1	33.1	33.1	33.1
	Shankill	6.0	6.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
	Sligo	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7	13.7
	Somerset	19.5	19.5	19.5	19.5	19.5	19.5	19.5	19.5	19.5	19.5
	Sorne Hill	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9	63.9
	Trien	61.7	61.7	61.7	68.3	68.3	68.3	68.3	68.3	68.3	68.3
	Trillick	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7	44.7
	Border Area Total	591.4	657.5	728.6	876.9	1005.1	1005.1	1005.1	1005.1	1005.1	1005.1
Dublin	Nangor	-	-	13.4	13.4	13.4	13.4	13.4	13.4	13.4	13.4
Dubtill	Poppintree	4	4	4	4	4	4	4	4	4	4
	Dublin Area Total	4.0	4.0	17.4	17.4	17.4	17.4	17.4	17.4	17.4	17.4
	Arklow	79.7	79.7	83.7	89.7	89.7	89.7	89.7	89.7	89.7	89.7
	Dunfirth	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
Mid-East	Kilteel	-	-	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0
	Monread	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Newbridge	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Mid-East Area Total	79.7	79.7	110.7	116.7	116.7	116.7	116.7	116.7	116.7	116.7
	Blake	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
	Dallow	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1	11.1
Midlanda	Mullingar	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
Midlands	Navan	-	-	4.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0
	Richmond	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Thornsberry	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Midlands Area Total	16.0	16.0	24.0	37.0	37.0	37.0	37.0	37.0	37.0	37.0

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

		Maximum Export Capacity (MEC) 2018 2019 2020 2021 2022 2023 2024 2025 2026 2027									
Area	110 kV Station	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Ardnacrusha	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2	8.2
	Ballydine	-	-	-	4.0	28.0	28.0	28.0	28.0	28.0	28.0
	Booltiagh	80.4	80.4	85.4	85.4	85.4	85.4	85.4	85.4	85.4	85.4
	Cahir	4.0	4.0	4.0	12.0	12.0	12.0	12.0	12.0	12.0	12.0
	Cauteen	177.1	182.1	182.1	182.1	182.1	182.1	182.1	182.1	182.1	182.1
	Charleville	56.7	56.7	56.7	56.7	56.7	56.7	56.7	56.7	56.7	70.7
Mid-West	Drumline	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Ikerrin	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0	36.0
	Nenagh	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0
	Rathkeale	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Thurles	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8	41.8
	Tipperary	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
	Tullabrack	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0	31.0
	Mid-West Area Total	480.7	485.7	494.6	506.6	530.6	530.6	530.6	530.6	530.6	544.6
	Aghyoule	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5	82.5
	Antrim	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5	31.5
	Ballymena	61.2	61.2	63.7	63.7	63.7	63.7	63.7	63.7	63.7	63.7
	Agivey	47.5	47.5	47-5	137.5	137.5	137.5	137.5	137.5	137.5	137.5
	Carnmoney	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8	13.8
	Coleraine	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0	108.0
	Coolkeeragh	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6	29.6
	Drumquin	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6	2.6
	Curraghamulkin	67.9	67.9	67.9	67.9	67.9	67.9	67.9	67.9	67.9	67.9
	Dungannon	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5
	Eden	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
Northern	Enniskillen	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4	34.4
Ireland	Glengormley	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3	2.3
	Kells	-	-	-	-	23.1	23.1	23.1	23.1	23.1	23.1
	Killymallaght	35.7	35.7	35.7	35.7	35.7	35.7	35.7	35.7	35.7	35.7
	Larne	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0
	Limavady	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7	37.7
	Lisburn	58.9	58.9	58.9	58.9	58.9	58.9	58.9	58.9	58.9	58.9
	Lismore	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5	17.5
	Loguestown	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2	9.2
	Magherakeel	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2	119.2
	Newry	15.3	15.3	15.3	15.3	15.3	15.3	15.3	15.3	15.3	15.3
	Omagh	163.4	163.4	163.4	163.4	163.4	163.4	163.4	163.4	163.4	163.4
	Gort	29.8	29.8	29.8	29.8	29.8	29.8	29.8	29.8	29.8	29.8

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

					Maximu	m Expor	t Capaci	ty (MEC)			
Area	110 kV Station	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Rasharkin	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6	84.6
	Rosebank	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Northern	Slieve Kirk	73.6	73.6	73.6	73.6	73.6	73.6	73.6	73.6	73.6	73.6
Ireland	Strabane	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4	27.4
	Tremogue	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2	77.2
	Northern Ireland Area Total	1275.6	1275.6	1278.1	1368.1	1391.2	1391.2	1391.2	1391.2	1391.2	1391.2
	Athy	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Banoge	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Barrymore	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9	39.9
	Butlerstown	1.7	1.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7	5.7
	Carlow	34.4	34.4	34.4	39.4	39.4	39.4	39.4	39.4	39.4	39.4
	Doon	-	-	-	4.0	29.0	29.0	29.0	29.0	29.0	29.0
South-East	Dungarvan	4.6	38.6	38.6	40.3	40.3	40.3	40.3	40.3	40.3	40.3
	Great Island	-	-	-	12.0	12.0	12.0	12.0	12.0	12.0	12.0
	Kilkenny	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0
	Lodgewood	60.1	60.1	64.1	64.1	64.1	64.1	64.1	64.1	64.1	64.1
	Portlaoise	64.2	64.2	64.2	68.2	68.2	68.2	68.2	68.2	68.2	68.2
	Waterford	18.3	18.3	22.2	22.2	22.2	22.2	22.2	22.2	22.2	22.2
	Wexford	38.9	38.9	38.9	42.9	46.9	46.9	46.9	46.9	46.9	46.9
	South-East Area Total	266.0	300.0	311.9	350.6	379.6	379.6	379.6	379.6	379.6	379.6
	Athea	-	-	3.6	41.5	41.5	41.5	41.5	41.5	41.5	41.5
	Ballylickey	54.0	54.0	54.0	54.0	54.0	54.0	54.0	54.0	54.0	54.0
	Bandon	26.6	26.6	26.6	26.6	30.6	30.6	30.6	30.6	30.6	30.6
	Boggeragh	20.0	20.0	20.0	31.4	31.4	31.4	31.4	31.4	31.4	31.4
	Castleview	-	-	-	-	4.0	4.0	4.0	4.0	4.0	4.0
	Cloghboola	44.6	44.6	54.6	54.6	54.6	54.6	54.6	54.6	54.6	54.6
	Coomataggart	-	82.2	82.2	82.2	82.2	82.2	82.2	82.2	82.2	82.2
	Cordal	78.3	76.8	76.8	76.8	76.8	76.8	76.8	76.8	76.8	76.8
Courth West	Garrow	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0
South-West	Glenlara	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0	53.0
	Glentane	-	-	40.3	40.3	40.3	40.3	40.3	40.3	40.3	40.3
	Kilbarry	0.8	0.8	5.8	5.8	5.8	5.8	5.8	5.8	5.8	5.8
	Killonan	-	-	140.5	140.5	140.5	140.5	140.5	140.5	140.5	140.5
	Kilpaddoge	61.6	61.6	61.6	61.6	61.6	61.6	61.6	61.6	61.6	61.6
	Knockacummer	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0	105.0
	Knockeragh	13.9	13.9	19.1	19.1	19.1	19.1	19.1	19.1	19.1	19.1
	Lanesboro	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6	4.6
	Limerick	-	-	4.0	4.0	4.0	4.0	4.0	4.0	4.0	4.0

Table D-2 Existing and Committed Distribution-Connected Wind Farm Capacity

					Maximu	m Expor	t Capaci	ty (MEC)			
Area	110 kV Station	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Macroom	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1	34.1
	Mallow	5.0	5.0	5.0	9.0	9.0	9.0	9.0	9.0	9.0	9.0
	Midleton	1.6	1.6	1.6	1.6	5.6	5.6	5.6	5.6	5.6	5.6
South-West	Oughtragh	9.0	9.0	13.0	13.0	13.0	13.0	13.0	13.0	13.0	13.0
	Reamore	14.8	14.8	14.8	28.3	53.6	53.6	53.6	53.6	53.6	96.2
	Trabeg	-	-	-	-	5.0	5.0	5.0	5.0	5.0	5.0
	Tralee	45.9	45.9	51.6	55.6	55.6	55.6	55.6	55.6	55.6	55.6
	South-West Area Total	587.5	668.2	886.5	957.3	999.4	999.4	999.4	999.4	999.4	1042.0
	Arigna	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6	15.6
	Carrick on Shannon	-	-	4.0	8.3	8.3	8.3	8.3	8.3	8.3	8.3
	Castlebar	34.7	34.7	39.2	39.2	39.2	39.2	39.2	39.2	39.2	39.2
	Cloon	4.3	4.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3	8.3
West	Dalton	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2	43.2
West	Glasmore	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8	0.8
	Salthill	53.3	53.3	53.3	53.3	53.3	53.3	53.3	53.3	53.3	46.1
	Screeb	3.0	3.0	3.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Tawnaghmore	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
	Tonroe	9.5	12.5	14.0	14.0	14.0	14.0	14.0	14.0	14.0	14.0
	West Area Total	194.4	197.4	211.4	242.7	242.7	242.7	242.7	242.7	242.7	235.5

Table D-3 Existing and Committed Distribution-Connected Generation in Ireland (excluding wind)

			Maximum Export Capacity (MEC)									
Area	110 kV Station	Туре	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Binbane	Hydro	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3	4.3
	Crane	PV	-	-	-	4	4	4	4	4	4	4
	Drybridge	Waste to Energy	20	20	20	20	20	20	20	20	20	20
Border	Drybridge	LFG	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229	6.229
	Drybridge	Biogas	-	-	-	3	3	3	3	3	3	3
	Meath Hill	CHP	1	1	1	1	1	1	1	1	1	1
	Shankill	LFG	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	Border Total Are	a	32.2	32.2	32.2	39.2	39.2	39.2	39.2	39.2	39.2	39.2
	Ringsend	Waste to Energy	72	72	72	72	72	72	72	72	72	72
	Ringsend	Diesel	2.5	2.5	2.5	2.5	2.5	72	72	72	2.5	2.5
Dublin	Glasmore	CHP	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7	1.7
	Finglas	CHP	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6	1.6
	Blackrock	CHP	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55	0.55
	Dublin Total Area	a	78.4	78.4	78.4	78.4	78.4	147.9	147.9	147.9	78.4	78.4
	Kilteel	LFG	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77	9.77
Mid-	Griffinrath	Hydro	4	4	4	4	4	4	4	4	4	4
East	Griffinrath	solar	-	-	4	4	4	4	4	4	4	4
	Arklow	Biomass	1	1	1	1	1	1	1	1	1	1
	Mid-East Total A	rea	14.8	14.8	18.8	18.8	18.8	18.8	18.8	18.8	18.8	18.8
	Athlone	PV	-	-	4	4	4	4	4	4	4	4
	Athlone	LFG	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75	0.75
Mid- lands	Navan	CHP	13	13	13	13	13	13	13	13	13	13
lanus	Navan	PV	-	-	-	4	4	4	4	4	4	4
	Thornsberry	СНР	-	-	-	10	10	10	10	10	10	10
	Midlands Total A	\rea	13.8	13.8	17.8	31.8	31.8	31.8	31.8	31.8	31.8	31.8
	Ballydine	Biogas	-	-	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44
	Rathkeale	CHP	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5	6.5
Mid- West	Rathkeale	LFG	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2	3.2
West	Rathkeale	Biogas	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44	0.44
	Tullabrack	Wave	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4	5.4
	Mid-West Total A	\rea	15.5	15.5	16.0	16.0	16.0	16.0	16.0	16.0	16.0	16.0

Table D-3 Existing and Committed Distribution-Connected Generation in Ireland (excluding wind)

			Maximum Export Capacity (MEC)									
Area	110 kV Station	Туре	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027
	Ballybeg	LFG	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26	4.26
	Barrymore	CHP	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8	4.8
	Doon	Hydro	-	-	1	1	1	1	1	1	1	1
South-	Kilkenny	CHP	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5	7.5
East	Kilkenny	Biogas	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18	0.18
	Portlaoise	PV	-	-	4	4	4	4	4	4	4	4
	Portlaoise	Biogas	1	1	1	1	1	1	1	1	1	1
	Wexford	CHP	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
	South-East Tota	l Area	17.9	17.9	22.9	22.9	22.9	22.9	22.9	22.9	22.9	22.9
	Castleview	CHP	2	2	2	2	2	2	2	2	2	2
South-	Dunmanway	CHP	6	6	6	6	6	6	6	6	6	6
West	Knockeragh	Biogas	3	3	3	3	3	3	3	3	3	3
	Midleton	PV	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95	3.95
	South-West Tota	ıl Area	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0	15.0
	Bellacorick	Wave	10	10	10	10	10	10	10	10	10	10
107	Tawnaghmore	Distillate	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3
West	Tawnaghmore	Distillate	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3	52.3
	Tawnaghmore	Biomass	-	-	-	-	54	54	54	54	54	54
	West Total Area		114.6	114.6	114.6	168.6	168.6	168.6	168.6	168.6	168.6	168.6

Table D-4 Existing and Committed Non-Embedded Distribution-Connected Renewables in Northern Ireland (excluding wind)

			Maximum Export Capacity (MEC)									
110 kV Station	Туре	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	
Antrim	PV	23	23	23	23	23	23	23	23	23	23	
Ballymena	PV	6	6	6	6	6	6	6	6	6	6	
Coolkeeragh	Biomass	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6	17.6	
Dungannon	PV	4	4	4	4	4	4	4	4	4	4	
Lisburn	PV	59	59	59	59	59	59	59	59	59	59	
Rasharkin	PV	35	35	35	35	35	35	35	35	35	35	
Rosebank	Biomass	10	10	10	10	10	10	10	10	10	10	
Waringstown	PV	9	9	9	9	9	9	9	9	9	9	
Northern Ireland Total		163.6	163.6	163.6	163.6	163.6	163.6	163.6	163.6	163.6	163.6	

Table D-5 Existing and Proposed Northern Ireland Generating Plant Contract Details

			Contract
Generation Unit	Fuel Type	Туре	Details
Ballylumford ST 4	GAS/HFO	IPP	See Note 1
Ballylumford ST 5	GAS/HFO	IPP	See Note 1
Ballylumford CCGT 21	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford CCGT 22	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford CCGT 20	STEAM	Power NI (PPB)	See Note 2
Ballylumford CCGT 10	GAS/GASOIL	Power NI (PPB)	See Note 2
Ballylumford GT 7	GASOIL	IPP	Independent from 01/11/12
Ballylumford GT 8	GASOIL	IPP	Independent from 01/11/12
Kilroot ST 1	COAL/OIL	IPP	Independent from 01/11/10
Kilroot ST 2	COAL/OIL	IPP	Independent from 01/11/10
Kilroot GT 1	GASOIL	IPP	Independent from 01/11/12
Kilroot GT 2	GASOIL	IPP	Independent from 01/11/12
Kilroot GT 3	GASOIL	IPP	Commenced Operation 01/03/2009
Kilroot GT 4	GASOIL	IPP	Commenced Operation 01/03/2009
Coolkeeragh GT8	GASOIL	IPP	Independent from 01/02/2013
Coolkeeragh CCGT	GAS/GASOIL	IPP	Commenced Operation 01/04/2005
Moyle	DC LINK		See Note 3

NOTE 1: This is an independent Power Producer (IPP). Ballylumford ST₄ and ST₅ are contracted to provide a total capacity of 250 MW of local reserve until the end of 2018.

NOTE 2: In a Generator Unit Agreement (GUA) with Power NI Energy Limited's Power Procurement Business (PPB). The contract expiry date is 23rd September 2018 (with a five year extension option)¹²³.

NOTE 3: Capacity is auctioned regularly (daily, monthly, seasonally and annually) to the market participants. Capacity is also available in ISEM through implicit auction process.

D.2 Generation Dispatch Details

Table D-6 through to Table D-7 lists generation dispatch profiles. These dispatch profiles are used for the purposes of the short circuit current level analyses and power flow diagrams. In the tables the SV column represents the dispatch at summer valley, SP denotes the summer peak dispatch and WP denotes the winter peak dispatch.

For the purpose of short circuit current level studies, wind farms were dispatched at 10% of their rated capacity for winter peak cases. Wind farms were not dispatched in summer valley cases. These dispatches are given in Table D-6.

For the purpose of power flow diagram dispatches, wind farms were dispatched at 30% of their rated capacity for winter peak and summer peak cases. Wind farms were dispatched at 10% for summer valley cases. These dispatches are given in Table D-7.

The values shown are in exported terms. They are the net of each generation unit's own consumption. They indicate the power delivered to the transmission system.

¹²³ https://www.uregni.gov.uk/sites/uregni.gov.uk/files/media-files/2014-10-10 GUA Decision Paper.pdf

In all winter peak short circuit current level studies, all units not included in the dispatch in Table D-6 were synchronised to the system but dispatched at o MW. In all other dispatch profiles, unless a MW value is provided for the generator, the unit is not dispatched and not synchronised to the system.

It should be noted that station demand projections are developed from the system demand forecasts on a top-down basis. The projections use a forecast of transmission losses. The transmission loss figures calculated by the network models used in this TYTFS may differ from the forecast figures. Hence the dispatch totals may differ from the system demand forecasts in Table 3-1 in Chapter 3.

Table D-6 Dispatch Profiles - Short Circuit

			20	18	20	21	20	24
Area	Generation Station	Unit ID	SV	WP	SV	WP	SV	WP
	Clady Hydro	-		4.3		4.3		4.3
	Erne Cliff Hydro (1)	ER1		10		10		10
	Erne Cliff Hydro (2)	ER2		10		10		10
	Erne Cathleens Fall Hydro (3)	ER3		22		22		22
	Erne Cathleens Fall Hydro (4)	ER4		23		23		23
	Whiteriver Landfill Gas to Energy	-	1	1.3		1.2		12
Border	Rathdrinagh Biogas	-				3		3
	Bailie Foods CHP	-		1		1		1
	Corranure LFG	-		0.7				
	Meath Waste-Energy	IW1	20	20	20	20	20	3
	Knockharley Landfill (1)	-		1.4		1.4		1.4
	Knockharley Landfill (2)	-		3.5		3.5		3.5
	Installed Wind	-		244		350		423
	Border Area Total		21.0	341.2	20.0	449.4	20.0	516.2
	Kilbush Nurseries CHP	-		1.5		1.6		1.5
	Huntstown	HN1	220	225	210	210	230	230
	Huntstown	HNo	100	115	100	110	120	120
	Huntstown	HN2		400		350		390
	Dublin Bay Power	DB1		400	200	300	250	300
Dublin	North Wall	NW5						
Dubliii	Dublin Waste to Energy Facility	DW1	50	72	70	72	72	72
	Poolbeg	PB14	127					
	Elm Park Development	-		0.2		0.2		0.2
	Elm Park Development	-		0.3		0.3		0.3
	Keelings CHP	-		1.7		1.7		1.7
	Installed Wind	-		1.4		5.5		5.5
	Dublin Area Total		497.0	1217.1	580.0	1051.3	672.0	1121.2

Table D-6 Dispatch Profiles -Short Circuit

			20	18	20	21	2024	
Area	Generation Station	Unit ID	SV	WP	SV	WP	SV	WP
	Aughrim Energy	-		1				
	Leixlip Hydro	-		4		4		4
	Arthurstown LFG	-		9.5		9.5		9
	Liffey Hydro (1)	Ll1		15		15		15
	Liffey Hydro (2)	Ll2		15		15		15
	Liffey Hydro (4)	LI4		4		4		4
Mid-East	Turlough Hill (1)	TH1	-75	65	-75	70	-75	70
	Turlough Hill (2)	TH2	-75	65	-75	70	-75	70
	Turlough Hill (3)	TH ₃	-75	65	-75	70	-75	70
	Turlough Hill (4)	TH4	-75	65	-75	70	-75	70
	East West Interconnector	EW1	100	300	100	300	100	300
	Installed Wind	-		24		35		35
	Mid-East Area Total		-200.0	632.5	-200.0	662.5	-200.0	662.0
	Edenderry Power	ED1	90	110	120	110	120	130
	Lough Ree Power	LR4	90	70	90	100	80	100
Midlands	Connaught Regional Residual Landfill	-		0.8		0.8		0.8
	West Offaly Power	WO ₄	130	140	120	120	110	150
	Shamrock Renewable Fuels	-		13		13		13
	Installed Wind	-		49		55		55
	Midlands Area Total		310.0	382.8	330.0	398.8	310.0	448.8
	Ardnacrusha Hydro (1)	AA1		21		21		21
	Ardnacrusha Hydro (2)	AA2		22		22		22
	Ardnacrusha Hydro (3)	AA3		19		19		19
	Ardnacrusha Hydro (4)	AA4		24		24		24
	Moneypoint (1)	MP1	220	232	220	250	200	250
	Moneypoint (2)	MP2		235	220	250	200	250
	Moneypoint (3)	MP3		235	220	250	200	250
Mid-West	Pfizer Askeaton (Wyeth)	-		6.5		6.5		6
	Aughinish	SK ₃	69	80	81	81	81	81
	Aughinish	SK4	69	80	81	81	81	81
	WestWave Killard	-				5.4		5.4
	R & L Dowley Biogas	-				0.4		0.4
	Gortadroma Landfill Gas	-		0.4				0.4
	McDonnell Farms Biogas	-		3.2				3.2
	Installed Wind	-		223		304		311
	Mid-West Area Total		358.0	1181.1	822.0	1314.3	762.0	1324.4

Table D-6 Dispatch Profiles -Short Circuit

			2018		20	21	2024	
Area	Generation Station	Unit ID	SV	WP	SV	WP	SV	WP
	Glasha Hydro	-				1		
	Great Island CCGT	GI4	300	410	270	400	300	350
	Glanbia Ballyraggett CHP	-		7.5		7.5		7
	Ballytobin Biogas	-		0.2		0.2		0.2
South-East	Gorteen Lower	-		1		1		1
	Ballyshannon Farms	-		0.2		0.2		0.2
	Ballynagran (1)	-		0.8		0.8		0.8
	Ballynagran (2)	-		3.5		3.5		3.5
	Installed Wind	-		99		125		136
	South-East Area Total		300.0	522.2	270.0	539.2	300.0	498.7
	Aghada CCGT	ADC				314		300
	Aghada	AT11				270		250
	Dairygold Mitchelstown	-		4.8		4.8		4.5
	Lee Carrigadrohid Hydro	LE1		8		8		8
	FMC Gas Turbine Ext.	-		2		2		2
South-West	Carbery Milk Products CHP	-		6		6		6
	Whitegate CCGT	WG		400			300	370
	Lee Inniscarra Hydro (1)	LE2		15		15		15
	Lee Inniscarra Hydro (2)	LE3		4		4		4
	Adambridge Manufacturers	-		3		3		3
	Installed Wind	-		377		509		521
	South-West Area Total		0.0	819.8	0.0	1135.8	300.0	1483.5
	Tynagh	TY1	155			200		219
	Tynagh	TY2	111					125
West	Mayo Renewable Power Biomass CHP	MB1					48	49
	Installed Wind	-		155		234		277
	West Area Total		266.0	155.0	0.0	434.0	48.0	670.0
	Ballylumford CCGT 10	B10	80	100	79	100		100
	Ballylumford CCGT 20	B20		170				170
	Ballylumford 4	B31	110	160		160	150	160
	Ballylumford 5	B32	110	160		160		160
	Coolkeeragh GT	C20	130	260	235	260	240	260
Northern	Coolkeeragh ST	C10	200	160	140	170	150	170
Ireland	Coolkeeragh GT8	CGT8						25
	Kilroot 1	K1	150	165	140	150		
	Kilroot 2	K2		165	140	150		
	Moyle Interconnector	MW1	80	80	80	100	80	80
	Rosebank Biomass	-		3				
	Installed Wind			367		370		377
	Northern Ireland Area Total		860.0	1790.0	814.0	1620.0	620.0	1502.0

Table D-7 Dispatch Profiles – Power Flow Diagrams

				2018		2027			
Area	Generation Station	Unit ID	SV	WP		SV	WP		
	Clady Hydro	-			4.3	4.3	4.3	4.3	
	Erne Cliff Hydro (1)	ER1		10	10	10	10	10	
	Erne Cliff Hydro (2)	ER2		10	10	10	10	10	
	Erne Cathleens Fall Hydro (3)	ER3		22	22	22	22	22	
	Erne Cathleens Fall Hydro (4)	ER4		23	23	23	23	23	
	Whiteriver Landfill Gas to Energy	-	1		1.2		1.2	1.2	
Border	Rathdrinagh Biogas	-					3	3	
	Bailie Foods CHP	-			1		1		
	Corranure LFG	-			0.9				
	Meath Waste-Energy	IW1	20		20		20	20	
	Knockharley Landfill (1)	-			1.4		1.4		
	Knockharley Landfill (2)	-			3.5		3		
	Installed Wind	-	0	218.4	244		422.8	422.8	
	Border Area Total		21.0	283.4	341.3	69.3	521.7	516.3	
	Kilbush Nurseries CHP	-			1.5		1		
	Huntstown	HN1	220		225	230	229	236	
	Huntstown	HNo	100		115	120	123	129	
	Huntstown	HN2			400			380	
	Dublin Bay Power	DB1		288	400	220	300	390	
Dublin	Dublin Waste to Energy Facility	DW1	50		72		72	72	
	Poolbeg	PBC	127				150	470	
	Elm Park Development	-			0.22		0.22		
	Elm Park Development	-			0.33		0.33		
	Keelings CHP	-			1.7		1.7		
	Installed Wind	-	0	1.4	1.4	0	5.5	5.5	
	Dublin Area Total		497.0	289.4	1217.2	570.0	882.8	1682.5	
	Leixlip Hydro	-			4	4	4	4	
	Arthurstown LFG	-			9.5		9		
	Liffey Hydro (1)	Ll1		15	15	15	15	15	
	Liffey Hydro (2)	Ll2		15	15	15	15	15	
	Liffey Hydro (4)	LI4			4	4	4		
Mid-East	Turlough Hill (1)	TH1	-75	40	65		70	70	
	Turlough Hill (2)	TH2	-75	40	65		70	70	
	Turlough Hill (3)	TH ₃	-75	40	65		70	70	
	Turlough Hill (4)	TH4	-75	40	65		70	70	
	East West Interconnector	EW1	100	200	300	-200	200	400	
	Installed Wind	-	0	18.5	23.9	0	35	35	
	Mid-East Area Total		-200.0	408.5	631.4	-162.0	562.0	749.0	

Table D-7 Dispatch Profiles – Power Flow Diagrams

			2018				2027	
Area	Generation Station	Unit ID	SV	WP		SV	WP	
	Edenderry Power	ED1	90	130	110	130	100	
	Lough Ree Power	LR4	90	100	70	100	80	
Midlands	Connaught Regional Residual Landfill	-			0.75		0.75	
	West Offaly Power	WO4	130	150	140	150		
	Shamrock Renewable Fuels	-			130		13	
	Installed Wind	-	0	48.8	48.8	0	55.1	55.1
	Midlands Area Total		310.0	428.8	499.6	380.0	248.9	55.1
	Ardnacrusha Hydro (1)	AA1		21	21	21	21	21
	Ardnacrusha Hydro (2)	AA2		22	22	22	22	22
	Ardnacrusha Hydro (3)	AA3		19	19	19	19	19
	Ardnacrusha Hydro (4)	AA4		24	24	24	24	24
	Moneypoint (1)	MP1	220	280	232	220	200	220
	Moneypoint (2)	MP2		280	235	150		128
	Moneypoint (3)	MP3		280	235			
Mid-West	Pfizer Askeaton (Wyeth)	-			6.5		6	
	Aughinish	SK ₃	69		80	81	81	81
	Aughinish	SK4	69		80	81	81	81
	WestWave Killard	-					5.4	5.4
	R & L Dowley Biogas	-						
	Gortadroma Landfill Gas	-			0.44		3.2	
	McDonnell Farms Biogas	-			3.2		0.44	
	Installed Wind	-	0	189.2	222.5	0	311.2	311.2
	Mid-West Area Total		358.0	1115.2	1180.6	618.0	774.2	912.6
	Glasha Hydro	-						1
	Great Island CCGT	GI4	300	380	410	250	350	440
	Glanbia Ballyraggett CHP	-			7.5		7	7
	Ballytobin Biogas	-			0.18			
South-East	Gorteen Lower	-			1		1	
	Ballyshannon Farms	-			0.15		0.15	
	Ballynagran (1)	-			0.75		0.75	
	Ballynagran (2)	-			3.5		3.5	
	Installed Wind	-	0	80.9	98.6	О	135.6	135.6
	South-East Area Total		358.0	1115.2	1180.6	618.0	774.2	912.6


Table D-7 Dispatch Profiles – Power Flow Diagrams

				2018		2027			
Area	Generation Station	Unit ID	SV	WP		SV	WP		
	Aghada CCGT	AD2		380			350	420	
	Aghada	AD1						250	
	Aghada	AT1						90	
	Aghada	AT2						90	
	Aghada	AT4						90	
	Dairygold Mitchelstown	-			4.8		4.8		
Carable Wash	Lee Carrigadrohid Hydro	LE1		8	8	8	8	8	
South-West	FMC Gas Turbine Ext.	-			2		2		
	Carbery Milk Products CHP	-			6		6	6	
	Whitegate CCGT	WG		380	400	200	300	430	
	Lee Inniscarra Hydro (1)	LE ₂		15	15	15	15	15	
	Lee Inniscarra Hydro (2)	LE ₃			4	4	4	4	
	Adambridge Manufacturers	-		3	3		3		
	Installed Wind	-	0	349.2	388	О	521.3	521.3	
	South-West Area Total		0.0	1135.2	830.8	227.0	1214.1	1924.3	
	Tynagh	TY1	155			200	268	268	
	Tynagh	TY2	111			86	142	142	
West	Mayo Renewable Power Biomass CHP	MB1					49	49	
	Installed Wind	-		117.5	155.3	О	276.8	276.8	
	West Area Total		266.0	117.5	155.3	286.0	735.8	735.8	
	Ballylumford CCGT 10	B10	80	160	170	170	178	178	
	Ballylumford CCGT 20	B20		65	100	100	100	100	
	Ballylumford 4	B31	110		160				
	Ballylumford 5	B32	110		160				
	Coolkeeragh GT	C20	200	260	260	160	200	260	
Northern	Coolkeeragh ST	C10	130	140	160	100	130	150	
Ireland	Kilroot 1	K1	150	175	165				
	Kilroot 2	K2		175	165				
	Lisahally Biomass			17	17	11	17.6	17.6	
	Moyle Interconnector	MW1	80		80	80	200	95	
	Rosebank Biomass	-			3	10	10	10	
	Installed Wind		0	334.5	356	0	376.5	376.5	
	Northern Ireland Area Total		860.0	1326.5	1796.0	631.0	1212.1	1187.1	

All-Island Ten Year

Transmission Forecast Statement 2018

Appendix E

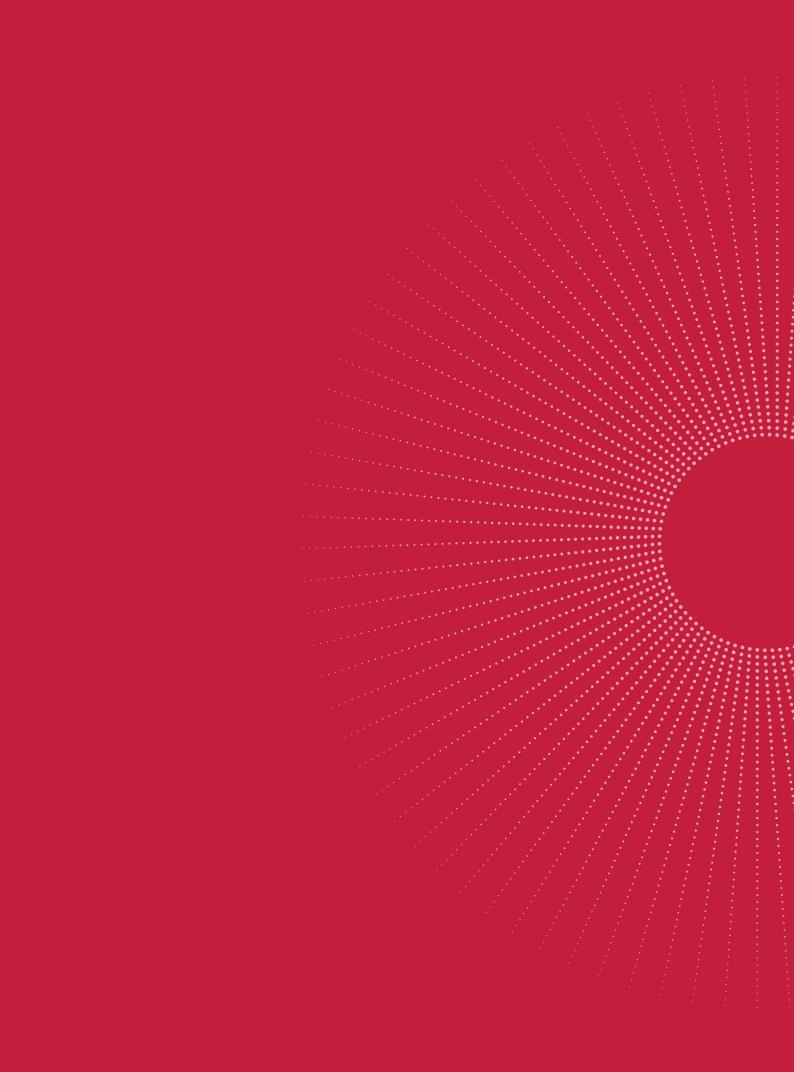

Appendix E Short Circuit Currents

E.1 Background of Short Circuit Currents

The main driver for calculating short circuit current levels is safety. All transmission system equipment must be capable of carrying very high currents. These high currents typically occur in the event of a short circuit fault. In particular, circuit breakers must be capable of closing onto a fault and opening to isolate a fault.

Their correct operation minimises risk to human life and prevents damage to transmission system equipment. It is also crucial for maintaining transmission system stability, security and quality of supply.

Short circuit current levels also give an indication of the electrical strength of the transmission system at each station. This provides an indication of the suitability of a station for connection of 'voltage sensitive' equipment.

A station with a high short circuit current level will be more attractive to these types of load. This is due to strong generation infeeds minimising distortions in voltage and frequency caused by transmission system disturbances. Similarly, generators will have less difficulty to ride through faults and maintain stability when connected to stations with high short circuit current levels.

Short circuit current levels vary across the transmission system. They are affected by the transmission system topology, system impedance and the available short circuit contribution from rotating machines (i.e. generators and large motors). Changes in the transmission system topology or the addition/retirement of generation units can bring about an increase/reduction in the short circuit current levels on the transmission system. Similarly, seasonal variations in generation dispatches and demand levels combined with possible transmission system sectionalising or plant outages will result in variations of short circuit current levels at different locations. To ensure safe and reliable operation of the transmission system and customer's equipment at all times, two types of short circuit current level calculations are carried out:

- Maximum short circuit current levels are required for the specification of transmission system equipment and for connections to the transmission system. Plant in substations is typically subjected to the most onerous short circuit currents. The high capital costs of HV equipment means that it is important to predict the maximum short circuit current the equipment may see in its lifetime, and this must be specified to a rating above the maximum expected short circuit current level. Also, for customers, the design and specification of equipment at lower voltage levels will depend on the short circuit level at the transmission connection point.
- Minimum short circuit current levels are required to guarantee reliable and coordinated
 operation of protection systems or to assess the suitability of a station for the connection of
 'voltage sensitive' equipment. Minimum short circuit current levels are also required at the
 design stage of generation plants to ensure fault ride through capabilities are in accordance
 with Grid Code requirements.

E.1.1. The Nature of Short Circuit Currents

The plot in Figure E-1 shows a typical short circuit current waveform. Short circuit current is normally made up of a symmetrical AC component, with a decay rate, and a DC offset component, which has a much faster decay rate. The combination of AC and DC components results in an asymmetrical current waveform.

While the AC component is always present in the short circuit current, the DC offset is dependent on the instant that the fault occurs within the voltage waveform. For the purposes of this document, it is assumed that the fault occurs at the instant of maximum DC offset in the short circuit current.

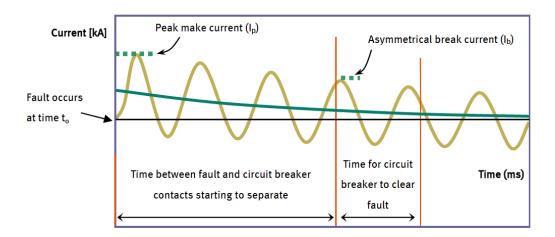


Figure E-1 Typical Short Circuit Current

The DC component of a short circuit current decays exponentially. Its rate of decay is influenced by the individual ratios of the reactance (X) to the resistance (R) of the paths back to the generators feeding power to the fault (the X/R ratio). Transmission nodes where large generators can have high X/R ratios, which may result in a slower decay time for the DC component of the short circuit current.

The AC component of a short circuit current also decays with time. This is due to the changes in the synchronous generators internal reactance and, thus, the AC reduction effect is more pronounced in the vicinity of large generation plants. The internal impedance of a synchronous generator is not constant after the start of the fault. It increases progressively and the short circuit current contribution becomes weaker, passing through three characteristic stages:

- Subtransient: (approx. 0.01 to 0.1 sec). Short-circuit current (RMS value of the AC component) is high: 5 to 10 times permanent rated current. This is called sub-transient short-circuit current, I_k ".
- Transient: (between 0.1 and 1 sec). Short-circuit current (RMS value of the AC component) drops to between 2 and 6 times rated current. This is called transient short-circuit current, I_{\(\beta\)}.
- Continuous: Short-circuit current (RMS value of the AC component) drops to between 0.5 and 2 times rated current. This is called steady-state short-circuit current, I_v.

E.1.2. Duty of Circuit Breakers

Over the duration of a fault the switchgear has to be able to withstand two events, namely the fault initiation and then the fault clearance. The short circuit currents at these two instances are referred to as the make current and the break current respectively.

i. The make current (Ip) is the maximum instantaneous current that the circuit breaker is called to withstand. The initiation of a fault causes an instantaneous peak current which results in the generation of electromechanical forces along the busbars and transmission lines. An example of such a fault initiation would be a circuit breaker energising a line that is still earthed following maintenance, hence the term make current.

Make current is expressed in peak values and is comprised of an AC and a DC component. Essentially, the make current is the maximum instantaneous peak of the short circuit current waveform, and this will occur at approximately 10 milliseconds (ms) after the instant of fault (see Figure E-1), whether the fault is energised through a circuit breaker or it spontaneously occurs on the transmission system. Circuit breakers are typically rated approximately 2.5 times higher for make duty than for break duty, as per IEC 62271-100 standard.

ii. After the fault initiation, there is a time period during which the protection scheme will identify the fault, make a decision and then instruct the relevant circuit breaker to open to interrupt the fault. This could take anything from 10 ms in modern fast protection systems to 60 ms in older systems. At this point the circuit breaker begins to open and it takes a certain time period before the contacts actually separate, normally around two cycles or 40 ms in modern switchgear equipment. The total time from the start of the fault until the breaker opening or fault clearance time can vary from 50 ms to 120 ms, depending on the protection system. In some cases; if main protection fails and back-up main protection is not installed; clearance times can be considerably longer than 120 ms.

At the point of physical separation, the short circuit current forms an arc and the thermal energy generated by this arc has to be dissipated as the short circuit current is interrupted. The short circuit current when this interruption occurs is referred to as the break current, lb. This value is expressed in RMS (root mean square) terms and is comprised of an AC component and a DC component. Circuit breakers designed and tested in accordance with the IEC 62271-100 standard can interrupt any short circuit current up to its rated breaking current containing any AC component up to the rated value and, associated with it, any percentage DC component up to that specified (typically 30%).

The duty of the circuit breaker is calculated from the make and break current as a percentage of the circuit breaker rating.

E.2 Short Circuit Current Calculation Methodology

Engineering Recommendation G74 has been applied to all short circuit studies reported in this document. Some of the general assumptions applied include:

- Short circuit level contribution from loads has been considered following G74
 recommendations. The demand at each node is assumed to contribute 1 MVA of induction motor
 fault infeed per MW of load. A constant X/R ratio of 2.76 is assumed for all of the loads; and
- A break time of 50 ms is assumed typical for the circuit breakers at 110 kV, 220 kV, 275 kV and 400 kV.

Winter Peak study results give an indication of the maximum prospective short circuit current levels on the transmission system. For winter peak studies, all generators have been included in the calculations. A merit order economic dispatch has been used and to enable maximum short circuit current level to be calculated, any generators that were not dispatched have been switched in with o MW output, thus contributing to short circuit current levels.

Summer Night Valley study results give an indication of the minimum short circuit current levels to be expected on the transmission system under normal transmission system operating conditions (i.e. maintenance outages are not considered in this section¹²⁴). For summer night valley studies, only generators dispatched on a merit order are considered in the model.

E.3 Short Circuit Currents in Ireland

E.3.1. Methodology used in Ireland

Short circuit current levels are calculated in accordance with the UK Engineering Recommendation G74, which is a computer based analysis, based on the International Standard IEC60909. Compliance with G74 includes:

 Short circuit contributions from rotating plant, including induction motors embedded in the general load;

¹²⁴ Minimum fault levels including maintenance outages are currently provided to generator applicants wishing to connect to the transmission system as part of the connection offer process to allow developers to design the plant in accordance with the Grid Code requirements.

- Comprehensive plant parameters including impedances, transformer winding and earthing configurations;
- Pre-fault voltage levels at each node which should be obtained from a credible, pre-fault load flow study; and
- Pre-fault transformer tap settings should also be obtained from the load flow study.

The short circuit current level network model includes the following component parameters:

- Transformer impedance variation with tap position;
- Zero sequence mutual coupling effect;
- Saturated generator reactance values; and
- Power station auxiliaries short circuit current level contributions.

The calculation of the X/R ratios, used by EirGrid, is undertaken in accordance with IEC60909-0 Method B. Method B is currently considered to be the most appropriate general purpose method for calculating DC short circuit currents in the transmission system of Ireland. The use of this calculation method is currently under review by EirGrid.

The transmission system of Ireland is designed and operated to maintain RMS break short circuit levels in accordance with EirGrid Grid Code CC.8.6. A summary of these requirements is set out in Table E-1. In designing the system, a 10% safety margin is applied.

It should be noted that the EirGrid Grid Code stipulates that short circuit current levels at designated stations in Ireland may be allowed to increase to 31.5 kA. If necessary, the equipment at these stations is to be modified or replaced in order to comply with this new rating. The stations currently designated for operation of the 110 kV equipment up to 31.5 kA are: Barnahely, Cloghran, College Park, Corduff, Finglas, Kilbarry, Knockraha, Louth, Marina, Raffeen, Tarbert and Trabeg. EirGrid will annually publish an updated list of designated stations.

Circuit breakers with a higher rating than the current levels may be necessary for a number of reasons, including, but not limited to the need to provide an adequate safety margin or to cater for a high DC component in the short circuit current.

 Voltage Level (kV)
 Short Circuit Current Levels (kA)

 400
 50

 220
 40

 110
 Countrywide
 25

 Designated sites
 31.5

Table E-1 Ireland Short Circuit Current Levels Specified in the Grid Code

E.3.2. Analysis

The generation dispatches used in the short circuit analysis are shown in Table D-6 in Appendix D.

The total RMS break current at a busbar is an indication of the short circuit level that one could expect at that point in the transmission system. However, they do not necessarily represent the short circuit current that could flow through each individual breaker, which may be lower.

E.3.3. Ireland Short Circuit Currents Level Results

Tables E-2 to E-4 list subtransient (I_k ''), transient (I_k ') currents and X/R ratios for single-phase to earth and balanced three-phase faults for transmission system busbars of Ireland. These are presented for maximum winter peak and minimum summer valley intact system demand conditions for 2018, 2021 and 2024. From these values, the relevant currents required to assess circuit breaker duty can be derived using the following equations:

Peak make current (I_n)

$$I_p = \sqrt{2} \cdot \left[1.02 + 0.98 \cdot e^{-3 \cdot \frac{R}{X}} \right] \cdot I_k''$$

• AC component $(I_{RMS_AC_b})$ of short-circuit current at a selected time of break (t_b)

$$I_{RMS_AC_b} = I_{k}' + (I_{k}'' - I_{k}') \cdot e^{-\frac{t_{b}}{40ms}}$$

• DC component (I_{DC_b}) of short-circuit current at a selected time of break (t_b)

$$I_{DC_b} = \sqrt{2} \cdot I_k \cdot e^{-2 \cdot \pi \cdot 50 t_b \cdot \frac{R}{X}}$$

• Break current (I_b) at a selected time of break (t_b)

$$I_b = \sqrt{I_{DC_b}^2 + I_{RMS_AC_b}^2}$$

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer						Winter						
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Single Phase			
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	
Adamstown 110 kV	15.46	10.68	9.53	10.39	12.05	11.52	15.75	13.41	11.71	10.09	14.35	13.63	
Agannygal 110 kV	2.82	4.92	4.74	3.89	4.17	4.12	2.96	6.45	5.79	4.24	4.93	4.79	
Aghada 110 kV	4.79	6.50	6.06	5.51	8.04	7.81	4.59	10.03	9.54	5.65	11.31	11.09	
Aghada A 220 kV	6.80	5.52	5.08	7.23	7.52	7.23	12.49	18.48	16.51	13.70	20.65	19.74	
Aghada B 220 kV	7.26	5.56	5.12	7.34	7.57	7.28	13.36	17.86	15.99	11.47	20.21	19.33	
Aghada C 220 kV	6.79	5.46	5.03	7.10	7.43	7.15	12.09	17.90	16.03	12.20	20.07	19.21	
Aghada D 220 kV	6.79	5.46	5.03	7.10	7.43	7.15	12.09	17.90	16.03	12.20	20.07	19.21	
Ahane 110 kV	5.76	10.18	9.30	6.20	9.14	8.89	5.00	14.78	13.72	5.79	11.27	11.05	
Anner 110 kV	4.21	5.74	5.38	4.60	4.47	4.40	4.02	7.32	6.79	4.54	5.05	4.96	
Ardnacrusha 110 kV	6.52	11.21	10.13	7.64	12.70	12.21	6.51	18.36	16.44	8.15	17.98	17.32	
Arigna 110 kV	3.72	6.03	5.77	4.72	4.78	4.72	4.76	8.41	7.63	5.91	6.08	5.94	
Arklow 110 kV	10.68	7.24	6.88	11.43	8.91	8.72	10.91	9.45	8.78	11.74	11.06	10.73	
Arklow 220 kV	9.28	6.59	6.20	10.55	6.35	6.22	8.91	8.50	8.08	10.37	7.56	7.45	
Artane 110 kV	13.95	10.12	9.36	6.32	12.14	11.76	13.30	13.09	11.93	5.70	15.14	14.59	
Arva 110 kV	3.87	8.01	7.55	4.95	6.51	6.41	3.88	10.28	9.29	5.14	7.48	7.29	
Athea 110 kV	9.53	5.54	5.33	10.14	6.20	6.11	9.60	8.40	7.36	10.37	8.33	7.96	
Athlone 110 kV	4.42	7.26	6.81	5.76	5.56	5.47	4.09	8.42	7.81	5.54	5.96	5.85	
Athy 110 kV	3.30	5.51	5.28	4.43	4.65	4.60	3.05	6.72	6.35	4.28	5.31	5.23	
Aughinish 110 kV	9.55	9.38	8.24	11.51	10.42	9.91	8.05	10.86	9.81	10.07	11.30	10.89	
Ballybeg 110 kV	10.25	5.45	5.21	10.59	6.46	6.35	10.37	6.60	6.23	10.71	7.55	7.38	
Ballydine 110 kV	4.24	6.35	5.97	3.88	5.31	5.21	3.99	7.99	7.47	3.74	6.02	5.91	
Ballylickey 110 kV	2.97	2.86	2.75	4.00	1.93	1.91	2.99	3.81	3.60	4.14	2.13	2.11	
Ballynahulla 110 kV	11.44	6.39	6.08	11.27	7.22	7.08	14.06	11.32	9.94	12.50	10.62	10.17	
Ballynahulla 220 kV	7.72	5.04	4.74	7.99	6.00	5.85	8.25	9.39	8.61	8.44	9.44	9.16	
Ballyvouskill 110 kV	11.14	6.44	6.10	11.37	7.88	7.70	13.85	10.82	9.74	13.28	11.67	11.22	
Ballyvouskill 220 kV	7.52	5.07	4.73	8.06	6.60	6.40	8.33	9.87	9.06	9.13	11.32	10.94	
Ballywater 110 kV	4.72	4.85	4.69	3.36	5.17	5.10	4.66	6.16	5.81	3.20	6.04	5.93	
Baltrasna 110 kV	6.41	9.51	8.90	7.45	7.53	7.40	5.90	10.93	10.36	7.13	8.29	8.18	
Bancroft 110 kV	13.86	7.51	6.93	9.12	8.05	7.81	13.86	8.98	8.25	8.83	9.23	8.95	
Bandon 110 kV	3.54	5.15	4.79	4.45	5.32	5.19	3.15	7.58	6.99	4.37	6.83	6.66	
Banoge 110 kV	6.24	5.29	5.09	6.94	4.90	4.84	6.00	6.54	6.14	6.81	5.59	5.49	
Barnahealy A 110 kV	4.89	8.06	7.39	5.39	9.30	8.98	4.54	14.21	13.20	5.37	13.96	13.61	
Barnahealy B 110 kV	6.12	7.95	7.29	6.62	9.09	8.78	6.52	14.14	13.07	7.21	13.57	13.22	
Barnakyle 110 kV	2.89	4.75	4.57	4.16	4.18	4.14	2.74	5.41	5.07	4.09	4.49	4.41	
Baroda 110 kV	4.21	7.58	7.11	5.00	8.82	8.60	3.92	9.69	9.03	4.75	10.72	10.44	
Barrymore 110 kV	4.07	6.20	5.81	4.95	4.26	4.19	3.74	8.91	8.43	4.93	4.93	4.88	
Belcamp 110 kV	-	-	-	-	-	-	37.65	7.33	7.15	31.87	7.42	7.36	
Belcamp 220 kV	-	-	-	-	-	-	11.88	22.62	20.07	9.30	25.62	24.41	
Belgard 110 kV	12.27	11.13	10.13	7.06	13.68	13.14	12.06	13.62	12.47	6.60	16.32	15.73	
Bellacorick 110 kV	2.88	2.97	2.87	3.39	3.27	3.23	3.86	4.69	4.27	4.47	4.53	4.39	
Binbane 110 kV	3.17	3.44	3.31	4.28	3.41	3.36	3.42	5.18	4.67	4.98	4.33	4.20	
Blackrock 110 kV	10.38	11.52	10.53	2.58	11.29	10.96	9.94	14.17	12.69	2.39	12.95	12.51	
Blake 110 kV	4.14	7.27	6.87	5.10	5.12	5.05	3.90	8.98	8.48	4.99	5.87	5.80	

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer						Winter						
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se	
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	
Boggeragh 110 kV	6.11	5.56	5.26	7.06	6.27	6.14	6.77	8.88	8.16	8.02	8.66	8.42	
Booltiagh 110 kV	6.51	6.23	5.94	8.01	5.52	5.44	7.00	9.23	8.40	8.80	6.88	6.72	
Bracklone 110 kV	-	-	-	-	-	-	3.67	9.32	8.69	4.81	8.28	8.11	
Brinny A 110 kV	3.39	4.72	4.42	4.30	4.52	4.43	3.02	6.68	6.22	4.20	5.55	5.44	
Brinny B 110 kV	3.39	4.74	4.44	4.30	4.55	4.45	3.01	6.72	6.25	4.20	5.60	5.48	
Bunkimalta 110 kV	5.38	5.01	4.77	5.60	5.30	5.21	5.10	6.07	5.80	5.41	6.14	6.04	
Butlerstown 110 kV	6.27	8.91	8.34	5.91	9.36	9.14	5.52	11.38	10.55	5.40	11.15	10.86	
Cabra 110 kV	12.88	9.79	9.08	5.12	10.97	10.65	12.18	12.61	11.51	4.62	13.46	13.01	
Cahir 110 kV	4.64	7.03	6.54	5.55	6.16	6.03	4.59	10.33	9.37	5.73	7.48	7.30	
Carlow 110 kV	5.34	7.24	6.87	6.07	7.99	7.83	5.21	9.46	8.71	6.03	9.71	9.43	
Carrickmines 220 kV	13.39	13.56	11.94	9.51	16.93	16.00	13.87	22.33	19.81	8.39	25.65	24.42	
Carrickmines A 110 kV	25.75	10.47	9.68	21.42	11.70	11.35	31.63	13.13	12.10	23.55	13.95	13.54	
Carrickmines B 110 kV	20.88	8.00	7.36	17.98	8.66	8.40	22.50	9.66	8.86	18.54	10.01	9.70	
Carrick-on-Shannon	4.34	9.69	9.05	5.03	10.68	10.41	4.29	13.08	11.80	5.15	13.33	12.86	
Carrigadrohid 110 kV	6.24	8.09	7.44	6.74	8.26	8.02	6.25	14.09	12.95	6.93	11.49	11.22	
Carrowbeg 110 kV	2.61	2.40	2.31	3.46	2.31	2.28	2.71	3.07	2.81	3.71	2.72	2.65	
Cashla 110 kV	7.70	13.56	12.36	8.05	17.26	16.57	7.51	19.54	17.60	7.91	23.47	22.47	
Cashla 220 kV	8.68	9.36	8.57	9.72	9.72	9.42	8.52	12.63	11.82	9.68	12.07	11.80	
Castlebar 110 kV	2.94	3.97	3.77	3.58	4.46	4.38	3.38	5.74	5.05	4.22	5.74	5.49	
Castledockrill 110 kV	6.98	6.30	6.05	5.00	7.70	7.57	6.92	8.18	7.70	4.70	9.30	9.09	
Castlefarm A 110 kV	8.52	9.05	7.98	9.90	9.71	9.26	7.23	10.44	9.46	8.76	10.50	10.15	
Castlefarm B 110 kV	8.54	9.04	7.96	9.91	9.70	9.25	7.25	10.42	9.44	8.78	10.49	10.14	
Castleview 110 kV	4.42	8.20	7.52	4.78	7.29	7.10	3.76	14.06	13.07	4.51	9.65	9.48	
Cathaleen's Fall 110 kV	4.21	6.32	5.97	4.87	7.22	7.06	5.42	11.79	10.01	6.40	10.93	10.35	
Cauteen 110 kV	5.53	6.10	5.76	6.38	4.27	4.22	5.95	9.39	8.57	6.75	5.11		
Central 110 kV	14.11	9.65	8.97	7.90	10.57	10.28	14.37	11.94	11.06	7.54	12.44		
Charleville 110 kV	4.57	5.24	4.95	5.86	5.07	4.98	4.82	7.70	7.02	6.57	6.50		
Cherrywood 110 kV	10.46	9.01	8.39	7.71	9.38	9.14	10.19	10.97	10.21	7.40	10.85		
City West 110 kV	6.26	7.19	6.62	6.16	5.55	5.43	5.94	8.56	7.69	5.98	6.08		
Clahane 110 kV	4.40	6.05	5.71	5.32	5.88	5.77	4.03	8.57	7.88	5.14	7.18		
Clashavoon 220 kV	7.35	5.44	5.04	7.92	6.98	6.75	8.32	11.15	10.28	9.19	12.32		
Clashavoon A 110 kV	7.22	9.24	8.44	7.51	12.42	11.91	8.06	17.70	15.98	8.36	21.39		
Clashavoon B 110 kV	7.22	9.24	8.44	7.51	12.42	11.91	8.06	17.70	15.98	8.36	21.39		
Cliff 110 kV	3.98	5.16	4.93	4.93	5.33	5.25	4.71	8.63	7.60	6.05	7.21		
Cloghboola 110 kV	6.66	4.63	4.49	7.08	5.54	5.47	7.17	7.53	6.29	7.66	7.97		
Clogher 110 kV	3.87	5.27	5.01	4.23	6.08	5.96	4.94	10.00	8.19	5.35	9.43		
Cloghran 110 kV	9.58	17.45	15.41	9.84	19.95	18.99	8.57	21.60	19.63	8.89	24.16		
Clonee 220 kV	14.25	15.32	13.37	10.59	15.07	14.35	12.48	21.93	19.76	9.34	19.68		
Clonkeen A 110 kV	5.81	5.06	4.80	6.79	4.02	3.97	5.57	6.59	6.24	6.76	4.55		
Clonkeen B 110 kV	5.82	5.34	5.10	5.02	6.52	6.40	6.22	8.79	7.82	4.88	9.56		
Cloon 110 kV	4.46	6.82	6.46	5.81	6.04	5.95	4.25	8.50	7.90	5.78	6.99		
College Park 110 kV	9.21	16.62	14.78	6.66	19.40	18.49	8.26	20.41	18.66	5.91	23.62		

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer						Winter					
	Th	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Single Phase		
Station	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]
Cookstown 110 kV	8.81	5.91	5.55	7.17	5.16	5.06	8.48	6.86	6.42	6.96	5.70	5.60
Coolroe 110 kV	5.24	7.06	6.54	6.28	7.38	7.19	5.03	11.40	10.58	6.57	10.00	9.77
Coomagearlahy 110 kV	5.69	4.46	4.29	6.05	5.49	5.40	6.48	7.36	6.41	6.91	8.17	7.75
Cordal 110 kV	10.17	5.69	5.44	7.92	6.38	6.27	11.90	9.84	8.67	7.62	9.20	8.82
Corderry 110 kV	3.67	6.22	5.95	4.61	6.15	6.05	4.52	9.65	8.42	5.81	8.12	7.80
Corduff 110 kV	10.52	18.85	16.54	11.35	22.25	21.08	9.39	23.66	21.38	10.31	27.70	26.59
Corduff 220 kV	16.71	17.21	14.74	14.73	20.65	19.30	15.77	26.26	23.10	13.65	29.74	28.23
Corkagh 110 kV	17.48	10.85	9.66	12.26	12.17	11.63	18.23	13.69	11.92	12.09	14.52	13.79
Corraclassy 110 kV	4.34	5.80	5.49	5.39	4.74	4.67	4.40	7.20	6.73	5.60	5.28	5.20
Cow Cross 110 kV	4.63	8.10	7.43	4.91	8.08	7.84	4.12	14.23	13.21	4.70	11.29	11.06
Crane 110 kV	6.59	6.81	6.50	6.62	7.49	7.36	6.63	9.17	8.41	6.57	9.18	8.91
Cromcastle A 110 kV	12.52	10.10	9.09	7.57	11.20	10.75	11.88	12.30	10.97	7.12	13.14	12.59
Cromcastle B 110 kV	12.52	10.10	9.09	7.57	11.20	10.75	11.88	12.30	10.97	7.12	13.14	12.59
Crory 110 kV	18.57	10.82	9.66	12.33	11.98	11.47	19.61	13.62	11.91	12.16	14.24	13.55
Cullenagh 110 kV	8.31	10.73	9.93	8.76	12.80	12.41	7.27	14.31	13.22	7.91	16.08	15.60
Cullenagh 220 kV	9.00	7.45	6.97	9.23	7.89	7.70	8.08	10.07	9.60	8.56	9.78	9.63
Cunghill 110 kV	3.04	4.16	4.01	3.52	4.18	4.13	3.25	6.12	5.65	3.82	5.31	5.18
Cureeny 110 kV	4.82	4.69	4.48	5.39	5.06	4.98	4.52	5.61	5.38	5.20	5.83	5.75
Cushaling 110 kV	5.74	8.55	7.73	6.92	10.24	9.82	6.96	12.78	11.39	8.77	13.59	13.02
Dallow 110 kV	3.52	4.94	4.74	4.66	3.10	3.08	3.44	5.69	5.37	4.65	3.37	3.33
Dalton 110 kV	2.99	3.63	3.48	4.04	3.20	3.16	3.33	5.04	4.53	4.61	3.84	3.73
Dardistown 110 kV	16.04	10.23	9.20	12.40	11.61	11.13	15.50	12.49	11.13	11.88	13.69	13.10
Derrybrien 110 kV	2.66	3.87	3.75	3.76	3.70	3.66	3.00	5.19	4.57	4.44	4.55	4.38
Derryiron 110 kV	4.96	7.19	6.81	6.19	7.47	7.33	5.71	10.17	9.50	7.34	9.36	9.16
Doon 110 kV	4.52	6.21	5.80	4.78	4.99	4.90	4.36	8.11	7.48	4.72	5.71	5.60
Dromada 110 kV	7.52	5.35	5.16	5.98	5.85	5.77	7.14	8.04	7.06	5.44	7.75	7.42
Drumkeen 110 kV	3.50	4.77	4.55	4.17	5.00	4.91	3.99	8.47	7.14	5.01	7.16	6.80
Drumline 110 kV	3.67	7.06	6.62	4.79	6.23	6.11	3.24	9.43	8.73	4.60	7.31	7.16
Drybridge 110 kV	5.90	12.20	11.22	6.75	10.41	10.16	5.22	14.75	13.58	6.31	11.79	11.52
Dundalk 110 kV	3.76	8.00	7.57	4.73	7.42	7.29	3.41	9.41	8.72	4.46	8.33	8.14
Dunfirth 110 kV	4.73	5.89	5.64	6.35	4.71	4.65	4.57	6.78	6.54	6.30	5.12	5.07
Dungarvan 110 kV	6.00	5.37	5.11	7.61	4.70	4.63	5.81	6.91	6.45	7.70	5.46	5.36
Dunmanway 110 kV	4.49	5.95	5.54	5.44	5.83	5.70	4.16	9.36	8.58	5.49	7.60	7.42
Dunstown 220 kV	13.26	15.17	13.41	12.81	17.73	16.84	10.87	21.38	19.65	10.83	23.58	22.83
Dunstown 400 kV	18.48	6.08	5.59	20.80	6.75	6.53	16.82	7.79	7.44	19.46	8.26	8.12
Ennis 110 kV	5.14	9.20	8.53	6.36	8.61	8.40	5.15	14.22	12.58	6.73	11.10	10.74
Fassaroe East 110 kV	6.53	5.64	5.31	6.39	4.55	4.47	6.20	6.57	6.13	6.20	5.00	4.91
Fassaroe West 110 kV	6.71	5.73	5.38	6.52	4.66	4.58	6.38	6.68	6.23	6.33	5.13	5.04
Finglas 220 kV	17.90	17.16	14.65	16.41	21.06	19.63	16.91	25.82	22.58	15.40	30.26	28.60
Finglas A 110 kV	32.57	11.69	10.43	29.16	13.06	12.50	34.79	14.65	12.89	30.33	15.69	14.95
Finglas B 110 kV	32.60	11.28	10.36	29.44	14.10	13.60	36.25	14.83	13.42	31.52	18.01	17.27
3	,		,	-2.44	-7.20	-5.00	JJ	-7.00		J-1J-		-,,

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer					,				inter			
	Th	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se	
Station	X/R Ratio	Ik" [kA]	Ik' [kA]										
Flagford 220 kV	7.15	6.39	6.02	9.15	6.13	6.01	7.51	8.19	7.76	9.86	7.23	7.11	
Francis Street A 110 kV	10.86	11.52	10.53	5.39	13.80	13.30	10.43	14.18	12.70	5.02	16.34	15.63	
Francis Street B 110 kV	12.87	11.11	10.15	6.92	13.59	13.08	12.74	13.63	12.51	6.46	16.24	15.67	
Galway 110 kV	5.04	10.38	9.59	4.62	12.63	12.22	5.20	14.89	13.41	4.58	16.81	16.13	
Garrow 110 kV	9.03	6.25	5.92	9.28	7.67	7.50	10.59	10.49	9.43	10.47	11.38	10.93	
Garvagh 110 kV	3.86	5.11	4.92	4.99	4.95	4.89	4.87	7.64	6.72	6.41	6.32	6.08	
Gilra 110 kV	3.22	5.85	5.58	4.04	4.64	4.58	3.04	6.96	6.54	3.98	5.14	5.06	
Glanagow 220 kV	7.26	5.60	5.15	7.53	7.67	7.37	13.80	18.48	16.48	13.26	21.02	20.08	
Glanlee 110 kV	5.66	4.35	4.19	5.77	5.35	5.27	6.40	7.09	6.19	6.37	7.90	7.49	
Glasmore A 110 kV	4.93	6.33	5.88	5.33	4.56	4.47	4.69	7.57	6.84	5.21	5.04	4.93	
Glenlara A 110 kV	2.99	2.56	2.48	4.21	2.28	2.26	3.15	3.31	3.04	4.66	2.66	2.60	
Glenlara B 110 kV	8.87	5.00	4.81	7.05	5.30	5.23	9.67	8.30	7.29	6.71	7.48	7.18	
Glenree 110 kV	2.92	3.14	3.03	3.57	3.24	3.20	3.69	5.22	4.84	4.51	4.43	4.33	
Glentanemacelligot 110 kV	8.68	4.76	4.59	8.44	4.25	4.20	8.42	6.95	6.40	8.24	5.12	5.02	
Golagh 110 kV	3.55	4.59	4.40	4.03	4.59	4.53	3.99	7.90	6.70	4.58	6.33	6.03	
Gorman 110 kV	6.81	12.87	11.81	7.71	14.33	13.87	6.08	15.90	14.60	7.13	16.89	16.37	
Gorman 220 kV	9.66	10.01	9.21	10.32	8.58	8.38	8.46	12.50	11.85	9.58	9.89	9.75	
Gortawee 110 kV	4.42	5.66	5.34	5.83	4.81	4.73	4.50	6.85	6.37	6.12	5.31	5.20	
Grange 110 kV	13.51	10.31	9.27	4.57	10.68	10.27	12.87	12.66	11.24	4.25	12.46	11.96	
Grange Castle 110 kV	16.21	10.81	9.63	11.41	12.21	11.67	16.66	13.62	11.87	11.17	14.57	13.83	
Great Island 110 kV	8.07	10.81	10.07	8.82	14.19	13.74	6.91	14.00	12.92	7.73	17.72	17.11	
Great Island 220 kV	12.53	9.93	9.21	13.86	12.16	11.78	10.51	12.73	12.02	11.97	14.64	14.30	
Griffinrath A 110 kV	7.27	9.41	8.85	7.56	9.65	9.45	6.68	11.42	10.80	7.15	11.17	10.96	
Griffinrath B 110 kV	8.48	10.06	9.43	8.57	10.75	10.50	7.82	12.31	11.61	8.08	12.59	12.33	
Harolds 110 kV	11.04	11.56	10.56	5.10	13.76	13.26	10.62	14.22	12.74	4.74	16.27	15.57	
Heuston 110 kV	13.82	11.31	10.32	8.25	13.98	13.44	13.83	13.91	12.76	7.80	16.76	16.17	
Huntstown A 220 kV	17.58	16.81	14.39	14.69	20.58	19.20	16.16	24.85	21.82	13.14	29.15	27.60	
Huntstown B 220 kV	15.40	15.38	13.37	11.65	18.67	17.56	15.02	23.32	20.81	10.45	26.79	25.57	
Ikerrin 110 kV	5.32	4.16	3.99	6.09	3.25	3.21	5.77	5.76	5.25	6.47	3.82	3.74	
Inchicore 220 kV	13.75	16.11	13.87	10.95	20.07	18.77	13.75	27.32	23.70	9.81	31.21	29.43	
Inchicore A 110 kV	25.61	12.36	11.19	23.34	15.64	14.98	30.41	15.44	14.05	26.14	19.06	18.31	
Inchicore B 110 kV	35.49	12.28	10.89	29.96	15.68	14.87	49.06	15.86	13.77	36.47	19.58	18.42	
Inniscarra 110 kV	4.93	6.84	6.36	5.86	7.01	6.84	4.67	10.96	10.18	6.05	9.36	9.16	
Irishtown 220 kV	13.48	14.13	12.38	11.55	18.07	17.01	15.21	25.35	22.13	11.33	29.56	27.93	
Kellis 110 kV	6.39	7.75	7.34	7.35	9.33	9.13	6.09	10.01	9.26	7.15	11.45	11.11	
Kellis 220 kV	8.32	7.00	6.61	9.95	6.22	6.11	7.65	8.64	8.29	9.52	7.18	7.09	
Kilbarry 110 kV	6.28	10.66	9.53	6.82	12.68	12.10	7.10	24.17	21.11	7.96	22.77	21.76	
Kildonan 110 kV	7.60	14.74	13.26	6.45	14.39	13.88	6.84	17.78	16.42	5.90	16.79	16.37	
Kilkenny 110 kV	3.06	4.66	4.47	4.27	4.30	4.25	2.97	5.67	5.26	4.30	4.81	4.71	
Kill Hill 110 kV	4.97	4.95	4.71	5.96	4.62	4.55	5.72	7.66	6.87	6.88	5.95	5.77	
Killonan 110 kV	7.57	13.33	11.88	8.48	15.68	14.96	6.97	22.38	20.07	8.29	23.00	22.12	
Killonan 220 kV	8.50	7.56	6.92	10.27	7.92	7.67	7.75	12.28	11.59	10.21	10.88	10.70	

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer						Winter						
	Three Phase			Single Phase			Three Phase			Single Phase			
Station	X/R Ratio	Ik" [kA]	Ik' [kA]										
Killoteran 110 kV	6.47	9.44	8.81	5.52	10.64	10.36	5.64	12.16	11.24	4.95	12.90	12.53	
Kilmahud 110 kV	17.30	10.88	9.69	12.43	12.33	11.78	18.00	13.74	11.96	12.27	14.75	13.99	
Kilmore 110 kV	15.52	10.55	9.45	9.80	11.75	11.26	14.95	12.95	11.48	9.29	13.88	13.26	
Kilpaddoge 110 kV	12.25	12.60	11.41	12.73	16.35	15.64	12.19	21.08	19.00	12.79	24.82	23.79	
Kilpaddoge 220 kV	12.92	10.00	9.05	12.17	13.49	12.87	16.01	23.79	21.31	12.64	28.40	27.11	
Kilteel 110 kV	4.51	6.92	6.54	5.54	6.40	6.29	4.30	8.56	7.99	5.43	7.34	7.20	
Kinnegad 110 kV	4.60	7.17	6.79	5.99	6.56	6.45	4.62	8.96	8.49	6.21	7.51	7.39	
Knockacummer 110 kV	6.21	4.32	4.17	6.32	4.81	4.75	6.29	6.87	6.08	6.41	6.77	6.49	
Knockalough 110 kV	4.05	4.09	3.93	3.66	4.12	4.07	4.48	5.34	4.87	3.79	4.89	4.75	
Knockanure 220 kV	9.00	7.16	6.63	6.67	9.61	9.27	8.52	13.89	12.66	5.33	17.05	16.38	
Knockanure A 110 kV	14.79	7.85	7.45	12.22	9.62	9.42	16.39	13.12	11.36	11.77	14.34	13.57	
Knockanure B 110 kV	5.20	6.89	6.47	6.00	6.16	6.04	4.62	9.65	8.92	5.72	7.40	7.25	
Knockearagh 110 kV	5.56	4.78	4.52	7.22	4.33	4.26	5.38	6.29	5.81	7.30	5.08	4.97	
Knockraha A 110 kV	6.87	11.22	10.04	7.53	13.07	12.49	8.11	24.88	22.18	9.04	22.80	21.97	
Knockraha A 220 kV	7.25	6.66	6.06	7.67	8.60	8.24	10.99	20.04	17.98	11.08	20.21	19.44	
Knockraha B 110 kV	6.87	11.22	10.04	7.53	13.07	12.49	8.11	24.88	22.18	9.04	22.80	21.97	
Knockraha B 220 kV	7.25	6.66	6.06	7.67	8.60	8.24	10.99	20.04	17.98	11.08	20.21	19.44	
Knockranny A 110 kV	3.99	4.45	4.27	3.61	4.41	4.35	4.35	5.83	5.32	3.72	5.23	5.08	
Knockranny B 110 kV	5.40	6.51	6.19	4.95	8.46	8.28	6.21	8.91	8.34	5.32	11.06	10.76	
Knockumber 110 kV	3.88	7.78	7.31	4.68	5.93	5.84	3.58	8.92	8.38	4.50	6.44	6.34	
Lanesboro 110 kV	4.09	9.99	9.17	5.23	10.53	10.21	3.79	12.04	10.84	5.02	11.78	11.38	
Letterkenny110 kV	3.79	5.49	5.18	4.41	6.39	6.25	4.35	10.12	8.41	5.39	9.79	9.18	
Liberty A 110 kV	5.58	9.64	8.69	5.11	11.83	11.32	5.71	20.30	17.99	4.83	20.86	19.97	
Liberty B 110 kV	5.53	9.64	8.68	5.00	11.81	11.30	5.59	20.27	17.97	4.66	20.79	19.91	
Limerick 110 kV	6.09	12.12	10.82	6.65	12.24	11.77	5.17	18.86	16.95	6.10	16.23	15.72	
Lisdrum 110 kV	2.89	4.75	4.57	4.16	4.18	4.14	2.74	5.41	5.07	4.09	4.49	4.41	
Lisheen 110 kV	4.01	3.22	3.11	4.02	4.83	4.74	4.97	5.31	4.63	4.97	7.95	7.41	
Lodgewood 110 kV	8.64	7.09	6.78	9.02	8.95	8.78	8.86	9.43	8.79	9.07	11.08	10.78	
Lodgewood 220 kV	9.11	6.39	6.05	10.23	6.38	6.26	8.75	8.16	7.78	9.94	7.57	7.45	
Longpoint 220 kV	6.76	5.47	5.04	7.05	7.43	7.15	12.19	18.18	16.26	12.02	20.16	19.29	
Louth 220 kV	10.99	13.87	12.42	11.92	16.19	15.47	9.22	19.19	17.73	10.49	20.71	20.11	
Louth A 110 kV	7.39	11.46	10.70	8.39	13.90	13.52	6.53	13.89	12.90	7.62	16.30	15.83	
Louth B 110 kV	7.98	12.33	11.47	8.80	15.33	14.86	6.97	15.08	14.00	7.88	18.16	17.61	
Macetown 110 kV	7.85	15.30	13.70	7.63	15.84	15.22	7.33	19.43	17.80	7.47	20.22	19.60	
Macroom 110 kV	6.33	8.63	7.90	6.68	9.42	9.11	6.38	15.88	14.43	6.85	13.92	13.52	
Mallow 110 kV	5.17	5.45	5.13	6.64	5.04	4.95	5.29	7.61	7.13	7.16	6.16	6.05	
Marina 110 kV	6.09	10.23	9.17	6.70	12.72	12.13	7.10	23.11	20.18	8.31	23.72	22.59	
Maynooth A 110 kV	11.22	11.61	10.79	11.82	14.29	13.86	10.46	14.53	13.60	11.18	17.36	16.90	
Maynooth A 220 kV	11.41	14.10	12.49	10.69	14.01	13.43	9.57	19.84	18.17	9.42	17.85	17.37	
Maynooth B 110 kV	8.83	15.32	13.82	10.05	15.11	14.59	7.82	18.75	17.51	9.30	17.58	17.20	
Maynooth B 220 kV	11.97	15.87	13.89	10.97	15.78	15.04	9.65	23.09	21.01	9.42	20.63	20.03	
McDermott 110 kV	16.57	10.39	9.59	6.41	12.20	11.81	16.51	13.58	12.31	5.81	15.27	14.70	
Meath Hill 110 kV	4.08	8.09	7.66	5.20	6.88	6.77	3.85	9.82	9.11	5.12	7.77	7.61	

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

System Part (1) Ika (1) Ray (1) <		Summer						Winter						
Station Ratio (LA) (RA)		Tł	Three Phase Single Phase			se	TI	ree Pha	se	Single Phase				
Midleton in okv 4,08 7,30 6,74 8,84 6,73 6,56 3,46 1,63 1,71 9,30 9,20 Milltown A in okv 44,96 12,40 11,31 7,01 15,09 14,50 14,84 15,46 13,76 6,50 13,20 3,60 13,20 13,20 13,20 15,50 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20 13,20	Station													
Milltown A 110 kV 14,96 12,44 11,31 7.01 15,09 14,50 14,86 13,78 13,66 18.03 12,12 Milltown B 110 kV 9.15 10.10 9.29 4,33 12,14 11,73 8,72 12,25 13,30 3,08 14,32 13,68 Milltown B 110 kV 9.13 10.10 1.07 7.69 14,88 14,30 13,19 5.02 1,750 10.90 Moneypoint 120 kV 13.38 10.88 9.13 12,49 13.97 12,95 16.69 20,32 10.93 10.12 19.99 Moneypoint 220 kV 13,42 7.10 6.33 20.99 8.36 8.02 24,80 11.28 10.55 25.23 12.04 11.74 Moneypoint 62 ao kV 13,42 7.10 6.32 2.99 8.36 8.02 24,80 11.82 10.55 25.23 12.04 11.74 Moneypoint 62 ao kV 24,64 6.32 2.99 8.29 8.99 8.91<	Meentycat 110 kV	3.24	4.10	3.93	4.08	4.18	4.13	3.71	6.95	5.94	5.01	5.80	5.54	
Militown B 110 kV 9,15 10.10 9.29 4.33 12.14 11.73 8.72 12.5 13.90 13.98 14,32 13.60 13.98 14,32 12.16 11.07 7.69 14.88 14.30 13.19 15.08 13.45 17.80 16.98 Monetpeni 110 kV 13.49 12.48 8.60 6.71 7.62 7.41 5.33 12.52 17.80 15.98 8.11 7.96 15.65 15.65 10.73 10.15 19.79 10.17 9.99 8.60 15.65 16.73 10.15 19.79 10.17 9.99 8.60 15.66 15.66 10.73 10.15 19.79 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17 10.17	Midleton 110 kV	4.08	7.30	6.74	4.84	6.73	6.56	3.46	11.63	10.87	4.71	9.38	9.20	
Misery Hill 110 kV 13,47 12.66 11.07 7.69 14.88 14.30 13.19 13.08 13.45 7.25 17.80 16.98 Moneteen 110 kV 6.13 9.48 8.60 6.71 7.62 7.41 5.33 13.53 11.59 6.29 8.82 8.65 Moneypoint 112 kV 13.89 7.70 7.30 15.99 8.11 7.96 16.65 13.28 11.59 10.29 10.10 Moneypoint 62 kV 13.38 10.08 9.13 12.49 13.25 12.95 16.65 23.28 20.98 12.29 12.09 Moneypoint 62 ko kV 13.42 10.08 23.23 12.29 13.65 12.25 13.65 13.25 13.25 12.04 17.44 Moneypoint 62 ko kV 13.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 17.44 Moneypoint 62 ko kV 13.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 17.44 Moneypoint 62 ko kV 13.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 17.44 Moneypoint 62 ko kV 13.42 3.60 6.42 5.09 6.70 3.96 8.42 5.75 5.78 12.04 17.84 Moneypoint 62 ko kV 4.46 6.18 6.29 5.99 5.62 6.70 3.95 8.49 8.83 4.94 7.84 Mount Lucas 110 kV 4.46 6.18 6.27 2.89 7.99 5.62 5.84 5.71 4.75 8.53 7.91 6.77 5.64 Mulliagharlin 10 kV 3.68 6.15 6.19 4.94 6.23 6.33 6.35 4.75 5.65 5.85 Mulliagharlin 10 kV 3.57 5.71 4.91 4.94 6.23 6.33 6.34 7.63 7.20 4.94 6.80 Mulliagharlin 10 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.95 11.82 10.98 5.96 8.16 8.02 Mungret A 10 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.95 11.82 10.95 5.96 8.16 8.02 Mungret B 10 kV 5.77 10.59 9.44 9.45 13.20 11.40 14.58 13.25 13.90 11.40 13.40 13.00 Nagori 10 kV 4.64 8.80 8.74 5.65 8.74 8.25 13.91 12.80 13.30 13.00 13.00 13.00 Newburt 10 kV 4.76 8.84 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34 8.34	Milltown A 110 kV	14.96	12.44	11.31	7.01	15.09	14.50	14.84	15.46	13.78	6.56	18.05	17.22	
Moneteen 110 kV 6.13 9.48 8.60 6.71 7.62 7.41 5.33 12.53 15.99 8.15 17.96 13.58 1.62 1.61 1.73 11.59 9.99 Moneypoint 120 kV 13.38 10.08 9.13 12.43 13.59 15.65 10.32 10.08 10.79 9.99 Moneypoint 62 qoo kV 13.42 7.10 6.43 20.99 8.36 8.02 2.80 11.28 10.55 25.23 12.04 11.74 Moneypoint 62 qoo kV 19.42 7.10 6.43 20.99 8.36 8.02 2.80 11.28 10.55 25.23 12.04 11.74 Moneypoint 62 qoo kV 19.42 7.10 6.43 20.99 8.36 8.02 2.80 11.28 12.04 12.04 12.04 11.74 Mongred 110 kV 4.24 6.20 5.99 5.62 5.90 4.93 15.92 5.09 5.92 5.94 4.93 15.92 6.94 8.65<	Milltown B 110 kV	9.15	10.10	9.29	4.33	12.14	11.73	8.72	12.25	11.30	3.98	14.32	13.86	
Moneypoint 110 kV 13.89 7.70 7.30 15.99 8.11 7.96 15.65 10.73 10.15 17.99 20.90 26.69 Moneypoint 220 kV 13.38 10.08 9.13 12.43 13.57 12.95 16.67 23.28 20.98 12.82 27.90 26.69 Moneypoint G1 400 kV 19.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 11.74 Mont C1 64 kV 4.23 6.80 6.42 5.09 6.91 6.77 3.98 8.42 7.88 4.92 8.01 7.72 7.04 Mount Lucas 10 kV 4.46 6.88 7.79 5.62 5.84 5.71 4.75 8.33 7.91 6.72 8.74 Multrasu 10 kV 2.88 2.97 2.87 4.29 7.80 3.59 5.59 5.59 5.83 5.63 5.81 8.64 Mullragari 10 kV 3.69 9.06 8.25	Misery Hill 110 kV	13.47	12.16	11.07	7.69	14.88	14.30	13.19	15.08	13.45	7.25	17.80	16.98	
Moneypoint 220 kV 13,38 10.08 9.13 12.43 13,57 12.95 16.67 23.28 20.98 12.82 27,90 26.69 Moneypoint Ga 400 kV 19.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 11.74 Moneypoint Ga 400 kV 26.94 7.70 6.43 20.99 8.36 8.02 24.80 11.82 10.55 25.23 12.04 11.74 Monread 110 kV 4.23 6.80 6.42 5.99 6.91 6.77 3.98 8.42 7.88 1.92 1.72 7.80 Mount Lucas 110 kV 4.46 6.18 5.79 5.62 5.84 5.71 4.75 8.53 7.91 6.72 7.80 Mount Lucas 110 kV 3.65 8.26 6.36 7.12 4.89 4.94 7.80 3.59 9.45 8.85 4.99 8.33 8.65 Mullingari 10 kV 3.65 9.62 8.25		6.13	9.48	8.60	6.71	7.62	7.41	5.33	12.53	11.59	6.29	8.82	8.65	
Moneypoint G1 400 kV 19.42 (2.10) 6.43 (2.09) 8.36 (8.02) 24.80 (3.13) 11.28 (3.05) 25.23 (3.04) 11.74 (5.67) 5.65 (5.66) Moneypoint G2 400 kV 26.91 (2.72) 2.60 (3.42) 2.99 (8.36) 8.20 (2.48) 11.28 (1.05) 25.23 (1.04) 11.74 (5.67) 5.65 (5.66) Moneypoint G3 400 kV 19.42 (7.10) 6.80 (3.42) 2.09 (8.01) 1.677 (3.98) 8.42 (7.88) 2.92 (7.04) 11.74 (7.04) Mount Lucas 110 kV 4.46 (6.18) 5.79 (5.02) 5.84 (5.71) 4.75 (5.85) 5.91 (6.17) 6.80 (7.04) 7.04 Moultlagharlin 10 kV 3.88 (8.14) 7.71 (8.89) 7.94 (7.80) 3.50 (8.55) 5.50 (8.55) 5.83 (8.56) Mulleayrin 10 kV 3.65 (5.10) 4.71 (4.51) 4.89 (7.94) 7.80 (8.42) 4.53 (8.44) 4.71 (9.66) 8.25 (8.66) 7.12 (8.94) 4.98 (8.18) 1.90 (8.98) 5.96 (8.16) 8.02 (8.04) 8.02 (8.16) 7.12 (8.94) 4.94 (8.18) 1.80 (8.18) 5.96 (8.16) 8.02 (8.18) 8.02 (8.18) 8.02 (8.18) 8.02 (8.18) 8.02 (8.18) 8.02 (8.18)	7.	13.89	7.70	7.30	15.99	8.11	7.96	15.65	10.73	10.15	17.93	10.17	9.99	
Moneypoint G2 400 kV 26.91 2.72 2.60 2.789 3.47 3.40 5.432 5.02 4.76 4.671 5.67 5.56 Moneypoint G3 400 kV 19.42 7.10 6.43 20.99 8.36 8.02 24.80 11.28 10.55 25.23 12.04 11.74 Montrad 110 kV 4.24 6.18 5.79 5.62 5.84 5.71 4.75 8.53 7.91 6.17 7.84 Mount Lucas 110 kV 4.46 6.18 5.79 5.62 5.84 5.71 4.75 8.53 4.59 6.53 6.91 6.94 6.23 6.51 4.59 5.94 6.23 6.53 5.99 9.48 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.85 4.59 8.87 8.60 Mulliaghartin 110 kV 5.73 9.08 8.25	7.	13.38	10.08	9.13		13.57	12.95	16.67	23.28	20.98	12.82	27.90	26.69	
Moneynomin G			7.10			8.36	8.02	24.80	11.28	10.55		12.04		
Monread 110 kV 4.23 6.80 6.42 5.09 6.91 6.77 3.98 8.42 7.88 4.92 8.01 7.84 Mount Lucas 110 kV 4.46 6.18 5.79 5.62 5.84 5.71 4.75 8.53 7.91 6.17 7.20 7.04 Moy 110 kV 2.89 2.97 2.87 3.39 3.65 3.59 4.53 5.99 5.08 5.50 5.85 5.64 Mullagharlin 110 kV 3.80 6.11 4.771 4.89 7.94 7.80 3.50 9.45 8.85 4.59 8.83 8.66 Mulligant 110 kV 3.60 6.51 6.19 4.94 6.23 6.13 3.47 7.63 7.20 8.66 8.67 Mungret A 110 kV 3.73 4.71 4.51 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.61 8.79 8.61 8.07 Mungret B 110 kV 4.47 10.58 9.44		_	-						5.02	4.76	46.71	5.67	5.56	
Mount Lucas 110 kV 4,46 6.18 5.79 5.62 5.84 5.71 4.75 8.53 7.91 6.17 7.20 7.70 Moy 110 kV 2.89 2.97 2.87 3.39 3.65 3.59 4.53 5.59 5.08 5.50 5.85 5.64 Mullagharlin In KV 3.88 8.14 7.71 4.89 7.94 7.80 3.50 9.45 8.85 4.59 8.83 8.65 Mullragy 110 kV 3.67 4.71 4.51 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.66 8.07 Mungret B 110 kV 3.57 4.71 4.51 4.08 5.59 6.94 4.98 11.82 11.09 5.96 8.16 8.02 Mungret B 110 kV 1.47 10.58 9.44 9.45 11.92 11.40 14.58 13.25 11.59 9.11 14.16 13.46 Navan 110 kV 1.477 10.58 8.74 11.92		19.42						-				'		
Moy 110 kV 2.89 2.97 2.87 3.39 3.65 3.59 4.53 5.59 5.68 5.50 5.85 5.6A Mullagharlin 110 kV 3.88 8.14 7.71 4.89 7.94 7.80 3.50 9.45 8.85 4.59 8.83 8.65 Mullingar 110 kV 3.60 6.51 6.19 4.94 6.23 6.13 3.47 7.63 7.20 4.91 6.92 6.79 Mulreay 110 kV 3.57 4.71 4.91 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.66 8.07 Mungret B 110 kV 5.73 9.06 8.25 6.36 7.12 6.94 4.97 11.84 11.00 5.96 8.17 8.02 Namingor 110 kV 14.47 10.58 8.24 9.45 11.92 11.40 44.58 13.25 11.11 14.16 13.46 Nawan 110 kV 3.40 3.48 3.34 4.10 2.47 <t< td=""><td></td><td></td><td></td><td></td><td></td><td></td><td>6.77</td><td>3.98</td><td></td><td></td><td></td><td>8.01</td><td></td></t<>							6.77	3.98				8.01		
Mullagharlin 110 kW 3.88 8.44 7.71 4.89 7.94 7.80 3.50 9.45 8.85 4.59 8.83 8.65 Mullingar 110 kW 3.60 6.51 6.19 4.94 6.23 6.13 3.47 7.63 7.20 4.91 6.92 6.79 Mullreavy 110 kW 3.57 4.71 4.51 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.66 8.07 Mungret A 110 kW 5.74 9.06 8.25 6.36 7.12 6.94 4.98 11.82 10.98 5.96 8.16 8.02 Mungret B 110 kW 5.73 9.08 8.26 6.36 7.12 6.94 4.98 11.82 11.00 5.96 8.17 8.03 Nangor 110 kW 14.47 10.58 9.44 9.45 11.29 11.40 14.58 13.25 9.11 14.16 13.46 Newbury 110 kW 4.46 8.80 8.17 5.15 8.74					_							-		
Mullingar 110 kV 3.60 6.51 6.19 4.94 6.23 6.13 3.47 7.63 7.20 4.91 6.92 6.79 Mulreavy 110 kV 3.57 4.71 4.51 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.66 8.07 Mungret A 110 kV 5.74 9.06 8.25 6.36 7.12 6.94 4.98 11.82 10.08 5.96 8.16 8.02 Mungret B 110 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.97 11.84 11.00 5.96 8.17 8.03 Nangor 110 kV 11.47 10.58 9.44 9.45 11.92 11.40 14.58 13.25 11.51 13.46 Navan 110 kV 4.46 8.80 8.77 5.15 8.74 8.52 4.15 11.86 10.99 1.12 11.24 Newbirige 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15	,	-								_				
Mulreavy 110 kV 3.57 4.71 4.51 4.08 5.59 5.49 4.53 8.74 7.16 5.42 8.66 8.07 Mungret A 110 kV 5.74 9.06 8.25 6.36 7.12 6.94 4.98 11.82 10.98 5.96 8.16 8.02 Mungret B 110 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.97 11.84 11.00 5.96 8.17 8.03 Naman 110 kV 15.77 11.39 10.51 6.51 11.30 11.00 5.23 13.91 12.80 6.13 13.04 12.70 Nemagh 110 kV 3.40 3.48 3.34 4.10 2.47 2.44 3.30 4.13 3.89 4.09 2.68 2.64 Newbridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbridge 110 kV 14.59 10.46 9.83 7.33			-											
Mungret A 110 kV 5.74 9.06 8.25 6.36 7.12 6.94 4.98 11.82 10.98 5.96 8.16 8.20 Mungret B 110 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.97 11.84 11.00 5.96 8.17 8.03 Nangor 110 kV 14.47 10.58 9.44 9.45 11.92 11.40 14.58 13.25 11.59 9.11 14.16 13.46 Navan 110 kV 5.77 11.39 10.51 6.51 11.30 11.00 5.23 13.91 12.80 6.13 13.04 12.70 Nembridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbridge 110 kV 14.69 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.32 0.99 11.27 10.96 Newbridge 110 kV 14.29 13.26 15.78			6.51									-		
Mungret B 110 kV 5.73 9.08 8.26 6.36 7.12 6.94 4.97 11.84 11.00 5.96 8.17 8.03 Nangor 110 kV 14.47 10.58 9.44 9.45 11.92 11.40 14.58 13.25 11.59 9.11 14.16 13.46 Navan 110 kV 5.77 11.39 10.51 6.51 11.30 11.00 5.23 13.91 12.80 6.13 13.04 12.70 Nembridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbury 110 kV 14.59 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.38 6.88 13.42 12.84 North Quays 110 kV 18.16 12.68 11.51 6.54 15.12 14.52 18.55 15.81 14.07 6.0 18.06 13.24 12.84 North Quays 110 kV 15.96 15.78	,													
Nangor 110 kV 14,47 10.58 9.44 9.45 11.92 11.40 14,58 13.25 11.59 9.11 14,16 13.46 Navan 110 kV 5.77 11.39 10.51 6.51 11.30 11.00 5.23 13.91 12.80 6.13 13.04 12.70 Nemagh 110 kV 3.40 3.48 3.34 4.10 2.47 2.44 3.30 4.13 3.89 4.09 2.68 2.64 Newbridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbury 110 kV 14.59 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.38 6.88 13.42 12.84 North Wall 220 kV 15.96 15.78 13.62 9.87 17.75 16.72 15.11 23.18 20.49 8.41 24.19 23.10 Oldcourt A 110 kV 4.19 7.22 6.68					_									
Navan 110 kV 5.77 11.39 10.51 6.51 11.30 11.00 5.23 13.91 12.80 6.13 13.04 12.70 Nenagh 110 kV 3.40 3.48 3.34 4.10 2.47 2.44 3.30 4.13 3.89 4.09 2.68 2.64 Newbirdge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbury 110 kV 14.59 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.38 6.88 13.42 12.84 North Quays 110 kV 18.16 12.68 11.51 6.54 15.12 14.52 18.55 15.81 14.07 6.10 18.06 17.24 North Wall 220 kV 15.96 15.78 13.62 9.87 17.75 16.72 15.11 23.18 20.49 8.41 24.19 23.10 Oldcourt B 110 kV 4.29 7.25 6.69 <td></td> <td></td> <td>_</td> <td></td> <td></td> <td>-</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td>•</td> <td></td>			_			-						•		
Nenagh 110 kV 3.40 3.48 3.34 4.10 2.47 2.44 3.30 4.13 3.89 4.09 2.68 2.64 Newbridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbury 110 kV 14.59 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.38 6.88 13.42 12.84 North Quays 110 kV 18.16 12.68 11.51 6.54 15.12 14.52 18.55 15.81 14.07 6.10 18.06 17.24 North Wall 220 kV 15.96 15.78 13.62 9.87 17.75 16.72 15.11 23.18 20.49 8.41 24.19 23.10 Oldcourt B 110 kV 4.19 7.22 6.68 4.60 6.59 6.43 3.66 11.77 11.07 4.39 8.57 8.44 Oldstreet 20 kV 16.99 9.66 8.86														
Newbridge 110 kV 4.46 8.80 8.17 5.15 8.74 8.52 4.15 11.86 10.91 4.97 11.27 10.96 Newbury 110 kV 14.59 10.46 9.38 7.33 11.41 10.94 13.99 12.83 11.38 6.88 13.42 12.84 North Quays 110 kV 18.16 12.68 11.51 6.54 15.12 14.52 18.55 15.81 14.07 6.10 18.06 17.24 North Wall 220 kV 15.96 15.78 13.62 9.87 17.75 16.72 15.11 23.18 20.49 8.41 24.19 23.10 Oldcourt B 110 kV 4.19 7.22 6.68 4.60 6.54 6.38 3.66 11.77 11.07 4.39 8.57 8.44 Oldstreet 220 kV 16.99 9.66 8.86 13.50 10.41 10.08 15.63 11.54 10.92 12.47 12.11 11.87 Oldstreet 220 kV 18.61 6.69														
Newbury 110 kV 14,59 10,46 9,38 7,33 11.41 10.94 13,99 12,83 11,38 6.88 13,42 12.84 North Quays 110 kV 18.16 12.68 11,51 6.54 15,12 14,52 18,55 15,81 14,07 6.10 18.06 17,24 North Wall 220 kV 15,96 15,78 13,62 9.87 17,75 16,72 15,11 23,18 20,49 8.41 24,19 23,10 Oldcourt A 110 kV 4.19 7.22 6.68 4.60 6.59 6.43 3.66 11,77 11.07 4.39 8.57 8.48 Oldstreet 220 kV 16.99 9.66 8.86 13,50 10,41 10,08 15,63 11.54 10,92 12,47 12,11 11.87 Oldstreet 220 kV 16.99 9.66 8.86 13,50 10,41 10,08 15,63 11.54 10,92 12,47 12,17 11.17 11.07 4.98 8.58 8.67 <t< td=""><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></t<>														
North Quays 110 kV	_									_		-	-	
North Wall 220 kV	,		-										_	
Oldcourt A 110 kV 4.19 7.22 6.68 4.60 6.54 6.38 3.63 11.69 10.99 4.37 8.48 8.35 Oldcourt B 110 kV 4.22 7.25 6.70 4.62 6.59 6.43 3.66 11.77 11.07 4.39 8.57 8.44 Oldstreet 220 kV 16.99 9.66 8.86 13.50 10.41 10.08 15.63 11.54 10.92 12.47 12.11 11.87 Oldstreet 400 kV 18.61 6.69 6.14 11.24 6.49 6.30 16.81 8.78 8.38 10.07 7.93 7.82 Oughtragh 110 kV 3.84 3.98 3.80 4.86 2.82 2.79 3.59 5.04 4.68 4.78 3.10 3.05 Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Pollaphuca 110 kV 2.78 2.40 2.36	-													
Oldcourt B 110 kV 4.22 7.25 6.70 4.62 6.59 6.43 3.66 11.77 11.07 4.39 8.57 8.44 Oldstreet 220 kV 16.99 9.66 8.86 13.50 10.41 10.08 15.63 11.54 10.92 12.47 12.11 11.87 Oldstreet 400 kV 18.61 6.69 6.14 11.24 6.49 6.30 16.81 8.78 8.38 10.07 7.93 7.82 Oughtragh 110 kV 3.84 3.98 3.80 4.86 2.82 2.79 3.59 5.04 4.68 4.78 3.10 3.05 Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.560 13.20 11.95					-		-	-					_	
Oldstreet 220 kV 16.99 9.66 8.86 13.50 10.41 10.08 15.63 11.54 10.92 12.47 12.11 11.87 Oldstreet 400 kV 18.61 6.69 6.14 11.24 6.49 6.30 16.81 8.78 8.38 10.07 7.93 7.82 Oughtragh 110 kV 3.84 3.98 3.80 4.86 2.82 2.79 3.59 5.04 4.68 4.78 3.10 3.05 Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 26.00 2.57 Poollbeg A 220 kV 16.96 15.96 13.75					-									
Oldstreet 400 kV 18.61 6.69 6.14 11.24 6.49 6.30 16.81 8.78 8.38 10.07 7.93 7.82 Oughtragh 110 kV 3.84 3.98 3.80 4.86 2.82 2.79 3.59 5.04 4.68 4.78 3.10 3.05 Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 2.60 2.57 Pollbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg B 110 kV 25.57 13.18 11.94														
Oughtragh 110 kV 3.84 3.98 3.80 4.86 2.82 2.79 3.59 5.04 4.68 4.78 3.10 3.05 Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 2.60 2.57 Poolbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37			_			· ·					-			
Pelletstown 110 kV 14.41 9.88 9.16 8.19 10.76 10.46 13.69 12.70 11.60 7.57 13.16 12.74 Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 2.60 2.57 Poolbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg A 220 kV 16.96 15.96 13.75 8.47 16.96 16.01 15.98 23.32 20.62 7.08 22.73 21.76 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44														
Platin 110 kV 5.24 11.27 10.42 5.82 8.76 8.58 4.66 13.35 12.43 5.48 9.72 9.55 Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 2.60 2.57 Poolbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg A 220 kV 16.96 15.96 13.75 8.47 16.96 16.01 15.98 23.32 20.62 7.08 22.73 21.76 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93					-									
Pollaphuca 110 kV 2.78 2.40 2.36 3.99 2.23 2.22 3.29 3.13 3.00 4.71 2.60 2.57 Poolbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg A 220 kV 16.96 15.96 13.75 8.47 16.96 16.01 15.98 23.32 20.62 7.08 22.73 21.76 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poptan 260 kV 25.60 8.73			_		-									
Poolbeg A 110 kV 25.60 13.20 11.95 21.13 16.53 15.84 28.34 16.55 14.71 22.09 20.06 19.09 Poolbeg A 220 kV 16.96 15.96 13.75 8.47 16.96 16.01 15.98 23.32 20.62 7.08 22.73 21.76 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8														
Poolbeg A 220 kV 16.96 15.96 13.75 8.47 16.96 16.01 15.98 23.32 20.62 7.08 22.73 21.76 Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 <td>-</td> <td></td>	-													
Poolbeg B 110 kV 25.57 13.18 11.94 21.12 16.51 15.82 28.30 16.53 14.69 22.08 20.04 19.06 Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17	_				_						-			
Poolbeg B 220 kV 13.89 15.44 13.37 10.71 18.13 17.06 13.32 25.18 22.05 9.45 26.74 25.41 Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17						-								
Poolbeg C 110 kV 20.37 12.93 11.72 7.57 15.46 14.84 21.27 16.17 14.36 7.11 18.53 17.67 Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17														
Poppintree 110 kV 16.49 10.81 9.69 10.00 12.03 11.53 16.03 13.36 11.83 9.48 14.28 13.64 Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17														
Portan 260 kV 25.60 8.73 8.12 100.00 2.97 2.95 23.60 11.35 10.93 107.02 3.17 3.15 Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17														
Portan 400 kV 21.41 7.02 6.45 20.11 7.99 7.72 19.05 9.34 8.91 18.37 10.35 10.17					l	_								
					20.11						18.37			
	-	4.10	7.55	7.09	5.51	6.97		3.95			5.44		8.70	

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

	Summer						Winter						
	Three Phase			Single Phase			Three Phase			Single Phase			
Station	X/R Ratio	lk" [kA]	lk'	X/R	lk"	Ik' [kA]	X/R	Ik" [kA]	Ik' [kA]	X/R	lk"	Ik' [kA]	
Pottery 110 kV	16.56	9.95	[kA]	Ratio 5.90	[kA] 10.38	10.10	17.48	12.37	11.44	Ratio 5.53	[kA]	11.85	
Prospect 220 kV	12.16	9.33	8.51	9.61	11.10	10.68	12.91	19.32	17.71	8.42	19.04	18.47	
Raffeen 220 kV	7.07	5.83	5.34	7.29	7.95	7.63	12.08	19.28	17.17	11.53	21.71	20.73	
Raffeen A 110 kV	5.52	8.86	8.07	6.03	11.32	10.86	5.62	16.93	15.53	6.58	19.09	18.46	
Raffeen B 110 kV	6.83	8.74	7.96	7.41	11.16	10.71	8.42	16.84	15.36	9.38	18.82	18.16	
Rathkeale 110 kV	3.79	6.34	5.93	4.91	5.32	5.22	3.46	8.16	7.66	4.80	6.07	5.98	
Ratrussan 110 kV	3.19	5.90	5.66	3.99	6.66	6.56	3.70	8.24	7.00	4.87	8.56	8.06	
Reamore 110 kV	4.57	5.60	5.29	3.67	5.39	5.29	4.46	8.10	7.28	3.45	6.62	6.42	
Richmond A 110 kV	3.24	6.76	6.35	4.38	6.15	6.04	3.04	7.82	7.20	4.25	6.77	6.61	
Richmond B 110 kV	3.24	6.76	6.35	4.38	6.15	6.04	3.04	7.82	7.20	4.25	6.77	6.61	
Rinawade 110 kV	5.19	9.90	9.22	6.08	7.32	7.19	4.76	11.54	11.01	5.83	8.09	8.00	
Ringaskiddy 110 kV	5.65	7.78	7.15	5.95	8.59	8.32	5.61	13.63	12.64	6.07	12.49	12.19	
Ringsend 110 kV	26.01	13.30	12.02	22.21	16.66	15.95	28.84	16.73	14.80	23.39	20.26	19.24	
Ryebrook 110 kV	5.91	13.31	11.87	6.63	12.18	11.75	5.29	15.64	14.44	6.18	13.57	13.25	
Salthill 110 kV	5.07	9.54	8.85	4.10	11.49	11.14	5.26	13.47	12.16	3.95	15.04	14.45	
Screeb 110 kV	3.60	2.39	2.31	3.38	2.79	2.75	3.77	2.88	2.65	3.46	3.20	3.10	
Seal Rock A 110 kV	9.17	9.24	8.13	10.81	10.29	9.79	7.72	10.67	9.65	9.46	11.14	10.75	
Seal Rock B 110 kV	9.20	9.25	8.13	10.83	10.30	9.79	7.75	10.67	9.65	9.47	11.14	10.75	
Shankill 110 kV	3.69	7.15	6.76	4.71	6.74	6.63	3.83	9.64	8.40	5.07	8.22	7.89	
Shannonbridge 110 kV	6.89	14.57	12.97	8.51	16.58	15.83	5.86	17.75	16.01	7.50	19.07	18.35	
Shannonbridge 220 kV	8.24	6.35	5.96	10.62	5.71	5.60	7.16	7.71	7.44	9.76	6.45	6.39	
Shellybanks A 220 kV	16.84	15.95	13.74	8.45	18.92	17.74	15.67	23.28	20.58	6.90	26.18	24.91	
Shellybanks B 220 kV	13.02	13.69	12.04	10.37	17.33	16.35	14.62	24.40	21.38	9.76	28.03	26.54	
Shelton Abbey 110 kV	7.86	6.53	6.23	7.85	7.03	6.91	7.54	8.31	7.78	7.61	8.38	8.19	
Singland 110 kV	6.97	11.53	10.40	7.72	12.18	11.73	6.60	18.22	16.53	7.66	16.46	15.96	
Sliabh Bawn 110 kV	3.46	8.29	7.78	4.43	8.01	7.84	3.48	10.48	9.50	4.62	9.25	8.98	
Slievecallan 110 kV	7.23	5.14	4.92	9.08	2.22	2.21	8.61	7.64	6.77	9.73	2.45	2.41	
Sligo 110 kV	3.80	7.10	6.71	4.40	7.19	7.05	3.72	10.62	9.51	4.50	9.34	9.03	
Snugborough 110 kV	-	-	-	-	-	-	6.95	18.27	16.84	7.32	19.48	18.90	
Somerset 110 kV	3.12	7.12	6.74	4.08	4.71	4.66	2.87	8.28	7.83	3.95	5.13	5.07	
Sorne Hill 110 kV	2.68	2.23	2.16	3.32	2.58	2.55	3.46	3.73	3.28	4.36	3.63	3.47	
Srananagh 110 kV	4.60	8.09	7.62	5.29	9.28	9.07	4.80	12.59	11.15	5.76	12.78	12.24	
Srananagh 220 kV	6.57	4.00	3.83	8.65	3.41	3.37	7.55	5.09	4.84	9.88	3.93	3.88	
Stevenstown 110 kV	4.76	5.34	5.02	5.15	3.61	3.56	4.54	6.19	5.71	5.04	3.94	3.87	
Stratford 110 kV	3.18	3.66	3.55	4.15	2.98	2.95	3.33	4.62	4.36	4.35	3.38	3.33	
Taney 110 kV	9.04	8.71	8.15	3.42	8.81	8.60	8.67	10.59	9.88	3.18	10.12	9.89	
Tarbert 110 kV	20.53	9.93	9.33	23.21	11.17	10.91	35.17	17.08	15.91	35.38	16.24	15.86	
Tarbert 220 kV	12.60	9.86	8.93	12.49	13.16	12.57	15.80	23.48	21.05	13.97	27.42	26.20	
Tawnaghmore A 110 kV	2.77	2.53	2.45	3.41	2.86	2.83	4.32	4.66	4.28	5.50	4.31	4.19	
Tawnaghmore B 110 kV	2.85	2.55	2.47	3.38	3.12	3.08	4.38	4.60	4.24	5.49	4.84	4.70	
Thornsberry 110 kV	4.12	5.65	5.35	5.29	5.39	5.30	4.13	7.43	6.95	5.52	6.55	6.42	
Thurles 110 kV	5.16	4.18	3.99	5.54	4.83	4.74	6.23	6.92	6.03	6.52	6.96	6.63	
Tipperary 110 kV	5.20	5.91	5.58	6.12	4.24	4.18	5.31	8.42	7.77	6.34	4.93	4.85	

Table E-2 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2018

			Sun	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]
Tonroe 110 kV	2.67	3.11	3.03	3.74	1.96	1.95	2.71	3.71	3.44	3.83	2.13	2.09
Trabeg 110 kV	6.09	10.17	9.11	6.62	12.53	11.95	7.03	22.74	19.92	8.05	23.09	22.02
Tralee 110 kV	5.19	6.96	6.49	6.14	6.67	6.52	5.02	10.67	9.44	6.15	8.47	8.18
Trien A 110 kV	4.86	6.39	6.01	5.91	6.08	5.96	4.39	9.01	8.26	5.71	7.43	7.25
Trien B 110 kV	10.65	6.19	5.94	8.97	6.87	6.77	10.97	10.10	8.65	8.50	9.63	9.14
Trillick 110 kV	2.72	2.39	2.31	3.40	2.60	2.57	3.55	4.08	3.55	4.46	3.63	3.47
Trinity 110 kV	11.97	11.84	10.80	6.45	14.36	13.82	11.58	14.63	13.07	6.04	17.10	16.33
Tullabrack 110 kV	6.90	6.02	5.76	7.40	4.95	4.89	6.68	8.13	7.71	7.33	5.81	5.74
Turlough 220 kV	12.32	10.94	9.84	13.27	10.12	9.78	10.51	13.22	12.28	11.94	11.44	11.19
Tynagh 220 kV	17.03	10.97	9.82	18.54	12.29	11.76	15.12	12.95	11.98	16.72	13.93	13.53
Uggool 110 kV	5.41	6.22	5.92	5.18	8.12	7.95	6.29	8.52	8.00	5.72	10.64	10.36
Waterford 110 kV	7.65	10.22	9.49	7.74	11.64	11.31	6.64	13.38	12.29	6.95	14.32	13.88
Wexford 110 kV	4.03	5.57	5.32	5.12	5.24	5.17	4.06	7.34	6.58	5.32	6.17	5.98
Whitegate 110 kV	4.60	6.88	6.38	5.16	7.76	7.53	4.26	10.88	10.28	5.10	10.72	10.52
Wolfe Tone 110 kV	14.77	10.19	9.42	5.86	11.84	11.47	14.36	13.25	12.04	5.29	14.74	14.20
Woodhouse 110 kV	5.93	5.27	5.02	7.17	4.19	4.14	5.85	6.85	6.43	7.29	4.81	4.74
Woodland 220 kV	15.20	17.29	15.07	14.21	19.00	17.99	12.29	24.71	22.43	12.12	25.48	24.60
Woodland 400 kV	23.01	7.05	6.47	21.87	8.03	7.76	20.70	9.39	8.95	20.17	10.43	10.24

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Adamstown 110 kV	16.24	11.54	10.00	10.51	12.74	12.05	11.66	13.26	11.97	6.17	15.50	14.86
Agannygal 110 kV	2.80	4.91	4.75	3.88	4.16	4.12	2.94	6.47	5.81	4.23	4.95	4.81
Aghada 110 kV	4.80	6.59	6.24	5.54	8.12	7.93	4.56	10.15	9.67	5.62	11.43	11.22
Aghada A 220 kV	7.21	6.12	5.71	7.56	8.56	8.28	15.68	22.18	19.57	16.71	26.15	24.81
Aghada B 220 kV	7.21	6.12	5.71	7.56	8.56	8.28	15.68	22.18	19.57	16.71	26.15	24.81
Aghada C 220 kV	7.19	6.05	5.65	7.34	8.44	8.17	14.54	21.22	18.81	13.24	25.08	23.84
Aghada D 220 kV	7.21	6.12	5.71	7.56	8.56	8.28	15.68	22.18	19.57	16.71	26.15	24.81
Ahane 110 kV	5.74	10.35	9.63	6.13	7.77	7.63	4.99	15.46	14.28	5.81	9.42	9.26
Anner 110 kV	4.18	5.73	5.43	4.58	4.43	4.37	3.96	7.44	6.93	4.54	5.02	4.94
Ardnacrusha 110 kV	6.52	11.40	10.48	7.90	12.46	12.07	6.49	19.06	17.03	8.55	17.57	16.95
Ardnagappary 110 kV	2.75	1.89	1.84	3.92	1.23	1.22	2.90	2.61	2.43	4.26	1.35	1.34
Arigna 110 kV	4.41	6.14	5.89	5.43	5.15	5.09	4.71	8.57	7.82	5.89	6.14	6.00
Arklow 110 kV	10.91	7.55	7.24	11.61	9.24	9.08	10.15	9.83	9.17	11.33	11.47	11.15
Arklow 220 kV	9.50	6.90	6.54	10.79	6.53	6.41	8.86	8.61	8.20	10.44	7.62	7.51
Artane 110 kV	14.01	10.15	9.43	6.31	12.21	11.84	13.26	13.33	12.10	5.67	15.37	14.78
Arva 110 kV	3.87	8.02	7.58	4.95	6.52	6.43	3.84	10.38	9.43	5.12	7.51	7.33
Athea 110 kV	10.82	6.11	5.92	11.42	6.65	6.58	10.82	9.89	8.60	11.61	9.29	8.86
Athlone 110 kV	4.44	7.21	6.81	5.78	5.53	5.45	4.09	8.48	7.88	5.55	5.98	5.87
Athy 110 kV	4.51	5.78	5.57	5.69	4.89	4.84	4.68	8.03	7.66	5.86	6.42	6.34
Aughinish 110 kV	9.47	9.59	8.51	11.47	10.58	10.10	7.96	10.96	9.92	10.01	11.36	10.96
Ballybeg 110 kV	9.97	5.94	5.73	10.16	7.07	6.96	9.66	7.15	6.79	10.01	8.23	8.07
Ballydine 110 kV	4.20	6.37	6.05	3.86	5.28	5.21	3.93	8.18	7.68	3.72	6.05	5.95
Ballylickey 110 kV	2.94	2.83	2.75	3.92	1.94	1.93	2.98	3.98	3.73	4.08	2.23	2.20
Ballynahulla 110 kV	12.79	7.06	6.78	12.39	7.77	7.66	14.82	11.98	10.49	13.18	11.05	10.58
Ballynahulla 220 kV	8.21	5.98	5.66	8.43	7.02	6.87	8.49	11.16	10.21	8.68	11.30	10.94
Ballyragget 110 kV	5.27	5.44	5.24	6.42	3.93	3.89	5.50	7.31	6.95	6.54	4.98	4.92
Ballyvouskill 110 kV	12.24	6.87	6.59	12.27	8.26	8.12	13.69	11.79	10.48	13.16	12.47	11.94
Ballyvouskill 220 kV	7.91	5.84	5.52	8.44	7.50	7.31	8.50	11.31	10.33	9.31	12.70	12.26
Ballywater 110 kV	5.08	4.96	4.82	3.46	5.26	5.21	4.84	6.32	6.00	3.24	6.17	6.06
Baltrasna 110 kV	6.39	9.52	8.91	7.41	7.55	7.42	5.86	11.01	10.42	7.10	8.31	8.20
Bancroft 110 kV	12.93	11.13	10.27	7.25	13.04	12.63	12.11	13.23	12.23	6.77	15.11	14.65
Bandon 110 kV	3.49	5.16	4.88	4.40	5.32	5.22	3.11	7.87	7.24	4.33	7.03	6.84
Banoge 110 kV	6.53	5.42	5.25	7.16	4.96	4.91	5.95	6.73	6.36	6.90	5.69	5.60
Barnadivane 110 kV	3.64	4.10	3.95	4.26	4.41	4.35	3.92	6.63	5.97	4.79	6.07	5.87
Barnahealy A 110 kV	4.86	8.19	7.65	5.37	9.40	9.15	4.44	14.40	13.41	5.28	14.10	13.77
Barnahealy B 110 kV	6.13	8.10	7.57	6.62	9.17	8.94	6.35	14.41	13.35	7.05	13.75	13.41
Barnakyle 110 kV	2.89	4.74	4.58	4.16	4.18	4.14	2.72	5.46	5.12	4.07	4.50	4.42
Baroda 110 kV	4.21	7.94	7.48	4.98	9.20	8.99	3.89	10.18	9.58	4.76	11.12	10.88
Barrymore 110 kV	4.02	6.22	5.91	4.93	4.21	4.16	3.70	8.96	8.50	4.91	4.92	4.87
Belcamp 110 kV	17.45	16.45	14.38	12.93	19.08	18.06	16.80	21.36	18.67	12.21	23.73	22.51
Belcamp 220 kV	10.94	13.48	11.83	7.12	15.74	14.90	9.18	19.48	17.34	5.90	21.32	20.36
Belgard 110 kV	12.67	11.50	10.53	7.02	14.05	13.54	12.05	13.62	12.45	6.60	16.33	15.73
Bellacorick 110 kV	2.89	2.96	2.87	3.21	3.75	3.70	5.08	6.52	5.62	5.62	7.02	6.63
Binbane 110 kV	3.17	3.50	3.38	4.29	3.46	3.42	3.82	6.73	6.21	5.83	5.00	4.89

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
	X/R	Ik"	Ik'	X/R	Ik"	Ik'	X/R	Ik"	Ik'	X/R	Ik"	Ik'
Station	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]
Blackrock 110 kV	10.49	11.75	10.82	2.53	11.41	11.10	9.95	14.20	12.69	2.40	12.97	12.51
Blake 110 kV	4.12	7.51	7.13	5.10	5.26	5.20	3.87	9.24	8.79	4.99	5.94	5.88
Boggeragh 110 kV	6.12	5.70	5.46	7.10	6.40	6.30	6.68	9.34	8.55	8.01	8.93	8.68
Booltiagh 110 kV	6.53	6.31	6.07	8.05	5.54	5.47	6.97	9.29	8.47	8.80	6.90	6.73
Bracklone 110 kV	4.02	7.74	7.32	5.04	7.34	7.21	3.68	10.33	9.76	4.83	8.90	8.76
Brinny A 110 kV	3.35	4.72	4.49	4.25	4.50	4.43	2.98	6.91	6.41	4.17	5.68	5.56
Brinny B 110 kV	3.35	4.74	4.50	4.25	4.53	4.45	2.98	6.94	6.44	4.17	5.72	5.60
Bunkimalta 110 kV	5.36	5.00	4.80	5.71	5.15	5.08	6.59	8.10	7.14	6.62	7.23	6.94
Butlerstown 110 kV	6.48	9.14	8.66	6.02	9.52	9.34	5.69	11.91	11.07	5.51	11.47	11.20
Cabra 110 kV	12.94	9.82	9.14	5.12	11.03	10.72	12.14	12.83	11.67	4.60	13.63	13.16
Cahir 110 kV	4.59	7.03	6.63	5.52	6.11	6.01	4.53	10.48	9.55	5.75	7.38	7.21
Carlow 110 kV	6.15	7.45	7.12	6.85	8.15	8.02	5.77	10.18	9.44	6.59	10.25	9.99
Carrickmines 220 kV	15.40	15.98	13.99	10.30	19.69	18.57	13.68	22.51	19.93	8.80	26.18	24.89
Carrickmines A 110 kV	30.30	10.96	10.19	24.35	12.12	11.79	31.38	13.16	12.10	24.48	14.01	13.59
Carrickmines B 110 kV	25.18	12.27	11.28	20.99	14.77	14.27	24.73	14.80	13.62	20.48	17.35	16.78
Carrick-on-Shannon 110 kV	4.40	9.59	9.00	5.08	10.65	10.40	4.24	13.37	12.14	5.11	13.56	13.11
Carrigadrohid 110 kV	6.69	8.81	8.24	6.88	9.44	9.21	6.70	16.03	14.64	6.95	13.89	13.51
Carrowbeg 110 kV	2.61	2.38	2.31	3.44	2.29	2.27	2.68	3.19	2.92	3.69	2.77	2.70
Cashla 110 kV	7.18	12.60	11.69	7.52	16.26	15.73	7.32	19.95	18.03	7.75	23.88	22.90
Cashla 220 kV	8.32	8.07	7.57	9.22	8.81	8.60	8.43	12.82	12.03	9.62	12.19	11.94
Castlebagot 110 kV	22.64	17.36	15.91	22.88	11.34	11.12	21.31	21.83	19.86	23.22	14.71	14.39
Castlebagot 220 kV	13.48	18.49	16.00	10.64	19.76	18.69	10.82	26.29	23.19	9.10	26.10	24.96
Castlebar 110 kV	2.95	3.93	3.76	3.49	4.46	4.38	3.38	6.35	5.57	4.15	6.22	5.95
Castledockrill 110 kV	7.63	6.44	6.23	5.21	7.86	7.75	7.21	8.40	7.95	4.81	9.52	9.32
Castlefarm A 110 kV	8.44	9.25	8.23	9.85	9.85	9.43	7.16	10.53	9.56	8.71	10.56	10.21
Castlefarm B 110 kV	8.46	9.24	8.22	9.86	9.84	9.42	7.18	10.51	9.54	8.72	10.54	10.19
Castleview 110 kV	4.35	8.36	7.81	4.74	7.31	7.16	3.69	14.25	13.28	4.46	9.68	9.52
Cathaleen's Fall 110 kV	4.23	6.35	6.03	4.89	7.22	7.08	5.25	13.50	11.59	6.37	11.87	11.31
Cauteen 110 kV	5.50	6.08	5.81	6.35	4.10	4.06	5.93	9.49	8.67	6.71	4.91	4.83
Central 110 kV	14.82	10.06	9.41	7.97	10.90	10.63	14.32	11.97	11.07	7.61	12.49	12.15
Charleville 110 kV	4.55	5.22	5.00	5.88	5.00	4.93	4.80	7.78	7.09	6.61	6.47	6.30
Cherrywood 110 kV	10.66	9.35	8.76	7.76	9.62	9.40	10.16	10.99	10.22	7.44	10.90	10.63
City West 110 kV	6.23	7.39	6.74	6.14	5.55	5.42	5.88	8.51	7.76	5.96	6.09	5.95
Clahane 110 kV	4.35	6.20	5.92	5.29	5.93	5.84	4.01	8.76	8.06	5.14	7.25	7.08
Clashavoon 220 kV	7.63	6.02	5.66	8.22	7.57	7.37	8.47	12.21	11.25	9.39	13.16	12.75
Clashavoon A 110 kV	7.37	9.88	9.18	7.64	13.16	12.72	8.02	19.66	17.61	8.34	23.39	22.35
Clashavoon B 110 kV	7.37	9.88	9.18	7.64	13.16	12.72	8.02	19.66	17.61	8.34	23.39	22.35
Cliff 110 kV	4.00	5.21	4.99	4.94	5.36	5.29	4.54	9.47	8.46	6.00	7.60	7.37
Cloghboola 110 kV	6.92	5.01	4.88	7.36	5.88	5.82	7.18	8.22	6.89	7.75	8.51	7.97
Clogher 110 kV	3.87	5.31	5.07	4.24	6.12	6.01	5.39	12.71	10.16	5.72	10.94	10.19
Cloghran 110 kV	9.48	17.65	15.51	9.41	20.34	19.31	8.47	21.70	19.63	8.66	24.03	23.12
Clonee 220 kV	14.69	16.03	13.92	10.61	15.67	14.91	12.48	23.26	20.77	9.25	20.48	19.76
Clonkeen A 110 kV	5.80	5.13	4.92	6.79	4.00	3.95	5.59	6.77	6.42	6.80	4.61	4.55

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	Ti	nree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Clonkeen B 110 kV	5.82	5.60	5.41	4.94	6.75	6.65	5.64	9.33	8.25	4.50	10.01	9.55
Cloon 110 kV	4.42	6.64	6.34	5.73	5.97	5.88	4.14	8.68	8.07	5.70	7.05	6.91
College Park 110 kV	9.15	16.91	14.96	6.52	20.13	19.13	8.19	20.71	18.82	5.88	23.90	23.01
Cookstown 110 kV	7.51	7.92	7.48	6.06	6.80	6.69	7.06	9.12	8.63	5.83	7.54	7.43
Coolnabacky 110 kV	4.97	7.83	7.44	6.15	6.42	6.33	7.30	15.25	14.39	7.74	18.59	18.15
Coolnabacky 400 kV	-	-	-	-	-	-	14.42	7.88	7.54	12.30	8.12	7.99
Coolroe 110 kV	5.21	7.28	6.86	6.24	7.54	7.38	4.89	11.84	11.01	6.40	10.26	10.04
Coomagearlahy 110 kV	5.69	4.62	4.48	6.05	5.62	5.55	5.99	7.68	6.68	6.50	8.43	7.99
Coomataggart 110 kV	9.22	4.70	4.57	6.92	3.36	3.33	8.90	7.41	6.77	6.49	4.06	3.99
Cordal 110 kV	10.96	6.14	5.93	8.16	6.74	6.65	12.01	10.28	9.05	7.55	9.50	9.11
Corderry 110 kV	4.03	6.28	6.01	4.98	6.26	6.17	4.46	9.92	8.73	5.78	8.25	7.94
Corduff 110 kV	10.44	19.27	16.80	11.14	23.29	21.98	9.29	24.08	21.62	10.26	28.13	26.93
Corduff 220 kV	17.19	17.89	15.23	14.78	21.63	20.15	15.71	28.05	24.33	13.44	31.48	29.72
Corkagh 110 kV	18.61	11.77	10.16	12.51	12.89	12.18	20.32	21.54	19.60	21.59	14.46	14.14
Corraclassy 110 kV	4.32	5.85	5.55	5.38	4.77	4.71	4.37	7.28	6.85	5.58	5.32	5.24
Cow Cross 110 kV	4.58	8.25		4.88	8.12		4.03	14.41	13.42	4.64	11.36	11.14
Crane 110 kV	7.81		7.71			7.93 7.58			8.81	7.18		9.22
Croaghaun 110 kV		7.03	6.77	7.49	7.69		7.37	9.55		-	9.48 5.60	_
Croaghnagawn 110 kV	2.97	2.79	2.71	3.41	3.30	3.27 2.80	5.09	5.77	5.05	5.74		5.35
Cromcastle A 110 kV	4.25	3.39	3.29	5.13 6.88	2.83		7.38	7.80	6.15	7.02 6.23	3.99	3.81
Cromcastle B 110 kV	11.29	15.04	13.29	6.88	17.22	16.39	10.32	19.22	16.98		21.10	
Crory 110 kV	11.29	15.04	13.29		17.22	16.39	10.32	19.22	16.98	6.23	21.10	20.11
Cruiserath 220 kV	19.91 16.86	11.72	10.15	12.58	12.65	11.97	19.46	21.37	19.47	20.57	14.31	14.01
	8.67	17.79	15.16	14.36	21.46	20.01	15.29	27.81	24.14	12.95	31.15	29.42
Cullenagh 110 kV		11.01	10.34	9.08	13.04	12.72	7.55	15.00	13.90	8.22	16.65	16.18
Cullenagh 220 kV	9.11	7.65	7.24	9.29	8.02	7.86	8.26	10.27	9.83	8.72	9.90	9.76
Cunghill 110 kV	3.06	4.19	4.05	3.53	4.20	4.16	3.24	6.49	5.98	3.86	5.54	5.41
Cureeny 110 kV	4.80	4.67	4.50	5.57	4.93	4.87	5.95	7.61	6.69	6.89	7.00	6.71
Cushaling 110 kV	5.84	8.80	8.00	7.05	10.50	10.09	6.92	13.53	12.19	8.81	14.17	13.65
Dallow 110 kV	3.53	4.95	4.77	4.66	3.10	3.07	3.45	5.76	5.45	4.66	3.39	3.36
Dalton 110 kV	3.00	3.58	3.45	4.02	3.19	3.15	3.26	5.24	4.73	4.56	3.96	3.85
Dardistown 110 kV	14.32	15.53	13.68	10.50	18.16	17.24	13.42	19.98	17.58	9.74	22.44	21.33
Darndale 110 kV	16.53	15.96	13.99	13.19	18.18	17.24	15.79	20.58	18.03	12.51	22.42	21.31
Derrybrien 110 kV	2.65	3.85	3.76	3.75	3.69	3.66	2.99	5.21	4.58	4.43	4.58	4.41
Derryiron 110 kV	4.93	7.23	6.88	6.17	7.49	7.36	5.63	10.36	9.71	7.29	9.47	9.28
Doon 110 kV	4.48	6.21	5.87	4.76	4.95	4.87	4.29	8.26	7.65	4.73	5.67	5.57
Dromada 110 kV	8.05	5.88	5.71	6.14	6.25	6.18	7.33	9.38	8.18	5.42	8.57	8.20
Drumkeen 110 kV	3.49	4.84	4.63	4.17	5.07	5.00	3.81	9.49	8.08	4.94	7.65	7.30
Drumline 110 kV	3.64	7.08	6.71	4.80	6.19	6.09	3.20	9.56	8.87	4.62	7.32	7.18
Drybridge 110 kV	5.87	12.20	11.25	6.72	10.39	10.15	5.13	14.96	13.77	6.26	11.89	11.62
Dundalk 110 kV	3.76	8.00	7.60	4.73	7.40	7.29	3.45	9.90	9.12	4.55	8.61	8.40
Dunfirth 110 kV	4.72	5.90	5.67	6.34	4.70	4.65	4.52	6.85	6.62	6.30	5.14	5.09
Dungarvan 110 kV	6.01	5.38	5.18	7.64	4.67	4.62	5.94	7.49	6.90	7.95	5.73	5.61
Dunmanway 110 kV	4.47	6.03	5.71	5.17	6.38	6.26	4.52	10.69	9.54	5.56	9.20	8.89
Dunstown 220 kV	13.51	16.62	14.78	12.89	19.09	18.20	10.82	22.02	20.21	10.79	24.28	23.49

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Dunstown 400 kV	19.08	6.47	6.00	21.42	7.07	6.87	15.80	8.41	8.00	17.04	9.14	8.98
Ennis 110 kV	5.11	9.24	8.68	6.36	8.59	8.42	5.08	14.40	12.76	6.72	11.14	10.78
Fassaroe East 110 kV	5.37	7.43	7.04	5.45	5.76	5.68	5.04	8.58	8.09	5.27	6.36	6.26
Fassaroe West 110 kV	5.53	7.58	7.18	5.55	5.95	5.86	5.18	8.77	8.26	5.36	6.57	6.47
Finglas 220 kV	18.19	17.57	14.96	16.13	21.85	20.33	16.75	27.41	23.66	14.91	32.11	30.18
Finglas A 110 kV	19.39	16.53	14.51	13.84	19.15	18.16	19.03	21.70	18.94	13.17	23.99	22.75
Finglas B 110 kV	32.82	11.32	10.45	29.25	14.20	13.72	36.37	15.13	13.64	31.51	18.34	17.56
Flagford 110 kV	4.70	10.03	9.39	5.44	12.23	11.90	4.53	14.04	12.73	5.47	16.02	15.41
Flagford 220 kV	7.11	6.22	5.90	9.05	6.05	5.94	7.48	8.31	7.91	9.85	7.30	7.19
Francis Street A 110 kV	10.99	11.75	10.83	5.32	14.02	13.55	10.44	14.22	12.70	5.02	16.37	15.64
Francis Street B 110 kV	13.34	11.48	10.55	6.87	13.97	13.48	12.72	13.63	12.49	6.46	16.24	15.67
Galway 110 kV	4.95	9.81	9.19	4.57	12.08	11.76	5.15	15.23	13.74	4.54	17.12	16.44
Garrow 110 kV	9.54	6.64	6.37	9.68	8.02	7.89	9.94	11.38	10.11	9.98	12.13	11.60
Garvagh 110 kV	4.18	5.15	4.98	5.32	5.03	4.97	4.83	7.79	6.91	6.39	6.38	6.16
Gilra 110 kV	3.24	5.83	5.58	4.05	4.65	4.59	3.01	7.03	6.64	3.96	5.17	5.10
Glanagow 220 kV	7.27	6.04	5.64	7.48	8.43	8.15	15.39	21.30	18.87	14.58	25.14	23.89
Glanlee 110 kV	5.65	4.49	4.37	5.75	5.47	5.40	5.94	7.39	6.44	6.01	8.13	7.71
Glasmore A 110 kV	4.07	7.43	6.93	4.59	5.09	5.01	3.80	8.95	8.17	4.45	5.65	5.53
Glenlara A 110 kV	2.98	2.53	2.46	4.20	2.24	2.22	3.14	3.32	3.04	4.66	2.65	2.59
Glenlara B 110 kV	9.27	5.29	5.14	7.16	5.54	5.48	9.55	8.58	7.55	6.63	7.57	7.27
Glenree 110 kV	2.93	3.15	3.06	3.57	3.27	3.23	3.98	6.04	5.52	4.96	4.93	4.80
Glentanemacelligot 110 kV	9.03	5.00	4.86	8.65	4.26	4.23	8.48	7.47	6.81	8.30	5.31	5.19
Golagh 110 kV	3.55	4.64	4.46	4.03	4.66	4.60	4.02	9.49	7.95	4.67	6.97	6.65
Gorman 110 kV	6.83	12.92	11.90	7.72	14.37	13.93	6.04	16.22	14.89	7.11	17.15	16.62
Gorman 220 kV	9.62	10.25	9.48	10.27	8.69	8.49	8.43	12.66	12.00	9.56	9.98	9.83
Gortawee 110 kV	4.41	5.70	5.39	5.83	4.83	4.75	4.47	6.92	6.46	6.10	5.34	5.24
Grange 110 kV	13.83	15.81	13.89	6.94	17.85	16.95	12.88	20.46	17.93	6.26	22.02	20.94
Grange Castle 110 kV	17.12	11.67	10.11	11.60	12.90	12.20	14.36	14.21	12.74	9.09	17.09	16.32
Great Island 110 kV	9.38	11.37	10.72	10.22	14.84	14.45	8.24	15.19	14.03	9.24	18.99	18.36
Great Island 220 kV	12.71	10.21	9.57	14.05	12.40	12.07	10.84	13.02	12.33	12.39	14.87	14.56
Griffinrath A 110 kV	7.24	9.59	9.08	7.54	9.76	9.58	6.60	11.58	10.97	7.09	11.27	11.07
Griffinrath B 110 kV	8.48	10.27	9.69	8.56	10.90	10.68	7.72	12.49	11.82	8.01	12.72	12.48
Harolds 110 kV	11.19	11.79	10.86	5.03	13.98	13.52	10.62	14.25	12.74	4.74	16.30	15.58
Heuston 110 kV	14.43	11.69	10.74	8.26	14.38	13.87	13.81	13.91	12.73	7.79	16.77	16.16
Huntstown A 220 kV	17.86	17.19	14.68	14.42	21.32	19.87	15.98	26.29	22.81	12.70	30.83	29.03
Huntstown B 220 kV	15.77	15.93	13.77	11.60	19.45	18.24	14.92	24.66	21.76	10.24	28.12	26.72
Ikerrin 110 kV	5.31	4.12	3.97	6.08	3.19	3.16	5.75	5.72	5.22	6.47	3.75	3.68
Inchicore 220 kV	15.76	18.68	15.98	11.32	22.87	21.34	13.66	27.13	23.49	9.57	31.23	29.42
Inchicore A 110 kV	29.46	12.84	11.70	25.72	16.17	15.53	30.15	15.44	14.02	25.90	19.08	18.31
Inchicore B 110 kV	44.04	13.32	11.52	34.47	16.80	15.75	47.53	15.44	13.79	35.05	19.08	18.18
Inniscarra 110 kV	4.90	7.08	6.69	5.81	7.19	7.05	4.55	11.43	10.64	5.88	9.64	9.45
Irishtown 220 kV	16.32	17.37	15.02	12.87	21.77	20.39	15.04	25.43	22.16	11.34	29.93	28.24

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Kellis 110 kV	7.56	8.04	7.68	8.59	9.60	9.43	6.76	10.79	10.06	7.94	12.15	11.83
Kellis 220 kV	8.64	7.21	6.86	10.25	6.32	6.23	7.97	8.78	8.44	9.81	7.25	7.17
Kilbarry 110 kV	6.34	11.08	10.13	6.88	13.06	12.59	6.92	25.14	22.03	7.81	23.37	22.38
Kildonan 110 kV	7.56	14.93	13.37	6.32	14.68	14.13	6.79	17.93	16.49	5.86	16.85	16.40
Kilkenny 110 kV	4.94	6.34	6.09	6.39	5.62	5.55	4.78	8.27	7.75	6.36	6.66	6.54
Kill Hill 110 kV	4.94	4.92	4.72	5.94	4.57	4.51	5.68	7.68	6.92	6.89	5.88	5.72
Killonan 110 kV	7.65	13.71	12.47	7.71	12.17	11.82	7.20	24.12	21.41	7.48	16.56	16.09
Killonan 220 kV	8.53	7.88	7.32	10.56	7.55	7.37	7.91	12.52	11.84	10.68	10.01	9.85
Killoteran 110 kV	6.76	9.72	9.18	5.64	10.87	10.64	5.90	12.80	11.86	5.06	13.37	13.01
Kilmahud 110 kV	18.40	11.80	10.19	12.70	13.08	12.35	19.87	21.38	19.48	21.29	14.40	14.09
Kilmore 110 kV	15.15	16.07	14.09	10.17	18.61	17.64	14.29	20.84	18.23	9.40	23.10	21.92
Kilpaddoge 110 kV	13.78	13.51	12.43	14.16	17.33	16.70	12.08	21.59	19.52	12.75	25.50	24.47
Kilpaddoge 220 kV	15.78	12.03	10.96	14.97	16.00	15.33	16.06	25.25	22.60	14.05	30.09	28.71
Kilteel 110 kV	4.47	7.05	6.71	5.51	6.51	6.41	4.29	8.82	8.30	5.45	7.47	7.34
Kinnegad 110 kV	4.58	7.19	6.83	5.98	6.56	6.46	4.59	9.07	8.61	6.20	7.56	7.45
Knockacummer 110 kV	6.23	4.48	4.37	6.32	4.98	4.94	6.08	7.03	6.25	6.24	6.81	6.54
Knockalough 110 kV	4.04	4.00	3.87	3.66	4.07	4.03	4.66	5.58	5.08	3.85	5.04	4.89
Knockanure 220 kV	13.78	10.00	9.24	9.54	13.25	12.77	12.99	19.24	17.45	7.45	23.20	22.26
Knockanure A 110 kV	24.00	9.16	8.75	18.30	10.94	10.74	22.57	15.45	13.41	15.83	16.29	15.45
Knockanure B 110 kV	5.18	7.11	6.76	6.00	6.22	6.13	4.58	9.79	9.08	5.69	7.46	7.32
Knockearagh 110 kV	5.54	4.82	4.62	7.21	4.30	4.25	5.50	6.50	6.01	7.49	5.17	5.06
Knockraha A 110 kV	6.92	11.63	10.64	7.58	13.41	12.94	7.84	25.54	22.87	8.74	22.97	22.18
Knockraha A 220 kV	7.35	7.01	6.50	7.76	8.96	8.67	10.78	20.56	18.52	10.61	19.98	19.28
Knockraha B 110 kV	6.92	11.63	10.64	7.58	13.41	12.94	7.84	25.54	22.87	8.74	22.97	22.18
Knockraha B 220 kV	7.35	7.01	6.50	7.76	8.96	8.67	10.78	20.56	18.52	10.61	19.98	19.28
Knockranny A 110 kV Knockranny B 110 kV	3.98	4.35	4.20	3.61	4.36	4.30	4.54	6.12	5.57	3.78	5.40	5.24
Knockumber 110 kV	5.32 3.87	6.29	6.03	4.89 4.67	8.22	8.07 5.84	6.17	9.03	8.47 8.50	5.29	11.20	6.39
Lanesboro 110 kV	4.11	7.78 9.82	7.33 9.06	5.24	5.93 10.33	10.03	3.56 3.75	12.24	11.05	4.50 4.98	6.49	11.61
Letterkenny110 kV	3.78	5.54	5.27	4.41	6.47	6.34	4.22	11.56	9.69	5.40	10.71	10.10
Liberty A 110 kV	5.58	9.94	9.15	5.07	12.16	11.75	5.54	20.91	18.60	4.72	21.31	20.43
Liberty B 110 kV	5.52	9.93	9.15	4.96	12.14	11.73	5.43	20.88	18.58	4.56	21.24	20.37
Limerick 110 kV	6.06	12.40	11.29	6.89	11.44	11.10	5.10	19.71	17.67	6.41	15.00	14.57
Lisdrum 110 kV	2.89	4.74	4.58	4.16	4.18	4.14	2.72	5.46	5.12	4.07	4.50	4.42
Lisheen 110 kV	4.00	3.18	3.09	4.01	4.77	4.70	4.95	5.30	4.64	4.96	7.95	7.42
Lodgewood 110 kV	9.92	7.28	7.02	10.18	9.16	9.01	9.55	9.73	9.12	9.86	11.39	11.10
Lodgewood 220 kV	9.33	6.59	6.29	10.43	6.51	6.41	8.78	8.29	7.93	10.08	7.64	7.54
Longpoint 220 kV	7.16	6.07	5.66	7.23	8.43	8.15	14.87	21.71	19.20	12.55	25.19	23.94
Louth 220 kV	11.22	14.36	12.90	12.06	16.63	15.92	9.24	19.45	17.95	10.50	20.95	20.33
Louth A 110 kV	7.41	11.50	10.78	8.41	13.93	13.56	6.39	14.10	13.10	7.49	16.52	16.04
Louth B 110 kV	8.06	12.41	11.58	8.86	15.38	14.95	6.83	15.49	14.38	7.75	18.58	18.02
Macetown 110 kV	7.65	15.21	13.58	7.35	16.00	15.35	6.86	18.37	16.81	6.81	18.53	17.97
Macroom 110 kV	6.90	9.55	8.88	6.89	11.37	11.04	7.08	18.69	16.80	6.96	18.50	17.83

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Mallow 110 kV	5.16	5.45	5.21	6.66	5.02	4.95	5.31	7.75	7.24	7.23	6.20	6.08
Marina 110 kV	6.12	10.58	9.69	6.76	13.12	12.64	6.88	23.90	20.95	8.12	24.30	23.18
Maynooth A 110 kV	11.37	11.91	11.15	11.97	14.62	14.22	10.30	14.78	13.89	11.07	17.63	17.19
Maynooth A 220 kV	11.43	15.83	14.06	10.65	15.34	14.72	9.29	20.99	19.18	9.29	18.84	18.31
Maynooth B 110 kV	8.96	15.66	14.20	10.25	15.31	14.81	7.74	18.84	17.62	9.33	17.60	17.22
Maynooth B 220 kV	12.46	17.97	15.71	10.90	17.57	16.75	9.66	24.75	22.40	9.21	22.17	21.48
McDermott 110 kV	16.65	10.43	9.66	6.41	12.28	11.90	16.46	13.83	12.50	5.78	15.50	14.90
Meath Hill 110 kV	4.08	8.09	7.68	5.20	6.86	6.76	3.89	10.17	9.44	5.19	7.93	7.77
Meentycat 110 kV	3.24	4.17	4.01	4.08	4.25	4.19	3.53	7.58	6.56	4.92	6.10	5.85
Midleton 110 kV	4.02	7.40	6.95	4.91	7.14	6.99	3.40	11.76	11.02	4.67	9.42	9.25
Milltown A 110 kV	15.48	12.73	11.66	6.95	15.38	14.83	14.84	15.50	13.78	6.56	18.09	17.24
Milltown B 110 kV	9.24	10.39	9.61	4.25	12.42	12.03	8.72	12.25	11.28	3.99	14.32	13.85
Misery Hill 110 kV	13.82	12.42	11.40	7.66	15.15	14.61	13.20	15.12	13.45	7.25	17.84	17.00
Moneteen 110 kV	6.09	9.63	8.86	6.81	7.39	7.23	5.28	12.79	11.84	6.40	8.56	8.41
Moneypoint 110 kV	15.12	7.99	7.66	17.56	8.31	8.19	15.67	10.82	10.25	18.49	10.23	10.06
Moneypoint 220 kV	16.28	12.15	11.07	15.16	16.13	15.45	16.39	24.86	22.34	13.98	29.71	28.39
Moneypoint G1 400 kV	23.51	8.57	7.77	24.59	9.71	9.34	23.37	11.72	10.99	23.72	12.41	12.11
Moneypoint G2 400 kV	38.74	4.18	3.90	39.91	4.93	4.79	55.75	5.09	4.83	51.23	5.75	5.63
Moneypoint G ₃ 400 kV	23.51	8.57	7.77	24.59	9.71	9.34	23.37	11.72	10.99	23.72	12.41	12.11
Monread 110 kV	4.20	6.98	6.64	5.06	7.04	6.92	3.98	8.73	8.24	4.94	8.20	8.05
Mount Lucas 110 kV	4.46	6.27	5.90	5.64	5.89	5.78	4.75	8.82	8.25	6.21	7.34	7.20
Moy 110 kV	2.90	2.97	2.88	3.37	3.69	3.64	5.25	6.58	5.86	6.45	6.69	6.42
Mullagharlin 110 kV	3.87	8.14	7.74	4.89	7.93	7.80	3.49	9.78	9.14	4.62	9.06	8.86
Mullingar 110 kV	3.60	6.49	6.20	4.94	6.22	6.13	3.49	7.70	7.27	4.94	6.92	6.80
Mulreavy 110 kV	3.57	4.76	4.57	4.09	5.63	5.54	4.57	10.60	8.57	5.60	9.84	9.16
Mungret A 110 kV	5.70	9.20	8.49	6.44	6.91	6.77	4.93	12.05	11.19	6.06	7.94	7.80
Mungret B 110 kV	5.69	9.21	8.50	6.44	6.92	6.78	4.92	12.07	11.22	6.05	7.94	7.81
Nangor 110 kV	15.09	11.39	9.89	9.51	12.56	11.89	12.77	13.84	12.43	7.50	16.55	15.82
Navan 110 kV	5.77	11.41	10.58	6.51	11.33	11.04	5.21	14.19	13.06	6.13	13.23	12.88
Nenagh 110 kV	3.38	3.45	3.33	4.08	2.40	2.39	3.30	4.55	4.19	4.13	2.73	2.68
Newbridge 110 kV	4.51	9.40	8.77	5.20	9.57	9.34	4.14	12.74	11.84	4.99	11.81	11.54
Newbury 110 kV	13.75	15.80	13.87	6.89	17.76	16.87	12.81	20.40	17.89	6.22	21.87	20.80
North Quays 110 kV	19.12	12.98	11.88	6.48	15.40	14.85	18.55	15.85	14.07	6.10	18.10	17.26
North Wall 220 kV	16.13	15.92	13.74	9.67	18.03	16.97	14.89	24.49	21.36	8.16	25.28	24.02
Oldcourt A 110 kV	4.14	7.31	6.88	4.57	6.53	6.41	3.56	11.81	11.14	4.33	8.52	8.40
Oldcourt B 110 kV	4.17	7.35	6.91	4.59	6.58	6.46	3.60	11.90	11.22	4.35	8.61	8.48
Oldstreet 220 kV	14.13	7.48	7.10	12.26	8.70	8.52	15.50	11.75	11.14	12.35	12.28	12.05
Oldstreet 400 kV	15.54	6.81	6.32	10.25	6.62	6.46	15.80	9.31	8.90	9.62	8.25	8.13
Oughtragh 110 kV	3.80	4.02	3.87	4.84	2.80	2.77	3.63	5.18	4.82	4.83	3.13	3.08
Oweninney 110 kV	2.92	2.89	2.80	3.24	3.68	3.63	5.18	6.36	5.49	5.78	6.92	6.53
Pelletstown 110 kV	14.47	9.91	9.22	8.18	10.82	10.53	13.65	12.92	11.77	7.53	13.33	12.89
Platin 110 kV	5.22	11.28	10.45	5.80	8.74	8.57	4.58	13.50	12.57	5.44	9.78	9.61
Pollaphuca 110 kV	2.83	2.42	2.38	4.06	2.24	2.23	3.28	3.19	3.07	4.73	2.63	2.60

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sur	nmer					Wir	nter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	lk' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Poolbeg A 110 kV	28.22	13.54	12.36	22.38	16.89	16.25	28.28	16.59	14.71	22.06	20.12	19.12
Poolbeg A 220 kV	17.07	16.04	13.83	8.34	17.15	16.19	15.80	24.73	21.55	6.90	23.71	22.59
Poolbeg B 110 kV	28.18	13.52	12.35	22.36	16.87	16.23	28.24	16.57	14.69	22.04	20.09	19.10
Poolbeg B 220 kV	15.44	17.66	15.22	10.95	20.25	19.04	13.33	25.12	21.95	9.38	26.81	25.46
Poolbeg C 110 kV	21.72	13.25	12.11	7.53	15.76	15.18	21.25	16.22	14.37	7.11	18.58	17.69
Poppintree 110 kV	12.56	15.48	13.66	7.23	17.78	16.91	11.63	20.00	17.59	6.54	21.97	20.90
Portan 260 kV	24.48	10.37	9.58	110.79	3.14	3.12	21.91	13.73	13.16	119.80	3.29	3.27
Portan 400 kV	19.74	8.77	7.97	17.29	9.87	9.50	16.75	11.93	11.29	15.34	12.81	12.55
Portlaoise 110 kV	4.75	8.85	8.33	6.09	8.19	8.04	5.57	14.75	13.80	6.66	13.18	12.91
Pottery 110 kV	17.80	10.39	9.70	5.86	10.71	10.45	17.40	12.40	11.45	5.56	12.23	11.90
Prospect 220 kV	13.84	10.73	9.88	10.05	12.37	11.97	12.72	19.90	18.25	8.33	19.44	18.87
Raffeen 220 kV	7.19	6.08	5.67	7.17	8.34	8.07	12.57	19.72	17.63	10.47	22.61	21.60
Raffeen A 110 kV	5.52	9.04	8.40	6.05	11.52	11.16	5.48	17.19	15.83	6.40	19.36	18.75
Raffeen B 110 kV	6.88	8.95	8.31	7.44	11.36	11.00	8.15	17.23	15.76	9.07	19.18	18.54
Rathkeale 110 kV	3.75	6.42	6.09	4.92	5.32	5.24	3.42	8.22	7.72	4.80	6.08	5.98
Ratrussan 110 kV	3.19	5.91	5.68	3.99	6.67	6.57	3.66	8.29	7.08	4.83	8.54	8.07
Reamore 110 kV	4.53	5.73	5.48	3.61	5.38	5.31	4.58	8.45	7.56	3.46	6.78	6.57
Richmond A 110 kV	3.25	6.68	6.30	4.39	6.10	5.99	3.03	7.92	7.31	4.25	6.84	6.68
Richmond B 110 kV	3.25	6.68	6.30	4.39	6.10	5.99	3.03	7.92	7.31	4.25	6.84	6.68
Rinawade 110 kV	5.18	10.00	9.35	6.08	7.33	7.21	4.73	11.58	11.07	5.83	8.09	8.00
Ringaskiddy 110 kV	5.63	7.93	7.42	5.92	8.66	8.44	5.47	13.88	12.90	5.94	12.64	12.36
Ringsend 110 kV	28.71	13.64	12.43	23.62	17.02	16.35	28.78	16.78	14.81	23.35	20.32	19.28
Ryebrook 110 kV	5.75	13.22	11.84	6.58	11.96	11.55	5.13	15.37	14.19	6.14	13.20	12.89
Salthill 110 kV	4.98	9.05	8.51	4.07	11.04	10.76	5.23	13.81	12.48	3.92	15.34	14.75
Screeb 110 kV	3.60	2.36	2.29	3.38	2.77	2.74	4.27	3.19	2.90	3.73	3.47	3.34
Seal Rock A 110 kV	9.08	9.45	8.39	10.76	10.45	9.98	7.64	10.76	9.75	9.40	11.20	10.81
Seal Rock B 110 kV	9.11	9.46	8.40	10.78	10.45	9.98	7.67	10.77	9.75	9.41	11.20	10.81
Shankill 110 kV	3.69	7.15	6.79	4.71	6.75	6.64	3.77	9.74	8.54	5.04	8.23	7.92
Shannonbridge 110 kV	6.97	14.61	13.14	8.60	16.60	15.91	5.88	17.87	16.21	7.54	19.10	18.42
Shannonbridge 220 kV	8.14	6.44	6.10	10.57	5.73	5.64	7.14	7.74	7.49	9.80	6.44	6.38
Shellybanks A 220 kV	16.76	16.02	13.81	9.26	19.39	18.17	15.55	24.69	21.51	7.61	27.91	26.37
Shellybanks B 220 kV	15.39	16.70	14.51	11.07	20.68	19.43	14.48	24.47	21.40	9.71	28.34	26.80
Shelton Abbey 110 kV	7.86	6.77	6.52	7.80	7.22	7.12	7.13	8.60	8.08	7.39	8.61	8.43
Singland 110 kV	6.99	11.75	10.81	7.76	11.05	10.75	6.66	19.12	17.26	7.77	14.66	14.27
Sliabh Bawn 110 kV	3.47	8.20	7.72	4.43	7.95	7.79	3.45	10.61	9.65	4.59	9.33	9.07
Slievecallan 110 kV	7.22	5.13	4.95	9.10	2.21	2.20	8.56	7.67	6.80	9.74	2.44	2.41
Sligo 110 kV	3.86	7.09	6.73	4.44	7.22	7.09	3.64	11.01	9.93	4.45	9.55	9.26
Snugborough 110 kV	7.65	15.28	13.60	7.81	16.93	16.19	6.86	18.40	16.82	7.22	19.56	18.92
Somerset 110 kV	3.13	7.08	6.73	4.09	4.69	4.64	2.86	8.32	7.88	3.95	5.14	5.08
Sorne Hill 110 kV	2.68	2.28	2.22	3.32	2.64	2.62	3.35	3.83	3.40	4.28	3.70	3.56
Srananagh 110 kV	4.74	8.08	7.64	5.42	9.30	9.10	4.67	13.10	11.73	5.66	13.17	12.67

Table E-3 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2021

			Sun	nmer					Wir	iter		
	Tł	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Srananagh 220 kV	6.61	3.96	3.81	8.67	3.41	3.37	7.55	5.18	4.95	9.91	3.97	3.93
Stevenstown 110 kV	4.05	6.10	5.77	4.57	3.94	3.89	3.81	7.10	6.63	4.46	4.30	4.24
Stratford 110 kV	3.29	3.71	3.61	4.26	2.99	2.97	3.36	4.77	4.52	4.40	3.44	3.39
Taney 110 kV	9.12	9.03	8.50	3.35	9.02	8.83	8.65	10.62	9.89	3.18	10.17	9.93
Tarbert 110 kV	24.87	10.65	10.11	27.60	11.81	11.58	35.34	17.24	16.08	36.16	16.34	15.97
Tarbert 220 kV	14.93	11.63	10.63	14.74	15.25	14.63	15.56	24.34	21.84	14.58	28.26	27.02
Tawnaghmore A 110 kV	2.78	2.54	2.47	3.40	2.89	2.86	4.57	5.27	4.78	5.89	4.74	4.60
Tawnaghmore B 110 kV	2.86	2.56	2.49	3.37	3.14	3.11	4.71	5.20	4.75	6.01	5.35	5.18
Thornsberry 110 kV	4.11	5.69	5.42	5.29	5.41	5.33	4.23	7.75	7.29	5.68	6.72	6.60
Thurles 110 kV	5.14	4.16	4.00	5.52	4.78	4.71	6.21	6.96	6.08	6.52	6.94	6.62
Tievebrack 110 kV	3.37	3.34	3.22	4.50	2.67	2.64	3.73	5.51	5.09	5.22	3.31	3.26
Tipperary 110 kV	5.16	5.89	5.62	6.10	4.13	4.09	5.28	8.48	7.85	6.34	4.82	4.74
Tonroe 110 kV	2.68	3.11	3.03	3.74	1.98	1.96	2.72	3.76	3.50	3.85	2.14	2.11
Trabeg 110 kV	6.12	10.50	9.62	6.69	12.91	12.44	6.82	23.50	20.65	7.86	23.63	22.57
Tralee 110 kV	5.16	7.16	6.78	6.07	6.70	6.58	5.14	11.11	9.82	6.29	8.66	8.37
Trien A 110 kV	4.83	6.56	6.25	5.90	6.13	6.04	4.35	9.16	8.41	5.69	7.50	7.32
Trien B 110 kV	12.82	6.94	6.70	10.10	7.45	7.36	11.78	11.37	9.78	8.96	10.41	9.91
Trillick 110 kV	2.72	2.45	2.38	3.39	2.67	2.64	3.43	4.22	3.69	4.38	3.71	3.56
Trinity 110 kV	12.18	12.09	11.11	6.39	14.61	14.10	11.59	14.67	13.07	6.04	17.14	16.35
Tullabrack 110 kV	6.95	6.15	5.94	7.47	4.99	4.94	6.65	8.18	7.76	7.35	5.83	5.75
Turlough 220 kV	12.12	11.46	10.38	13.11	10.41	10.09	10.40	13.38	12.44	11.86	11.53	11.28
Tynagh 220 kV	10.78	7.06	6.71	11.84	8.76	8.58	14.87	13.13	12.17	16.50	14.09	13.69
Uggool 110 kV	5.33	6.02	5.78	5.11	7.89	7.75	6.26	8.63	8.11	5.69	10.76	10.48
Waterford 110 kV	8.26	10.56	9.94	8.19	11.93	11.65	7.21	14.19	13.06	7.43	14.92	14.48
Wexford 110 kV	5.87	5.87	5.66	7.06	5.72	5.65	5.75	7.84	7.07	7.20	6.85	6.64
Whitegate 110 kV	4.58	6.98	6.58	5.16	7.82	7.65	4.21	11.00	10.42	5.06	10.81	10.61
Wolfe Tone 110 kV	14.84	10.22	9.48	5.86	11.91	11.55	14.31	13.49	12.21	5.26	14.95	14.39
Woodhouse 110 kV	5.94	5.28	5.08	7.18	4.16	4.12	5.91	7.25	6.76	7.39	4.95	4.87
Woodland 220 kV	16.35	18.74	16.27	14.74	20.47	19.36	12.74	26.95	24.26	12.37	27.34	26.33
Woodland 400 kV	21.54	8.81	8.01	19.26	9.95	9.58	18.51	12.02	11.37	17.27	12.96	12.70

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

			Sun	nmer					Wir	iter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Adamstown 110 kV	12.09	10.95	10.02	6.55	13.21	12.72	11.62	13.34	11.96	6.16	15.59	14.91
Agannygal 110 kV	2.77	4.96	4.81	3.86	4.18	4.14	2.94	6.47	5.81	4.23	4.94	4.80
Aghada 110 kV	5.06	7.79	7.35	5.99	9.22	9.00	4.54	10.20	9.71	5.60	11.48	11.27
Aghada A 220 kV	10.95	10.22	9.19	11.73	13.64	12.98	15.43	22.27	19.66	16.54	26.21	24.88
Aghada B 220 kV	10.95	10.22	9.19	11.73	13.64	12.98	15.43	22.27	19.66	16.54	26.21	24.88
Aghada C 220 kV	10.75	10.00	9.01	10.78	13.33	12.69	14.34	21.30	18.89	13.14	25.14	23.91
Aghada D 220 kV	10.95	10.22	9.19	11.73	13.64	12.98	15.43	22.27	19.66	16.54	26.21	24.88
Ahane 110 kV	5.59	11.11	10.36	6.06	8.00	7.86	4.97	15.58	14.40	5.80	9.45	9.29
Anner 110 kV	4.08	5.91	5.61	4.54	4.48	4.42	4.04	7.75	7.17	4.59	5.09	5.00
Ardnacrusha 110 kV	6.38	12.24	11.28	7.85	13.09	12.71	6.45	19.30	17.24	8.52	17.72	17.09
Ardnagappary 110 kV	2.77	1.93	1.87	3.93	1.26	1.25	2.90	2.63	2.44	4.26	1.35	1.33
Arigna 110 kV	4.42	6.25	5.95	5.45	5.22	5.14	4.68	8.59	7.84	5.87	6.14	6.00
Arklow 110 kV	10.77	7.62	7.30	11.48	9.31	9.14	10.13	9.84	9.16	11.31	11.46	11.14
Arklow 220 kV	9.32	7.01	6.65	10.65	6.59	6.48	8.83	8.63	8.23	10.42	7.62	7.51
Artane 110 kV	13.95	10.20	9.41	6.30	12.26	11.85	13.14	13.52	12.22	5.62	15.53	14.91
Arva 110 kV	3.90	7.94	7.43	4.97	6.51	6.39	3.84	10.43	9.44	5.12	7.51	7.33
Athea 110 kV	10.64	6.45	6.27	11.30	6.91	6.84	10.73	10.00	8.73	11.55	9.35	8.94
Athlone 110 kV	4.41	7.31	6.89	5.77	5.57	5.48	4.08	8.55	7.90	5.54	6.02	5.91
Athy 110 kV	5.09	6.91	6.65	6.10	5.79	5.73	4.69	8.17	7.79	5.89	6.47	6.39
Aughinish 110 kV	9.08	9.78	8.74	11.11	10.59	10.15	7.92	11.01	9.98	9.96	11.40	11.01
Ballybeg 110 kV	9.88	5.98	5.76	10.09	7.11	7.00	9.65	7.14	6.78	10.00	8.21	8.05
Ballydine 110 kV	4.10	6.59	6.27	3.81	5.37	5.30	4.03	8.58	7.98	3.75	6.17	6.06
Ballylickey 110 kV	2.85	2.92	2.84	3.89	1.94	1.93	2.98	3.98	3.73	4.08	2.23	2.20
Ballynahulla 110 kV	13.80	7.60	7.34	13.04	8.20	8.09	14.74	12.05	10.57	13.14	11.09	10.63
Ballynahulla 220 kV	8.38	6.95	6.59	8.60	7.86	7.70	8.35	11.31	10.38	8.59	11.39	11.05
Ballyragget 110 kV	5.80	6.33	6.11	6.69	4.56	4.52	5.51	7.42	7.04	6.55	5.00	4.94
Ballyvouskill 110 kV	13.67	7.46	7.17	13.39	8.82	8.68	13.63	11.83	10.54	13.12	12.51	11.98
Ballyvouskill 220 kV	8.31	6.92	6.54	8.93	8.65	8.44	8.39	11.41	10.45	9.22	12.79	12.36
Ballywater 110 kV	5.03	5.01	4.87	3.43	5.29	5.24	4.83	6.33	5.99	3.24	6.18	6.07
Baltrasna 110 kV	6.40	9.50	8.84	7.42	7.54	7.40	5.85	10.99	10.38	7.09	8.30	8.18
Bancroft 110 kV	12.72	11.22	10.34	7.18	13.13	12.70	12.08	13.27	12.26	6.75	15.11	14.65
Bandon 110 kV	3.37	5.69	5.38	4.37	5.70	5.59	3.08	7.97	7.32	4.34	7.07	6.89
Banoge 110 kV	6.47	5.47	5.29	7.12	5.00	4.94	5.95	6.74	6.35	6.89	5.69	5.59
Barnadivane 110 kV	3.53	4.35	4.20	4.20	4.60	4.54	3.90	6.64	5.98	4.78	6.05	5.85
Barnahealy A 110 kV	5.18	10.16	9.42	5.78	10.93	10.63	4.42	14.49	13.49	5.26	14.16	13.83
Barnahealy B 110 kV	6.95	9.97	9.26	7.42	10.58	10.30	6.29	14.51	13.43	7.02	13.82	13.47
Barnakyle 110 kV	2.91	4.71	4.52	4.17	4.17	4.12	2.80	5.73	5.28	4.23	4.59	4.49
Baroda 110 kV	4.13	8.30	7.82	4.92	9.52	9.30	3.87	10.23	9.61	4.74	11.16	10.90
Barrymore 110 kV	3.96	6.82	6.49	4.95	4.31	4.27	3.68	8.99	8.52	4.90	4.91	4.86
Belcamp 110 kV	17.31	16.53	14.35	12.86	19.15	18.08	16.52	21.73	18.95	12.04	24.06	22.81
Belcamp 220 kV	10.87	13.53	11.79	7.10	15.79	14.89	8.90	20.00	17.79	5.76	21.76	20.79
Belgard 110 kV	12.52	11.59	10.58	6.96	14.14	13.61	12.00	13.67	12.46	6.58	16.35	15.74
Bellacorick 110 kV	3.49	3.48	3.30	3.81	4.50	4.39	5.96	8.58	7.08	6.55	9.27	8.60
Binbane 110 kV	ノ・4ブ	ر ۲۰۹۰	3.38	4.30	3.48	3.43	3.82	6.73	6.20	5.83	21	4.89

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

			Sun	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	Th	ree Pha	se	Si	ngle Pha	ise
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Blackrock 110 kV	10.39	11.86	10.87	2.52	11.46	11.13	9.92	14.35	12.74	2.39	12.98	12.50
Blake 110 kV	4.07	7.75	7.35	5.07	5.34	5.27	3.85	9.27	8.80	4.98	5.94	5.87
Boggeragh 110 kV	6.18	6.22	5.97	7.26	6.83	6.72	6.65	9.37	8.58	7.99	8.95	8.69
Booltiagh 110 kV	6.43	6.52	6.29	8.01	5.65	5.59	6.94	9.33	8.52	8.79	6.91	6.75
Bracklone 110 kV	3.96	8.52	8.05	5.00	7.85	7.71	3.66	10.42	9.84	4.81	8.93	8.78
Brinny A 110 kV	3.23	5.15	4.89	4.22	4.75	4.67	2.96	6.98	6.47	4.17	5.70	5.58
Brinny B 110 kV	3.23	5.17	4.91	4.22	4.78	4.70	2.96	7.01	6.50	4.17	5.75	5.62
Bunkimalta 110 kV	5.29	5.14	4.95	5.66	5.25	5.18	6.58	8.14	7.18	6.61	7.25	6.97
Butlerstown 110 kV	6.37	9.56	9.07	5.94	9.80	9.62	5.63	12.04	11.15	5.46	11.55	11.26
Cabra 110 kV	12.89	9.87	9.12	5.11	11.06	10.72	12.03	13.00	11.78	4.57	13.75	13.26
Cahir 110 kV	4.44	7.35	6.95	5.43	6.24	6.14	4.60	10.70	9.72	5.81	7.43	7.26
Carlow 110 kV	5.87	8.09	7.73	6.60	8.69	8.54	5.74	10.34	9.56	6.57	10.36	10.08
Carrickmines 220 kV	14.71	16.35	14.27	9.97	20.06	18.89	13.55	22.88	20.25	8.71	26.49	25.18
Carrickmines A 110 kV	29.57	11.06	10.27	23.94	12.20	11.86	31.38	13.24	12.14	24.46	14.07	13.62
Carrickmines B 110 kV	24.54	12.39	11.38	20.59	14.89	14.37	24.73	14.86	13.66	20.45	17.38	16.80
Carrick-on-Shannon	4.42	9.73	9.04	5.11	10.77	10.47	4.22	13.44	12.18	5.09	13.58	13.12
Carrigadrohid 110 kV	6.99	10.34	9.66	7.13	10.47	10.22	6.65	16.11	14.73	6.92	13.91	13.54
Carrowbeg 110 kV	2.75	2.69	2.57	3.63	2.50	2.47	2.74	3.66	3.37	3.82	3.01	2.94
Cashla 110 kV	7.24	13.34	12.29	7.59	17.06	16.45	7.13	20.49	18.54	7.59	24.39	23.40
Cashla 220 kV	8.36	8.56	7.98	9.31	9.18	8.94	8.26	13.09	12.31	9.50	12.34	12.10
Castlebagot 110 kV	22.09	18.45	16.26	23.51	13.29	12.87	21.02	21.81	19.85	23.03	14.65	14.34
Castlebagot 220 kV	12.99	19.10	16.33	10.56	20.44	19.23	10.61	26.37	23.28	8.99	26.01	24.89
Castlebar 110 kV	3.37	4.78	4.48	3.93	5.37	5.24	3.95	8.54	7.42	4.77	7.92	7.56
Castledockrill 110 kV	7.54	6.53	6.31	5.16	7.94	7.83	7.20	8.43	7.96	4.80	9.54	9.33
Castlefarm A 110 kV	8.11	9.43	8.44	9.56	9.86	9.47	7.12	10.58	9.62	8.68	10.59	10.25
Castlefarm B 110 kV	8.12	9.41	8.43	9.58	9.84	9.46	7.14	10.56	9.60	8.69	10.58	10.23
Castleview 110 kV	4.36	10.13	9.43	4.80	8.00	7.84	3.65	14.36	13.38	4.45	9.71	9.55
Cathaleen's Fall	4.28	6.35	5.96	4.94	7.23	7.05	5.23	13.56	11.63	6.35	11.90	11.34
Cauteen 110 kV	5.39	6.30	6.04	6.31	4.14	4.10	5.95	9.56	8.73	6.72	4.92	4.84
Central 110 kV	14.61	10.15	9.47	7.90	10.97	10.69	14.29	12.03	11.09	7.59	12.53	12.16
Charleville 110 kV	4.53	5.50	5.27	5.94	5.15	5.09	4.79	7.82	7.11	6.60	6.50	6.33
Cherrywood 110 kV	10.54	9.43	8.81	7.70	9.67	9.44	10.14	11.04	10.23	7.43	10.91	10.63
City West 110 kV	6.20	7.25	6.77	6.13	5.54	5.44	5.87	8.61	7.78	5.95	6.14	5.99
Clahane 110 kV	4.21	6.50	6.21	5.20	6.10	6.02	3.98	8.91	8.18	5.13	7.35	7.17
Clashavoon 220 kV	8.33	7.47	6.99	9.05	8.99	8.74	8.38	12.30	11.35	9.32	13.22	12.83
Clashavoon A 110 kV	7.88	11.81	10.95	8.18	15.32	14.82	7.95	19.78	17.74	8.29	23.51	22.47
Clashavoon B 110 kV	7.88	11.81	10.95	8.18	15.32	14.82	7.95	19.78	17.74	8.29	23.51	22.47
Cliff 110 kV	4.04	5.24	4.97	4.98	5.38	5.28	4.53	9.50	8.48	5.99	7.62	7.38
Cloghboola 110 kV	6.74	5.23	5.11	7.22	6.09	6.03	7.12	8.28	6.97	7.70	8.55	8.02
Clogher 110 kV	3.92	5.28	4.98	4.28	6.08	5.95	5.39	12.74	10.18	5.72	10.96	10.20
Cloghran 110 kV	9.47	17.66	15.40	9.40	20.35	19.26	8.44	21.82	19.70	8.64	24.12	23.19
Clonee 220 kV		16.07	13.84	10.51		14.91	12.18		21.85	9.05	21.23	20.48
CIUIICE ZZU KV	14.43	10.0/	13.04	10.51	15.72	14.91	12.10	24.54	21.05	9.05	21.23	20.40

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

			Sur	nmer					Wir	nter		
	Tŀ	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]									
Clonkeen A 110 kV	5.75	5.42	5.22	6.80	4.08	4.04	5.59	6.81	6.45	6.79	4.61	4.56
Clonkeen B 110 kV	5.77	6.00	5.81	4.86	7.14	7.05	5.62	9.36	8.29	4.49	10.03	9.58
Cloon 110 kV	4.45	6.99	6.63	5.80	6.15	6.06	4.05	8.99	8.37	5.64	7.18	7.04
College Park 110 kV	9.14	16.92	14.86	6.52	20.14	19.07	8.16	20.81	18.89	5.86	23.99	23.07
Cookstown 110 kV	7.44	7.97	7.52	6.02	6.82	6.70	7.04	9.11	8.62	5.82	7.52	7.40
Coolnabacky 110 kV	8.35	12.85	12.06	8.64	15.98	15.55	7.62	16.14	15.23	8.03	19.43	18.97
Coolnabacky 400 kV	10.45	9.09	8.22	10.08	8.71	8.41	9.01	14.46	13.52	8.48	11.89	11.66
Coolroe 110 kV	5.31	8.39	7.90	6.50	8.25	8.09	4.86	11.90	11.06	6.39	10.29	10.07
Coomagearlahy 110 kV	5.64	4.90	4.77	6.03	5.89	5.83	5.97	7.70	6.70	6.49	8.45	8.01
Coomataggart 110 kV	9.54	4.99	4.86	6.94	3.47	3.45	8.88	7.43	6.79	6.48	4.06	3.99
Cordal 110 kV	11.43	6.55	6.35	8.21	7.05	6.97	11.96	10.33	9.11	7.53	9.53	9.15
Corderry 110 kV	4.02	6.42	6.10	4.98	6.36	6.25	4.41	9.96	8.78	5.74	8.26	7.96
Corduff 110 kV	10.41	19.28	16.67	11.11	23.31	21.91	9.26	24.23	21.71	10.23	28.27	27.04
Corduff 220 kV	16.83	17.96	15.15	14.53	21.71	20.14	15.15	29.44	25.46	13.02	32.70	30.85
Corkagh 110 kV	21.15	18.23	16.08	21.94	13.07	12.66	20.06	21.52	19.60	21.43	14.40	14.09
Corraclassy 110 kV	4.38	5.73	5.38	5.42	4.74	4.66	4.37	7.22	6.78	5.59	5.28	5.20
Cow Cross 110 kV	4.76	10.19	9.46	5.06	9.14	8.94	4.00	14.51	13.50	4.62	11.40	11.18
Crane 110 kV	7.70	7.14	6.86	7.41	7.77	7.66	7.36	9.61	8.84	7.17	9.52	9.25
Croaghaun 110 kV	3.57	3.26	3.10	3.98	4.10	4.02	6.05	7.58	6.33	6.89	7.96	7.43
Croaghnagawn 110 kV	4.29	3.42	3.30	5.15	2.87	2.84	7.37	7.81	6.16	7.02	3.99	3.81
Cromcastle A 110 kV	11.24	15.10	13.26	6.87	17.28	16.39	10.17	19.52	17.21	6.15	21.36	20.35
Cromcastle B 110 kV	11.24	15.10	13.26	6.87	17.28	16.39	10.17	19.52	17.21	6.15	21.36	20.35
Crory 110 kV	20.33	18.09	15.98	20.95	12.94	12.54	19.22	21.34	19.46	20.42	14.26	13.95
Cruiserath 220 kV	16.52	17.85	15.07	14.13	21.55	20.00	14.74	29.17	25.25	12.54	32.35	30.53
Cullenagh 110 kV	8.65	11.70	11.01	9.09	13.66	13.33	7.42	15.23	14.06	8.10	16.82	16.32
Cullenagh 220 kV	9.24	8.33	7.90	9.41	8.48	8.32	8.24	10.32	9.87	8.70	9.93	9.78
Cunghill 110 kV	3.23	4.81	4.58	3.72	4.60	4.53	3.13	6.85	6.34	3.78	5.69	5.56
Cureeny 110 kV	4.72	4.79	4.63	5.52	5.02	4.96	5.93	7.64	6.72	6.88	7.02	6.73
Cushaling 110 kV	5.76	9.34	8.50	7.03	11.00	10.59	6.86	13.57	12.24	8.75	14.17	13.65
Dallow 110 kV	3.52	5.03	4.85	4.66	3.12	3.09	3.45	5.76	5.45	4.66	3.39	3.35
Dalton 110 kV	3.12	3.96	3.78	4.19	3.41	3.36	3.25	5.80	5.27	4.61	4.19	4.09
Dardistown 110 kV	14.23	15.60	13.65	10.46	18.22	17.25	13.21	20.30	17.83	9.62	22.74	21.61
Darndale 110 kV	16.41	16.03	13.96	13.12	18.24	17.26	15.54	20.92	18.30	12.35	22.72	21.58
Derrybrien 110 kV	2.62	3.88	3.78	3.73	3.71	3.68	2.98	5.20	4.58	4.43	4.57	4.40
Derryiron 110 kV	4.87	7.31	6.94	6.11	7.54	7.41	5.61	10.42	9.76	7.27	9.50	9.31
Doon 110 kV	4.38	6.43	6.09	4.71	5.02	4.94	4.42	8.64	7.95	4.79	5.76	5.65
Dromada 110 kV	7.83	6.19	6.02	5.99	6.48	6.41	7.27	9.47	8.30	5.38	8.62	8.26
Drumkeen 110 kV	3.54	4.77	4.51	4.21	5.08	4.97	3.81	9.51	8.08	4.94	7.64	7.29
Drumline 110 kV	3.54	7.33	6.96	4.74	6.31	6.22	3.19	9.63	8.92	4.61	7.38	7.23
Drybridge 110 kV	5.91	12.08	11.04	6.74	10.35	10.07	5.13	14.99	13.72	6.26	11.91	11.62
Dundalk 110 kV	3.80	7.86	7.40	4.74	7.33	7.19	3.45	9.91	9.08	4.55	8.56	8.34
Dunfirth 110 kV	4.70	5.93	5.68	6.33	4.71	4.65	4.50	6.84	6.61	6.28	5.13	5.08
Dungarvan 110 kV	6.03	5.64	5.43	7.74	4.79	4.74	5.92	7.51	6.91	7.93	5.72	5.60
Dunmanway 110 kV	4.35	6.70	6.34	5.14	6.83	6.70	4.49	10.76	9.59	5.55	9.22	8.91

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

			Sur	nmer					Wir	nter		
	Th	ree Pha	se	Si	ngle Pha	se	TI	hree Pha	se	Si	ngle Pha	se
	X/R	Ik"	Ik'	X/R	Ik"	Ik'	X/R	Ik"	Ik'	X/R	Ik"	Ik'
Station	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]	Ratio	[kA]	[kA]
Dunstown 220 kV	12.82	18.41	16.19	12.35	20.77	19.72	11.97	23.63	21.72	11.49	25.54	24.74
Dunstown 400 kV	10.77	8.86	8.02	12.71	9.29	8.95	10.99	15.19	14.15	10.89	14.64	14.29
Ennis 110 kV	4.99	9.66	9.09	6.30	8.80	8.63	5.06	14.53	12.85	6.71	11.22	10.86
Fassaroe East 110 kV	5.33	7.48	7.07	5.42	5.77	5.69	5.03	8.58	8.08	5.26	6.33	6.24
Fassaroe West 110 kV	5.48	7.63	7.21	5.53	5.96	5.87	5.17	8.77	8.25	5.36	6.55	6.45
Finglas 220 kV	17.84	17.64	14.89	15.87	21.95	20.33	16.03	28.57	24.61	14.36	33.25	31.23
Finglas A 110 kV	19.20	16.62	14.48	13.76	19.23	18.18	18.71	22.09	19.23	12.99	24.34	23.06
Finglas B 110 kV	32.38	11.39	10.43	28.90	14.27	13.74	35.97	15.37	13.80	31.22	18.58	17.76
Flagford 110 kV	4.73	10.17	9.43	5.48	12.38	12.00	4.50	14.12	12.77	5.44	16.07	15.45
Flagford 220 kV	7.26	6.27	5.89	9.20	6.08	5.96	7.45	8.33	7.92	9.83	7.29	7.18
Francis Street A 110 kV	10.89	11.86	10.87	5.29	14.11	13.62	10.40	14.37	12.75	5.01	16.47	15.69
Francis Street B 110 kV	13.18	11.57	10.60	6.82	14.06	13.55	12.67	13.68	12.50	6.44	16.27	15.68
Galway 110 kV	4.90	10.26	9.55	4.53	12.52	12.15	5.05	15.55	14.01	4.46	17.39	16.69
Garrow 110 kV	10.08	7.20	6.92	10.14	8.55	8.42	9.89	11.42	10.16	9.95	12.16	11.64
Garvagh 110 kV	4.18	5.26	5.04	5.33	5.10	5.02	4.78	7.82	6.94	6.35	6.40	6.18
Gilra 110 kV	3.24	5.89	5.60	4.06	4.68	4.62	3.00	7.03	6.64	3.96	5.16	5.09
Glanagow 220 kV	11.39	10.29	9.23	11.63	13.66	12.98	15.17	21.38	18.95	14.46	25.20	23.96
Glanlee 110 kV	5.60	4.76	4.64	5.72	5.73	5.67	5.92	7.40	6.46	6.00	8.15	7.73
Glasmore A 110 kV	4.07	7.46	6.92	4.59	5.09	5.00	3.77	9.06	8.24	4.43	5.67	5.55
Glenlara A 110 kV	2.94	2.56	2.50	4.19	2.26	2.24	3.14	3.33	3.05	4.66	2.68	2.62
Glenlara B 110 kV	9.45	5.59	5.45	7.14	5.74	5.69	9.51	8.61	7.59	6.61	7.59	7.29
Glenree 110 kV	3.36	4.24	4.00	4.11	4.01	3.94	3.73	7.28	6.63	4.81	5.48	5.35
Glentanemacelligot 110 kV	9.17	5.26	5.13	8.71	4.38	4.35	8.45	7.49	6.84	8.29	5.32	5.20
Golagh 110 kV	3.59	4.64	4.41	4.06	4.68	4.60	4.01	9.51	7.96	4.66	6.97	6.65
Gorman 110 kV	6.84	12.74	11.62	7.71	14.23	13.73	6.13	16.29	14.87	7.17	17.35	16.78
Gorman 220 kV	9.52	9.97	9.13	10.15	8.57	8.34	9.78	13.09	12.31	10.04	10.84	10.65
Gortawee 110 kV	4.46	5.62	5.27	5.86	4.81	4.72	4.47	6.88	6.41	6.11	5.30	5.21
Grange 110 kV	13.75	15.88	13.86	6.93	17.91	16.96	12.69	20.81	18.19	6.19	22.31	21.20
Grange Castle 110 kV	14.60	11.61	10.57	9.51	14.38	13.81	14.30	14.30	12.73	9.06	17.19	16.37
Great Island 110 kV	9.27	11.95	11.28	10.15	15.47	15.08	8.15	15.35	14.13	9.14	19.15	18.48
Great Island 220 kV	12.50	10.82	10.17	13.93	12.97	12.64	10.79	13.11	12.42	12.35	14.92	14.61
Griffinrath A 110 kV	7.11	9.69	9.14	7.45	9.83	9.63	6.60	11.62	11.00	7.08	11.29	11.09
Griffinrath B 110 kV	8.31	10.38	9.77	8.44	10.99	10.75	7.72	12.55	11.85	8.00	12.76	12.51
Harolds 110 kV	11.08	11.90	10.91	5.00	14.07	13.58	10.59	14.40	12.79	4.73	16.39	15.63
Heuston 110 kV	14.24	11.79	10.79	8.19	14.47	13.94	13.75	13.97	12.75	7.76	16.81	16.18
Huntstown A 220 kV	17.55	17.25	14.62	14.23	21.41	19.86	15.30	27.33	23.68	12.24	31.85	29.99
Huntstown B 220 kV	15.51	15.98	13.70	11.47	19.52	18.23	14.43	25.65	22.60	9.92	29.01	27.56
Ikerrin 110 kV	5.26	4.16	4.02	6.05	3.21	3.18	5.76	5.75	5.24	6.47	3.75	3.68
Inchicore 220 kV	15.11	18.99	16.18	11.00	23.21	21.61	13.44	27.47	23.77	9.43	31.51	29.67
Inchicore A 110 kV	28.80	12.95	11.77	25.27	16.29	15.62	29.97	15.52	14.05	25.74	19.14	18.35
Inchicore B 110 kV	42.74	12.50	11.35	33.39	15.86	15.20	47.20	15.53	13.78	34.80	19.19	18.23
Inniscarra 110 kV	4.92	8.10	7.65	5.96	7.82	7.67	4.53	11.48	10.69	5.87	9.67	9.47
Irishtown 220 kV	15.61	17.70	15.25	12.42	22.13	20.69	14.84	25.78	22.46	11.21	30.23	28.52

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

	Summer Winter											
	Tŀ	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Kellis 110 kV	7.09	8.70	8.30	8.15	10.23	10.04	6.72	10.95	10.19	7.91	12.28	11.95
Kellis 220 kV	8.49	7.50	7.14	10.14	6.47	6.38	8.00	8.90	8.57	9.85	7.29	7.21
Kilbarry 110 kV	7.24	14.39	13.01	7.84	15.83	15.23	6.84	25.40	22.22	7.76	23.51	22.50
Kildonan 110 kV	7.57	14.93	13.29	6.32	14.69	14.11	6.77	18.00	16.53	5.84	16.87	16.41
Kilkenny 110 kV	5.01	6.93	6.66	6.47	5.99	5.92	4.76	8.38	7.82	6.36	6.73	6.60
Kill Hill 110 kV	4.84	5.03	4.83	5.88	4.62	4.57	5.72	7.75	6.97	6.92	5.90	5.73
Killonan 110 kV	7.57	15.14	13.79	7.67	12.85	12.50	7.15	24.41	21.68	7.45	16.65	16.18
Killonan 220 kV	8.42	8.98	8.35	10.69	8.13	7.95	7.84	12.64	11.97	10.63	10.05	9.90
Killoteran 110 kV	6.64	10.19	9.64	5.54	11.25	11.01	5.83	12.96	11.95	5.02	13.46	13.08
Kilmahud 110 kV	20.72	18.11	15.99	21.65	13.03	12.62	19.62	21.36	19.47	21.13	14.34	14.04
Kilmore 110 kV	15.05	16.15	14.06	10.14	18.68	17.65	14.06	21.19	18.50	9.28	23.42	22.21
Kilpaddoge 110 kV	14.00	15.04	13.88	14.38	18.92	18.27	12.12	22.27	20.20	12.79	26.13	25.12
Kilpaddoge 220 kV	15.71	15.59	14.07	14.72	19.99	19.09	14.92	28.83	25.93	13.22	33.34	31.92
Kilpaddoge 400 kV	9.75	10.82	9.64	8.21	10.46	10.05	7.89	15.78	14.61	7.03	13.37	13.06
Kilteel 110 kV	4.40	7.19	6.83	5.47	6.58	6.47	4.28	8.87	8.31	5.44	7.47	7.33
Kinnegad 110 kV	4.55	7.25	6.87	5.95	6.59	6.48	4.57	9.10	8.63	6.19	7.57	7.46
Knockacummer 110 kV	6.17	4.69	4.58	6.28	5.15	5.11	6.06	7.05	6.27	6.23	6.83	6.56
Knockalough 110 kV	4.02	4.08	3.93	3.64	4.12	4.07	4.62	5.60	5.10	3.83	5.03	4.88
Knockanure 220 kV	13.57	12.35	11.37	8.90	15.88	15.30	12.36	20.87	19.06	7.08	24.73	23.81
Knockanure A 110 kV	25.57	9.99	9.57	18.64	11.69	11.49	22.63	15.79	13.78	15.78	16.53	15.72
Knockanure B 110 kV	5.00		7.14	5.90	6.40	6.31		9.95	9.22	5.67		7.38
Knockearagh 110 kV	5.46	7.49 5.04	4.84	7.21	4.42	4.36	4.53	6.57	6.05	7.50	7.53 5.19	5.08
Knockraha A 110 kV	8.48		13.87	9.05	16.22	15.63	5.50 7.72	25.77	23.06	8.68	23.08	22.29
Knockraha A 220 kV	10.12	15.35		10.28		11.87		20.67	18.63			
Knockraha B 110 kV		10.71	9.68		12.37		10.64		_	10.54 8.68	20.04	19.34
Knockraha B 220 kV	8.48	15.35	13.87	9.05	16.22	15.63	7.72	25.77	23.06		23.08	22.29
	10.12	10.71	9.68	10.28	12.37	11.87	10.64	20.67	18.63	10.54	20.04	19.34
Knockranny A 110 kV	3.96	4.44	4.27	3.59	4.41	4.35	4.50	6.15	5.59	3.76	5.40	5.24
Knockranny B 110 kV	5.30	6.47	6.18	4.87	8.41	8.24	6.10	9.11	8.55	5.23	11.29	10.99
Knockumber 110 kV	3.90	7.72	7.22	4.69	5.91	5.81	3.57	9.03	8.46	4.50	6.48	6.38
Lanesboro 110 kV	4.10	10.03	9.20	5.23	10.57	10.24	3.75	12.32	11.11	4.99	11.98	11.57
Letterkenny110 kV	3.84	5.39	5.05	4.46	6.37	6.20	4.23	11.62	9.71	5.40	10.76	10.13
Liberty A 110 kV	6.05	12.63	11.52	5.26	14.67	14.14	5.50	21.10	18.73	4.70	21.39	20.51
Liberty B 110 kV	5.97	12.62	11.51	5.12	14.64	14.11	5.39	21.06	18.71	4.54	21.32	20.44
Limerick 110 kV	5.82	13.42	12.25	6.75	11.98	11.64	5.07	19.93	17.86	6.39	15.08	14.65
Lisdrum 110 kV	2.91	4.71	4.52	4.17	4.17	4.12	2.80	5.73	5.28	4.23	4.59	4.49
Lisheen 110 kV	3.95	3.21	3.12	3.96	4.81	4.74	4.95	5.33	4.66	4.96	7.99	7.45
Lodgewood 110 kV	9.79	7.39	7.12	10.07	9.27	9.12	9.53	9.77	9.14	9.84	11.43	11.13
Lodgewood 220 kV	9.15	6.75	6.45	10.31	6.61	6.51	8.75	8.33	7.96	10.05	7.66	7.55
Longpoint 220 kV	10.67	10.06	9.06	10.43	13.29	12.66	14.65	21.79	19.28	12.45	25.25	24.00
Louth 220 kV	10.73	13.02	11.56	11.25	15.54	14.78	9.80	20.20	18.27	10.66	22.01	21.18
Louth A 110 kV	7.37	11.22	10.40	8.32	13.66	13.24	6.42	14.14	13.06	7.52	16.53	16.02
Louth B 110 kV	7.92	12.03	11.10	8.67	15.01	14.51	6.90	15.65	14.40	7.81	18.74	18.11

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

Station		Summer								Wir	ıter		
Station Ratio IkAJ Ratio IkAJ Ratio IkAJ Ratio IkAJ Ratio IkAJ IkAJ Ratio IkAJ Ratio IkAJ		Th	ree Pha	se	Si	ngle Pha	se	TI	hree Pha	se	Si	ngle Pha	se
Macroom 110 kV 7.26 11.39 10.57 7.18 12.95 12.58 0.72 18.80 16.91 6.93 18.57 17.90 Mallow 110 kV 5.21 5.86 5.61 6.81 5.22 5.55 5.30 7.79 7.26 7.22 6.26 6.14 Maynooth A 110 kV 11.05 12.07 11.26 11.69 11.78 11.39 10.33 14.86 13.94 11.77 17.28 Maynooth B 110 kV 8.85 15.79 11.26 10.16 15.40 14.78 14.37 10.30 14.66 19.37 41.60 19.30 10.71 17.89 14.49 2.47 18.60 19.30 14.04 19.90 17.73 19.70 Maynooth B 110 kV 41.62 18.29 10.71 17.89 17.01 18.90 14.00 18.60 19.30 18.70 19.70 19.70 18.70 Mallormal 110 kV 41.22 8.75 8.70 5.51 5.29 18.20 <th< th=""><th>Station</th><th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th><th></th></th<>	Station												
Mallow 110 kV 5.21 5.86 5.61 6.83 5.22 5.15 5.90 7.79 7.26 7.22 6.26 6.14 Marina 110 kV 6.98 3.71 12.42 7.82 16.10 14.78 14.35 14.35 12.43 21.33 8.07 24.42 23.29 Maynooth A110 kV 11.05 10.05 11.26 11.69 14.78 14.35 10.33 14.86 13.94 10.90 17.73 17.28 Maynooth B220 kV 11.07 16.26 14.31 10.44 15.65 14.97 9.62 21.16 19.37 9.46 19.30 18.76 Maynooth B220 kV 12.09 18.41 15.95 10.71 17.89 17.01 18.89 22.40 20.43 8.75 19.73 19.71 McDermott 110 kV 41.22 9.88 9.65 6.40 12.32 11.91 16.30 14.04 16.63 3.73 15.67 15.04 Mach Hill 110 kV 41.22 9.88 7.51 5.22 6.82 6.70 3.89 10.17 9.40 5.19 10.20 18.37 Midleon 110 kV 3.98 8.75 8.19 5.01 7.88 7.72 3.39 11.83 11.08 4.66 9.45 9.28 Milltown 110 kV 9.16 10.46 9.46 4.23 12.49 12.08 8.66 12.29 11.28 3.96 18.23 17.28 Milltown 110 kV 9.16 10.46 9.46 4.23 12.49 12.08 8.66 12.29 11.28 3.96 18.23 17.28 Milltown 110 kV 9.16 10.46 9.45 13.49 12.08 8.66 12.29 11.28 3.96 18.23 17.28 Minecypolint 110 kV 9.16 10.46 9.45 13.49 12.08 8.66 12.29 11.28 3.96 18.23 17.28 Monecypolint 10 kV 9.16 10.46 9.45 13.49 12.08 8.69 12.29 12.88 8.68 13.23 13.08 13.18 13.08 13.18 13.08 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 13.18 1	Macetown 110 kV	7.65	15.22	13.50	7.35	16.01	15.32	6.84	18.44	16.85	6.79	18.57	17.99
Marina 110 kV 6.98 13,71 12,42 7.82 16.10 15,47 6.81 24,15 21.13 8.07 24,42 23.29 Maynooth A 110 kV 11.05 12,07 11.26 11.69 14,78 14.33 10.33 14.86 19.37 9.46 17.23 17.28 Maynooth B 20 kV 11.05 16.26 14.31 10.44 15.65 14.48 7.47 18.67 17.46 9.64 17.26 Maynooth B 220 kV 12.09 18.41 15.95 10.71 17.89 17.01 8.89 22.40 20.43 8.75 19.73 19.71 McDermott 110 kV 4.12 7.98 7.51 5.22 6.82 6.70 3.89 10.47 9.40 5.19 19.78 17.28 17.28 17.28 17.29 18.61 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 14.79 1	Macroom 110 kV	7.26	11.39	10.57	7.18	12.95	12.58	7.02	18.80	16.91	6.93	18.57	17.90
Maynooth A 110 kV 11.05 12.07 11.26 11.69 14.78 14.35 10.33 14.86 13.94 11.09 17.73 17.28 Maynooth A 220 kV 11.07 16.26 14.31 10.44 15.65 14.97 9.62 21.16 19.37 9.46 19.30 18.76 Maynooth B 220 kV 12.09 18.41 15.95 10.71 17.89 17.01 18.69 22.40 20.43 8.75 19.73 19.70 McDermott 10 kV 16.66 10.48 9.65 6.40 12.32 11.91 16.30 14.04 12.63 3.73 15.72 15.72 Meentycat 10 kV 3.28 4.14 3.94 4.11 4.28 4.20 3.53 7.58 6.55 4.92 16.07 7.88 Milltown A 10 kV 3.28 8.75 8.19 5.01 7.88 7.72 3.39 18.33 11.08 4.60 9.65 4.23 12.49 12.08 16.92 16.07 7	Mallow 110 kV	5.21	5.86	5.61	6.83	5.22	5.15	5.30	7.79	7.26	7.22	6.26	6.14
Maynooth A 220 kV 11.07 16.26 14.31 10.44 15.65 14.97 9.62 21.16 19.37 9.46 19.30 18.76 Maynooth B 10 kV 8.85 15.79 14.26 10.16 15.40 14.87 7.47 18.67 17.46 9.05 17.45 17.08 Maynooth B 220 kV 12.09 18.41 15.95 10.71 17.89 17.01 8.89 22.40 20.43 8.75 19.73 19.78 McChermott 110 kV 16.56 10.48 9.65 6.40 12.32 11.91 16.30 14.04 12.63 5.73 15.76 15.70 15.70 15.70 15.77 15.70 15.77 15.70 15.70 15.77 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 15.70 <	Marina 110 kV	6.98	13.71	12.42	7.82	16.10	15.47	6.81	24.15	21.13	8.07	24.42	23.29
Maynoth B 110 kV 8.85 15.79 14.26 10.16 15.40 14.87 7.47 18.67 17.46 9.05 17.45 17.08 Maynoth B 220 kV 12.09 18.41 15.95 10.71 17.89 17.01 8.89 22.40 20.43 8.75 19.73 19.17 McDermott 110 kV 16.56 10.48 9.65 6.40 12.32 11.91 16.50 14.04 12.63 5.73 15.67 15.04 Meentycat 110 kV 4.12 7.98 7.51 5.22 6.82 6.70 3.89 10.17 5.92 7.88 7.72 3.39 11.83 11.08 4.69 9.65 18.28 17.22 6.91 15.94 14.09 11.83 11.28 18.38 11.72 19.89 14.09 18.69 11.22 18.28 18.38 18.22 17.32 Milltown A 110 kV 9.16 10.46 9.61 15.26 14.69 13.15 15.63 3.38 16.22 14.90 </td <td>Maynooth A 110 kV</td> <td>11.05</td> <td>12.07</td> <td>11.26</td> <td>11.69</td> <td>14.78</td> <td>14.35</td> <td>10.33</td> <td>14.86</td> <td>13.94</td> <td>11.09</td> <td>17.73</td> <td>17.28</td>	Maynooth A 110 kV	11.05	12.07	11.26	11.69	14.78	14.35	10.33	14.86	13.94	11.09	17.73	17.28
Maynoth B 220 kV 12.09 18.41 15.95 10.71 17.89 17.01 8.89 22.40 20.43 8.75 19.73 19.17 McDermott 110 kV 16.56 10.48 9.65 6.40 12.32 11.91 16.30 14.04 12.63 5.73 15.67 15.04 Meath Hill 110 kV 4.12 7.98 7.51 5.22 6.82 6.70 3.89 10.17 9.40 5.19 7.88 7.72 Meentycat 110 kV 3.28 4.14 3.94 4.11 4.28 4.20 3.53 7.58 6.55 4.92 6.07 5.83 Milletorn 10 kV 3.28 8.75 11.72 6.91 15.49 14.90 14.79 15.68 13.42 6.54 18.22 17.33 Milltown A 110 kV 13.66 12.55 11.46 7.61 15.26 14.69 13.15 15.68 13.24 13.25 Milltown B 110 kV 13.66 12.55 11.46 7.76 7	Maynooth A 220 kV	11.07	16.26	14.31	10.44	15.65	14.97	9.62	21.16	19.37	9.46	19.30	18.76
McDermott 110 kV 16.56 10.48 9.65 6.40 12.32 11.91 16.30 14.04 12.63 5.75 15.67 15.04 Meath Hill 110 kV 4.12 7.98 7.51 5.22 6.82 6.70 3.89 10.17 9.40 5.19 7.88 7.72 Meentycat 110 kV 3.28 4.14 3.94 4.11 4.28 4.20 3.53 7.58 6.55 4.92 6.70 5.83 Milltown A 110 kV 3.98 8.75 8.19 5.01 7.88 7.72 3.39 11.83 11.08 4.66 9.45 9.28 Milltown B 110 kV 15.66 10.46 9.66 4.23 12.49 12.08 8.69 12.29 11.28 3.98 14.34 13.85 Milltown B 110 kV 13.66 12.55 11.46 7.61 15.26 14.69 13.15 15.02 16.28 18.28 15.20 18.28 15.20 12.28 14.98 16.28 18.23	Maynooth B 110 kV	8.85	15.79	14.26	10.16	15.40	14.87	7.47	18.67	17.46	9.05	17.45	17.08
Meath Hill 110 kV 4,12 7,98 7,51 5,22 6.82 6,70 3.89 10.17 9,40 5.19 7,88 7,72 Meentycat 110 kV 3.28 4,14 3.94 4,11 4,28 4,20 3.53 7,58 6,55 4,92 6,07 5,83 Mildtown A 110 kV 15,28 12,88 11,72 6,91 15,49 14,79 15,68 13,84 6,64 9,43 9,28 Milltown A 110 kV 13,66 12,55 11,46 7,61 15,26 14,69 13,13 15,30 13,51 7,23 17,98 17,08 Milltown A 110 kV 13,66 12,55 11,40 7,61 15,26 14,69 13,13 15,30 13,51 7,23 17,98 17,08 Monetheen 110 kV 13,66 8,12 17,99 8,61 8,49 15,71 10,96 10,42 18,52 10,14 Moneypoint 20 400 kV 16,64 11,02 9,80 16,79 7,53 <	Maynooth B 220 kV	12.09	18.41	15.95	10.71	17.89	17.01	8.89	22.40	20.43	8.75	19.73	19.17
Meentycat 110 kV 3.28 4.14 3.94 4.11 4.28 4.20 3.53 7.58 6.55 4.92 6.07 5.83 Midleton 110 kV 3.98 8.75 8.19 5.01 7.88 7.72 3.39 11.83 11.08 4.66 9.45 9.28 Milltown A 110 kV 15.28 12.85 11.72 6.91 15.49 14.90 14.79 15.68 13.84 6.54 18.22 17.32 Milltown B 110 kV 9.16 10.46 9.66 4.23 12.49 12.08 18.99 11.28 3.98 14.34 13.85 Milltown B 110 kV 13.66 12.55 11.46 7.61 15.26 14.60 13.15 15.30 13.51 72.3 17.92 6.38 8.43 Moneteen 110 kV 13.66 8.25 8.21 17.99 8.61 8.49 15.71 10.96 10.42 18.25 10.31 10.14 Moneypoint Ga Vok V 16.64 11.02 9	McDermott 110 kV	16.56	10.48	9.65	6.40	12.32	11.91	16.30	14.04	12.63	5.73	15.67	15.04
Midleton 110 kV 3.98 8.75 8.19 5.01 7.88 7.72 3.39 11.83 11.08 4.66 9.42 9.28 Milltown A 110 kV 15.28 12.28 11.72 6.91 15.49 14.90 14.79 15.68 13.84 6.54 18.22 17.32 Milltown B 110 kV 9.16 10.46 9.66 4.23 12.49 12.08 8.69 12.29 11.28 3.98 14.34 13.85 Misery Hill 110 kV 3.66 12.55 11.46 7.61 15.26 14.69 13.15 15.20 13.51 7.23 17.98 17.08 17.02 18.68 13.51 15.20 13.51 15.20 13.51 15.20 14.72 17.28 18.68 18.72 17.90 8.61 8.49 15.70 27.98 25.27 13.05 32.56 31.25 14.90 Moneypoint 220 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14	Meath Hill 110 kV	4.12	7.98	7.51	5.22	6.82	6.70	3.89	10.17	9.40	5.19	7.88	7.72
Milltown A 110 kV 15,28 12,85 11,72 6.91 15,49 14,90 14,79 15,68 13,84 6.54 18.22 17,32 Milltown B 110 kV 9.16 10,46 9.66 4.23 12,49 12,08 8.69 12,29 11,28 3.98 14,34 13,85 Misery Hill 110 kV 13,66 12,55 11,46 7.61 15,26 14,69 13,15 15,30 13,51 7.23 17,98 17,08 Moneypoint 12 kV 15,66 8.45 8.12 17,99 8.61 8.49 15,71 10,96 10,42 18,55 10,11 Moneypoint 12 dov kV 16,64 11,02 9.80 18,68 11,72 11,12 13,55 16,12 14,91 16,20 15,29 14,90 Moneypoint 63 400 kV 16,64 11,02 9.80 18,68 11,72 11,21 13,55 16,12 14,91 16,20 15,29 14,90 Moneypoint 63 400 kV 4,64 6.30	Meentycat 110 kV	3.28	4.14	3.94	4.11	4.28	4.20	3.53	7.58	6.55	4.92	6.07	5.83
Milltown B 110 kV 9.16 10.46 9.66 4.23 12.49 12.08 8.69 12.29 11.28 3.98 14.34 13.85 Misery Hill 110 kV 13.66 12.55 11.46 7.61 15.26 14.69 13.15 15.30 13.51 7.23 17.98 17.08 Moneteen 110 kV 5.88 10.12 9.35 6.70 7.55 7.39 5.25 12.87 11.92 6.38 8.58 8.43 Moneypoint 110 kV 15.46 8.45 8.12 17.99 8.61 8.49 15.71 10.96 10.42 18.55 10.31 10.14 Moneypoint G1 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint G2 400 kV 43.33 452 4.23 43.35 5.24 5.11 5.95 5.22 4.97 51.25 5.86 5.75 Moneypoint G3 400 kV 4.63 6.09 <td>Midleton 110 kV</td> <td>3.98</td> <td>8.75</td> <td>8.19</td> <td>5.01</td> <td>7.88</td> <td>7.72</td> <td>3.39</td> <td>11.83</td> <td>11.08</td> <td>4.66</td> <td>9.45</td> <td>9.28</td>	Midleton 110 kV	3.98	8.75	8.19	5.01	7.88	7.72	3.39	11.83	11.08	4.66	9.45	9.28
Misery Hill 110 kV 13.66 12.55 11.46 7.61 15.26 14.69 13.15 15.30 13.51 7.23 17.98 17.08 Moneteen 110 kV 5.88 10.12 9.35 6.70 7.55 7.39 5.25 12.87 11.92 6.38 8.58 8.43 Moneypoint 110 kV 15.46 8.45 8.12 17.99 8.61 8.49 15.71 10.96 10.42 18.55 10.31 10.14 Moneypoint 220 kV 16.00 15.50 14.01 14.72 19.89 19.00 15.07 27.98 25.27 13.05 32.56 31.23 Moneypoint 61 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint 62 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7	Milltown A 110 kV	15.28	12.85	11.72	6.91	15.49	14.90		15.68	13.84	6.54	18.22	17.32
Moneteen 110 kV 5.88 10.12 9.35 6.70 7.55 7.39 5.25 12.87 11.92 6.38 8.98 8.43 Moneypoint 110 kV 15.46 8.45 8.12 17.99 8.61 8.49 15.71 10.96 10.42 18.55 10.31 10.14 Moneypoint 22 kV 16.00 15.50 14.01 14.72 19.89 19.00 15.07 27.98 25.27 13.05 32.56 31.23 Moneypoint 62 400 kV 43.13 4.52 4.23 33.35 5.24 5.11 55.91 5.22 4.97 51.25 5.66 5.75 Moneypoint 63 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.90 14.90 Monread 110 kV 4.13 7.77 6.81 5.01 7.76 7.04 3.96 8.77 8.26 4.93 8.20 7.09 4.92 8.20 7.02 4.90 8.20 <td>Milltown B 110 kV</td> <td>9.16</td> <td>10.46</td> <td>9.66</td> <td>4.23</td> <td>12.49</td> <td>12.08</td> <td>8.69</td> <td>12.29</td> <td>11.28</td> <td>3.98</td> <td>14.34</td> <td>13.85</td>	Milltown B 110 kV	9.16	10.46	9.66	4.23	12.49	12.08	8.69	12.29	11.28	3.98	14.34	13.85
Moneypoint 110 kV 15,46 8.45 8.12 17,99 8.61 8.49 15,71 10.96 10.42 18.55 10.31 10.14 Moneypoint 220 kV 16.00 15.50 14.01 14.72 19.89 19.00 15.07 27.98 25.27 13.05 32.56 31.23 Moneypoint 61 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint 62 400 kV 4.313 4.52 4.23 43.35 5.24 5.11 55.91 5.22 4.97 51.25 5.66 5.75 Moneypoint 63 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.90 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.50 Month Lucas 110 kV 3.76 4.52<	Misery Hill 110 kV	13.66	12.55	11.46	7.61	15.26	14.69	13.15	15.30	13.51		17.98	17.08
Moneypoint 220 kV 16.00 15.50 14.01 14.72 19.89 19.00 15.07 27.98 25.27 13.05 32.56 31.23 Moneypoint G1 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint G2 400 kV 43.13 4.52 4.23 43.35 5.24 5.11 55.91 5.22 4.97 51.25 5.86 5.75 Moneypoint G3 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Moy 110 kV 3.76 4.56 <t< td=""><td>Moneteen 110 kV</td><td>5.88</td><td>10.12</td><td>9.35</td><td>6.70</td><td>7.55</td><td>7.39</td><td>5.25</td><td>12.87</td><td>11.92</td><td>6.38</td><td>8.58</td><td>8.43</td></t<>	Moneteen 110 kV	5.88	10.12	9.35	6.70	7.55	7.39	5.25	12.87	11.92	6.38	8.58	8.43
Moneypoint G1 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint G2 400 kV 43.13 4.52 4.23 43.35 5.24 5.11 55.91 5.22 4.97 51.25 5.86 5.75 Moneypoint G3 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mulleawy 110 kV 3.59 6.54 6.2	Moneypoint 110 kV	15.46	8.45	8.12	17.99	8.61	8.49	15.71	10.96	10.42	18.55	10.31	10.14
Moneypoint G1 40 ok V 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Moneypoint G2 400 kV 43.13 4.52 4.23 43.35 5.24 5.11 55.91 5.22 4.97 51.25 5.86 5.75 Moneypoint G3 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mulliagharlin 110 kV 3.50 6.54 <	Moneypoint 220 kV			14.01		19.89			27.98	25.27		32.56	31.23
Moneypoint G2 400 kV 43.13 4.52 4.23 43.35 5.24 5.11 55.91 5.22 4.97 51.25 5.86 5.75 Moneypoint G3 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mullreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93	Moneypoint G1 400 kV	16.64		9.80	18.68	11.72	11.21	13.55		14.91	16.20	15.29	14.90
Moneypoint G3 400 kV 16.64 11.02 9.80 18.68 11.72 11.21 13.55 16.12 14.91 16.20 15.29 14.90 Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Moy 110 kV 3.76 4.56 4.23 4.43 5.34 5.18 5.76 9.51 8.25 7.09 8.97 8.56 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mullreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.49 9.65 8.94 6.34 <td>Moneypoint G2 400 kV</td> <td>43.13</td> <td>4.52</td> <td>4.23</td> <td>43.35</td> <td>5.24</td> <td>5.11</td> <td></td> <td>5.22</td> <td></td> <td>51.25</td> <td>1</td> <td></td>	Moneypoint G2 400 kV	43.13	4.52	4.23	43.35	5.24	5.11		5.22		51.25	1	
Monread 110 kV 4.13 7.17 6.81 5.01 7.16 7.04 3.96 8.77 8.26 4.93 8.20 8.05 Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Moy 110 kV 3.76 4.56 4.23 4.43 5.34 5.18 5.76 9.51 8.25 7.09 8.97 8.56 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mullingar 110 kV 3.59 6.54 6.22 4.94 6.25 6.15 3.48 7.75 7.29 4.93 6.98 6.85 Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.	Moneypoint G ₃ 400 kV		11.02	9.80		11.72	11.21		16.12		16.20	15.29	14.90
Mount Lucas 110 kV 4.40 6.46 6.09 5.60 6.00 5.89 4.73 8.85 8.26 6.19 7.34 7.20 Moy 110 kV 3.76 4.56 4.23 4.43 5.34 5.18 5.76 9.51 8.25 7.09 8.97 8.56 Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mullingar 110 kV 3.59 6.54 6.22 4.94 6.25 6.15 3.48 7.75 7.29 4.93 6.98 6.85 Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.90 12.14 11.27 6.05 7.95 7.82 Mungret B 110 kV 13.05 11.34 10.35 7.88	Monread 110 kV	4.13	7.17	6.81	5.01	7.16	7.04		8.77	8.26	4.93	8.20	
Mullagharlin 110 kV 3.91 8.00 7.53 4.91 7.85 7.69 3.49 9.77 9.09 4.62 9.00 8.80 Mullingar 110 kV 3.59 6.54 6.22 4.94 6.25 6.15 3.48 7.75 7.29 4.93 6.98 6.85 Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.91 12.12 11.27 6.05 7.95 7.82 Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Neading 110 kV 3.32 3.50 3.39 4.05	Mount Lucas 110 kV	4.40	6.46	6.09	5.60	6.00	5.89	4.73	8.85	8.26	6.19	7.34	7.20
Mullingar 110 kV 3.59 6.54 6.22 4.94 6.25 6.15 3.48 7.75 7.29 4.93 6.98 6.85 Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.91 12.12 11.27 6.05 7.95 7.82 Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nemagh 110 kV 4.43 10.05 9.36 5.16 <td>Moy 110 kV</td> <td>3.76</td> <td>4.56</td> <td>4.23</td> <td>4.43</td> <td>5.34</td> <td>5.18</td> <td>5.76</td> <td>9.51</td> <td>8.25</td> <td>7.09</td> <td>8.97</td> <td>8.56</td>	Moy 110 kV	3.76	4.56	4.23	4.43	5.34	5.18	5.76	9.51	8.25	7.09	8.97	8.56
Mullingar 110 kV 3.59 6.54 6.22 4.94 6.25 6.15 3.48 7.75 7.29 4.93 6.98 6.85 Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.91 12.12 11.27 6.05 7.95 7.82 Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nemagh 110 kV 4.43 10.05 9.36 5.16 <td>Mullagharlin 110 kV</td> <td></td> <td></td> <td>7.53</td> <td></td> <td></td> <td>7.69</td> <td></td> <td>9.77</td> <td>9.09</td> <td>4.62</td> <td>9.00</td> <td></td>	Mullagharlin 110 kV			7.53			7.69		9.77	9.09	4.62	9.00	
Mulreavy 110 kV 3.61 4.76 4.52 4.12 5.61 5.49 4.56 10.62 8.59 5.60 9.86 9.17 Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.91 12.12 11.27 6.05 7.95 7.82 Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nenagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 <td>Mullingar 110 kV</td> <td></td> <td>6.54</td> <td>6.22</td> <td>4.94</td> <td>6.25</td> <td>6.15</td> <td>3.48</td> <td>7.75</td> <td>7.29</td> <td>4.93</td> <td>6.98</td> <td>6.85</td>	Mullingar 110 kV		6.54	6.22	4.94	6.25	6.15	3.48	7.75	7.29	4.93	6.98	6.85
Mungret A 110 kV 5.50 9.64 8.93 6.34 7.04 6.91 4.91 12.12 11.27 6.05 7.95 7.82 Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nenagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 10 kV 13.68 15.87 13.84 6.8	Mulreavy 110 kV	3.61	4.76	4.52	4.12	5.61	5.49	4.56		8.59	5.60	9.86	9.17
Mungret B 110 kV 5.49 9.65 8.94 6.34 7.05 6.91 4.90 12.14 11.29 6.04 7.96 7.83 Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nemagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94	Mungret A 110 kV	5.50			6.34	7.04			12.12	11.27	6.05	7.95	7.82
Nangor 110 kV 13.05 11.34 10.35 7.88 13.98 13.43 12.72 13.92 12.43 7.47 16.64 15.87 Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nenagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68<	Mungret B 110 kV		9.65	8.94	6.34	7.05	6.91		12.14	11.29	6.04		7.83
Navan 110 kV 5.80 11.28 10.35 6.52 11.25 10.93 5.27 14.25 13.04 6.15 13.33 12.95 Nenagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22	Nangor 110 kV		11.34				13.43		13.92	12.43	7.47		
Nenagh 110 kV 3.32 3.50 3.39 4.05 2.41 2.39 3.30 4.57 4.20 4.12 2.73 2.69 Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72<	Navan 110 kV				6.52			5.27	14.25	13.04		1	
Newbridge 110 kV 4.43 10.05 9.36 5.16 10.02 9.78 4.11 12.85 11.92 4.97 11.88 11.60 Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.55 11.88 11.19 4.32 8.54 8.42 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64	Nenagh 110 kV		3.50								4.12		t e
Newbury 110 kV 13.68 15.87 13.84 6.88 17.82 16.87 12.61 20.74 18.15 6.14 22.15 21.05 North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.55 11.88 11.19 4.32 8.54 8.42 Oldcourt B 110 kV 4.20 8.81 8.26 4.68 7.19 7.06 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 <	Newbridge 110 kV		10.05			10.02				11.92			11.60
North Quays 110 kV 18.84 13.11 11.94 6.44 15.52 14.93 18.47 16.04 14.14 6.09 18.23 17.33 North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.55 11.88 11.19 4.32 8.54 8.42 Oldcourt B 110 kV 4.20 8.81 8.26 4.68 7.19 7.06 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75	Newbury 110 kV		15.87			17.82		12.61	20.74	18.15		22.15	21.05
North Wall 220 kV 15.91 15.98 13.68 9.61 18.09 16.97 14.27 25.33 22.08 7.92 25.93 24.64 Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.55 11.88 11.19 4.32 8.54 8.42 Oldcourt B 110 kV 4.20 8.81 8.26 4.68 7.19 7.06 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75	North Quays 110 kV	18.84	13.11	11.94	6.44	15.52	14.93	18.47	16.04	14.14	6.09	18.23	17.33
Oldcourt A 110 kV 4.17 8.76 8.22 4.65 7.13 7.00 3.55 11.88 11.19 4.32 8.54 8.42 Oldcourt B 110 kV 4.20 8.81 8.26 4.68 7.19 7.06 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75	North Wall 220 kV							14.27	25.33		7.92		
Oldcourt B 110 kV 4.20 8.81 8.26 4.68 7.19 7.06 3.58 11.96 11.27 4.34 8.63 8.51 Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75	Oldcourt A 110 kV									11.19			
Oldstreet 220 kV 14.03 8.20 7.72 12.11 9.30 9.08 14.73 12.74 12.09 11.84 12.97 12.73 Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75												 	
Oldstreet 400 kV 12.20 8.64 7.81 8.91 7.61 7.38 9.56 13.14 12.38 7.48 9.90 9.75		· ·					_						
							_						
	· ·				_								
Oughtragh 110 kV 3.71 4.13 3.99 4.80 2.82 2.80 3.62 5.25 4.87 4.83 3.14 3.09													

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

	Summer						Winter						
	Tŀ	ree Pha	se	Si	ngle Pha	se	TI	ree Pha	se	Si	ngle Pha	se	
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]	
Oweninney 110 kV	3.51	3.39	3.21	3.83	4.35	4.25	6.01	8.25	6.83	6.58	8.83	8.21	
Pelletstown 110 kV	14.41	9.96	9.21	8.17	10.85	10.53	13.53	13.10	11.88	7.48	13.45	12.99	
Platin 110 kV	5.27	11.19	10.28	5.83	8.72	8.52	4.58	13.49	12.51	5.43	9.76	9.58	
Pollaphuca 110 kV	2.77	2.48	2.44	4.01	2.28	2.27	3.27	3.20	3.08	4.72	2.62	2.59	
Poolbeg A 110 kV	27.65	13.68	12.43	22.05	17.04	16.35	28.15	16.80	14.79	21.96	20.30	19.24	
Poolbeg A 220 kV	16.82	16.11	13.78	8.30	17.21	16.19	15.11	25.56	22.26	6.71	24.27	23.13	
Poolbeg B 110 kV	27.62	13.66	12.41	22.04	17.02	16.33	28.11	16.77	14.77	21.94	20.28	19.21	
Poolbeg B 220 kV	14.82	17.92	15.39	10.66	20.50	19.24	13.13	25.44	22.21	9.27	27.03	25.66	
Poolbeg C 110 kV	21.37	13.38	12.17	7.48	15.88	15.27	21.16	16.42	14.44	7.09	18.72	17.77	
Poppintree 110 kV	12.50	15.55	13.63	7.21	17.84	16.91	11.46	20.33	17.84	6.47	22.26	21.16	
Portan 260 kV	19.47	10.92	9.96	91.39	3.19	3.16	19.03	17.40	16.49	133.94	3.44	3.43	
Portan 400 kV	15.55	9.33	8.34	14.46	10.42	9.96	13.18	16.82	15.59	11.48	17.22	16.76	
Portlaoise 110 kV	6.13	11.78	11.04	7.01	11.30	11.06	5.63	15.20	14.21	6.73	13.42	13.15	
Pottery 110 kV	17.50	10.49	9.77	5.82	10.77	10.50	17.36	12.47	11.47	5.55	12.26	11.91	
Prospect 220 kV	13.31	13.18	12.08	9.42	14.39	13.91	11.90	21.74	20.06	7.95	20.54	20.00	
Raffeen 220 kV	10.64	9.89	8.92	10.01	12.81	12.22	12.41	19.80	17.71	10.40	22.68	21.67	
Raffeen A 110 kV	6.26	11.54	10.62	6.96	14.03	13.55	5.43	17.32	15.94	6.37	19.47	18.85	
Raffeen B 110 kV	8.44	11.33	10.43	9.13	13.72	13.25	8.05	17.36	15.87	9.01	19.30	18.65	
Rathkeale 110 kV	3.63	6.68	6.34	4.85	5.43	5.35	3.41	8.27	7.77	4.79	6.09	6.00	
Ratrussan 110 kV	3.22	5.86	5.59	4.01	6.64	6.52	3.64	8.31	7.07	4.82	8.53	8.05	
Reamore 110 kV	4.40	5.99	5.74	3.54	5.53	5.46	4.66	8.77	7.78	3.47	6.86	6.64	
Richmond A 110 kV	3.24	6.78	6.37	4.38	6.17	6.05	3.02	7.97	7.34	4.25	6.85	6.69	
Richmond B 110 kV	3.24	6.78	6.37	4.38	6.17	6.05	3.02	7.97	7.34	4.25	6.85	6.69	
Rinawade 110 kV	5.15	10.05	9.38	6.06	7.35	7.22	4.68	11.52	11.01	5.79	8.05	7.96	
Ringaskiddy 110 kV	6.16	9.71	9.04	6.39	9.87	9.63	5.43	13.97	12.98	5.92	12.70	12.41	
Ringsend 110 kV	28.13	13.78	12.50	23.26	17.17	16.46	28.64	17.00	14.89	23.24	20.52	19.41	
Ryebrook 110 kV	5.73	13.26	11.82	6.56	11.99	11.56	5.08	15.34	14.15	6.10	13.22	12.90	
Salthill 110 kV	4.94	9.44	8.82	4.03	11.40	11.09	5.13	14.07	12.70	3.86	15.54	14.94	
Screeb 110 kV	3.59	2.39	2.31	3.37	2.79	2.76	4.26	3.20	2.90	3.72	3.47	3.34	
Seal Rock A 110 kV	8.71	9.62	8.61	10.42	10.45	10.02	7.60	10.81	9.81	9.35	11.24	10.85	
Seal Rock B 110 kV	8.74	9.63	8.61	10.43	10.46	10.02	7.62	10.82	9.82	9.37	11.24	10.86	
Shankill 110 kV	3.72	7.09	6.67	4.73	6.73	6.60	3.77	9.85	8.58	5.05	8.30	7.97	
Shannonbridge 110 kV	6.87	15.01	13.50	8.52	16.92	16.23	5.85	17.93	16.24	7.51	19.13	18.45	
Shannonbridge 220 kV	8.00	6.60	6.26	10.48	5.80	5.71	7.14	7.71	7.46	9.80	6.41	6.35	
Shellybanks A 220 kV	16.52	16.08	13.76	9.21	19.46	18.17	14.88	25.53	22.22	7.36	28.67	27.09	
Shellybanks B 220 kV	14.76	17.00	14.73	10.73	21.00	19.69	14.29	24.79	21.68	9.60	28.60	27.05	
Shelton Abbey 110 kV	7.77	6.83	6.57	7.74	7.26	7.15	7.11	8.60	8.07	7.39	8.60	8.41	
Singland 110 kV	6.87	12.71	11.72	7.72	11.57	11.28	6.63	19.32	17.45	7.75	14.74	14.35	
Sliabh Bawn 110 kV	3.47	8.31	7.79	4.44	8.04	7.86	3.44	10.66	9.68	4.58	9.38	9.11	
Slievecallan 110 kV	7.18	5.23	5.06	9.09	2.20	2.19	8.55	7.70	6.82	9.73	2.44	2.41	
Sligo 110 kV	3.94	7.50	7.03	4.53	7.49	7.33	3.57	11.21	10.12	4.40	9.63	9.34	
Snugborough 110 kV	7.65	15.29	13.52	7.81	16.94	16.15	6.84	18.47	16.86	7.21	19.60	18.96	
Somerset 110 kV	3.09	7.16	6.82	4.06	4.71	4.65	2.85	8.33	7.88	3.94	5.13	5.07	

Table E-4 Ireland Short Circuit Currents for Maximum and Minimum Demand in 2024

			Sun	nmer					Wir	ıter		
	Tł	ree Pha	se	Si	ngle Pha	se	Ti	ree Pha	se	Si	ngle Pha	se
Station	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	lk" [kA]	Ik' [kA]	X/R Ratio	Ik" [kA]	Ik' [kA]
Sorne Hill 110 kV	2.70	2.32	2.24	3.33	2.71	2.67	3.35	3.84	3.40	4.28	3.71	3.56
Srananagh 110 kV	4.78	8.38	7.83	5.48	9.59	9.33	4.58	13.25	11.86	5.58	13.26	12.76
Srananagh 220 kV	6.76	4.03	3.85	8.83	3.45	3.41	7.50	5.19	4.97	9.87	3.97	3.92
Stevenstown 110 kV	4.05	6.12	5.76	4.57	3.94	3.89	3.79	7.17	6.67	4.45	4.31	4.25
Stratford 110 kV	3.19	3.85	3.75	4.19	3.06	3.04	3.34	4.80	4.54	4.39	3.43	3.39
Taney 110 kV	9.02	9.10	8.55	3.33	9.06	8.87	8.63	10.66	9.90	3.17	10.17	9.93
Tarbert 110 kV	26.47	11.77	11.20	29.25	12.67	12.44	35.05	17.67	16.60	36.00	16.47	16.14
Tarbert 220 kV	14.63	14.87	13.48	14.45	18.78	17.98	14.36	27.44	24.76	13.71	30.90	29.66
Tawnaghmore A 110 kV	3.31	3.61	3.40	4.14	3.75	3.67	4.36	6.76	6.09	5.79	5.57	5.41
Tawnaghmore B 110 kV	3.88	3.97	3.69	4.72	4.51	4.38	5.18	7.23	6.46	6.76	6.80	6.55
Thornsberry 110 kV	4.07	5.79	5.52	5.27	5.47	5.39	4.22	7.79	7.31	5.67	6.74	6.61
Thurles 110 kV	5.08	4.20	4.04	5.47	4.83	4.75	6.22	7.02	6.12	6.53	6.98	6.65
Tievebrack 110 kV	3.39	3.37	3.22	4.51	2.72	2.68	3.73	5.52	5.09	5.22	3.31	3.25
Tipperary 110 kV	5.05	6.09	5.83	6.06	4.17	4.13	5.31	8.57	7.91	6.36	4.82	4.75
Tonroe 110 kV	2.68	3.14	3.05	3.74	1.99	1.97	2.72	3.77	3.50	3.84	2.13	2.10
Trabeg 110 kV	6.99	13.62	12.34	7.71	15.82	15.20	6.75	23.74	20.82	7.82	23.76	22.68
Tralee 110 kV	5.01	7.59	7.20	5.99	6.95	6.84	5.17	11.44	10.05	6.34	8.70	8.41
Trien A 110 kV	4.68	6.89	6.57	5.80	6.33	6.24	4.31	9.30	8.54	5.66	7.57	7.39
Trien B 110 kV	12.71	7.39	7.16	9.94	7.78	7.69	11.69	11.52	9.95	8.91	10.49	10.00
Trillick 110 kV	2.74	2.48	2.39	3.41	2.73	2.70	3.43	4.23	3.70	4.38	3.71	3.56
Trinity 110 kV	12.06	12.20	11.16	6.35	14.71	14.17	11.55	14.83	13.13	6.02	17.25	16.41
Tullabrack 110 kV	6.84	6.39	6.18	7.41	5.07	5.03	6.62	8.24	7.83	7.33	5.84	5.77
Turlough 220 kV	11.67	11.89	10.74	12.80	10.66	10.32	10.59	13.31	12.41	12.00	11.45	11.21
Tynagh 220 kV	10.69	7.58	7.16	11.82	9.25	9.03	14.09	13.73	12.75	15.85	14.49	14.10
Uggool 110 kV	5.31	6.18	5.92	5.10	8.07	7.92	6.19	8.70	8.19	5.64	10.85	10.57
Waterford 110 kV	8.15	11.13	10.48	8.11	12.38	12.10	7.12	14.37	13.18	7.35	15.04	14.57
Wexford 110 kV	5.81	5.98	5.75	7.02	5.78	5.71	5.73	7.90	7.09	7.18	6.90	6.68
Whitegate 110 kV	4.76	8.32	7.81	5.44	8.82	8.61	4.19	11.06	10.47	5.04	10.85	10.65
Wolfe Tone 110 kV	14.78	10.27	9.47	5.85	11.95	11.56	14.18	13.69	12.34	5.22	15.10	14.51
Woodhouse 110 kV	5.98	5.56	5.37	7.27	4.25	4.21	5.89	7.25	6.75	7.38	4.94	4.86
Woodland 220 kV	15.81	18.81	16.15	14.34	20.59	19.38	13.10	30.40	27.07	12.48	30.58	29.34
Woodland 400 kV	16.70	9.38	8.38	15.85	10.51	10.05	14.87	17.00	15.75	13.51	17.59	17.11

E.4 Short Circuit Currents in Northern Ireland

E.4.1. Methodology used in Northern Ireland

Short circuit current levels are calculated in accordance with the UK Engineering Recommendation G74, which is a computer based analysis, based on the International Standard IEC60909. Compliance with G74 includes:

- Short circuit current contributions from all synchronous and non-synchronous rotating plant including induction motors embedded in the general load;
- Comprehensive plant parameters including time-dependent impedances, transformer winding and earthing configurations;
- Pre-fault voltage levels at each node which should be obtained from a credible, pre-fault load flow study; and
- Pre-fault transformer tap settings should also be obtained from the load flow study.

The short circuit current level network model includes the following component parameters:

- Transformer impedance variation with tap position;
- Zero sequence mutual coupling effect;
- Unsaturated generator reactance values; and
- Power station auxiliaries fault level contributions.

The calculation of the X/R ratios, used by SONI, is undertaken in accordance with IEC60909-0 Method C, which is known as the equivalent frequency method. The equivalent frequency method is considered to be the most appropriate general purpose method for calculating the D.C. component of short circuit currents on the Northern Ireland transmission system.

The Northern Ireland transmission system is designed and operated to maintain short circuit current levels below the ratings of equipment at each substation. Table E-5 below, indicates the range of circuit breaker RMS ratings that are currently installed on the Northern Ireland transmission system, for the respective voltage levels currently operated.

Table E-5 Northern Ireland Station Equipment Rating Range by Voltage Level

Voltage Level (kV)	Short Circuit Current Equipment Rating Range (kA)
275	26.5 – 31.5
110	18.4 – 40

E.4.2. Analysis

The generation dispatches used in the short circuit analysis are shown in Table D-6 in Appendix D.

The total RMS break current at a busbar is an indication of the short circuit level that one could expect at that point in the transmission system. However, they do not necessarily represent the short circuit current that could flow through each individual breaker, which may be lower.

E.4.3. Northern Ireland Short Circuit Current Level Results

Tables E-6 to E-11 contain the following three-phase and single-phase short circuit current level results for maximum winter peak and minimum summer valley system demand conditions for 2018, 2021 and 2024:

Initial Short Circuit Current (I")

This is the initial RMS value of the AC component of the short circuit current, prior to contact separation time. It is calculated using generator sub-transient reactances.

Peak Make Current (ip)

The largest peak current occurs around 10ms, and is the short circuit current that equipment must be able to withstand, for example, when a circuit breaker is closed directly onto an earthed section of network, thus energising a fault. All equipment in the fault current path will be subjected to the peak make current, and therefore should be rated to withstand this.

RMS Break Current (IB)

This is the RMS value of the AC component of the short circuit current at the time of circuit breaker contact separation. The break time at which contact separation occurs varies from circuit to circuit, and depends on protection settings, fault location, circuit breaker design etc. For the purposes of this report, we have used a short circuit current break time of 50ms for all 275 kV and 110 kV calculations.

In the Northern Ireland results tables, the RMS Break and Peak Make ratings of the existing nodes are shown. It should be noted that the Ballylumford 110 kV node (highlighted in the tables with *) currently have separate ratings for three-phase and single-phase faults; these are indicated in the tables. All ratings are in kA.

Single phase to earth short circuit currents tend to be larger than three phase short circuit currents in heavily meshed transmission networks. This is due to the multiplicity of zero phase sequence paths available to earth fault currents. In all tables, any nodes where short circuit currents exceed 90% of the corresponding existing rating are highlighted in **orange**. Any nodes where short circuit currents exceed the corresponding existing ratings are highlighted in **red**.

The results presented in the following section are indicative only. They are based on intact network conditions and are representative of the assumed generation dispatch and transmission system conditions.

Table E-6 Northern Ireland Short Circuit Currents for Minimum Demand in 2018

	Rat	ing		T	hree Pha	se			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
275kV				'	'					'		
Ballylumford	31.5	79	13.84	22.03	10.45	26.72	9.19	14.56	23.64	13.54	34.80	12.47
Castlereagh	31.5	79	11.67	17.23	9.66	24.28	8.52	11.35	17.50	11.25	28.21	10.44
Coolkeeragh	31.5	79	10.20	16.30	8.63	21.37	7.77	11.38	18.90	9.69	24.28	9.15
Hannahstown	31.5	79	11.89	17.59	9.54	24.03	8.43	11.53	18.09	11.09	27.85	10.31
Kells	31.5	79	12.95	19.63	10.39	26.40	9.14	11.82	17.92	12.35	31.10	11.45
Kilroot	31.5	79	13.35	20.31	10.09	25.72	8.90	14.30	22.31	13.24	33.98	12.22
Magherafelt	31.5	79	12.57	18.56	10.79	27.35	9.49	9.85	13.03	11.25	27.72	10.51
Moyle	31.5	79	13.71	21.61	10.32	26.37	9.09	14.29	22.81	13.28	34.07	12.24
Tandragee	31.5	79	11.55	16.67	11.27	28.31	9.89	10.77	16.29	12.94	32.24	11.97
Tamnamore	40	100	11.69	16.84	10.67	26.82	9.40	11.45	18.53	11.61	29.13	10.81
110kV												
Aghyoule	40	100	2.96	3.16	3.06	5.96	2.98	3.96	5.00	3.32	6.95	3.26
Antrim	40	100	4.67	7.46	8.17	17.74	7.76	4.76	9.40	8.55	18.64	8.31
	21.9	55	11.23	24.11	15.65	39.17	14.32		,	33	,	
Ballylumford	26.2	65		,			,,,,	10.08	24.37	16.19	40.01	15.27
Ballymena	40	100	4.77	8.29	7.41	16.17	7.06	5.35	11.38	7.96	17.78	7.75
Banbridge	18.4	46.8	4.10	6.44	6.09	12.85	5.85	5.06	9.83	6.17	13.63	6.04
Ballyvallagh	21.9	46.8	5.43	6.65	12.16	27.25	11.32	4.96	6.62	12.22	26.86	11.77
Ballynahinch	18.4	46.8	4.23	7.03	5.22	11.09	5.00	4.96	10.01	5.37	11.82	5.25
Belfast Central	n/a	n/a	8.42	12.90	11.41	27.54	10.50	5.54	11.61	14.32	32.20	13.54
Belfast North	n/a	n/a	5.11	7.86	10.71	23.69	9.97	3.26	11.79	11.70	23.33	11.23
Brockaghboy	40	100	4.52	4.84	3.40	7.33	3.32	4.10	5.15	2.90	6.11	2.86
Carnmoney	31.5	79	4.04	6.45	7.50	15.76	7.12	4.56	8.82	7.75	16.73	7.54
Castlereagh	31.5	79	11.22	21.01	13.60	34.05	12.36	12.01	21.86	17.99	45.36	16.79
Coleraine	40	100	3.74	4.15	6.33	13.07	6.00	4.31	5.38	7.66	16.35	7.40
Coolkeeragh	31.5	79	10.42	20.43	14.98	37.16	13.60	11.01	21.66	19.59	48.92	18.43
Creagh	31.5	79	3.65	4.16	7.20	14.78	6.88	4.40	6.63	7.77	16.66	7.57
Cregagh	26.2	65	9.38	15.41	12.51	30.63	11.43	7.54	13.83	16.06	38.11	15.08
Donegall North	31.5	79	8.39	13.54	12.00	28.93	11.09	5.84	10.94	15.34	34.84	14.53
Donegall South	n/a	n/a	6.23	8.89	9.82	22.58	9.20	5.15	8.99	11.19	24.81	10.76
Drumnakelly	31.5	79	7.89	12.41	16.01	38.28	14.56	7.61	12.82	18.33	43.57	17.29
Dungannon	40	100	7.09	12.70	13.85	32.55	12.75	6.98	13.23	16.24	38.07	15.43
Eden	25	62.5	4.19	6.22	8.27	17.54	7.85	4.61	8.43	8.49	18.38	8.26
Enniskillen	31.5	79	3.61	4.03	6.22	12.73	5.91	4.25	5.06	7.84	16.66	7.55
Finaghy	31.5	79	9.43	15.98	12.37	30.32	11.42	7.07	12.48	16.20	38.06	15.32
Glengormley	18.4	46.8	3.42	3.92	5.00	10.09	4.83	4.11	6.93	5.03	10.62	4.94
Gort Cluster	40	100	5.96	7.22	6.64	15.14	6.36	5.77	10.91	6.62	15.00	6.47
Hannahstown	31.5	79	10.56	19.78	13.36	33.20	12.26	11.13	20.78	17.80	44.52	16.75
Kells	40	100	9.42	19.78	14.87	36.45	13.63	9.95	20.76	19.31	47.65	18.22
Killymallaght	40	100	6.03	7.68	9.40	21.49	8.84	5.65	9.29	9.62	21.71	9.32

Table E-6 Northern Ireland Short Circuit Currents for Minimum Demand in 2018

	Rat	ing		TI	hree Pha	se			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	1"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
Knock	n/a	n/a	5.31	7.92	12.03	26.83	11.03	3.32	10.87	13.30	26.65	12.64
Larne	18.4	46.8	4.56	5.53	8.02	17.32	7.62	5.16	8.49	8.02	17.79	7.82
Limavady	18.4	46.8	3.63	4.03	5.90	12.08	5.62	4.27	6.10	6.63	14.12	6.45
Lisburn	18.4	46.8	5.88	8.09	9.97	22.69	9.34	5.43	9.50	10.30	23.08	9.93
Lisaghmore	31.5	79	4.76	7.23	8.23	17.95	7.78	4.90	9.44	8.47	18.59	8.24
Loguestown	26.2	65	3.45	4.02	4.81	9.72	4.61	4.03	5.54	5.45	11.46	5.31
Magherakeel Cluster	40	100	4.24	4.60	3.25	6.90	3.17	5.39	6.23	3.82	8.54	3.76
Newtownards	40	100	4.79	7.08	6.98	15.24	6.62	5.73	9.76	6.92	15.66	6.72
Newry	18.4	46.8	3.92	6.64	5.17	10.79	4.97	4.84	9.72	5.22	11.42	5.11
Omagh	40	100	4.65	6.05	10.32	22.40	9.63	4.92	7.75	11.91	26.15	11.40
Rasharkin	40	100	3.85	4.27	5.55	11.53	5.33	4.41	6.93	5.84	12.53	5.72
Rathgael	26.2	65	4.30	6.78	5.55	11.84	5.31	4.95	9.75	5.66	12.44	5.52
Rosebank	40	100	10.20	17.48	12.82	31.73	11.70	11.27	19.22	16.68	41.77	15.64
Slieve Kirk	40	100	4.52	5.30	7.06	15.23	6.74	5.26	9.70	6.30	14.01	6.17
Springtown	n/a	n/a	4.97	7.56	8.41	18.51	7.94	5.03	9.51	8.78	19.37	8.53
Strabane	18.4	46.8	5.26	6.79	11.21	24.95	10.41	5.79	9.19	12.97	29.42	12.41
Tandragee	31.5	79	9.71	18.43	17.14	42.16	15.50	10.32	20.17	21.37	52.98	19.99
Tremoge	40	100	4.12	4.97	7.27	15.35	6.94	4.45	7.99	7.30	15.68	7.12
Tamnamore	40	100	8.48	18.29	16.11	38.90	14.68	9.22	19.96	21.14	51.67	19.84
Waringstown	18.4	46.8	5.04	7.52	7.55	16.67	7.19	5.60	10.26	7.48	16.85	7.28

Table E-7 Northern Ireland Short Circuit Currents for Maximum Demand in 2018

	Rat	ing		1	Three Pha	ise			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
275kV				'	'		,					
Ballylumford	31.5	79	14.83	23.80	20.01	51.52	17.63	15.98	26.62	22.99	59.58	21.51
Castlereagh	31.5	79	10.76	15.05	16.52	41.15	14.63	10.63	16.13	16.57	41.23	15.58
Coolkeeragh	31.5	79	8.42	13.18	12.43	30.00	11.44	10.14	16.55	12.50	30.92	12.05
Hannahstown	31.5	79	11.12	15.58	16.38	40.96	14.55	10.90	16.93	16.35	40.80	15.42
Kells	31.5	79	12.85	18.26	18.89	47.98	16.75	11.22	16.46	19.18	48.01	18.13
Kilroot	31.5	79	14.19	21.19	18.46	47-35	16.38	15.83	24.79	22.00	56.96	20.65
Magherafelt	31.5	79	11.45	15.37	18.59	46.65	16.59	8.70	10.79	15.81	38.31	15.10
Moyle	31.5	79	14.52	22.82	19.53	50.18	17.25	15.40	24.82	22.23	57-43	20.83
Tandragee	31.5	79	10.29	13.75	19.38	48.01	17.21	9.73	14.35	18.99	46.72	17.93
Tamnamore	40	100	10.52	13.90	18.08	44.92	16.15	10.65	17.05	16.46	40.95	15.66
110kV							,					
Aghyoule	40	100	3.67	8.46	4.60	9.45	4.11	5.12	11.88	4.27	9.46	4.10
Antrim	40	100	4.25	7.41	10.23	21.74	9.69	4.51	9.64	9.96	21.47	9.73
Dalla laure Carrel	21.9	55	10.54	25.54	23.46	58.29	21.54					
Ballylumford	26.2	65						9.96	26.56	21.59	53.27	20.69
Ballymena	40	100	4.47	8.56	9.21	19.80	8.71	5.23	12.06	9.44	20.99	9.20
Banbridge	18.4	46.8	3.74	5.97	6.85	14.12	6.59	4.81	9.51	6.64	14.51	6.50
Ballyvallagh	21.9	46.8	4.48	5.24	16.47	35.44	15.36	4.39	5.76	14.82	31.74	14.39
Ballynahinch	18.4	46.8	3.88	6.64	5.87	12.22	5.58	4.73	9.79	5.80	12.63	5.63
Belfast Central	n/a	n/a	7.25	11.42	15.18	35.80	13.75	4.77	10.89	17.97	39.21	16.79
Belfast North	n/a	n/a	4.30	6.77	13.64	29.09	12.65	2.89	11.37	13.74	26.56	13.16
Brockaghboy	40	100	5.21	6.34	5.72	12.70	4.62	4.21	5.91	3.43	7.28	3.26
Carnmoney	31.5	79	3.59	6.09	8.86	18.12	8.45	4.27	8.62	8.65	18.42	8.43
Castlereagh	31.5	79	9.91	20.47	19.35	47.72	17.17	10.97	21.48	24.40	60.91	22.36
Coleraine	40	100	4.12	5.79	10.00	21.11	8.98	4.94	7.80	10.78	23.70	10.24
Coolkeeragh	31.5	79	8.70	17.64	23.17	56.18	20.83	9.67	19.50	28.18	69.29	26.61
Creagh	31.5	79	3.21	3.56	8.43	16.75	8.08	4.10	6.11	8.70	18.35	8.51
Cregagh	26.2	65	8.09	13.92	17.21	41.27	15.42	6.55	12.88	20.91	48.50	19.35
Curraghamulkin	40	100	5.21	7.83	6.95	15.43	6.39	5.71	12.09	6.30	14.26	6.12
Donegall North	31.5	79	7.33	11.95	15.86	37.48	14.56	5.04	9.92	19.31	42.62	18.22
Donegall South	n/a	n/a	5.41	7.72	12.25	27.43	11.44	4.61	8.35	13.16	28.48	12.62
Drumnakelly	31.5	79	6.51	10.44	22.74	52.67	20.63	6.65	11.60	23.62	54.92	22.36
Dungannon	40	100	6.06	10.87	19.67	44.99	18.13	6.36	12.38	21.09	48.65	20.19
Eden	25	62.5	3.67	5.63	9.98	20.51	9.51	4.27	8.08	9.61	20.45	9.38
Enniskillen	31.5	79	3.59	4.94	11.55	23.61	9.32	4.67	6.81	11.78	25.57	10.73
Finaghy	31.5	79	8.36	14.41	16.51	39.79	15.13	6.15	11.28	20.71	47.50	19.49
Glengormley	18.4	46.8	3.11	3.47	5.65	11.13	5.44	3.92	6.59	5.46	11.40	5.35
Gort Cluster	40	100	6.21	8.19	8.75	20.11	8.28	5.91	12.57	7.90	17.98	7.74
Hannahstown	31.5	79	9.49	18.60	18.30	44.89	16.65	10.24	19.91	23.44	58.06	21.92
Kells	40	100	8.47	18.42	22.34	53.96	20.29	9.29	19.99	27.44	67.11	25.99
Killymallaght	40	100	5.61	7.94	13.11	29.57	12.29	5.36	9.90	11.98	26.78	11.68
Knock	n/a	n/a	4.29	6.71	16.18	34.49	14.58	2.88	10.68	16.15	31.20	15.21

Table E-7 Northern Ireland Short Circuit Currents for Maximum Demand in 2018

	Rat	ing		1	Three Pha	ise			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	1"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
Larne	18.4	46.8	4.00	4.77	9.74	20.43	9.28	4.83	8.00	9.13	19.97	8.94
Limavady	18.4	46.8	3.60	4.43	8.10	16.56	7.54	4.45	7.16	8.35	17.93	8.07
Lisburn	18.4	46.8	5.25	7.39	12.65	28.14	11.82	5.04	9.26	12.04	26.56	11.63
Lisaghmore	31.5	79	4.10	6.51	10.28	21.69	9.74	4.49	9.05	9.82	21.15	9.59
Loguestown	26.2	65	3.57	4.95	6.70	13.67	6.19	4.32	7.00	6.91	14.76	6.66
Magherakeel Cluster	40	100	5.13	9.51	4.39	9.73	4.34	6.77	12.18	4.83	11.27	4.80
Newtownards	40	100	4.29	6.61	8.22	17.51	7.74	5.41	9.56	7.66	17.15	7.42
Newry	18.4	46.8	3.80	7.36	5.87	12.15	5.59	4.83	10.65	5.68	12.42	5.53
Omagh	40	100	4.52	7.05	17.55	37.85	15.66	4.96	9.46	17.18	37.80	16.38
Rasharkin	40	100	4.47	6.67	9.02	19.40	7.83	4.96	10.61	7.58	16.68	7.23
Rathgael	26.2	65	3.92	6.34	6.30	13.15	5.98	4.72	9.50	6.16	13.41	5.98
Rosebank	40	100	8.93	16.30	17.79	43.29	15.92	10.38	18.62	22.03	54.65	20.35
Slieve Kirk	40	100	4.32	6.31	9.19	19.61	8.77	5.37	11.23	7.46	16.68	7.34
Springtown	n/a	n/a	4.25	6.70	10.53	22.40	9.96	4.61	9.05	10.24	22.18	9.99
Strabane	18.4	46.8	4.52	5.98	16.79	36.18	15.38	5.34	9.00	17.35	38.75	16.68
Tandragee	31.5	79	8.20	16.72	24.93	59.92	22.45	9.21	19.09	28.80	70.36	26.97
Tremoge	40	100	4.01	5.77	9.74	20.45	9.32	4.46	9.32	8.72	18.75	8.57
Tamnamore	40	100	7.23	16.12	24.01	56.60	21.94	8.23	18.26	29.57	71.11	28.00
Waringstown	18.4	46.8	4.60	7.27	8.87	19.20	8.45	5.37	10.29	8.33	18.62	8.12

Table E- 8 Northern Ireland Short Circuit Currents for Minimum Demand in 2021

	Rat	ing		1	hree Pha	ise			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV				'			,			'		
Turleenan	50	125	15.63	20.84	7.58	19.60	6.87	13.54	19.86	8.89	22.70	8.37
275kV												
Ballylumford	31.5	79	12.98	18.71	10.93	27.78	9.70	13.68	20.69	13.55	34.63	12.58
Castlereagh	31.5	79	11.87	16.59	10.54	26.54	9.35	11.50	17.05	12.05	30.25	11.22
Coolkeeragh	31.5	79	9.86	15.09	9.36	23.06	8.46	11.12	17.88	10.27	25.68	9.73
Hannahstown	31.5	79	11.85	16.50	10.28	25.89	9.14	11.52	17.32	11.70	29.39	10.92
Kells	31.5	79	13.73	20.15	11.86	30.32	10.45	12.20	18.09	13.64	34.45	12.68
Kilroot	31.5	79	15.19	23.43	12.10	31.21	10.63	16.29	25.99	15.44	40.07	14.26
Magherafelt	31.5	79	13.41	18.96	12.42	31.68	10.95	9.88	12.62	12.44	30.68	11.66
Moyle	31.5	79	12.89	18.45	10.80	27.43	9.59	13.53	20.25	13.33	34.03	12.38
Tandragee	31.5	79	12.39	17.53	13.04	32.99	11.43	11.07	16.61	14.64	36.58	13.55
Tamnamore	40	100	12.95	18.26	12.79	32.51	11.25	11.81	19.50	13.80	34.75	12.84
Turleenan	40	100	12.98	18.37	12.97	32.98	11.41	11.22	17.57	13.91	34.82	12.94
100kV												
Aghyoule	40	100	2.95	3.14	3.09	6.01	3.01	3.95	5.02	3.33	6.97	3.28
Antrim	40	100	4.66	7.37	8.38	18.19	7.99	4.75	9.36	8.70	18.96	8.48
2 11 1 6 1	21.9	55	9.66	20.19	14.75	36.27	13.68					
Ballylumford	26.2	65						10.71	22.49	18.55	46.20	17.67
Ballymena	40	100	4.76	8.22	7.59	16.54	7.25	5.35	11.36	8.09	18.08	7.89
Banbridge	18.4	46.8	4.05	6.35	6.28	13.21	6.06	5.04	9.79	6.30	13.91	6.18
Ballyvallagh	21.9	46.8	5.35	6.56	12.09	27.01	11.33	4.91	6.57	12.15	26.67	11.74
Ballynahinch	18.4	46.8	4.19	6.90	5.28	11.20	5.08	4.95	9.93	5.41	11.89	5.29
Belfast Central	n/a	n/a	8.54	12.39	12.01	29.03	11.12	5.39	11.43	14.95	33.44	14.18
Belfast North	n/a	n/a	4.99	7.59	11.13	24.51	10.42	3.20	11.64	12.02	23.86	11.57
Brockaghboy	40	100	4.50	4.78	3.45	7.42	3.37	4.09	5.13	2.92	6.16	2.89
Carnmoney	31.5	79	4.00	6.38	7.50	15.73	7.17	4.54	8.77	7.75	16.72	7.55
Castlereagh	31.5	79	11.84	20.82	14.52	36.56	13.26	12.55	21.68	19.11	48.42	17.90
Coleraine	40	100	3.71	4.06	6.46	13.30	6.14	4.29	5.30	7.79	16.59	7.54
Coolkeeragh	31.5	79	10.44	19.77	15.55	38.61	14.20	11.05	21.06	20.23	50.54	19.09
Creagh	31.5	79	3.61	4.05	7.41	15.17	7.11	4.38	6.56	7.93	16.99	7.74
Cregagh	26.2	65	9.63	14.89	13.25	32.57	12.18	7.45	13.40	16.91	40.05	15.94
Curraghmulkin	40	100	4.55	5.02	4.85	10.47	4.69	5.06	8.13	5.06	11.18	4.97
Donegall North	31.5	79	8.27	13.07	12.53	30.14	11.65	5.73	10.65	15.89	35.96	15.11
Donegall South	n/a	n/a	6.12	8.60	10.18	23.32	9.58	5.07	8.81	11.50	25.40	11.08
Drumnakelly	31.5	79	7.99	12.39	17.30	41.42	15.81	7.65	12.80	19.43	46.23	18.39
Dungannon	40	100	7.20	12.90	14.81	34.89	13.71	7.06	13.46	17.13	40.22	16.32
Eden	25	62.5	4.14	6.17	8.17	17.26	7.79	4.58	8.38	8.42	18.19	8.20
Enniskillen	31.5	79	3.58	3.98	6.31	12.88	6.01	4.22	5.01	7.93	16.83	7.66
Finaghy	31.5	79	9.32	15.45	12.93	31.64	12.00	6.95	12.12	16.81	39.39	15.95
Glengormley	18.4	46.8	3.40	3.86	5.08	10.25	4.92	4.10	6.90	5.09	10.74	5.00
Gort Cluster	40	100	5.96	7.13	6.82	15.55	6.56	5.77	10.91	6.74	15.28	6.60

Table E- 8 Northern Ireland Short Circuit Currents for Minimum Demand in 2021

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
Hannahstown	31.5	79	10.46	19.16	14.01	34.78	12.94	11.06	20.23	18.54	46.33	17.51
Kells	40	100	9.77	20.45	15.54	38.26	14.32	10.31	21.45	20.02	49.61	18.95
Killymallaght	40	100	5.99	7.50	9.63	21.98	9.09	5.62	9.18	9.79	22.08	9.51
Knock	n/a	n/a	5.20	7.52	12.71	28.22	11.72	3.23	10.98	13.81	27.47	13.17
Larne	18.4	46.8	4.52	5.49	7.99	17.22	7.63	5.13	8.44	8.00	17.71	7.81
Limavady	18.4	46.8	3.60	3.95	6.00	12.28	5.75	4.25	6.03	6.73	14.31	6.56
Lisburn	18.4	46.8	5.78	7.84	10.37	23.51	9.76	5.37	9.34	10.58	23.65	10.23
Lisaghmore	31.5	79	4.71	7.08	8.43	18.33	7.99	4.87	9.33	8.62	18.88	8.40
Loguestown	26.2	65	3.42	3.96	4.88	9.86	4.69	4.01	5.49	5.52	11.59	5.39
Magherakeel Cluster	40	100	4.23	4.56	3.30	7.00	3.23	5.39	6.20	3.87	8.65	3.82
Newtownards	40	100	4.74	6.89	7.15	15.57	6.81	5.73	9.70	7.03	15.92	6.85
Newry	18.4	46.8	3.87	6.57	5.31	11.05	5.13	4.81	9.69	5.32	11.62	5.22
Omagh	40	100	4.62	5.93	10.66	23.11	9.99	4.90	7.66	12.19	26.74	11.70
Omagh South	40	100	3.87	4.50	8.01	16.66	7.59	4.04	4.89	8.86	18.62	8.57
Rasharkin	40	100	3.82	4.19	5.65	11.72	5.44	4.40	6.88	5.92	12.69	5.80
Rathgael	26.2	65	4.26	6.64	5.64	12.00	5.42	4.96	9.68	5.73	12.60	5.60
Rosebank	40	100	10.59	17.03	13.61	33.84	12.49	11.65	18.94	17.61	44.26	16.57
Slieve Kirk	40	100	4.49	5.20	7.21	15.51	6.90	5.24	9.61	6.39	14.21	6.27
Springtown	n/a	n/a	4.94	7.47	8.62	18.94	8.16	5.03	9.50	8.97	19.78	8.72
Strabane	18.4	46.8	5.21	6.62	11.47	25.49	10.71	5.76	9.03	13.21	29.93	12.68
Tandragee	31.5	79	10.04	19.22	18.61	45.98	16.92	10.67	21.05	22.88	56.95	21.48
Tremoge	40	100	4.09	4.87	7.50	15.80	7.19	4.43	7.95	7.45	16.01	7.29
Tamnamore	40	100	8.80	19.53	17.44	42.34	15.98	9.61	21.39	22.65	55.66	21.33
Waringstown	18.4	46.8	4.99	7.41	7.84	17.27	7.49	5.57	10.22	7.67	17.26	7.49

Table E-9 Northern Ireland Short Circuit Currents for Maximum Demand in 2021

	Rat	Rating Three Phase							Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV												
Turleenan	50	125	15.18	18.90	10.27	26.49	9.61	12.86	18.43	11.29	28.68	10.90
275kV												
Ballylumford	31.5	79	13.07	19.70	18.38	46.77	16.39	14.11	22.73	20.41	52.32	19.22
Castlereagh	31.5	79	10.47	14.54	16.38	40.68	14.57	10.47	15.73	16.60	41.22	15.61
Coolkeeragh	31.5	79	8.29	12.96	12.74	30.68	11.79	10.02	16.35	12.74	31.46	12.30
Hannahstown	31.5	79	10.69	14.83	16.03	39.89	14.31	10.67	16.37	16.12	40.13	15.21
Kells	31.5	79	12.48	17.65	18.87	47.80	16.84	11.05	16.19	19.14	47.84	18.13
Kilroot	31.5	79	13.88	20.71	18.56	47.48	16.54	15.53	24.25	22.10	57.12	20.77
Magherafelt	31.5	79	11.55	15.46	19.53	49.05	17.53	8.60	10.63	16.48	39.88	15.77
Moyle	31.5	79	12.89	19.17	18.00	45.72	16.08	13.85	21.90	19.91	50.93	18.76
Tandragee	31.5	79	10.53	14.20	20.74	51.53	18.48	9.68	14.43	20.37	50.10	19.25
Tamnamore	40	100	11.07	14.77	20.15	50.37	18.07	10.49	17.44	18.82	46.74	17.90
Turleenan	40	100	11.07	14.81	20.44	51.09	18.32	9.86	15.39	18.93	46.65	18.00
110kV												
Aghyoule	40	100	3.66	8.44	4.64	9.53	4.14	5.11	11.86	4.30	9.52	4.13
Agivey	40	100	5.91	9.26	6.55	14.92	5.45	6.80	14.37	5.25	12.25	4.95
Antrim	40	100	4.26	7.53	10.32	21.95	9.79	4.54	9.79	10.07	21.72	9.83
Ballylumford	40	100	10.09	23.87	23.15	57.23	21.30	11.69	27.55	26.67	67.07	25.51
Ballymena	40	100	4.46	8.59	9.27	19.93	8.79	5.22	12.08	9.49	21.10	9.26
Banbridge	18.4	46.8	3.73	5.96	6.94	14.31	6.69	4.81	9.52	6.72	14.67	6.58
Ballyvallagh	21.9	46.8	4.45	5.22	16.44	35.32	15.36	4.37	5.75	14.81	31.69	14.38
Ballynahinch	18.4	46.8	3.89	6.63	5.91	12.31	5.62	4.77	9.80	5.87	12.80	5.69
Belfast Central	n/a	n/a	7.19	11.06	15.45	36.40	14.01	4.64	10.82	18.30	39.68	17.08
Belfast North	n/a	n/a	4.27	6.75	13.72	29.21	12.73	2.88	11.33	13.82	26.70	13.25
Brockaghboy	40	100	5.92	8.63	5.97	13.60	4.86	5.96	10.53	4.31	9.83	4.07
Carnmoney	31.5	79	3.58	6.11	8.87	18.12	8.46	4.27	8.64	8.68	18.49	8.46
Castlereagh	31.5	79	9.93	19.75	19.85	48.97	17.62	10.94	20.87	25.13	62.72	23.00
Coleraine	40	100	4.15	5.88	10.21	21.58	9.26	4.96	7.94	11.03	24.26	10.52
Coolkeeragh	31.5	79	8.59	17.48	23.51	56.89	21.27	9.56	19.33	28.55	70.09	27.05
Creagh	31.5	79	3.20	3.54	8.51	16.89	8.17	4.09	6.10	8.77	18.48	8.58
Cregagh	26.2	65	8.03	13.42	17.58	42.14	15.76	6.37	12.48	21.41	49.40	19.79
Curraghmulkin	40	100	5.19	7.80	7.00	15.54	6.45	5.69	12.07	6.35	14.35	6.16
Donegall North	31.5	79	7.23	11.80	15.95	37.60	14.67	4.99	9.85	19.42	42.77	18.33
Donegall South	n/a	n/a	5.37	7.66	12.32	27.54	11.52	4.58	8.31	13.24	28.62	12.70
Drumnakelly	31.5	79	6.53	10.52	23.38	54.20	21.30	6.66	11.64	24.17	56.22	22.92
Dungannon	40	100	6.10	11.05	20.19	46.24	18.70	6.37	12.52	21.56	49.75	20.68
Eden	25	62.5	3.66	5.63	9.96	20.46	9.50	4.27	8.09	9.63	20.50	9.40
Enniskillen	31.5	79	3.57	4.91	11.74	23.96	9.46	4.65	6.77	11.95	25.93	10.89
Finaghy	31.5	79	8.22	14.10	16.59	39.90	15.23	6.07	11.13	20.83	47.65	19.60
Glengormley	18.4	46.8	3.10	3.46	5.68	11.18	5.47	3.92	6.58	5.48	11.45	5.38
Gort Cluster	40	100	6.20	8.17	8.85	20.32	8.39	5.90	12.56	7.97	18.13	7.81

Table E-9 Northern Ireland Short Circuit Currents for Maximum Demand in 2021

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	1"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
Hannahstown	31.5	79	9.29	18.02	18.39	44.99	16.77	10.02	19.31	23.57	58.20	22.05
Kells	40	100	8.41	18.16	22.53	54.37	20.55	9.22	19.71	27.65	67.55	26.23
Killymallaght	40	100	5.56	7.88	13.26	29.84	12.49	5.34	9.86	12.08	26.97	11.80
Knock	n/a	n/a	4.20	6.51	16.50	34.98	14.88	2.81	10.70	16.37	31.42	15.42
Larne	18.4	46.8	3.99	4.77	9.74	20.41	9.29	4.82	7.98	9.13	19.97	8.94
Limavady	18.4	46.8	3.59	4.42	8.18	16.73	7.66	4.44	7.17	8.43	18.10	8.17
Lisburn	18.4	46.8	5.23	7.39	12.77	28.39	11.95	5.04	9.34	12.18	26.87	11.76
Lisaghmore	31.5	79	4.08	6.49	10.36	21.83	9.84	4.48	9.03	9.88	21.26	9.66
Loguestown	26.2	65	3.58	4.98	6.80	13.88	6.33	4.33	7.07	7.01	14.97	6.78
Magherakeel Cluster	40	100	5.09	9.35	4.40	9.73	4.35	6.74	12.05	4.81	11.20	4.78
Newtownards	40	100	4.26	6.56	8.28	17.61	7.79	5.41	9.59	7.74	17.32	7.49
Newry	18.4	46.8	3.79	7.35	5.94	12.30	5.67	4.83	10.65	5.74	12.55	5.59
Omagh	40	100	4.48	7.00	17.81	38.32	15.95	4.93	9.42	17.37	38.17	16.59
Omagh South	40	100	3.81	5.84	13.45	27.88	11.73	4.05	5.88	12.21	25.68	11.59
Rasharkin	40	100	4.76	7.95	9.55	20.83	8.45	5.26	10.91	8.56	19.05	8.20
Rathgael	26.2	65	3.90	6.30	6.34	13.21	6.01	4.73	9.47	6.23	13.56	6.04
Rosebank	40	100	8.91	15.72	18.20	44.27	16.29	10.32	18.14	22.60	56.02	20.85
Slieve Kirk	40	100	4.29	6.29	9.27	19.75	8.88	5.35	11.21	7.51	16.76	7.40
Springtown	n/a	n/a	4.23	6.67	10.61	22.54	10.07	4.59	9.03	10.31	22.30	10.07
Strabane	18.4	46.8	4.46	5.90	17.08	36.72	15.77	5.29	8.97	17.59	39.21	16.97
Tandragee	31.5	79	8.30	17.16	25.68	61.82	23.21	9.31	19.55	29.60	72.43	27.77
Tremoge	40	100	4.00	5.75	9.86	20.68	9.45	4.45	9.31	8.81	18.92	8.66
Tamnamore	40	100	7.34	16.82	24.79	58.58	22.77	8.36	19.06	30.48	73-47	28.93
Waringstown	18.4	46.8	4.59	7.26	9.01	19.49	8.59	5.37	10.30	8.43	18.85	8.23

Table E-10 Northern Ireland Short Circuit Currents for Minimum Demand in 2024

	Rat	ing		1	Three Pha	ise			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV			(,,,,,	(50)				(1.5)	(5.5)			
Turleenan	50	125	12.79	18.46	6.68	16.97	5.98	11.85	18.25	8.04	20.25	7.45
275kV				, , , , , , , , , , , , , , , , , , ,		7.				,		, 13
Ballylumford	31.5	79	10.88	16.65	8.47	21.13	7.46	11.54	18.17	10.91	27.39	9.95
Castlereagh	31.5	79	10.14	14.96	8.26	20.43	7.27	10.23	15.64	9.96	24.66	9.11
Coolkeeragh	31.5	79	12.96	20.21	8.20	20.86	7.32	13.74	22.72	9.28	23.73	8.66
Hannahstown	31.5	79	10.19	15.05	8.11	20.08	7.15	10.28	15.93	9.72	24.08	8.91
Kells	31.5	79	10.67	15.88	8.59	21.37	7.57	10.32	15.51	10.53	26.09	9.64
Kilroot	31.5	79	10.53	15.06	8.02	19.93	7.13	11.27	16.43	10.75	26.93	9.83
Magherafelt	31.5	79	11.58	18.14	9.83	24.70	8.60	9.47	13.14	10.55	25.88	9.72
Moyle	31.5	79	10.84	16.51	8.39	20.92	7.40	11.48	17.93	10.76	27.01	9.83
Tandragee	31.5	79	10.63	16.21	10.45	25.99	9.09	10.07	15.84	12.33	30.46	11.21
Tamnamore	40	100	11.20	17.32	10.33	25.85	9.01	10.79	18.54	11.76	29.31	10.75
Turleenan	40	100	11.19	17.33	10.50	26.28	9.15	10.35	17.01	11.88	29.47	10.86
110kV												
Aghyoule	40	100	2.98	3.19	3.01	5.86	2.91	3.95	4.94	3.30	6.89	3.23
Agivey	40	100	4.47	4.82	3.39	7.29	3.29	5.27	7.26	3.75	8.34	3.68
Antrim	40	100	4.71	7.48	7.64	16.62	7.21	4.78	9.32	8.14	17.77	7.86
Airport Road	40	100	4.92	7.25	6.92	15.19	6.51	5.28	9.78	7.18	16.00	6.92
Ballylumford	40	100	9.11	18.64	12.74	31.09	11.67	10.02	20.56	16.37	40.42	15.34
Ballymena	40	100	4.81	8.31	6.98	15.25	6.60	5.36	11.27	7.61	17.00	7.34
Banbridge	18.4	46.8	4.12	6.51	5.96	12.59	5.70	5.07	9.86	6.07	13.41	5.91
Ballyvallagh	21.9	46.8	5.42	6.95	10.68	23.91	9.88	4.99	6.82	11.13	24.50	10.62
Ballynahinch	18.4	46.8	4.26	7.03	5.00	10.63	4.76	4.96	9.96	5.19	11.43	5.04
Belfast Central	n/a	n/a	8.19	12.21	10.68	25.67	9.76	5.45	11.40	13.57	30.41	12.67
Belfast North	n/a	n/a	5.06	7.86	10.05	22.21	9.30	3.29	11.63	11.12	22.25	10.57
Brockaghboy	40	100	4.59	4.91	3.07	6.64	2.99	5.00	6.54	3.19	7.04	3.15
Carnmoney	31.5	79	4.11	6.59	6.93	14.63	6.55	4.60	8.87	7.32	15.85	7.07
Castlereagh	31.5	79	10.60	18.51	12.64	31.42	11.39	11.31	19.49	16.99	42.56	15.63
Coleraine	40	100	3.79	4.22	6.17	12.78	5.82	4.32	5.42	7.54	16.08	7.23
Coolkeeragh	31.5	79	11.19	23.51	14.44	36.14	13.01	11.73	24.61	18.92	47.61	17.63
Creagh	31.5	79	3.71	4.28	6.89	14.19	6.54	4.44	6.70	7.51	16.12	7.26
Cregagh	26.2	65	9.03	14.25	11.66	28.41	10.58	7.30	13.14	15.19	35.86	14.08
Curraghmulkin	40	100	4.58	5.12	4.66	10.08	4.48	5.11	8.13	4.92	10.89	4.80
Donegall North	31.5	79	7.95	12.87	11.20	26.80	10.29	5.73	10.72	14.41	32.62	13.50
Donegall South	n/a	n/a	6.10	8.79	9.27	21.23	8.63	5.11	8.92	10.68	23.64	10.17
Drumnakelly	31.5	79	7.75	12.47	15.25	36.35	13.75	7.52	12.82	17.61	41.79	16.42
Dungannon	18.4	46.8	7.11	13.00	13.37	31.43	12.21	7.01	13.50	15.77	36.99	14.82
Eden	25	62.5	4.26	6.43	7.50	15.95	7.07	4.65	8.51	7.91	17.17	7.63
Enniskillen	31.5	79	3.63	4.08	6.08	12.45	5.74	4.24	5.07	7.69	16.34	7.36
Finaghy	31.5	79	8.78	14.77	11.53	27.98	10.57	6.83	12.01	15.18	35.45	14.19
Glengormley	18.4	46.8	3.47	4.01	4.79	9.71	4.60	4.14	6.96	4.88	10.31	4.76

Table E-10 Northern Ireland Short Circuit Currents for Minimum Demand in 2024

	Rat	ing		1	Three Pha	ıse		Single Phase						
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB		
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]		
Gort Cluster	40	100	5.97	7.30	6.49	14.80	6.19	5.86	11.00	6.52	14.82	6.34		
Hannahstown	31.5	79	9.62	17.57	12.38	30.43	11.29	10.15	18.51	16.60	41.06	15.43		
Kells	21.9	55.9	8.82	17.53	13.27	32.23	12.08	9.31	18.51	17.43	42.64	16.24		
Kells Cluster	40	100	8.52	16.21	12.84	31.04	11.73	0.00	0.00	0.00	0.00	0.00		
Killymallaght	40	100	6.18	7.94	9.14	20.99	8.54	5.76	9.54	9.44	21.38	9.09		
Knock	n/a	n/a	5.30	7.82	11.21	24.98	10.20	3.35	10.99	12.59	25.29	11.82		
Larne	18.4	46.8	4.61	5.76	7.33	15.88	6.93	5.17	8.55	7.53	16.70	7.28		
Limavady	18.4	46.8	3.69	4.10	5.77	11.86	5.47	4.31	6.12	6.54	13.95	6.33		
Lisburn	18.4	46.8	5.80	8.09	9.46	21.46	8.80	5.39	9.44	9.91	22.17	9.47		
Lisaghmore	31.5	79	4.91	7.47	8.04	17.65	7.56	5.00	9.65	8.31	18.31	8.04		
Loguestown	26.2	65	3.48	4.08	4.71	9.54	4.49	4.04	5.58	5.38	11.30	5.21		
Magherakeel Cluster	40	100	4.26	4.63	3.17	6.74	3.09	5.36	6.17	3.76	8.41	3.70		
Newtownards	40	100	4.81	7.07	6.64	14.51	6.25	5.69	9.71	6.69	15.12	6.45		
Newry	18.4	46.8	3.96	6.72	5.09	10.66	4.88	4.87	9.76	5.19	11.37	5.06		
Omagh	40	100	4.69	6.15	10.14	22.04	9.39	4.96	7.82	11.72	25.78	11.13		
Omagh South	40	100	3.92	4.65	7.66	16.00	7.19	4.08	4.97	8.54	17.99	8.20		
Rasharkin	40	100	3.88	4.34	5.37	11.19	5.13	4.38	6.17	6.03	12.90	5.86		
Rathgael	26.2	65	4.33	6.79	5.32	11.35	5.06	4.97	9.72	5.49	12.08	5.32		
Rosebank	40	100	9.75	15.90	11.94	29.39	10.82	10.57	17.11	15.81	39.31	14.63		
Slieve Kirk	40	100	4.61	5.43	6.90	14.94	6.55	5.35	9.74	6.23	13.90	6.07		
Springtown	n/a	n/a	5.15	7.90	8.22	18.22	7.71	5.17	9.85	8.64	19.17	8.34		
Strabane	18.4	46.8	5.37	6.99	10.84	24.22	9.99	5.88	9.35	12.61	28.68	11.97		
Tandragee	31.5	79	9.36	18.00	16.25	39.79	14.57	10.00	19.69	20.42	50.42	18.85		
Tremoge	40	100	4.15	5.05	7.10	15.01	6.74	4.51	8.06	7.19	15.48	6.97		
Tamnamore	40	100	8.46	18.65	15.46	37.33	13.98	9.18	20.27	20.36	49.73	18.86		
Waringstown	18.4	46.8	5.05	7.61	7.36	16.26	6.97	5.60	10.29	7.34	16.54	7.10		

Table E-11 Northern Ireland Short Circuit Currents for Maximum Demand in 2024

	Rat	ing		1	Three Pha	ıse			Si	ngle Pha	se	
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]
400kV												
Turleenan	50.0	125	14.31	18.23	10.40	26.69	9.67	12.36	17.99	11.43	28.91	10.99
275kV												
Ballylumford	31.5	79	10.88	16.65	17.20	43.66	15.22	13.76	22.53	19.43	49.68	18.17
Castlereagh	31.5	79	10.14	14.96	15.33	37.95	13.53	10.30	15.56	15.92	39.47	14.88
Coolkeeragh	31.5	79	12.96	20.21	12.61	31.96	11.59	13.78	21.29	12.62	32.27	12.15
Hannahstown	31.5	79	10.19	15.05	15.08	37.42	13.35	10.50	16.21	15.49	38.47	14.52
Kells	31.5	79	10.67	15.88	16.71	42.01	14.86	10.67	15.49	17.61	43.83	16.59
Kilroot	31.5	79	10.53	15.06	15.07	37.87	13.53	12.93	18.34	18.69	47.51	17.54
Magherafelt	31.5	79	11.58	18.14	18.44	46.40	16.43	8.74	11.05	15.95	38.69	15.19
Moyle	31.5	79	10.84	16.51	16.86	42.74	14.95	13.53	21.75	18.97	48.42	17.76
Tandragee	31.5	79	10.63	16.21	19.81	49.20	17.48	9.67	14.57	19.81	48.70	18.59
Tamnamore	40	100	11.20	17.32	19.37	48.42	17.22	10.52	17.68	18.37	45.64	17.38
Turleenan	40	100	11.19	17.33	19.70	49.25	17.51	9.88	15.60	18.52	45.67	17.53
110kV	,			, , ,				-			10	7 2 2
Aghyoule	40	100	2.98	3.19	4.58	9.45	4.08	5.19	12.08	4.27	9.48	4.09
Agivey	40	100	4.47	4.82	7.13	16.44	6.02	6.99	14.67	5.65	13.25	5.36
Antrim	40	100	4.71	7.48	10.42	22.13	9.81	4.51	9.70	10.10	21.78	9.84
Airport Road	40	100	4.92	7.25	8.58	18.30	8.04	4.90	9.52	8.36	18.33	8.05
Ballylumford	40	100	9.11	18.64	22.74	56.11	20.78	11.53	27.34	26.29	66.01	25.02
Ballymena	40	100	4.81	8.31	9.36	20.08	8.81	5.20	11.97	9.53	21.15	9.26
Banbridge	18.4	46.8	4.12	6.51	6.88	14.19	6.61	4.81	9.53	6.66	14.56	6.52
Ballyvallagh	21.9	46.8	5.42	6.95	16.39	35.17	15.19	4.36	5.76	14.75	31.56	14.28
Ballynahinch	18.4	46.8	4.26	7.03	5.87	12.24	5.56	4.75	9.80	5.84	12.73	5.66
Belfast Central	n/a	n/a	8.19	12.21	15.20	35.73	13.67	4.64	10.81	18.15	39.35	16.84
Belfast North	n/a	n/a	5.06	7.86	13.50	28.75	12.46	2.89	11.33	13.66	26.42	13.05
Brockaghboy	40	100	4.59	4.91	6.40	14.73	5.29	6.03	10.42	4.57	10.45	4.33
Carnmoney	31.5	79	4.11	6.59	8.79	17.97	8.35	4.27	8.66	8.64	18.39	8.39
Castlereagh	31.5	79	10.60	18.51	19.44	47.78	17.10	10.66	20.42	24.92	62.01	22.63
Coleraine	40	100	3.79	4.22	10.69	22.61	9.76	4.97	7.75	11.50	25.31	11.00
Coolkeeragh	31.5	79	11.19	23.51	23.38	57.18	21.12	10.21	22.50	28.40	70.32	26.87
Creagh	31.5	79	3.71	4.28	8.47	16.82	8.10	4.08	6.09	8.72	18.37	8.51
Cregagh	26.2	65	9.03	14.25	17.25	41.24	15.34	6.32	12.43	21.22	48.91	19.48
Curraghmulkin	40	100	4.58	5.12	6.87	15.28	6.33	5.78	12.23	6.25	14.17	6.07
Donegall North	31.5	79	7.95	12.87	15.65	36.87	14.32	5.00	9.87	19.12	42.12	17.97
Donegall South	n/a	n/a	6.10	8.79	12.14	27.13	11.29	4.59	8.33	13.09	28.31	12.52
Drumnakelly	31.5	79	7.75	12.47	22.96	53.19	20.76	6.67	11.76	23.88	55.55	22.54
Dungannon	40	100	7.11	13.00	19.90	45.54	18.33	6.39	12.63	21.29	49.15	20.36
Eden	25	62.5	4.26	6.43	9.88	20.30	9.38	4.28	8.12	9.57	20.39	9.32
Enniskillen	31.5	79	3.63	4.08	11.79	24.06	9.45	4.66	6.74	11.94	25.92	10.85
Finaghy	31.5	79	8.78	14.77	16.27	39.07	14.86	6.06	11.14	20.48	46.85	19.20
Glengormley	18.4	46.8					5.48		6.55			
Grengonniey	10.4	40.0	3.47	4.01	5.72	11.24	5.40	3.91	0.55	5.50	11.47	5.38

Table E-11 Northern Ireland Short Circuit Currents for Maximum Demand in 2024

	Rat	ing		1	hree Pha	ise		Single Phase					
	RMS	Peak	X/R	X/R	l"	ip	IB	X/R	X/R	l"	ip	IB	
Node	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	Ratio (AC)	Ratio (DC)	[kA]	[kA]	[kA]	
Gort Cluster	40	100	5.97	7.30	8.69	19.98	8.23	6.01	12.78	7.87	17.99	7.72	
Hannahstown	31.5	80	9.62	17.57	18.01	43.95	16.32	9.86	19.03	23.14	57.04	21.55	
Kells	40	100	8.82	17.53	23.10	55.60	20.68	9.04	18.60	28.02	68.28	26.34	
Kells Cluster	40	100	8.52	16.21	21.88	52.27	19.69	0.00	0.00	0.00	0.00	0.00	
Killymallaght	40	100	6.18	7.94	13.15	29.69	12.37	5.37	9.95	11.97	26.77	11.69	
Knock	n/a	n/a	5.30	7.82	16.19	34-33	14.48	2.82	10.70	16.22	31.17	15.19	
Larne	18.4	46.8	4.61	5.76	9.72	20.37	9.23	4.81	7.98	9.12	19.93	8.90	
Limavady	18.4	46.8	3.69	4.10	8.28	16.91	7.77	4.44	7.12	8.50	18.26	8.25	
Lisburn	18.4	46.8	5.80	8.09	12.59	27.99	11.73	5.04	9.37	12.06	26.61	11.61	
Lisaghmore	31.5	79	4.91	7.47	10.30	21.78	9.77	4.53	9.17	9.81	21.17	9.59	
Loguestown	26.2	65	3.48	4.08	7.01	14.29	6.56	4.32	6.95	7.19	15.34	6.96	
Magherakeel Cluster	40	100	4.26	4.63	4.30	9.54	4.26	6.78	12.28	4.75	11.08	4.72	
Newtownards	40	100	4.81	7.07	8.20	17.45	7.69	5.34	9.56	7.70	17.20	7.43	
Newry	18.4	46.8	3.96	6.72	5.92	12.30	5.63	4.87	10.72	5.76	12.61	5.60	
Omagh	40	100	4.69	6.15	17.81	38.35	15.94	4.96	9.52	17.31	38.07	16.52	
Omagh South	40	100	3.92	4.65	13.37	27.72	11.65	4.05	5.85	12.06	25.36	11.45	
Rasharkin	40	100	3.88	4.34	11.80	26.40	10.54	5.50	10.99	10.48	23.54	10.06	
Rathgael	26.2	65	4.33	6.79	6.30	13.13	5.95	4.71	9.48	6.20	13.49	6.00	
Rosebank	40	100	9.75	15.90	17.88	43.35	15.85	9.85	17.15	22.51	55.47	20.60	
Slieve Kirk	40	100	4.61	5.43	9.18	19.60	8.79	5.41	11.24	7.46	16.69	7.35	
Springtown	n/a	n/a	5.15	7.90	10.54	22.50	9.99	4.64	9.18	10.24	22.21	10.00	
Strabane	40	100	5.37	6.99	16.97	36.57	15.65	5.34	9.03	17.48	39.03	16.85	
Tandragee	31.5	79	9.36	18.00	25.16	60.52	22.58	9.24	19.49	29.15	71.25	27.21	
Tremoge	40	100	4.15	5.05	9.69	20.33	9.29	4.48	9.39	8.67	18.65	8.52	
Tamnamore	40	100	8.46	18.65	24.39	57.60	22.29	8.31	19.02	30.03	72.32	28.40	
Waringstown	18.4	46.8	5.05	7.61	8.92	19.30	8.48	5.37	10.32	8.36	18.70	8.15	



All-Island Ten Year

Transmission Forecast
Statement 2018

Appendix F



Appendix F Approaches to Consultation for Developing the Grid

F.1 EirGrid Approach to Consultation

In December 2016 EirGrid launched Have Your Say¹²⁵, which outlines our approach to consultation. It followed a review of our consultation activities, after which, we made a commitment to improve the way we engage with the public and stakeholders.


Have Your Say outlines the way we develop our projects and how the public can engage with us at each stage of project development.

F.2 SONI Approach to Consultation

SONI has reviewed its approach to engaging and consulting with the public and stakeholders, this included independent analysis by The Consultation Institute (TCI) which made a number of recommendations. Following engagement with a range of stakeholders and in line with TCI's recommendations, SONI has developed a new Grid Development Process¹²⁶. This new three part process puts stakeholders and the community at the heart of what we do. To find out more visit www.soni.ltd.uk and if you have any queries you can contact us at info@soni.ltd.uk.

¹²⁵ http://www.eirgridgroup.com/the-grid/have-your-say/


¹²⁶ http://www.soni.ltd.uk/media/SONIs-Powering-The-Future-Grid-Development-Process-brochure.pdf

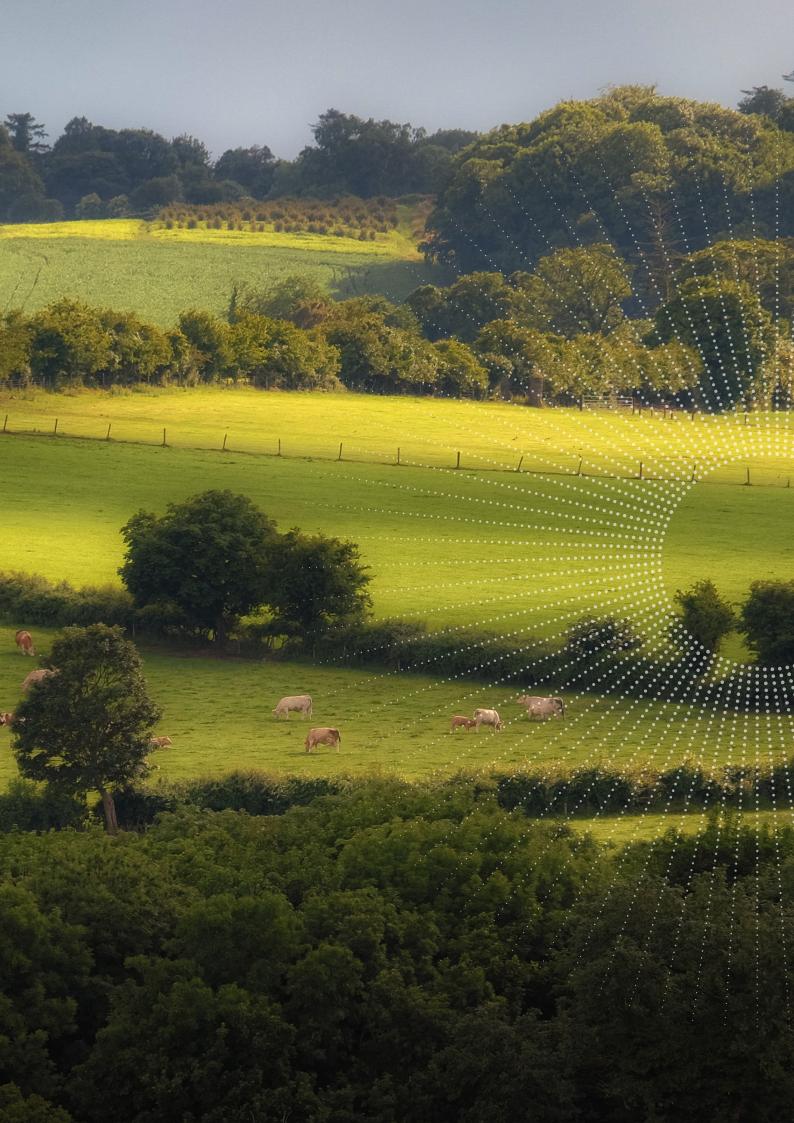

All-Island Ten Year

Transmission Forecast
Statement 2018

Appendix G

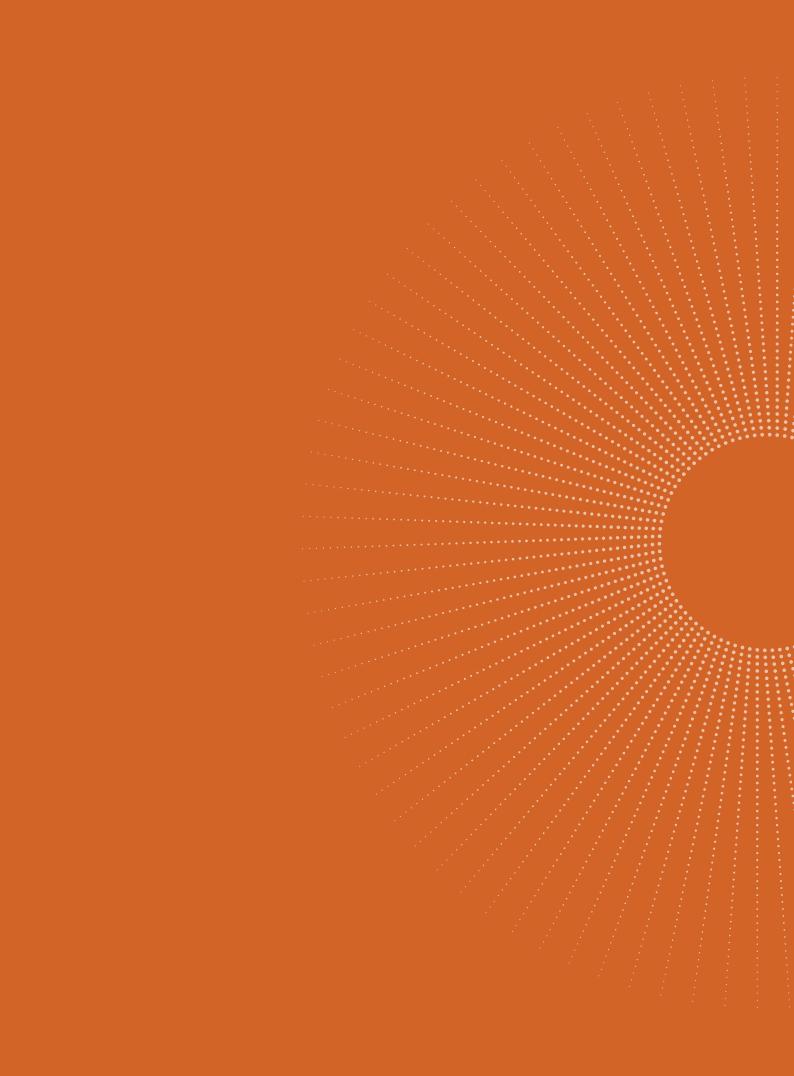

Appendix G References

The following documents are referenced in this All-Island Ten Year Transmission Forecast Statement:


- Electricity Regulation Act, 1999. This act provides the regulatory framework for the introduction of competition in the generation and supply of electricity in Ireland. The Act provided for the establishment of the Commission for Regulation of Utilities (CRU) (previously called the Commission for Energy Regulation) and gave it the necessary powers to licence and regulate the generation, distribution, transmission and supply of electricity. Available on www.cru.ie.
- The Utility Regulator Northern Ireland's powers are derived from the Electricity (Northern Ireland) Order 1992, as amended by the Energy (Northern Ireland) Order 2003. This Order provides the regulatory framework for the Electricity Sector in Northern Ireland.
- All-Island Generation Capacity Statement 2018-2027. EirGrid and SONI issued this report in October 2018. Its main purpose is to inform market participants, regulatory agencies and policy makers of the likely minimum generation capacity required to achieve an adequate supply and demand balance for electricity for the period 2018 to 2027. Available on www.eirgridgroup.com.
- Transmission Development Plan 2017-2026, published in 2018. The main purpose of this document is to document the plan for the development of the Irish transmission system and interconnection for the following 10 year period. Available on on www.eirgridgroup.com.
- EirGrid Grid Code Version 7.0, December 2018. The EirGrid Grid Code covers technical aspects relating to the operation and use of the transmission system, and to plant and apparatus connected to the transmission system or to the distribution system. Available on www.eirgridgroup.com.
- The SONI Grid Code, October 2018. The SONI Grid Code is designed to permit the development, maintenance and operation of an efficient, co-ordinated and economical Transmission System in Northern Ireland. The grid code is prepared by the TSO (SONI) pursuant to condition 16 of SONI's Licence. The SONI Grid Code is available at www.soni.ltd.uk
- Transmission System Security and Planning Standards Ireland, May 2016. This document sets out the technical standards by which the adequacy of the grid in Ireland is determined. Available on www.eirgridgroup.com
- Transmission System Security and Planning Standards Northern Ireland, September 2015.
 This document sets out the technical standards by which the adequacy of the grid in Northern Ireland is determined. Available on www.soni.ltd.uk
- Statutory Instrument no. 445. These Regulations give legal effect to Directive No. 96/92/EC of the European Parliament and of the Council of 19th December 1996, concerning common rules for the internal market in electricity, not already implemented by the Electricity Regulation Act, 1999, by providing for the designation of a Transmission System Operator, the designation of a Distribution System Operator, and the unbundling of the accounts of electricity undertakings, and other matters. Available on www.cru.ie.

- EirGrid's TSO Licence. On June 29th 2006, the CER issued a Transmission System Operator (TSO) Licence to EirGrid plc. pursuant to Section 14(1)(e) of the Electricity Regulation Act, 1999, as inserted by Regulation 32 of S.I. No. 445 of 2000 European Communities (Internal Market in Electricity) Regulations 2001. The most recent update was issued in Mach 2017. Available on www.cru.ie.
- SONI's Licence to Participate in the Transmission of Electricity, Updated to December 2017. Available on www.uregni.gov.uk. Condition 33 requires SONI to prepare a statement (in a form; in consultation with EirGrid; and based on methodologies approved by UREGNI) showing in respect of each of the ten succeeding financial years; circuit capacity; forecast electrical flows and loading on each part of the transmission system; and fault levels for each transmission node.
- Ireland's Transition to a Low Carbon Energy Future 2015-2030, December 2015. Government White Paper on energy policy out to 2030, published by the Department of Communications, Climate Action and Environment. Available on www.dccae.gov.ie.
- Strategic Energy Framework 2010-2020, September 2010. A Strategic Energy Framework for Northern Ireland. Available on www.economy-ni.gov.uk/.
- Treatment of Curtailment in Tie Break Situations. Single Electricity Market (SEM) decision paper (SEM-13-010) in relation to the treatment of curtailment in tie break situations. Available on www.semcommittee.com/.
- Operating Security Standards, March 2016. This document sets out the main standard that the transmission licensee (SONI ltd) shall use in the operation of the Northern Ireland transmission system. Available on www.soni.ltd.uk

All-Island Ten Year

Transmission Forecast
Statement 2018

Appendix H

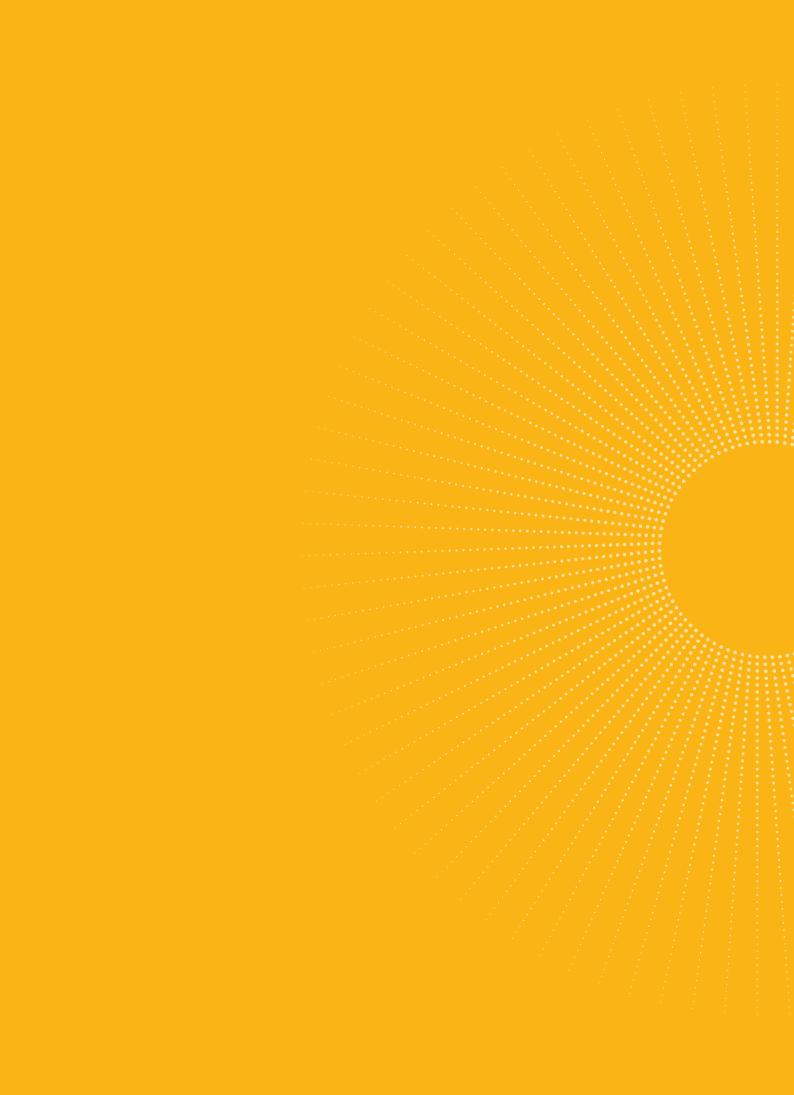

Appendix H Power Flow Diagrams

This appendix presents power flow diagrams for the following cases:

- Figure H-1 Summer Night Valley 2018
- Figure H-2 Summer Peak 2018
- Figure H-3 Winter Peak 2018
- Figure H-4 Summer Night Valley 2027
- Figure H-5 Summer Peak 2027
- Figure H-6 Winter Peak 2027

Note that summer cases cover the period between May and August and winter cases cover the period between November and February. As such, the layout of the network in the power flow diagrams may not feature all projects listed in Appendix B for a particular year as these are listed on a yearly basis.


H.1 Guide to the Power Flow Diagrams


Different colours represent each of the voltage levels:


400 kV red
275 kV blue
220 kV green
110 kV black


Generation (>5MW) connected at each bus is shown beside a symbol, with the generation dispatched in MW shown beside the symbol. Embedded generation is shown at the transmission bus to which it is connected through the distribution system. The East-West interconnector is denoted by a symbol and the Moyle interconnector is denoted by a symbol. The magnitude of the power on the interconnectors is given beneath the symbol in MW.


There are two values shown at both ends of each circuit. The value above the line is the MW flow and the value below the line is the Mvar flow. A positive value indicates that the direction of flow is away from the bus; a negative value, towards the bus.

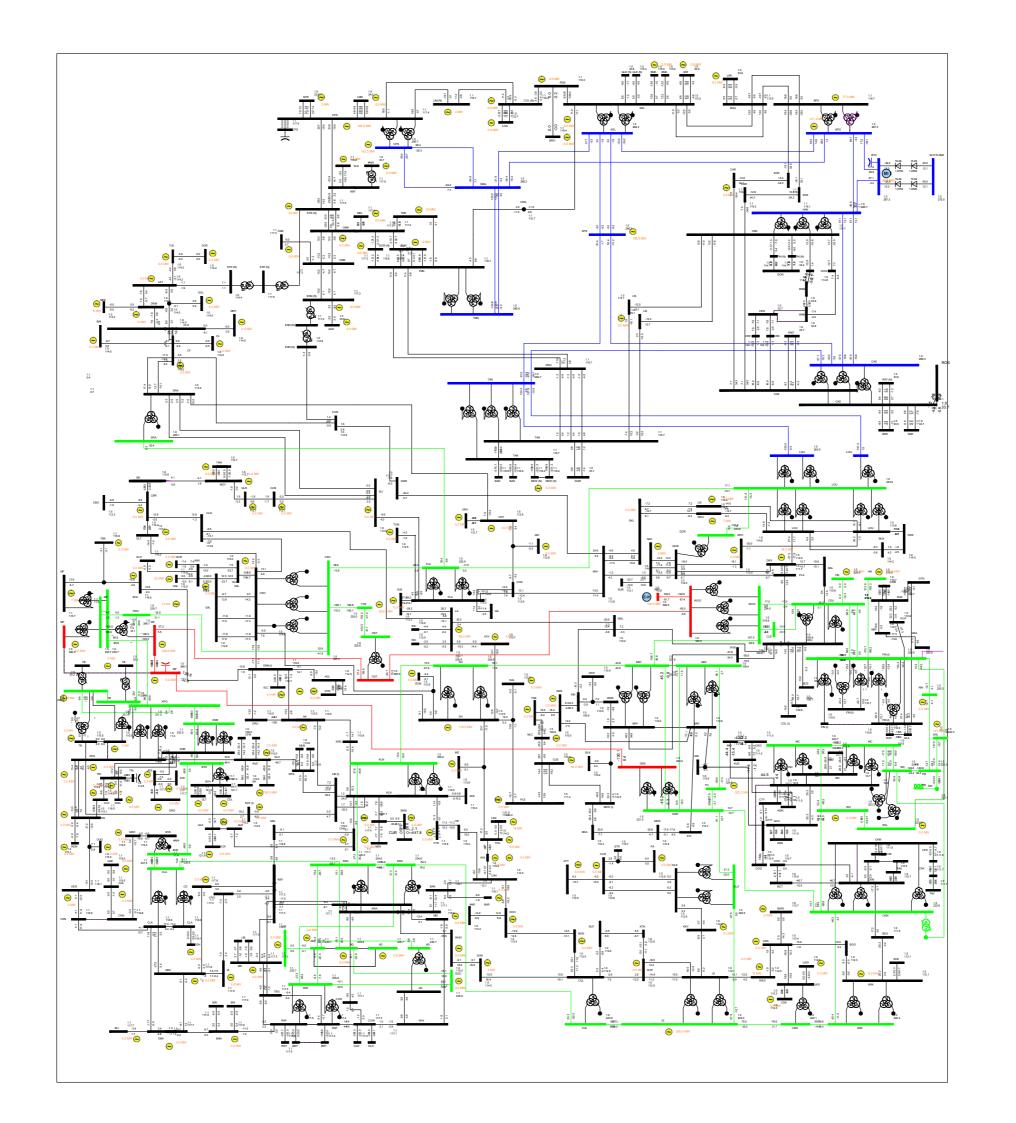


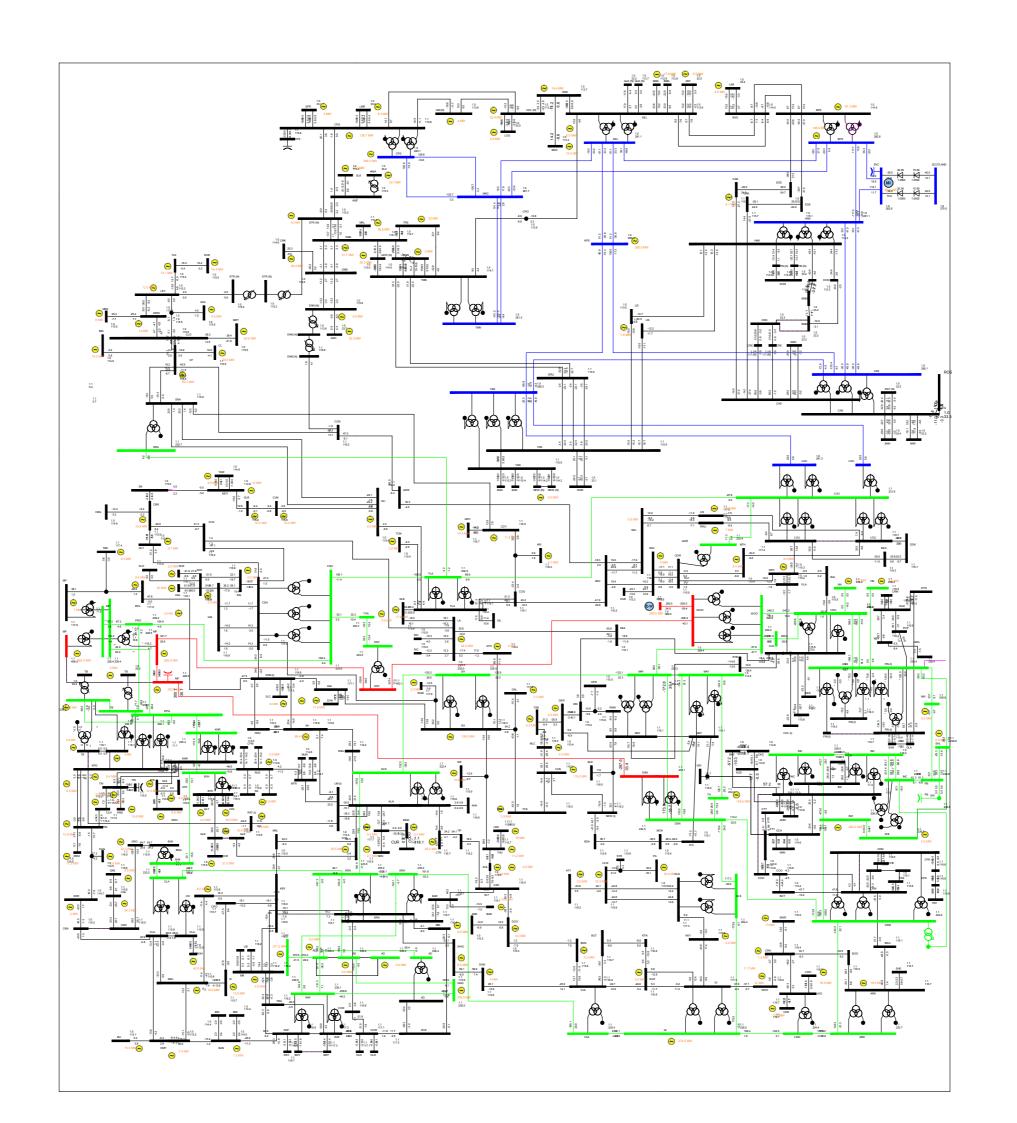

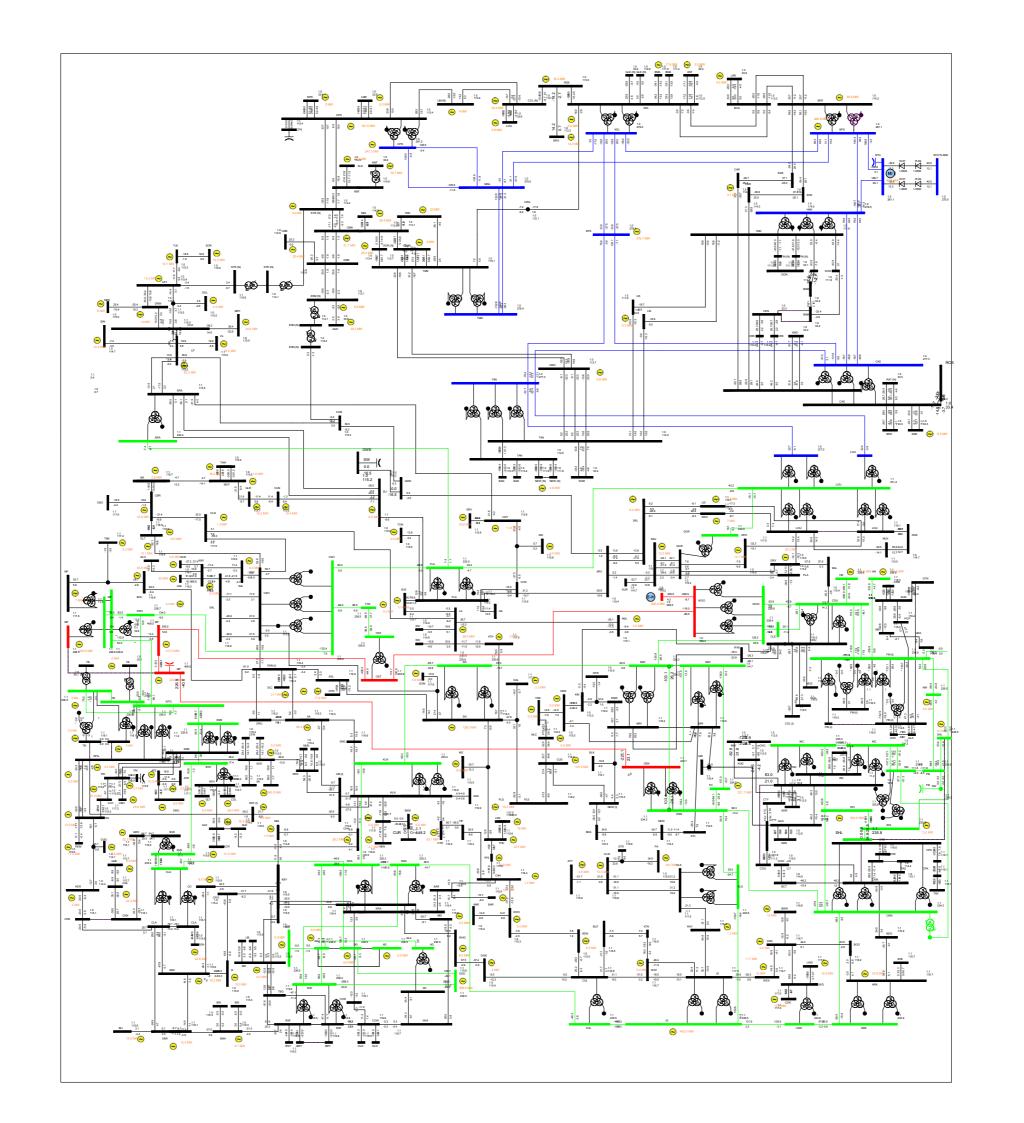

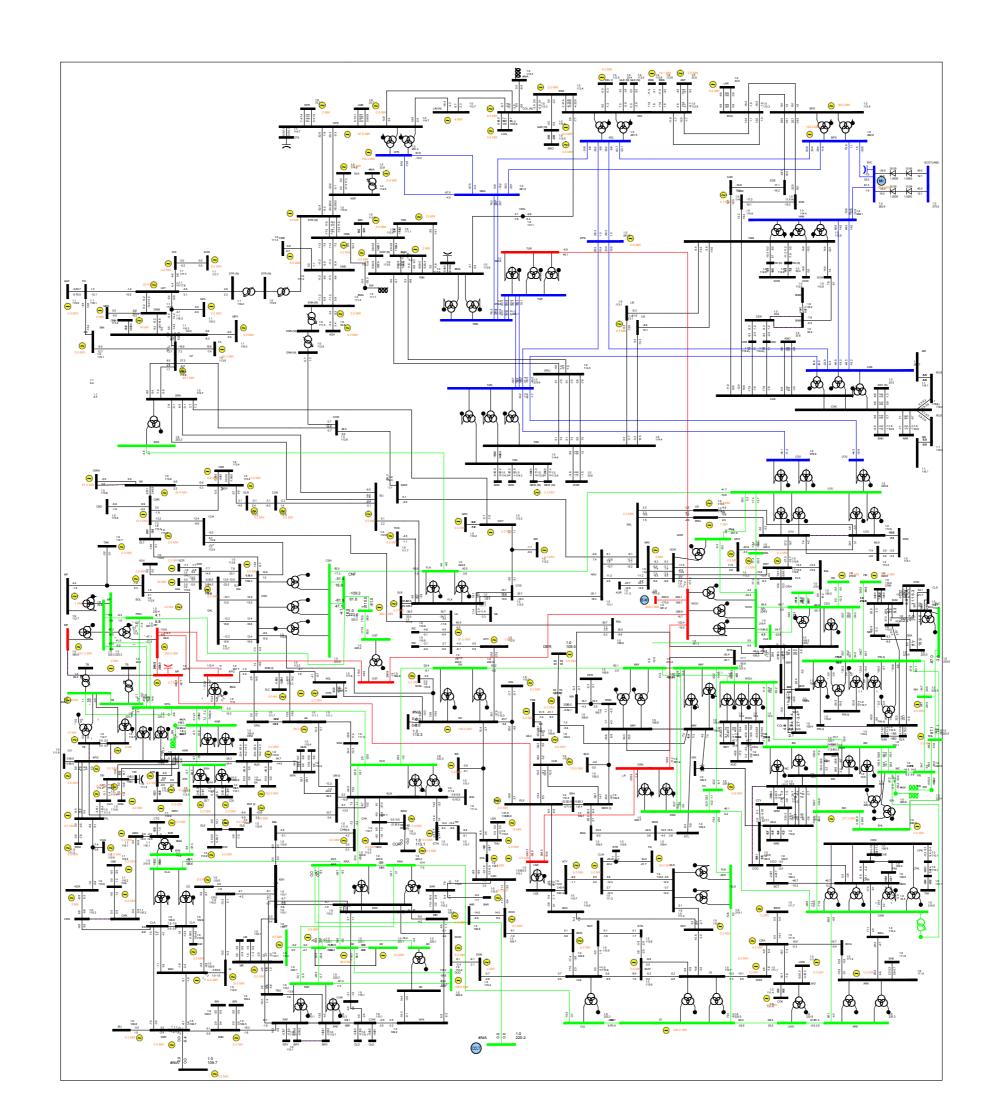

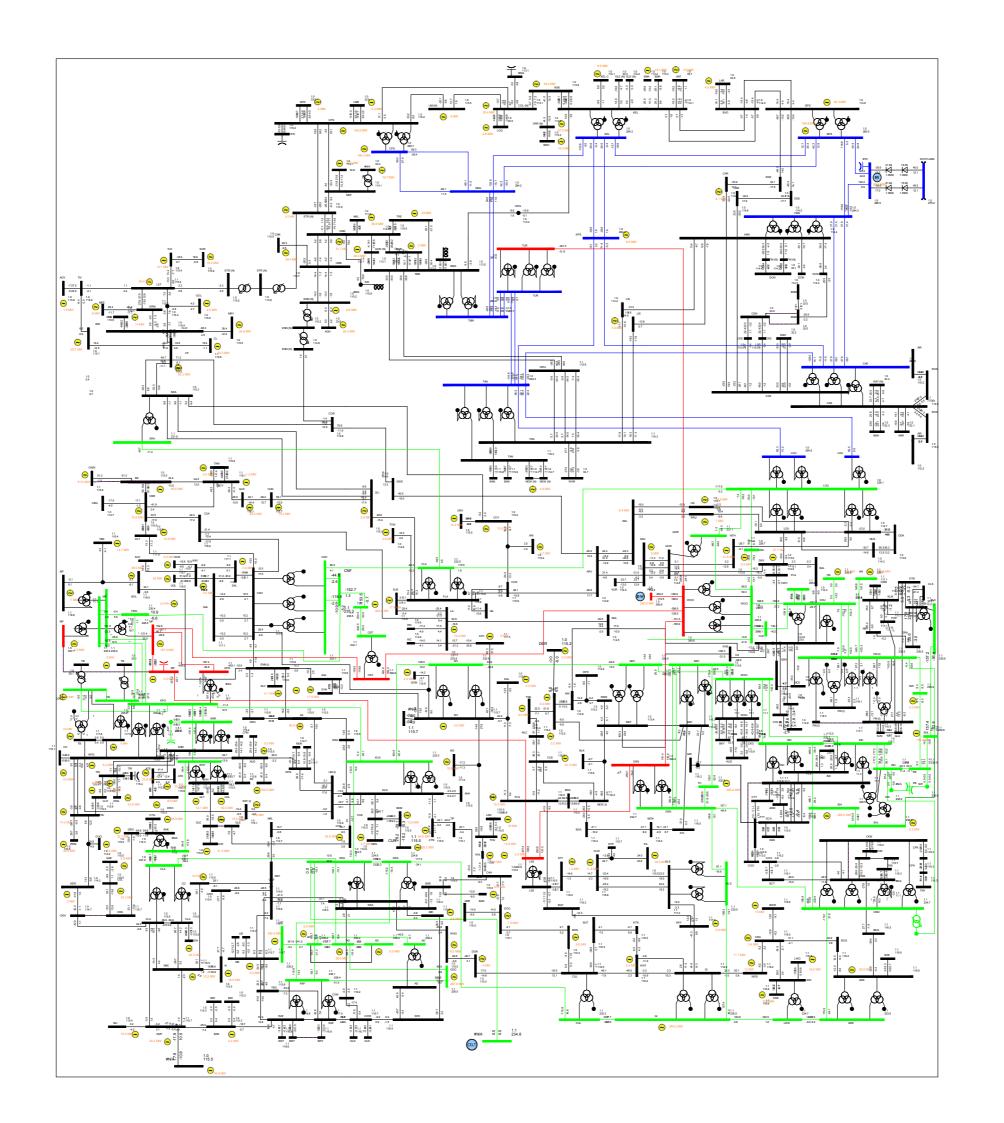

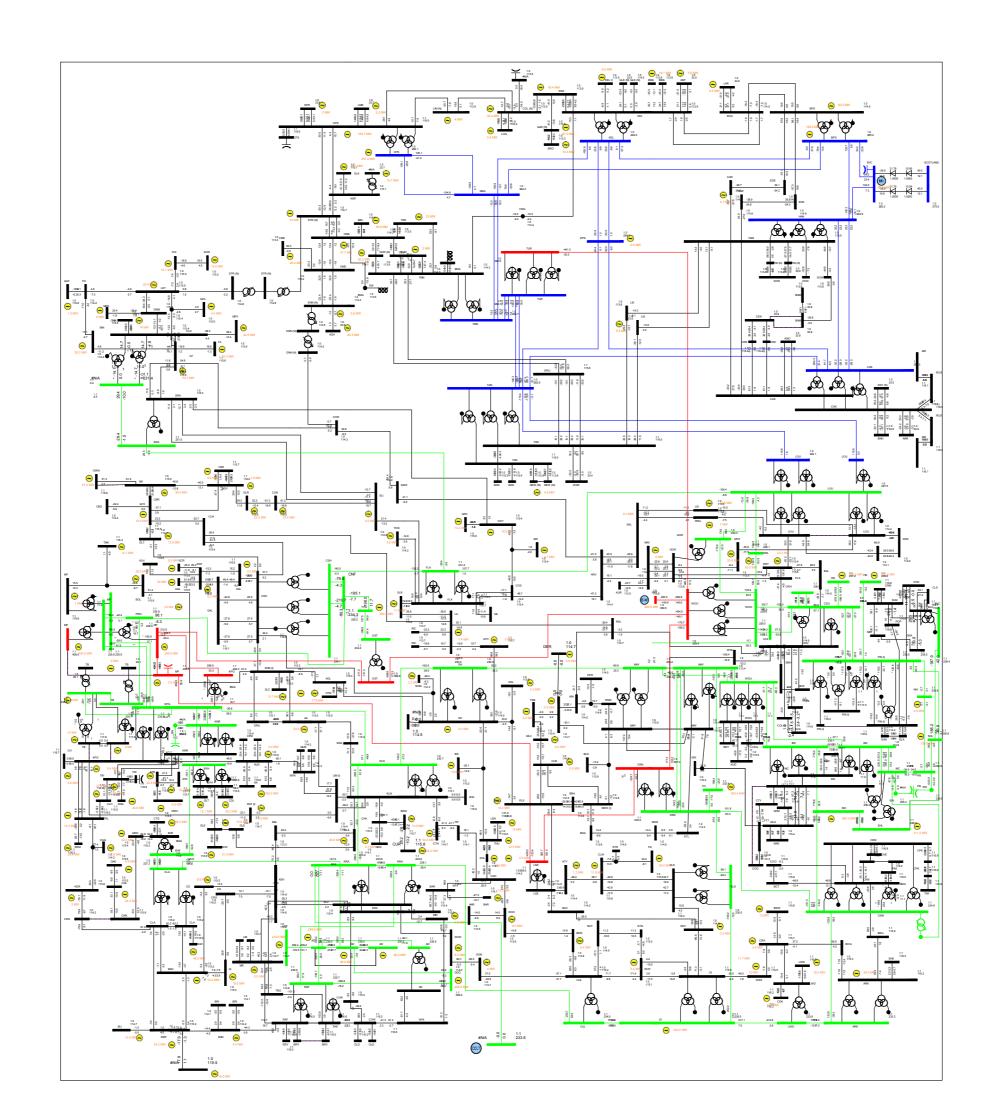

Notes:

Notes:

Notes:





The Oval, 160 Shelbourne Road, Ballsbridge, Dublin Do4 FW28 Tel: +353 (0)1 677 1700 www.eirgrid.com



Castlereagh House, 12 Manse Road, Belfast BT6 9RT Tel: +44 (0)28 9079 4336 www.soni.ltd.uk

